

Prepared In the Office of:



AECOM TECHNICAL SERVICES OF NORTH CAROLINA, INC.  
701 CORPORATE CENTER DRIVE, SUITE 475, RALEIGH, NC 27607  
919-854-6200 919-854-6259 (fax)  
F - 0342


PROJECT REFERENCE NO.	R-5021	SHEET NO.	UC-14
DESIGNED BY:		10/29/2021	
DRAWN BY:			
CHECKED BY:			
APPROVED BY:			
REVISED:			
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION		SEAL 10666	
UTILITIES ENGINEERING SEC.		D. Stephen Scruggs	
PHONE: (919) 707-6690		UTILITY CONSTRUCTION PLANS ONLY	
FAX: (919) 250-4151			

DOCUMENT NOT CONSIDERED FINAL  
UNLESS ALL SIGNATURES COMPLETED

### UTILITY CONSTRUCTION

#### NOTES

- SEE SHEET UC-43 FOR PROFILES OF NEW 24" FORCE MAIN AND 16" RECLAIMED WATER MAIN.
- SEE SHEET UC-46 FOR PROFILE OF NEW 18" WATER MAIN.

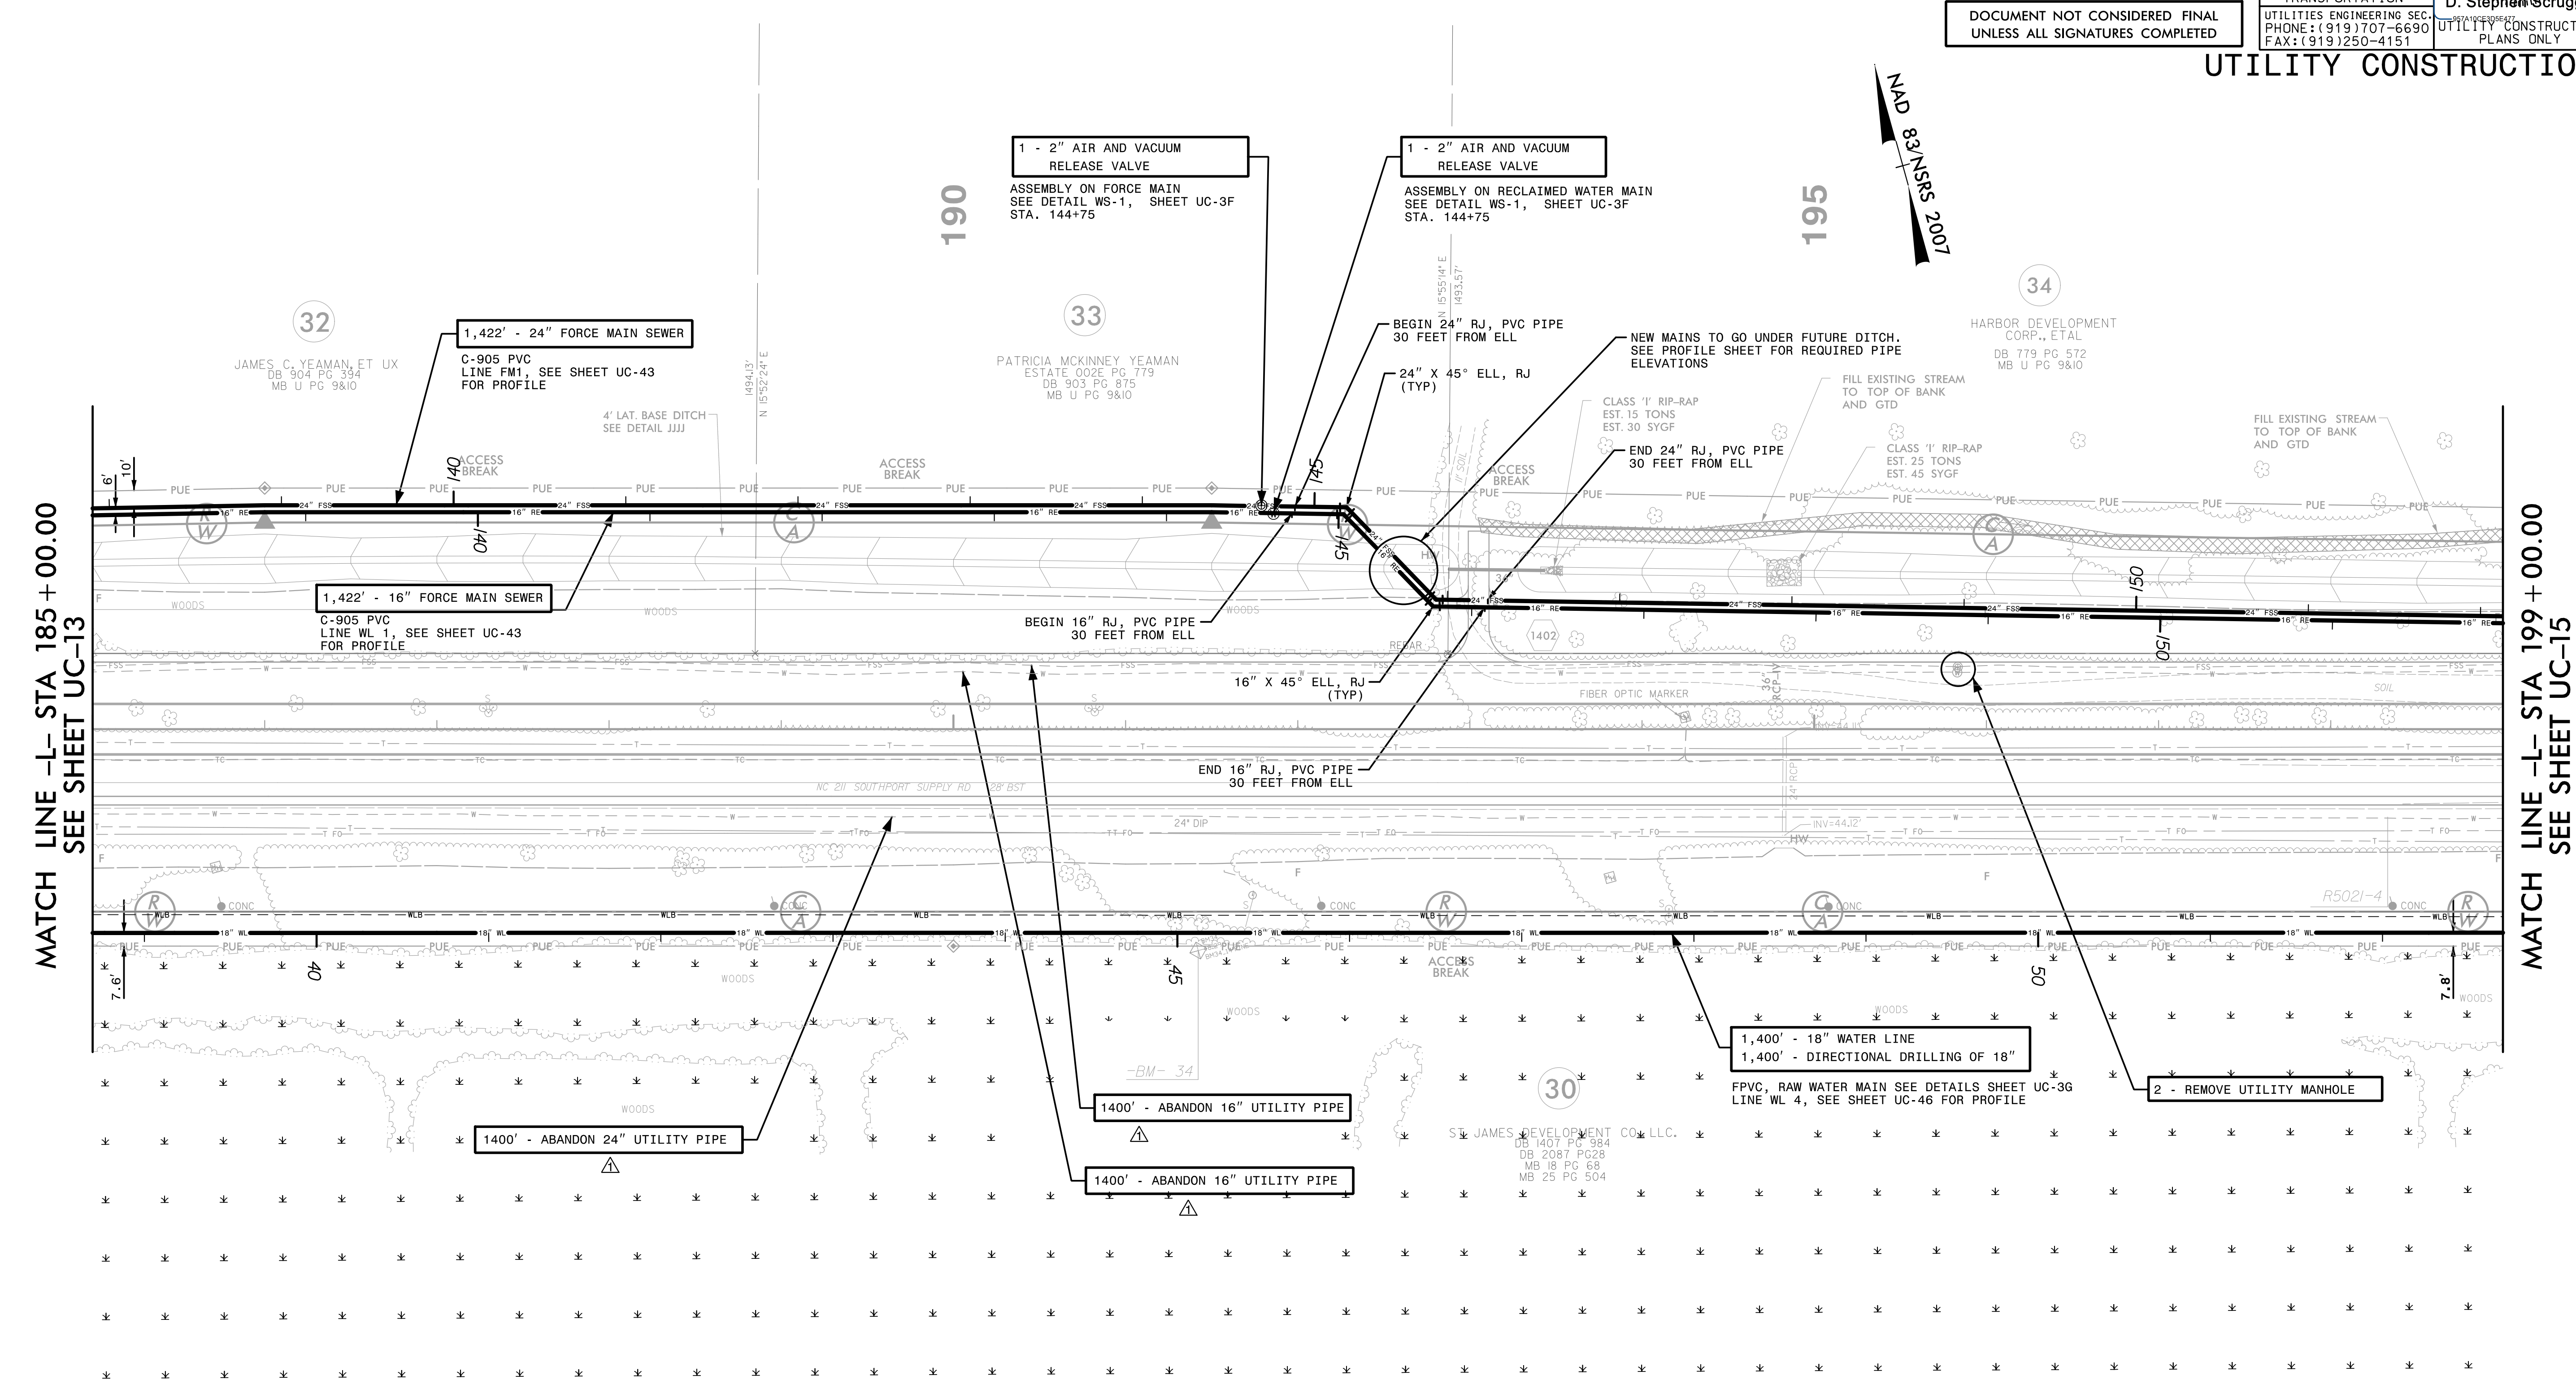

MATCH LINE -L- STA 185 + 00.00  
SEE SHEET UC-13

MATCH LINE -L- STA 199 + 00.00  
SEE SHEET UC-15

The estimated quantity of Ductile Iron Sewer Pipe Fittings on this plan sheet is 2,190 pounds. The actual quantity and type of fittings will vary based on field conditions.

△ REMOVED NOTE BELOW PAY ITEM FOR ABANDON UTILITY PIPE PER ADDENDUM NO. 1

DATE: 10/18/2021  
TIME: 2:24:12 PM  
DGN: Z:\Projects\UTILITY\Projects\60428203\900\_MerA\915\_UTILITY Construction\2021\_REV\010\SR-5021\_UC-F51H4.dgn