

NOTES

1. SEE SHEET UC-54 FOR PROFILE OF NEW WATER MAIN.

Prepared In the Office of:





AECOM TECHNICAL SERVICES OF NORTH CAROLINA, INC.
701 CORPORATE CENTER DRIVE, SUITE 475, RALEIGH, NC 27607
919-854-6200 919-854-6259 (fax)
F - 0342

DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED

PROJECT REFERENCE NO.	SHEET NO.
R-5021	UC-36
DESIGNED BY:	
DRAWN BY:	
CHECKED BY:	
APPROVED BY:	
REVISED:	
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151	
D. Stephen Struggs UTILITY CONSTRUCTION PLANS ONLY	

UTILITY CONSTRUCTION

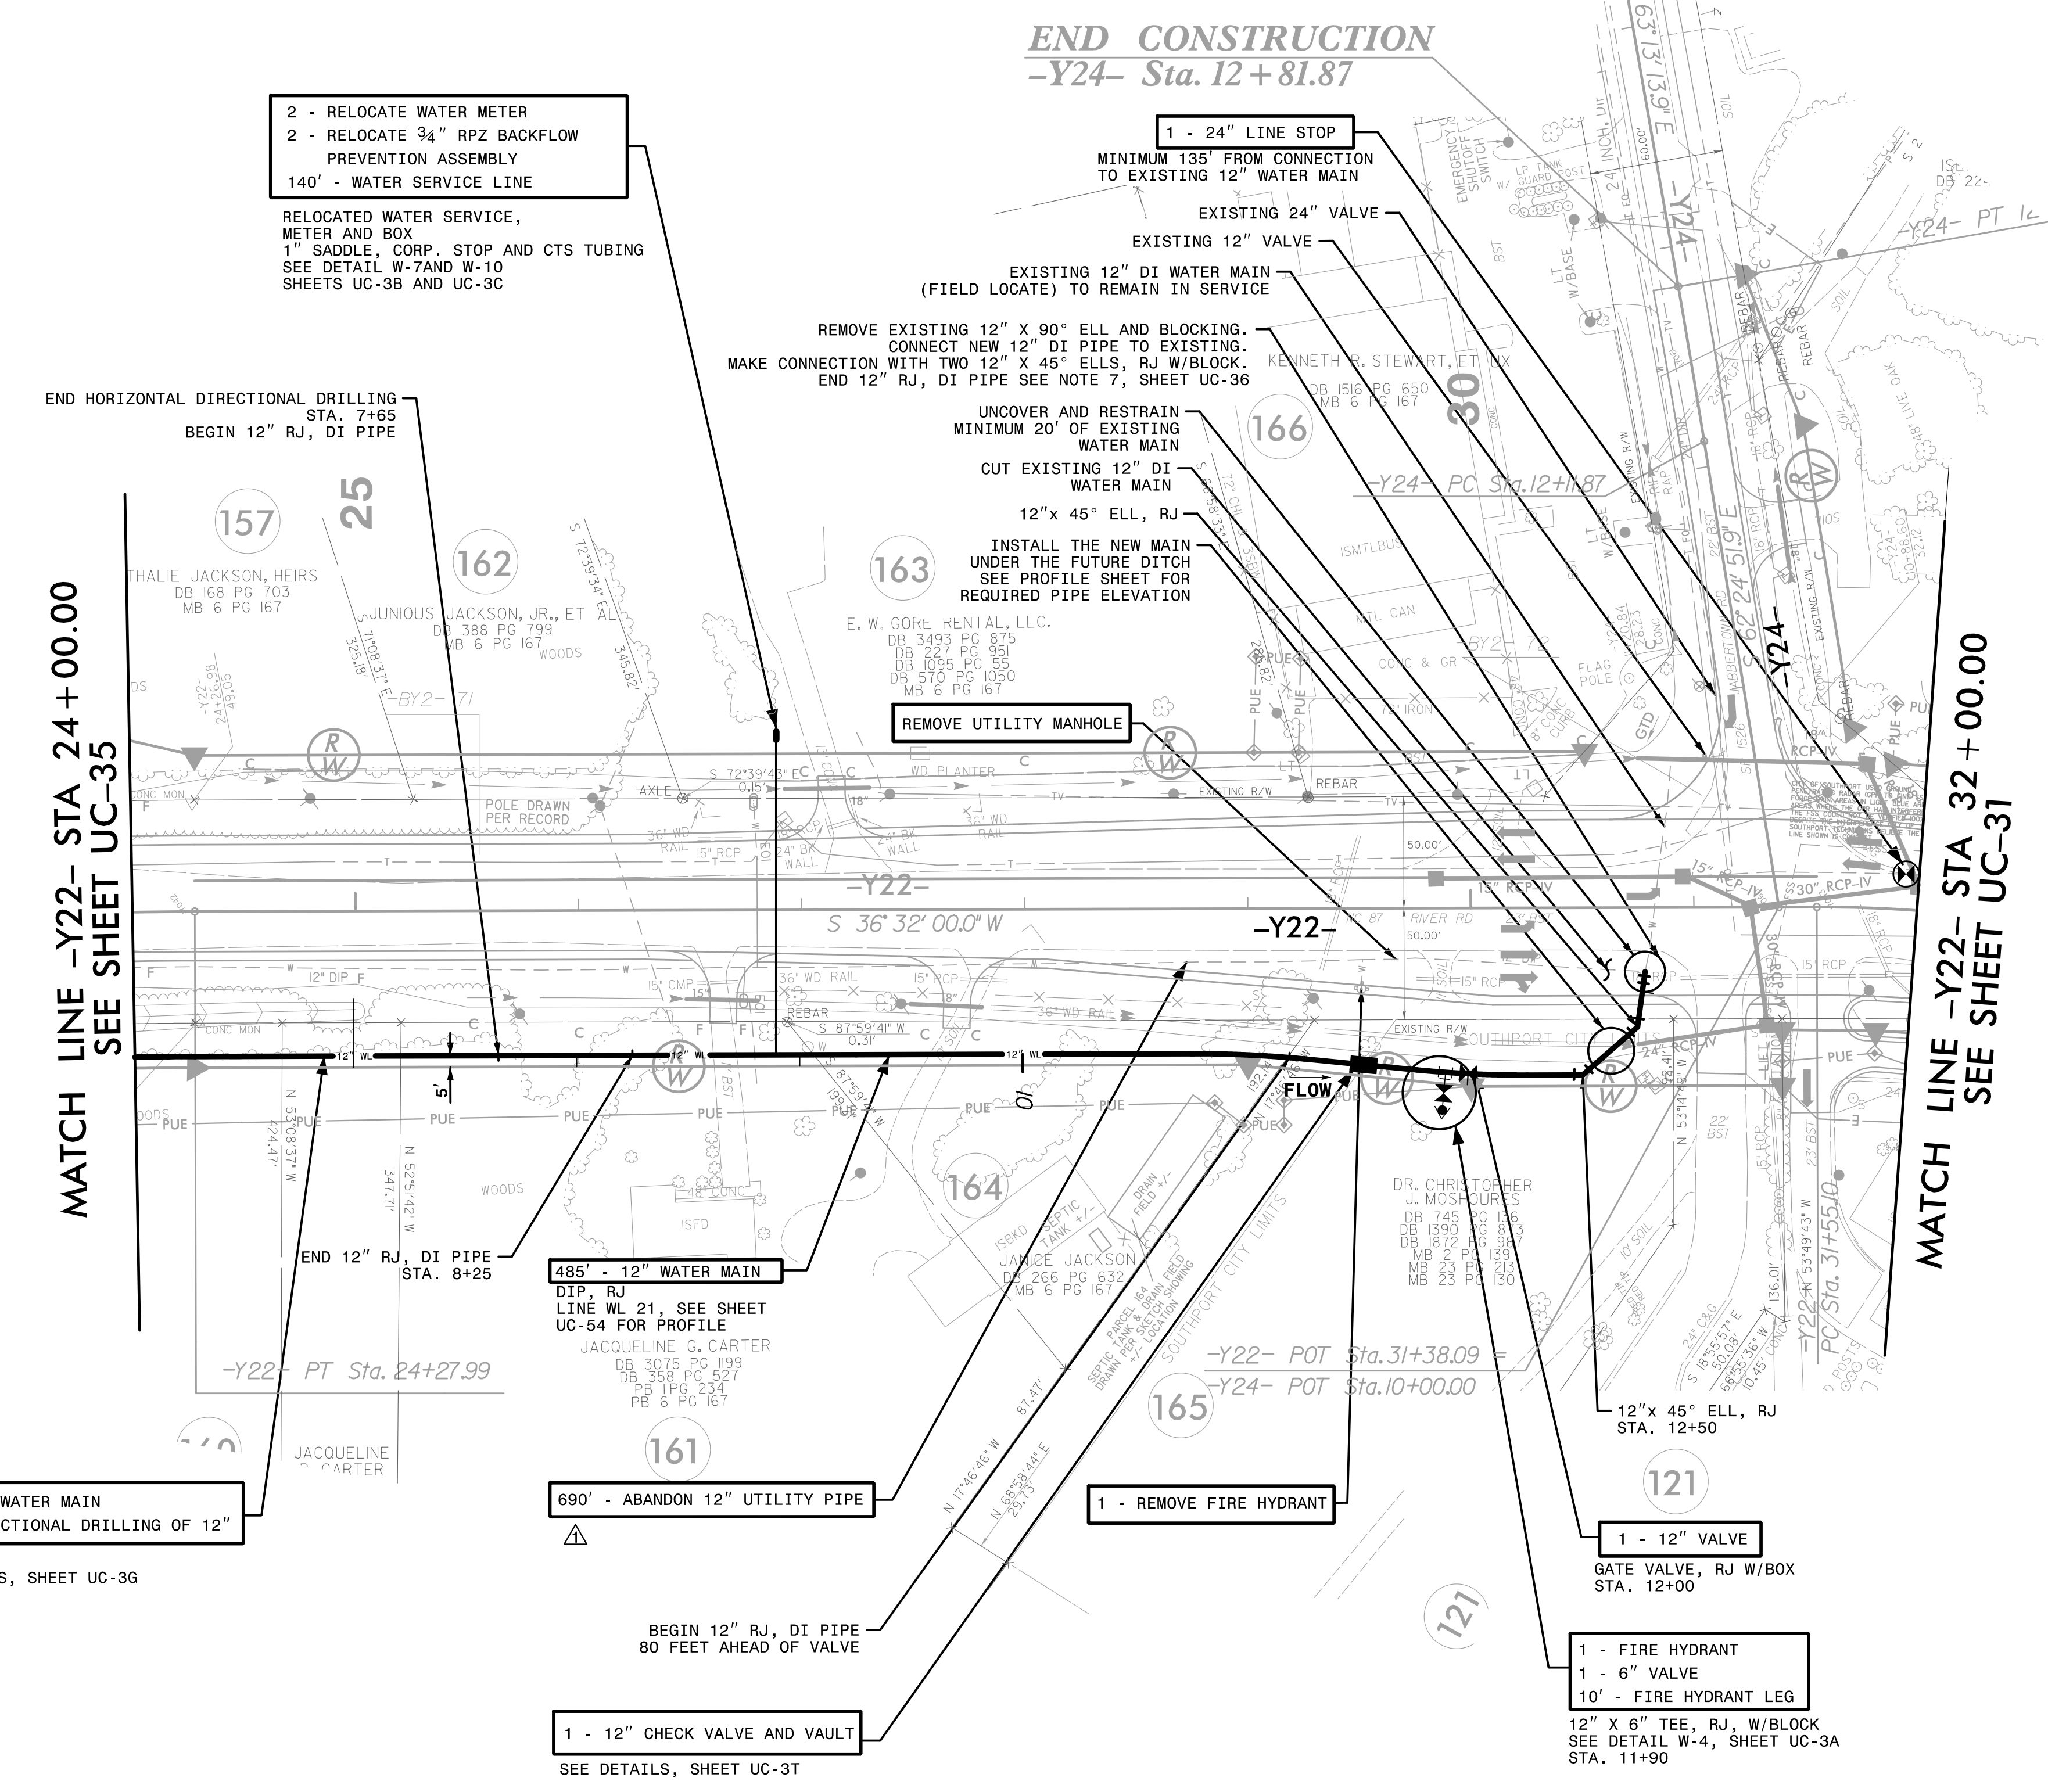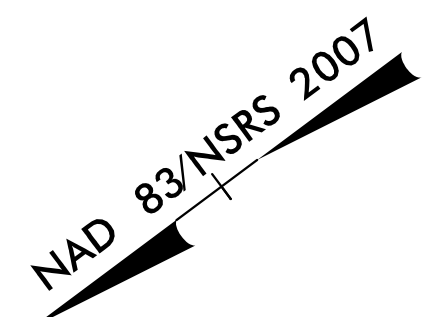

DATE: 10/19/2021
TIME: 2:40:29 PM
DGN: ZVoleigh-USFALTYLegacy\Projects\60428203\900_MerA\915_UTILITY Construction\2021_REV\1010\NSR-5021_UC-F5136.dgn

REMOVED NOTE BELOW PAY ITEM FOR ABANDON UTILITY PIPE PER ADDENDUM NO. 1

The estimated quantity of Ductile Iron Water Pipe Fittings on this plan sheet is 1,185 pounds. The actual quantity and type of fittings will vary based on field conditions.