


PROJECT REFERENCE NO.	SHEET NO.
R-5021	UC-67
DESIGNED BY: MEP	
DRAWN BY: MEP	
CHECKED BY: BMB	
APPROVED BY: BMB	
REVISOR:	UTILITY CONSTRUCTION PLANS ONLY
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION UTILITIES ENGINEERING SECTION PHONE: (919) 707-6690 FAX: (919) 250-4151	

THE ESTIMATED QUANTITY OF DUCTILE IRON SEWER PIPE FITTING ON THIS PLAN SHEET IS 1510 POUNDS. THE ACTUAL QUANTITY AND TYPE OF FITTINGS WILL VARY BASED ON FIELD CONDITIONS.

PRIOR TO COMMENCING WORK ON ANY TRENCHLESS INSTALLATION, PROVIDE A DESIGN FOR THE TRENCHLESS INSTALLATION CERTIFIED BY AN ENGINEER LICENSED BY THE STATE OF NORTH CAROLINA, AS REQUIRED BY SUBARTICLE 1550-3(B) OF THE STANDARD SPECIFICATIONS.

1. UPSIZED 16" FSS TO 24" FSS
2. REMOVED DUPLICATE AIR RELEASE VALVE NEAR -L- STA. 309+00
3. UPDATED 4" TO BE ABANDONED FROM 84 LF TO 75 LF
4. RECONNECT FORCE MAIN
5. ADDED 42 LF OF 48" ENCASEMENT PIPE

UTILITY CONSTRUCTION
DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED

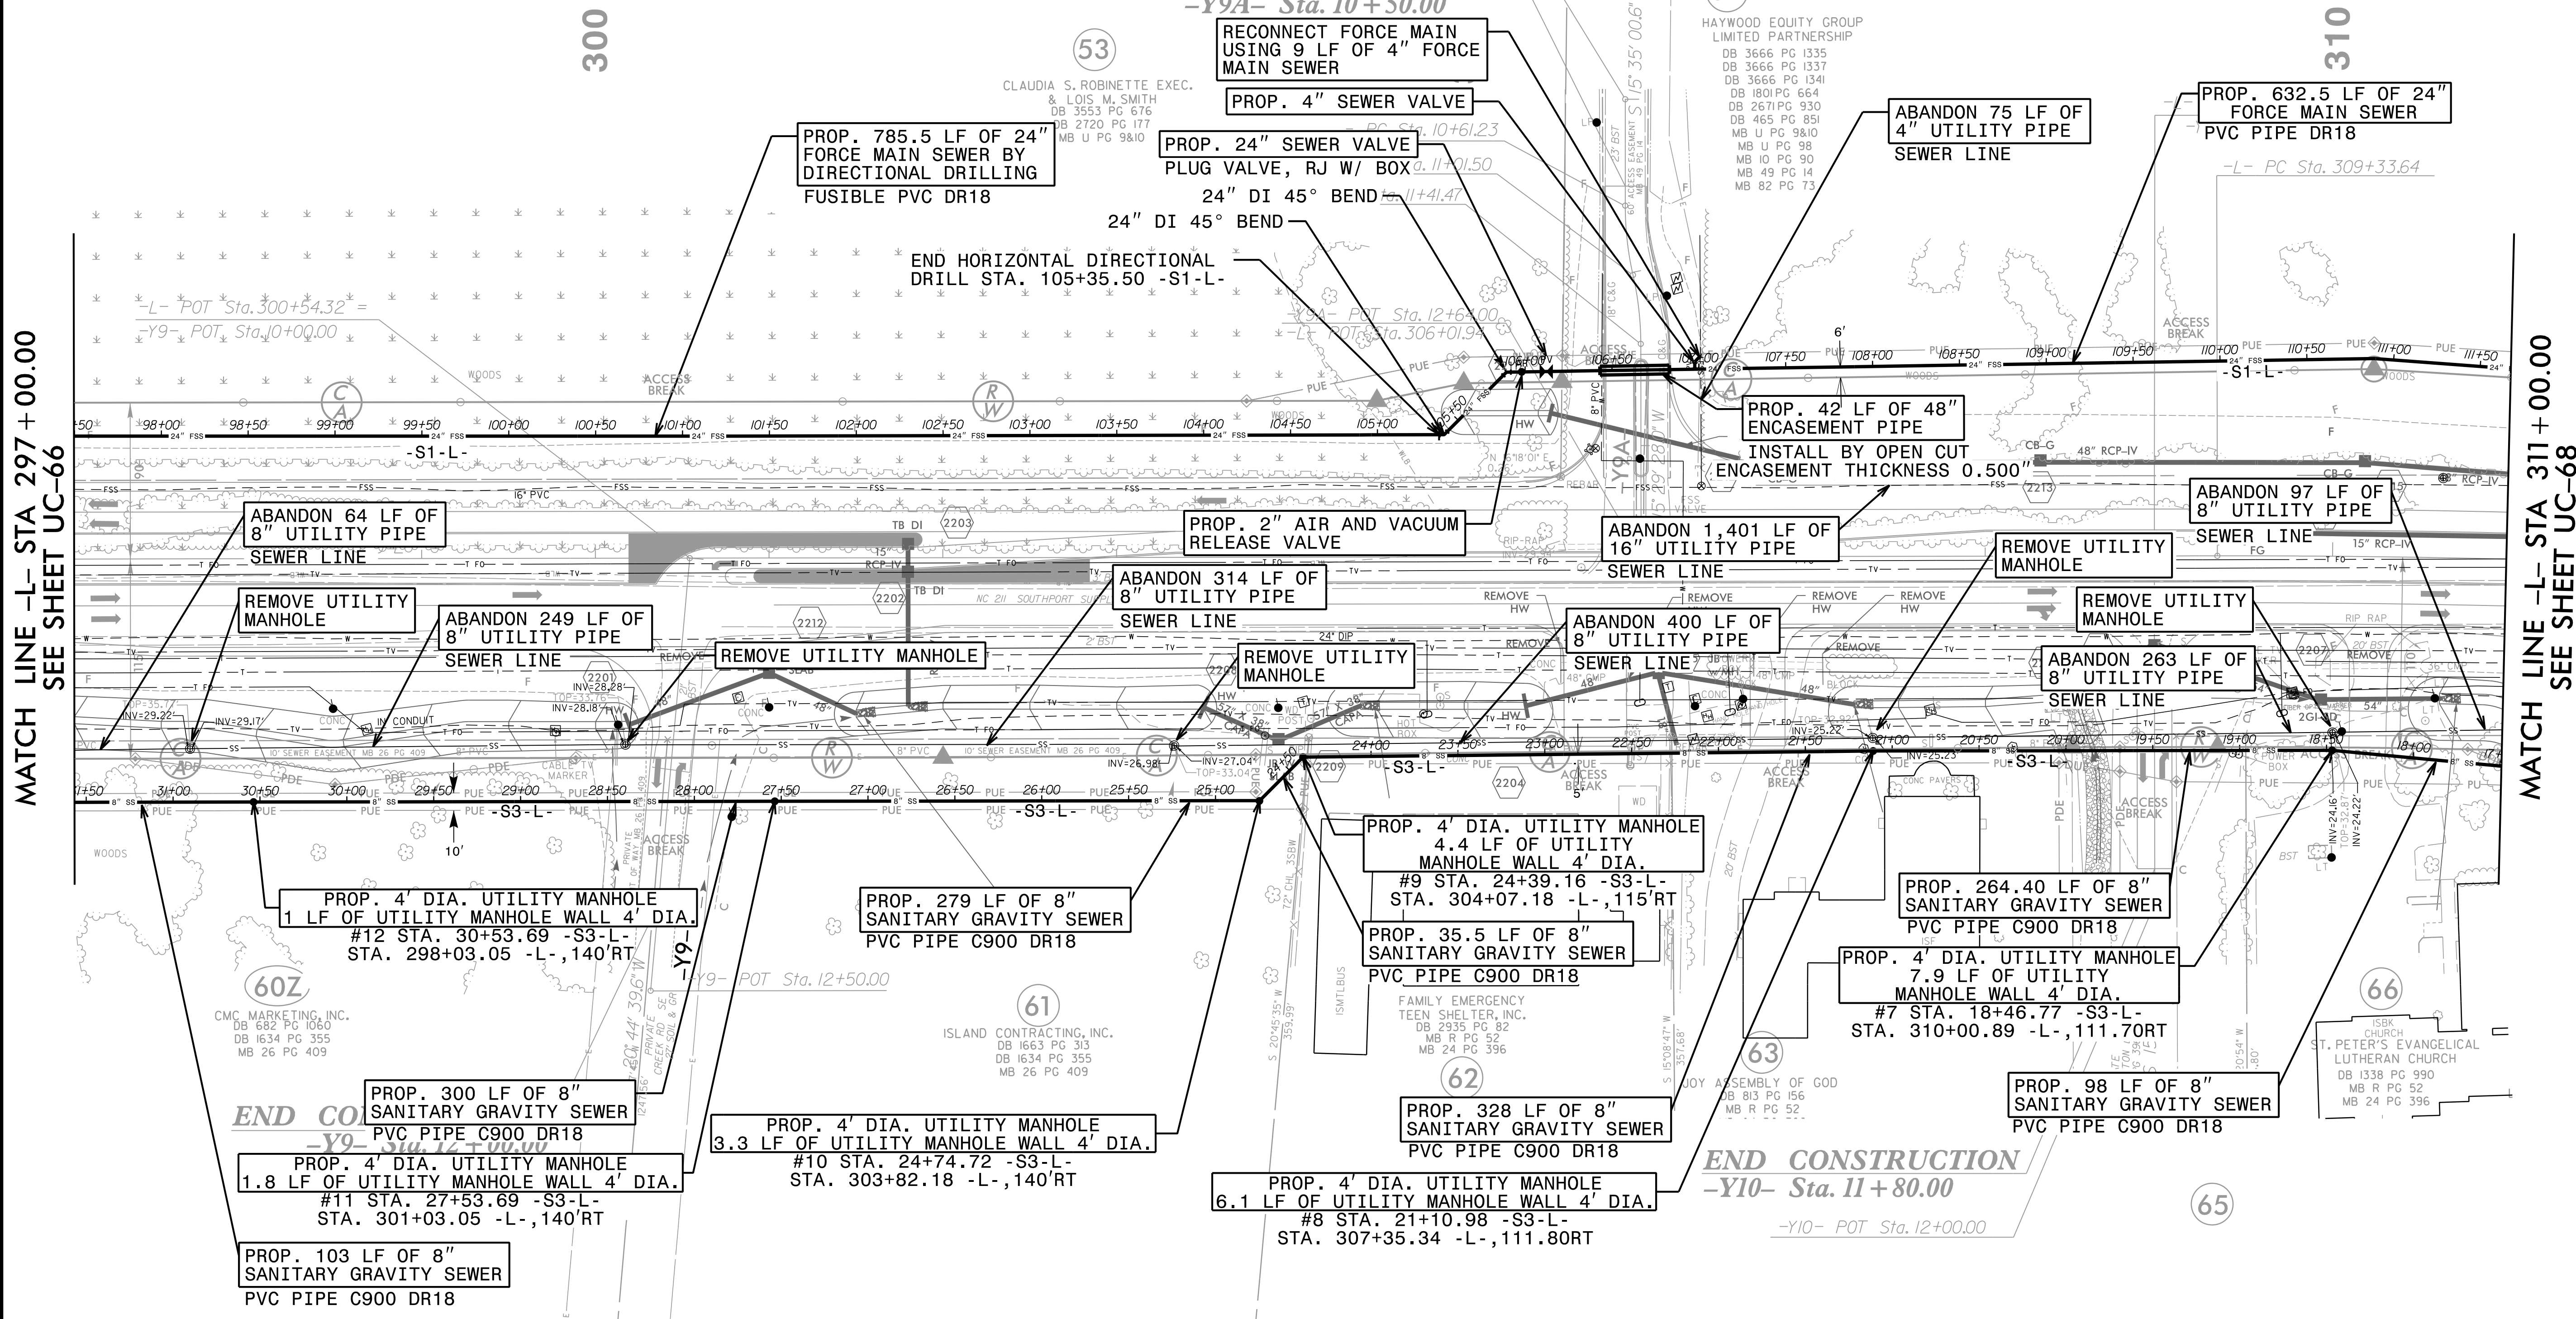

MATCH LINE -L- STA 297 + 00.00
SEE SHEET UC-66

MATCH LINE -L- STA 311 + 00.00
SEE SHEET UC-68

R: (919) 878-9560
 8601 Six Forks Road, Forum 1, Suite 700
 Raleigh, North Carolina 27615-3960
 NC License No. F-0112
 Engineers | Construction Managers | Planners | Scientists
 www.rk&k.com
 Responsive People | Creative Solutions

FOR -S1-L- PROFILE, SEE SHEET UC-82
 FOR -S3-L- PROFILE, SEE SHEET UC-84

5/14/99
 I:\3\2021\UC\Proj\N-5021\UC-67_psh.dgn
 I:\3\2021\UC\Proj\N-5021\UC-67_psh.dgn