

FOUNDATION LAYOUT

FOUNDATION NOTES

- FOR PILES, SEE SECTION 450 OF THE STANDARD SPECIFICATIONS.
- PILES AT END BENT NO.1 ARE DESIGNED FOR A FACTORED RESISTANCE OF 120 TONS PER PILE.
- DRIVE PILES AT END BENT NO.1 TO A REQUIRED DRIVING RESISTANCE OF 200 TONS PER PILE.
- PILES AT BENT NO.1 ARE DESIGNED FOR A FACTORED RESISTANCE OF 265 TONS PER PILE.
- DRIVE PILES AT BENT NO.1 TO A REQUIRED DRIVING RESISTANCE OF 360 TONS PER PILE. THIS REQUIRED DRIVING RESISTANCE INCLUDES ADDITIONAL RESISTANCE FOR SCOUR.
- INSTALL PILES AT BENT NO.1 TO A TIP ELEVATION NO HIGHER THAN -45.0 FEET.
- THE SCOUR CRITICAL ELEVATION FOR BENT NO.1 IS -17.0 FT. SCOUR CRITICAL ELEVATIONS ARE USED TO MONITOR POSSIBLE SCOUR PROBLEMS DURING THE LIFE OF THE STRUCTURE.
- PILES AT BENT NO.2 ARE DESIGNED FOR A FACTORED RESISTANCE OF 265 TONS PER PILE.
- DRIVE PILES AT BENT NO.2 TO A REQUIRED DRIVING RESISTANCE OF 360 TONS PER PILE. THIS REQUIRED DRIVING RESISTANCE INCLUDES ADDITIONAL RESISTANCE FOR SCOUR.
- INSTALL PILES AT BENT NO.2 TO A TIP ELEVATION NO HIGHER THAN -45.0 FEET.

- THE SCOUR CRITICAL ELEVATION FOR BENT NO.2 IS -17.0 FT. SCOUR CRITICAL ELEVATIONS ARE USED TO MONITOR POSSIBLE SCOUR PROBLEMS DURING THE LIFE OF THE STRUCTURE.
- STEEL PILE TIPS ARE REQUIRED FOR PRESTRESSED CONCRETE PILES AT BENTS NO.1 AND 2. FOR STEEL PILE TIPS, SEE SECTION 450 OF THE STANDARD SPECIFICATIONS.
- TESTING THE FIRST PRODUCTION PILES WITH THE PDA DURING DRIVING IS REQUIRED AT BENTS NO.1 AND 2. FOR PDA TESTING, SEE SECTION 450 OF THE STANDARD SPECIFICATIONS.
- IT HAS BEEN ESTIMATED THAT A HAMMER WITH AN EQUIVALENT RATED ENERGY IN THE RANGE OF 75,000 TO 125,000 FT-LBS PER BLOW WILL BE REQUIRED TO DRIVE PILES AT BENTS NO.1 AND 2. THIS ESTIMATED ENERGY RANGE DOES NOT RELEASE THE CONTRACTOR FROM PROVIDING DRIVING EQUIPMENT IN ACCORDANCE WITH SUBARTICLE 450-3(D)(2) OF THE STANDARD SPECIFICATIONS.
- PILES AT END BENT NO.2 ARE DESIGNED FOR A FACTORED RESISTANCE OF 120 TONS PER PILE.
- DRIVE PILES AT END BENT NO.2 TO A REQUIRED DRIVING RESISTANCE OF 200 TONS PER PILE.


- NOTES:**
- ALL DIMENSIONS ARE PARALLEL OR NORMAL TO BENT CONTROL LINES AND FILL FACES.
 - INDICATES PILE BATTER IN DIRECTION SHOWN. BRACE PILES AT BENTS ARE TO BE BATTERED AT 1/2:12.
 - ALL PILES AT END BENT 1 AND END BENT 2 ARE HP 12x53 STEEL PILES.
 - FOR FOUNDATION ELEVATIONS AND DETAILS, SEE BENT AND END BENT SHEETS.
 - ALL PILE DIMENSIONS ARE TO CENTERS OF PILES AT BOTTOM OF END BENTS.

PROJECT NO. R-5021
BRUNSWICK COUNTY
 STATION: POC 390+15.00 -L-

SHEET 2 OF 4

STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH

GENERAL DRAWING
 FOUNDATION LAYOUT
 RIGHT LANE

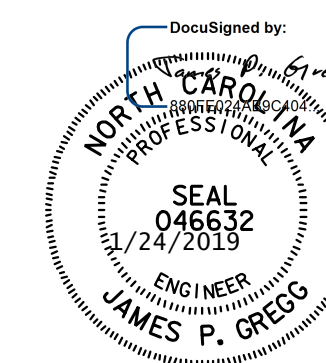

HNTB HNTB NORTH CAROLINA, P.C.
 NC License No. C-1554
 343 E. Six Forks Rd., Suite 200, Raleigh, N.C. 27609

DRAWN BY: B. NEUPANE DATE: 8/17
 CHECKED BY: B. EMAMI DATE: 9/17
 DESIGN ENGINEER OF RECORD: J. GREGG DATE: 8/18

DWG. NO. 2

REVISIONS						SHEET NO.
NO.	BY	DATE	NO.	BY	DATE	S6-2
1			3			TOTAL SHEETS
2			4			39