DESIGN FILL = 27.65'

FOR OTHER DESIGN DATA AND NOTES, SEE STANDARD NOTE SHEET.

3"Ø WEEP HOLES INDICATED TO BE IN ACCORDANCE WITH THE SPECIFICATIONS.

CONCRETE IN THE CULVERTS TO BE POURED IN THE FOLLOWING ORDER:

1. WING FOOTINGS AND FLOOR SLAB INCLUDING 4"OF ALL VERTICAL WALLS.

2. THE REMAINING PORTIONS OF THE WALLS AND WINGS FULL HEIGHT FOLLOWED BY ROOF SLAB AND HEADWALLS.

IT OUT TO MAKE CERTAIN THAT IT WILL PROPERLY TAKE CARE OF THE FILL.

DIMENSIONS FOR WING LAYOUT AS WELL AS ADDITIONAL REINFORCING STEEL EMBEDDED IN BARREL ARE SHOWN ON THE WING SHEETS.

TRANSVERSE CONSTRUCTION JOINTS SHALL BE USED IN THE BARREL, SPACED TO LIMIT THE POURS TO A MAXIMUM OF 70 FEET. LOCATION OF JOINTS SHALL BE SUBJECT TO APPROVAL OF THE ENGINEER.

OPTIONAL PRECAST REINFORCING CONCRETE BOX CULVERT, SEE SPECIAL PROVISIONS.

FOR CULVERT DIVERSION DETAILS AND PAY ITEM, SEE EROSION CONTROL PLANS.

FOR FALSEWORK AND FORMWORK, SEE SPECIAL PROVISIONS.

FOR CRANE SAFETY, SEE SPECIAL PROVISIONS.

FOR GROUT FOR STRUCTURES, SEE SPECIAL PROVISIONS.

FOR BOX CULVERT EXCAVATION, SEE SECTION 414 OF THE STANDARD SPECIFICATIONS.

UNDERCUT SOFT/VERY LOOSE SOILS THAT MAY BE ENCOUNTERED BENEATH THE BOTTOM OF THE FOUNDATION CONDITIONING MATERIAL. BACKFILL UNDERCUT AREAS WITH FOUNDATION CONDITIONING MATERIAL. IF MORE THAN 1 FT UNDERCUT IS REQUIRED, CONTACT THE OPPERATIONS ENGINEER FOR APPROVAL.

SAMPLE BAR REPLACEMENT				
SIZE	LENGTH			
#3	6'-2"			
#4	7'-4"			
#5	8'-6"			
#6	9'-8"			
#7	10'-10"			
#8	12'-0"			
#9	13'-2"			
#10	14'-6"			
#11	15′-10″			


SAMPLE BAR REPLACEMENT LENGTHS BASED ON 30" (SAMPLE LENGTH) PLUS TWO SPLICE LENGTHS AND fy = 60 ksi.



STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION

SINGLE BARREL 6 FT. X 7 FT. CONCRETE BOX CULVERT

REVISIONS					SHEET NO.
	DATE:	NO.	BY:	DATE:	C7-1
		3			TOTAL SHEETS
		4			6

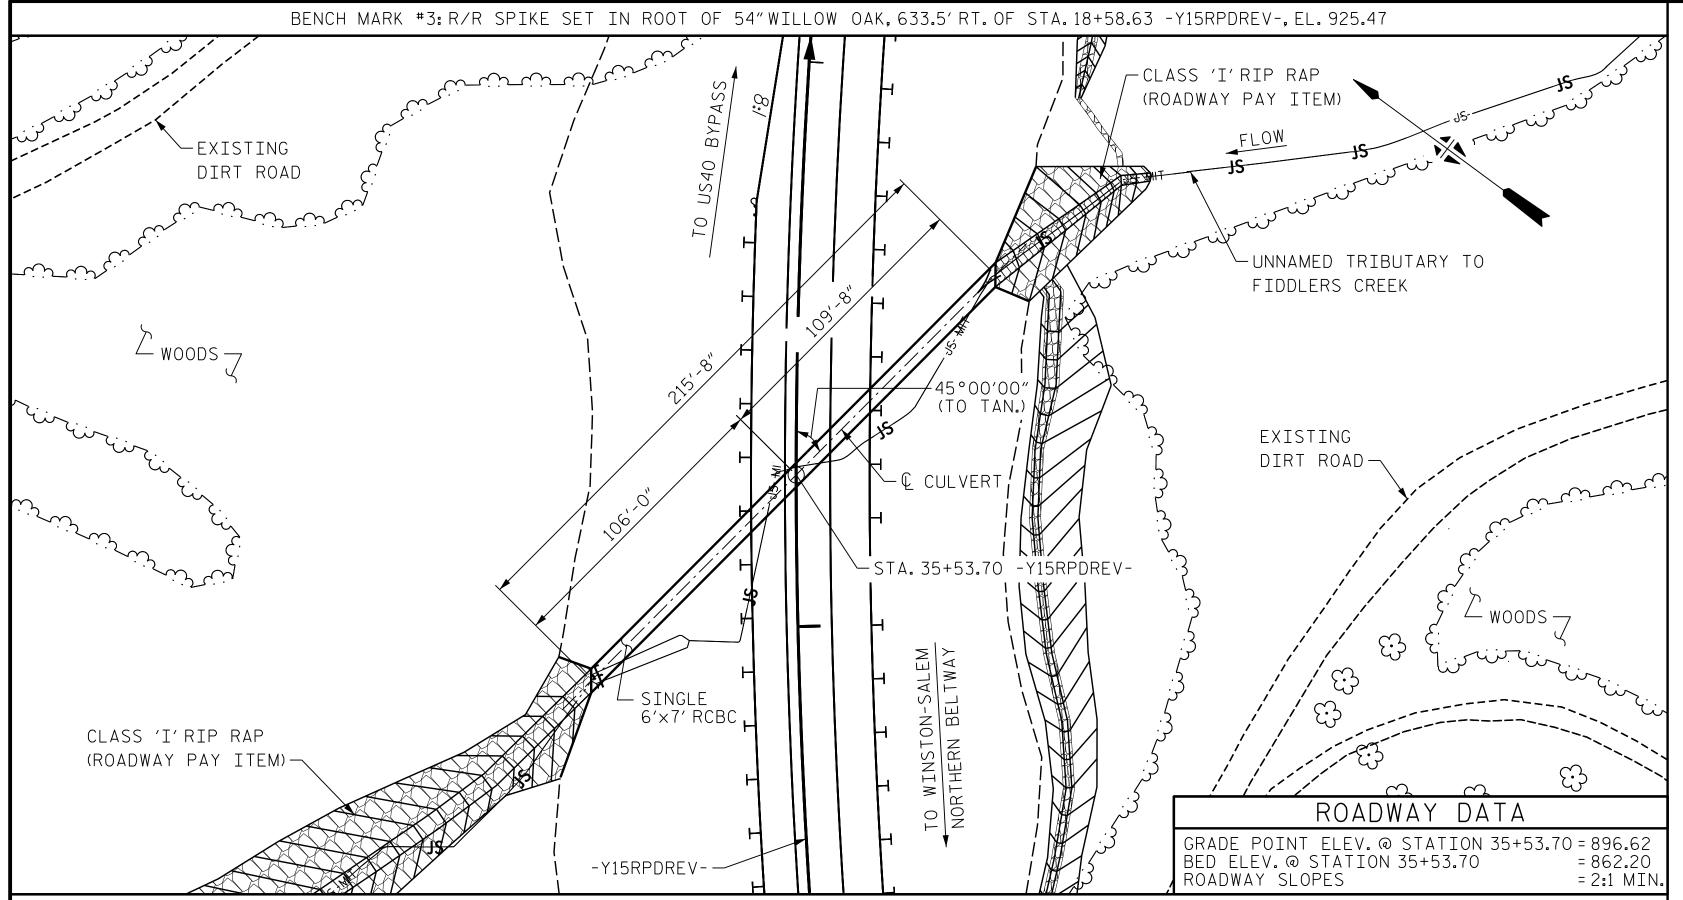

LOCATION SKETCH

FOR UTILITY INFORMATION, SEE UTILITY PLANS AND SPECIAL PROVISIONS

TOTAL STRUCTURE QUANTITIES CLASS A CONCRETE BARREL @ 1.004 C.Y./FT. 216.6 C.Y. 43.8 C.Y. WINGS ETC. SILLS/BAFFLES <u> 2.4</u> C.Y. TOTAL 262.8 C.Y. REINFORCING STEEL BARREL, HEADWALLS, SILLS, & BAFFLES 43,361 LBS. 3,962 LBS. WINGS TOTAL 47,323 LBS. CULVERT EXCAVATION LUMP SUM

FOUNDATION CONDITIONING MATERIAL 178 TONS

HYDRAULIC DATA

OVERTOPPING FLOOD DATA

FREQUENCY OF OVERTOPPING FLOOD = >500 YR.

OVERTOPPING FLOOD ELEVATION = 892.4

= 180 CFS

= 200 CFS

= 840 CFS

= 0.09 SQ.MI.

= 50 YR.

= 869.4

= 869.7

DESIGN DISCHARGE

BASE DISCHARGE (Q100)

OVERTOPPING DISCHARGE

DRAINAGE AREA

FREQUENCY OF DESIGN FLOOD

BASE HIGH WATER ELEVATION

DESIGN HIGH WATER ELEVATION

-Y15RPDREV-3′-10″ r6′-11″ 4'-3"г2′-5″ г5′-5″ 20'-8" 49'-5" 34'-8" 14'-0" 62′-5″ 27′-3″ 30'-11" 13'-7" 14'-1" EL.867.0 ± ¬ EL.864.4 EL.864.1 ± --EL.866.0 -EL.866.2 ± EL.865.5 ± -EL.864.9 ± -EL.865.0 ± └EL.864.7 ± -EL.864.3 ± EL.863.2 ± -└EL.862.8 ± EL.862.7 ± --EL.861.8 ± -EL.863.6 ± -EL.861.1 ± EL.864.5 ±

PROFILE ALONG & CULVERT

DWG BY: T. MCALEENAN DATE : 11/19 DATE: 11/19 T. MCALEENAN DES CHK: R. TURNAGE CHK BY: R. TURNAGE . DATE : 11/19 DATE: 11/19

HDR Engineering, Inc. of the Carolinas 555 Fayetteville St., Suite 900 Raleigh, N.C. 27601 N.C.B.E.L.S. License Number: F-0116

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

THE RESIDENT ENGINEER SHALL CHECK THE LENGTH OF CULVERT BEFORE STAKING

AT THE CONTRACTOR'S OPTION HE MAY SUBMIT, TO THE ENGINEER FOR APPROVAL, DESIGN AND DETAIL DRAWINGS FOR A PRECAST REINFORCED CONCRETE BOX CULVERT IN LIEU OF THE CAST-IN-PLACE CULVERT SHOWN ON PLANS. THE DESIGN SHALL PROVIDE THE SAME SIZE AND NUMBER OF BARRELS AS USED ON THE CAST-IN-PLACE DESIGN. FOR

A 3 FOOT STRIP OF GEOTEXTILE SHALL BE ATTACHED TO THE FILL FACE OF THE WING COVERING THE ENTIRE LENGTH OF THE EXPANSION JOINT.

THE CONTRACTOR SHALL PROVIDE INDEPENDENT ASSURANCE SAMPLES OF REINFORCING STEEL AS FOLLOWS: FOR PROJECTS REQUIRING UP TO 400 TONS OF REINFORCING STEEL ONE 30 INCH SAMPLE OF EACH SIZE BAR USED, AND FOR PROJECTS REQUIRING OVER 400 TONS OF REINFORCING STEEL, TWO 30 INCH SAMPLES OF EACH SIZE BAR USED. THE SAMPLE BARS SHOULD COME FROM STEEL ACTUALLY USED IN THE PROJECT AND THE SAMPLE BARS SHOULD BE REPLACED BY SPLICED BARS AS SPECIFIED IN THE SAMPLE BAR REPLACEMENT CHART. PAYMENT FOR THE SAMPLE BARS AND REPLACEMENT REINFORCING STEEL SHALL BE CONSIDERED INCIDENTAL TO THE VARIOUS PAY ITEMS.

FOR SUBMITTAL OF WORKING DRAWINGS, SEE SPECIAL PROVISIONS.

AT THE CONTRACTOR'S OPTION, HE MAY SPLICE THE VERTICAL REINFORCING STEEL IN THE INTERIOR FACE OF EXTERIOR WALL ABOVE LOWER WALL CONSTRUCTION JOINT. THE SPLICE LENGTH SHALL BE AS PROVIDED IN THE SPLICE LENGTH CHART SHOWN ON THE PLANS. EXTRA WEIGHT OF STEEL DUE TO THE SPLICES SHALL BE PAID FOR BY THE CONTRACTOR.

THE REINFORCED CONCRETE BOX CULVERT SHALL BE PLACED ON THE STANDARD 1.0 FOOT BLANKET OF FOUNDATION CONDITIONING MATERIAL.

> U-2579AB PROJECT NO. ___

> > FORSYTH

STATION: 35+53.70 -Y15RPDREV-

COUNTY

45° SKEW