

ANGLE BALL VALVE—

<u>AWWA C800-</u>89 <u>ASTM B62-</u>93

SEE STANDARD DETAIL W-12

(2) METER - TO BE INSTALLED BY THE CITY

(3) METER BOX- SEE CURRENT APPROVED PRODUCT MANUFACTURERS

CITY OF SALISBURY, N.C. STANDARD DETAIL

WATER SYSTEMS

3/4" & 1 " METER DETAIL

SHEET FOR APPROVED TYPES, (APPENDIX A)

(5) ALL ITEMS AS SPECIFIED OR APPROVED EQUAL(DOMESTIC MANUFACTURED ONLY)

(6) METER BOXES SHALL NOT BE LOCATED IN DRIVEWAYS OR DESIGNATED PARKING SPACES.

(7) SEE STANDARD DETAIL W-12 FOR METER BOX LOCATION. IN AREAS WHERE SIDEWALKS ARE

NOT REQUIRED THE BACK OF THE METER BOX SHALL BE LOCATED AT THE PROPERTY LINE.

INLET & OUTLET—

CTS GRIP JOINT INLET & OUTLET

(1) METER SETTER - INLET: COPPERTUBE PACK JOINT/OUTLET COPPERTUBE PACK JOINT - SEE

(4) 24" OF COPPER W/BE USED FOR TAIL PIPE AND FIP x CTPJ W/BE PROVIDED FOR CONNECTION

12" LONG STABILIZING PVC BAR — 6" OF #67 WASH STONE

CURRENT APPROVED PRODUCT MANUFACTURERS SHEET FOR APPROVED TYPES


DUAL CARTRIDGE CHECKVALVE


AMENDED: MAY 19, 2009


NOT TO SCALE

STANDARD

OOO INLET & OUTLET

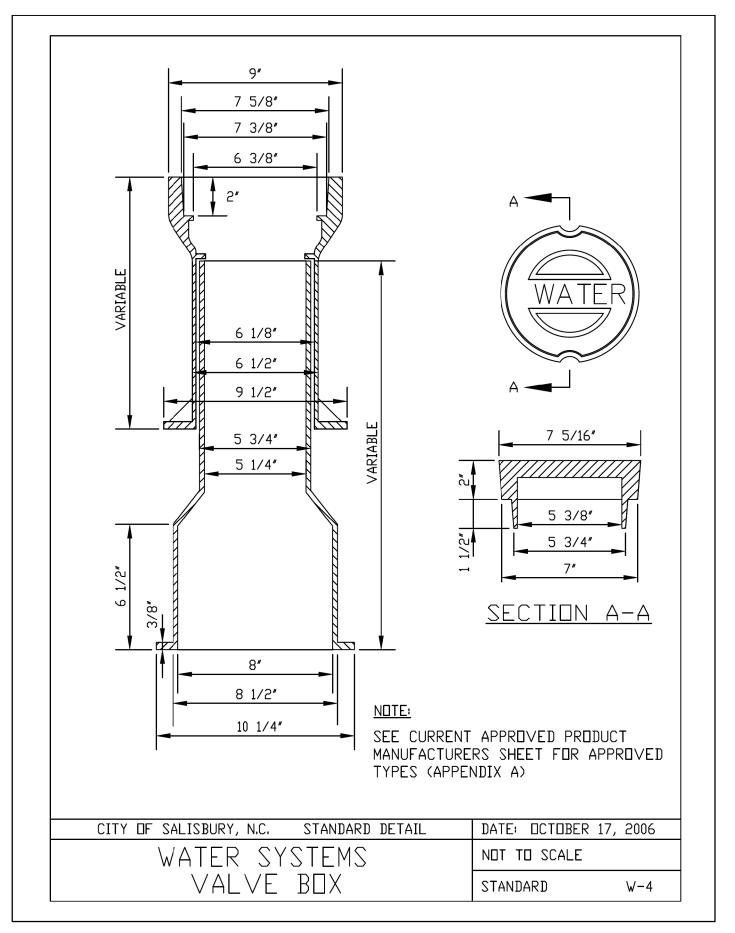

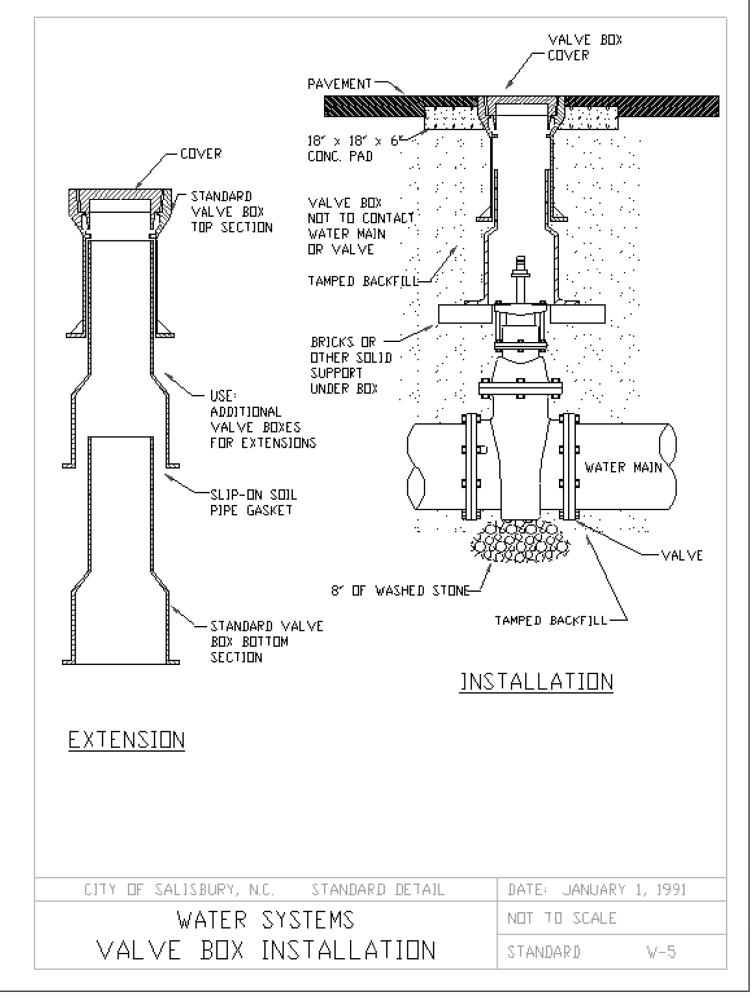

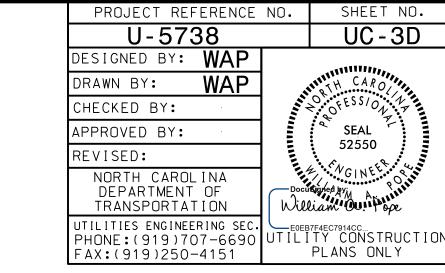

UTILITY CONSTRUCTION

DOCUMENT NOT CONSIDERED FINAL UNTIL ALL SIGNATURES ARE COMPLETED

**PROJECT TYPICAL DETAILS** 

