


5/14/99

UTILITY CONSTRUCTION PLANS		PROJECT REFERENCE NO. R-4705	SHEET NO. UC-44
DESIGNED BY: SLK		3/25/2022	
DRAWN BY: SLK			
CHECKED BY: AMM			
APPROVED BY: AMM			
REVISED:		NORTH CAROLINA DEPARTMENT OF TRANSPORTATION	
TIE TO EXISTING 6" PVC WATER MAIN. RESTRAIN NEW 6" C900 DR 18 PC 150 PVC TO EXISTING. COORDINATE WORK WITH TOWN OF WILLIAMSTON.		UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151	
TIE TO EXISTING 6" PVC WATER MAIN. RESTRAIN NEW 6" C900 DR 18 PC 150 PVC TO EXISTING. COORDINATE WORK WITH TOWN OF WILLIAMSTON.			
		1223 Jones Franklin Rd. Raleigh, N.C. 27606 License No. F-0377 Bus: 919 851 8077 Fax: 919 851 8107	
		TRANSPORTATION PLANNING/DESIGN - BRIDGE/STRUCTURE DESIGN CIVIL/SITE DESIGN - GIS/GPS - CONSTRUCTION OBSERVATION	

FINAL DESIGN
RELEASE
FOR CONSTRUCTION

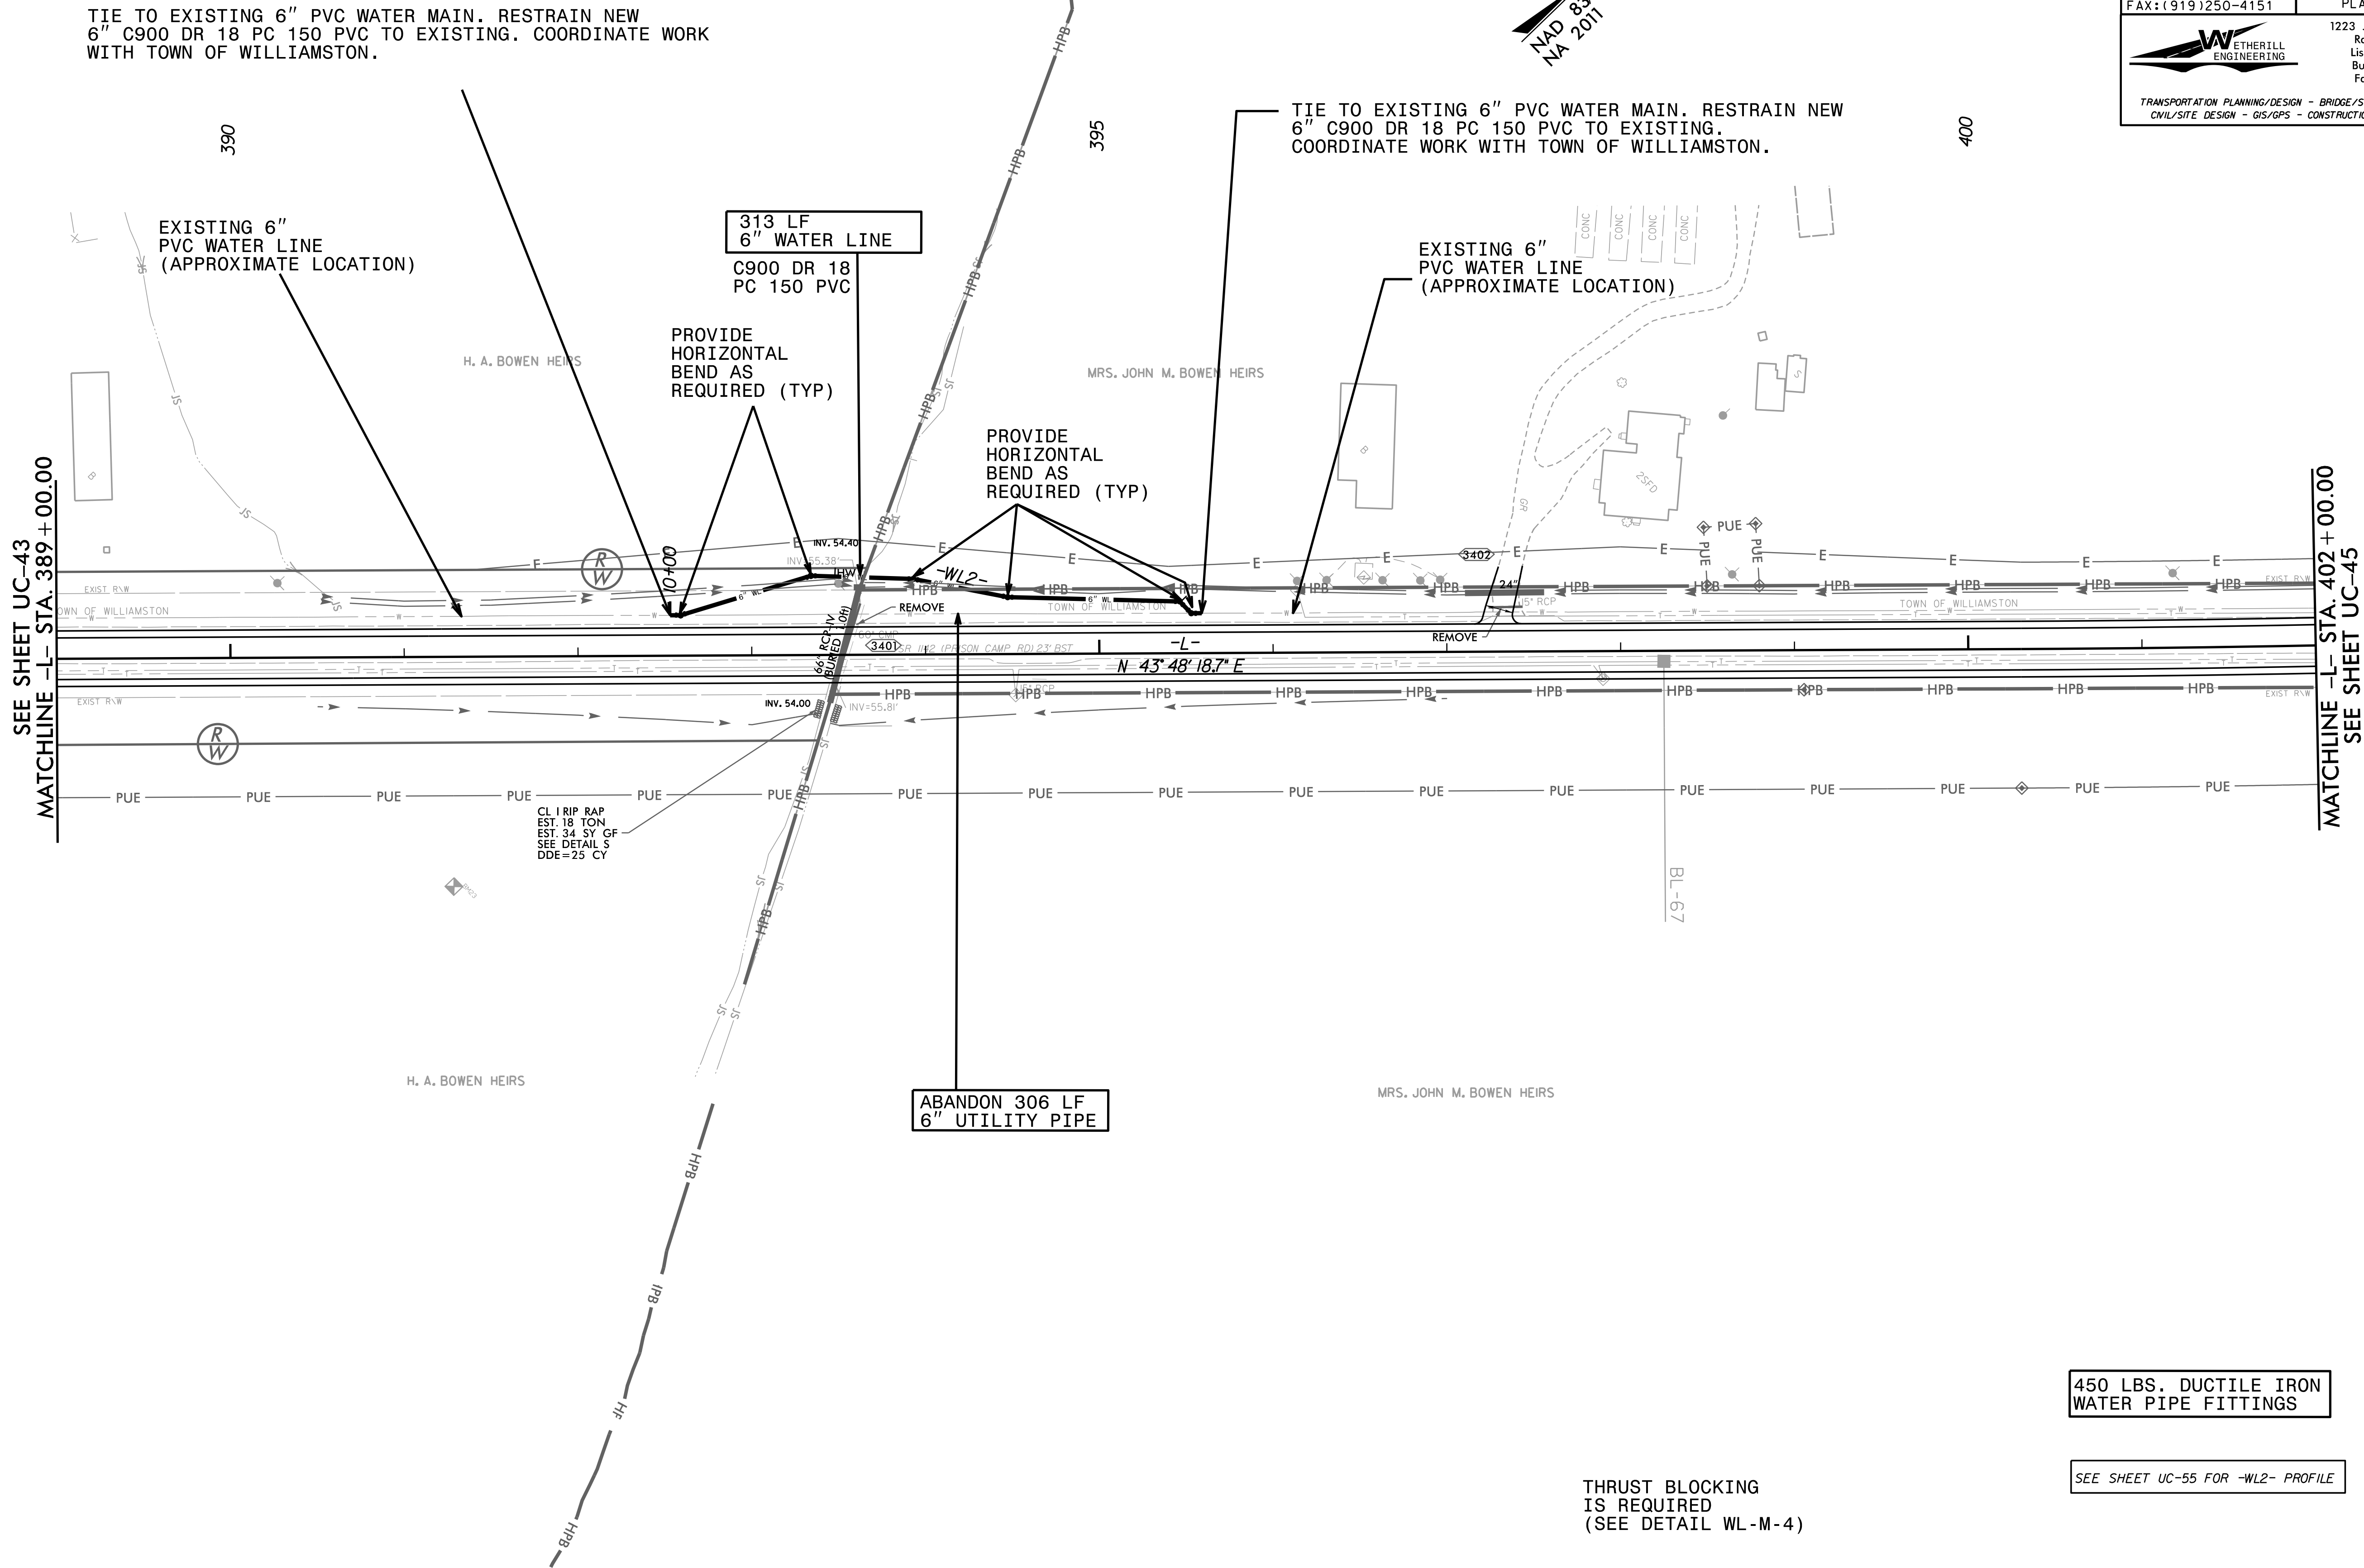

TIE TO EXISTING 6" PVC WATER MAIN. RESTRAIN NEW 6" C900 DR 18 PC 150 PVC TO EXISTING. COORDINATE WORK WITH TOWN OF WILLIAMSTON.

TIE TO EXISTING 6" PVC WATER MAIN. RESTRAIN NEW 6" C900 DR 18 PC 150 PVC TO EXISTING. COORDINATE WORK WITH TOWN OF WILLIAMSTON.

SEE SHEET UC-43
MATCHLINE -L- STA. 389+00.00

MATCHLINE -L- STA. 402+00.00
SEE SHEET UC-45

REVISIONS

450 LBS. DUCTILE IRON
WATER PIPE FITTINGS

SEE SHEET UC-55 FOR -WL2- PROFILE

THRUST BLOCKING
IS REQUIRED
(SEE DETAIL WL-M-4)

3/24/2022
UC44.rdg
UC44.psh.dgn