


5/14/99

CONTRACTOR TO BACKFILL OVER WATER LINE PRIOR TO TESTING AND PLACING INTO SERVICE WITH MINIMUM 36" OF COVER.


PROP. 6" SEWER FORCE MAIN SL-2 TOWN OF ST. PAULS

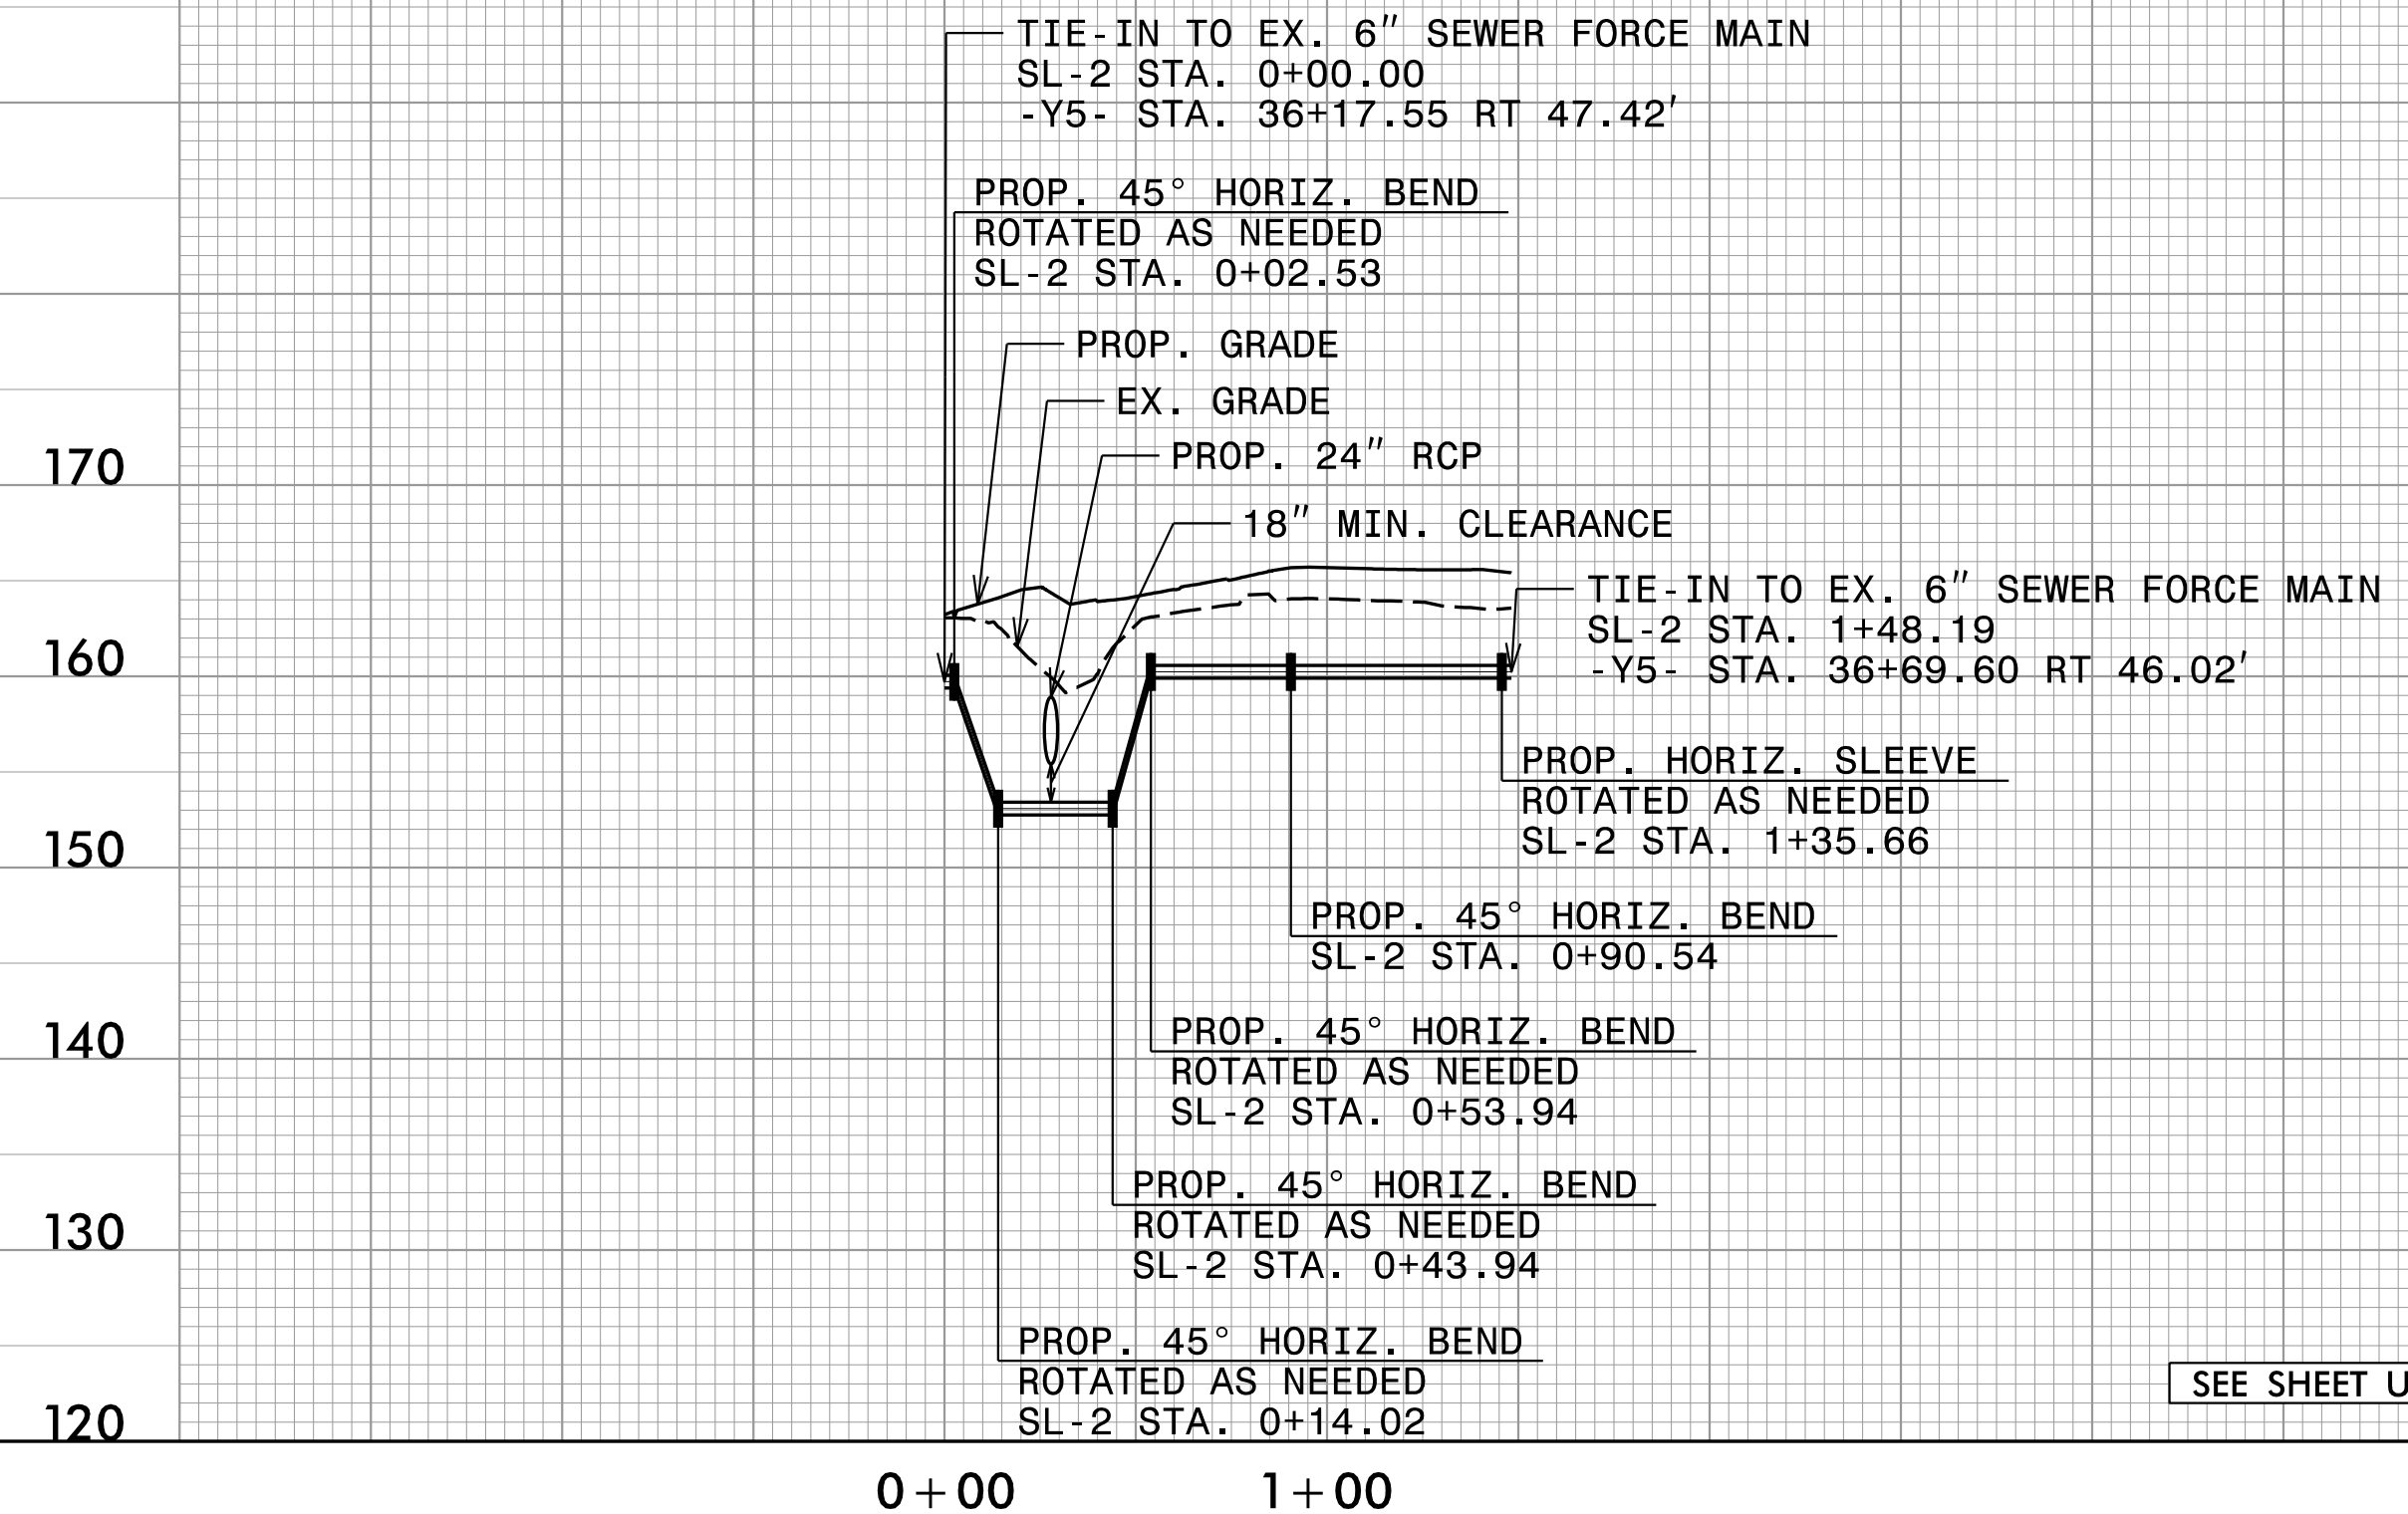

SEE SHEET UC-9 FOR SEWER PLAN

0+00 1+00


PROP. 6" SEWER FORCE MAIN SL-3 TOWN OF ST. PAULS

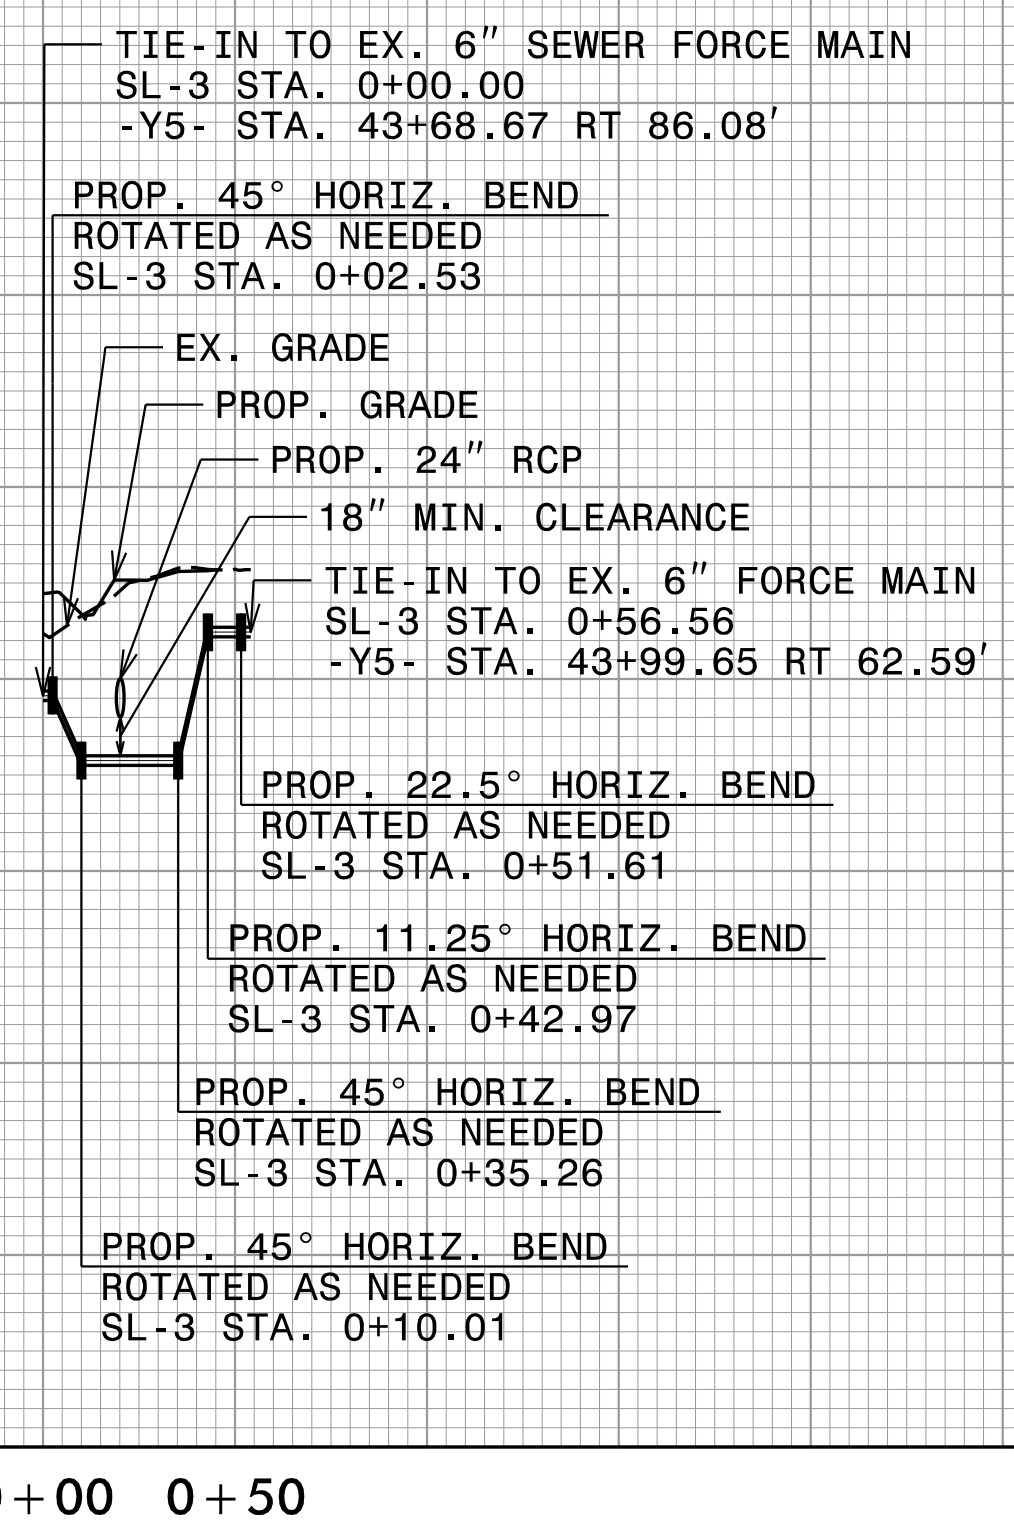

SEE SHEET UC-9 SEWER WATER PLAN

0+00 0+50


PROP. 6" GRAVITY SEWER SL-5 TOWN OF ST. PAULS

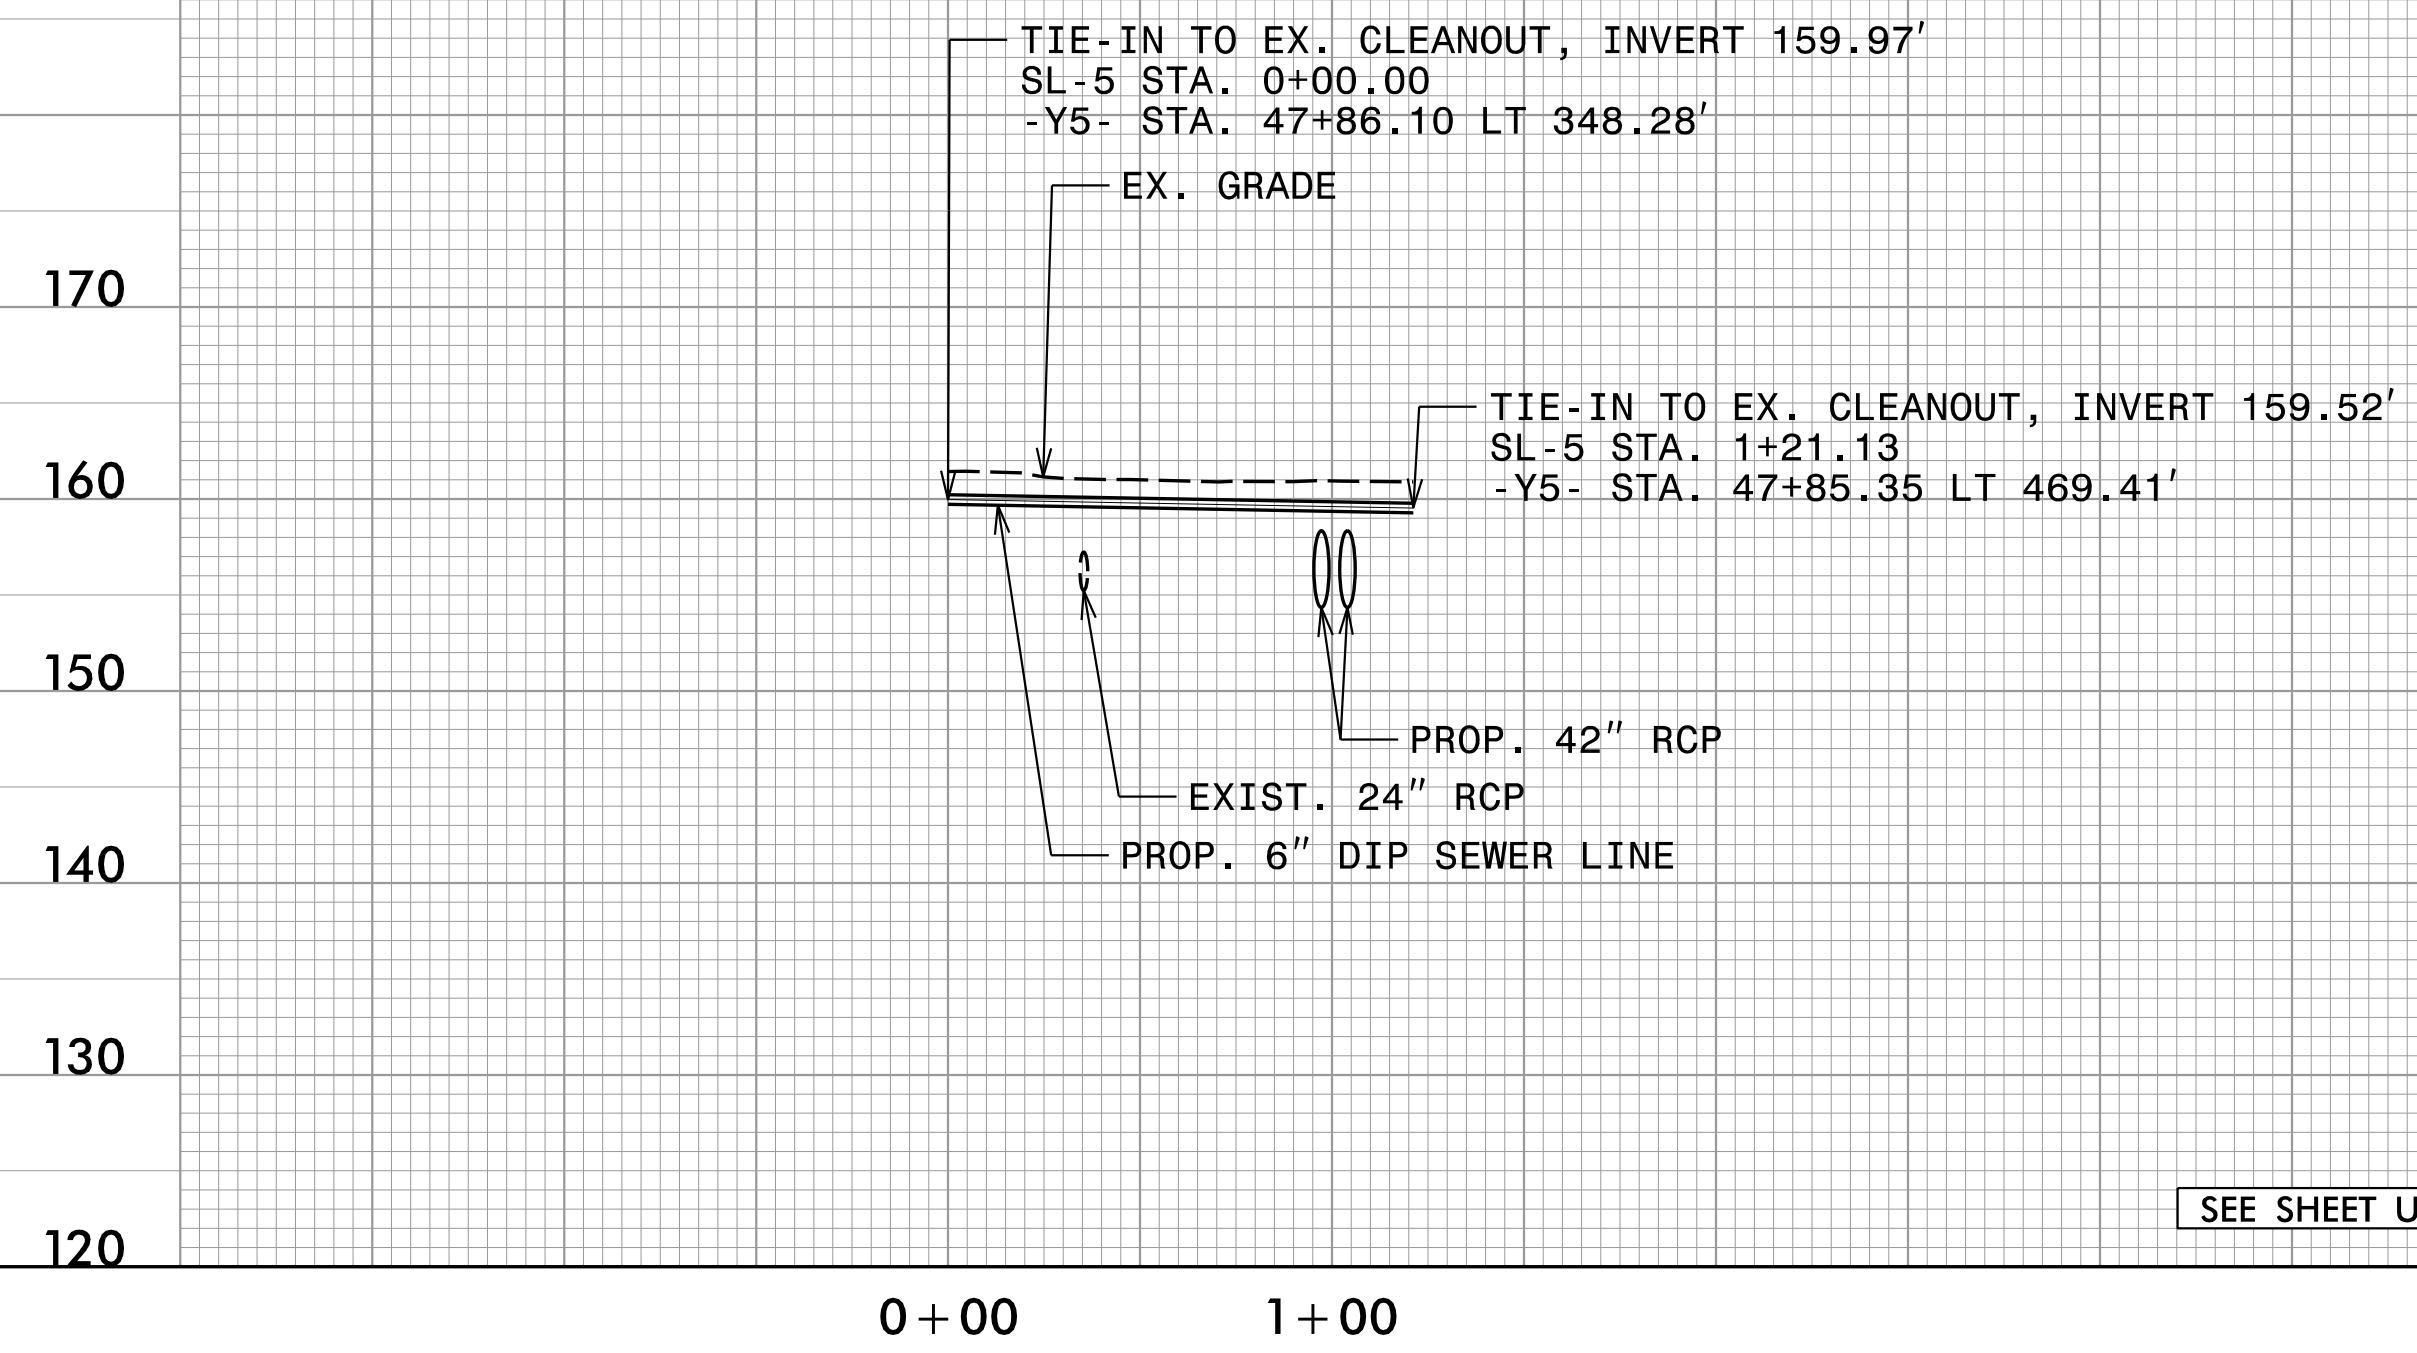

SEE SHEET UC-9 FOR SEWER PLAN

0+00 1+00

PROP. 6" SEWER FORCE MAIN SL-6 TOWN OF ST. PAULS

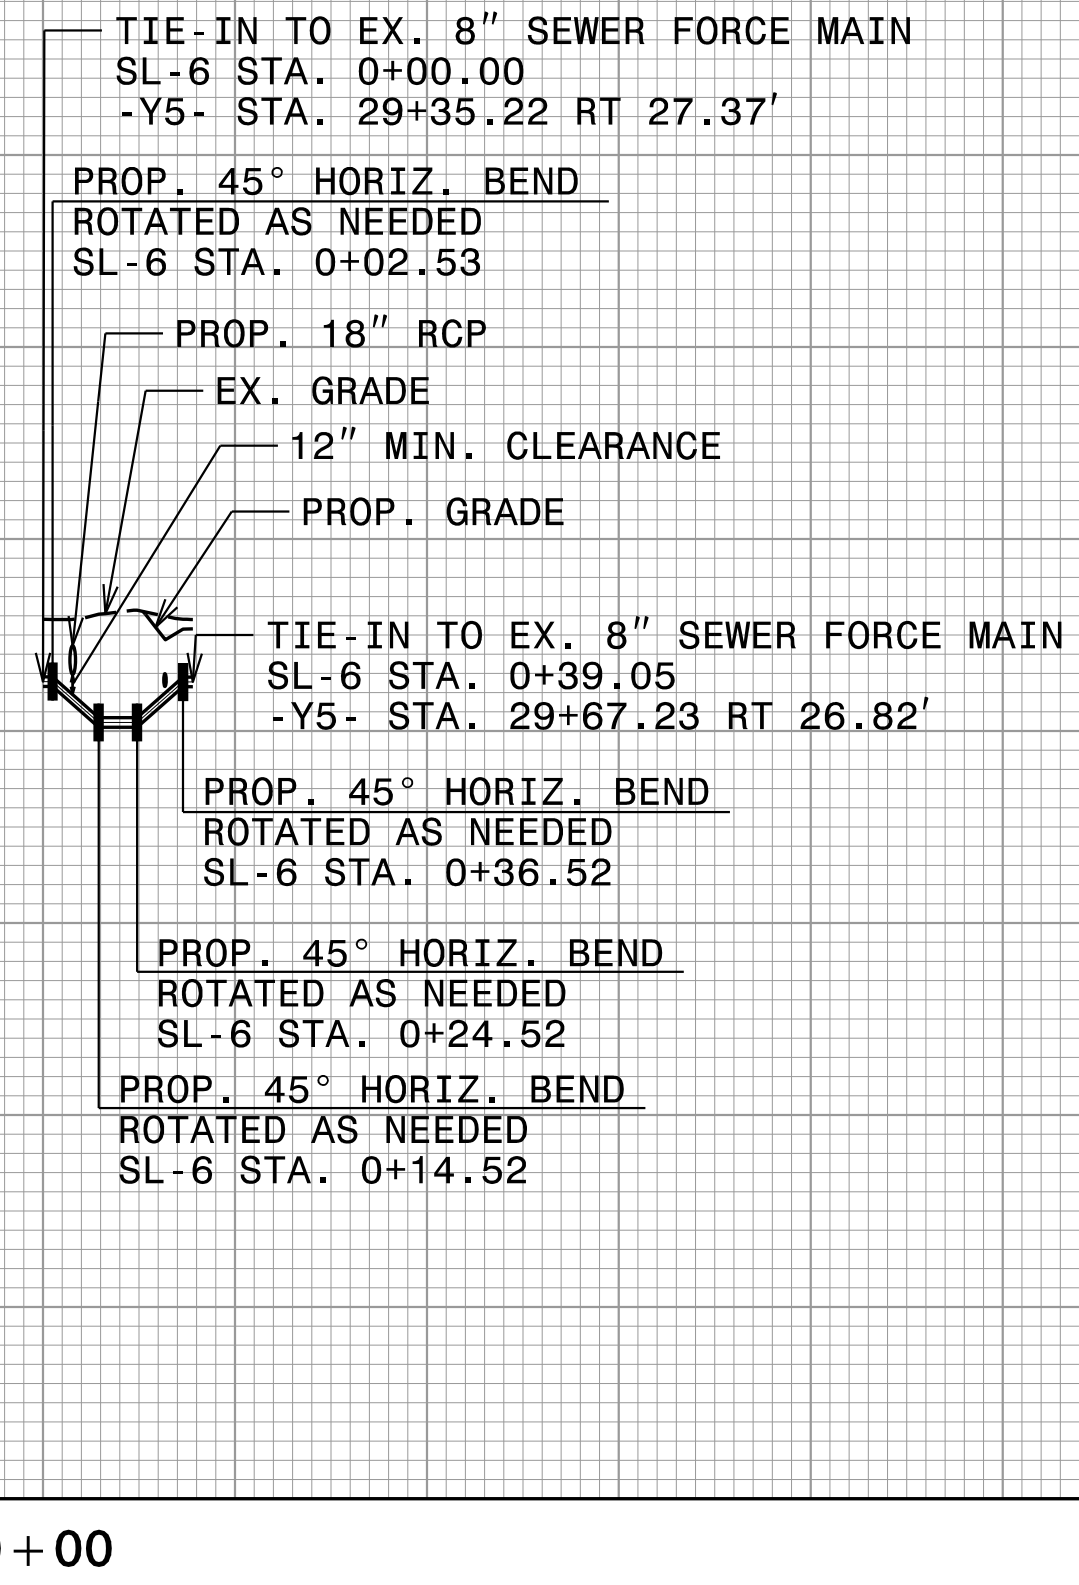

SEE SHEET UC-16 FOR SEWER PLAN

0+00

PROJECT REFERENCE NO. 1-5987B	SHEET NO. UC-26
DESIGNED BY: BLP	
DRAWN BY: BLP	
CHECKED BY: DLJ	
APPROVED BY:	
REVISED:	
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151	
UTILITY CONSTRUCTION PLANS ONLY DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED	
Prepared in the Office of:	M PO Box 700 FURQUAY-VARINA, NC 27526 MOTT MACDONALD www.mottmac.com/americas
UTILITY CONSTRUCTION	

7/12/2022 R:\11111111\Engineering\UC\Proj\15987b-utl_UC26.dgn