


PROP. 12" DI RJ WATER LINE
USE FLEXIBLE RESTRAINED JOINT PIPE
TO ALLOW EXPANSION AND CONTRACTION
AT THE JOINT AFTER IN SERVICE

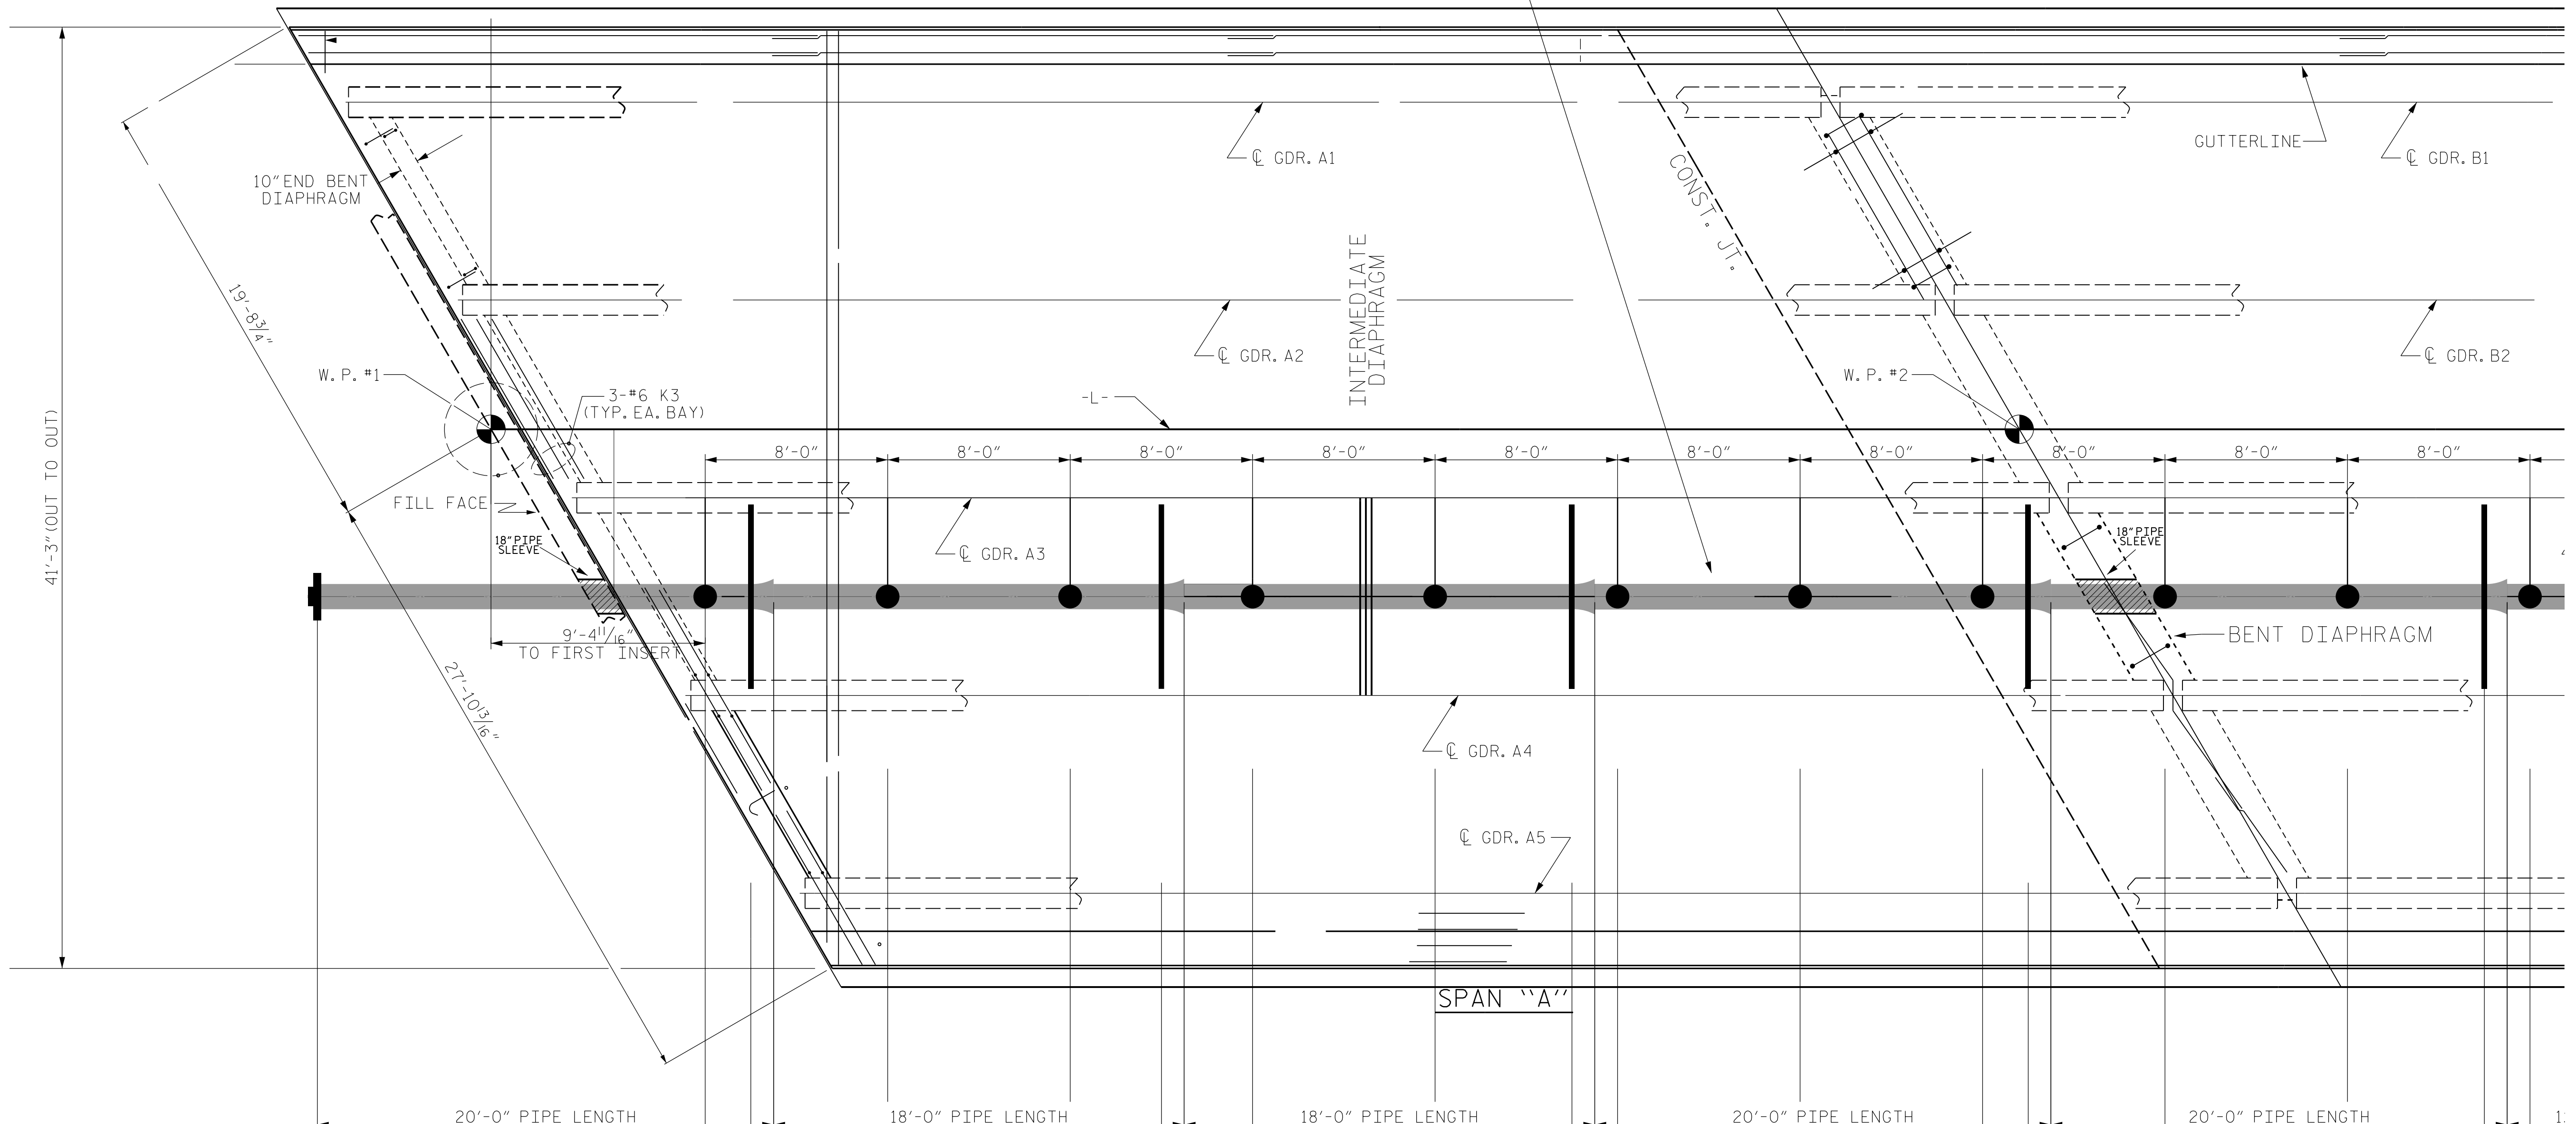

41'-3" (OUT TO OUT)

20'-0" PIPE LENGTH 18'-0" PIPE LENGTH 18'-0" PIPE LENGTH 20'-0" PIPE LENGTH 20'-0" PIPE LENGTH 20'-0" PIPE LENGTH

PROP. PIPE HANGER AND INSERT 1
PROP. (LPB) 1
1'-0" BELL OFFSET

PROP. PIPE HANGER AND INSERT 2

PROP. PIPE HANGER AND INSERT 3

PROP. (LPB) 2
1'-0" BELL OFFSET

PROP. PIPE HANGER AND INSERT 4

PROP. PIPE HANGER AND INSERT 5

PROP. (LPB) 3
1'-0" BELL OFFSET

PROP. PIPE HANGER AND INSERT 6

PROP. PIPE HANGER AND INSERT 7

PROP. PIPE HANGER AND INSERT 8

PROP. (LPB) 4
1'-0" BELL OFFSET


PROP. PIPE HANGER AND INSERT 9

(LPB) - LATERAL PIPE BRACING

INTERMEDIATE DIAPHRAGM TO BE REMOVED PRIOR TO PROPOSED WATER LINE BEING INSTALLED

PROJECT NO. B-4786
PITT COUNTY
 STATION: 28+03.00 -L-

SHEET OF

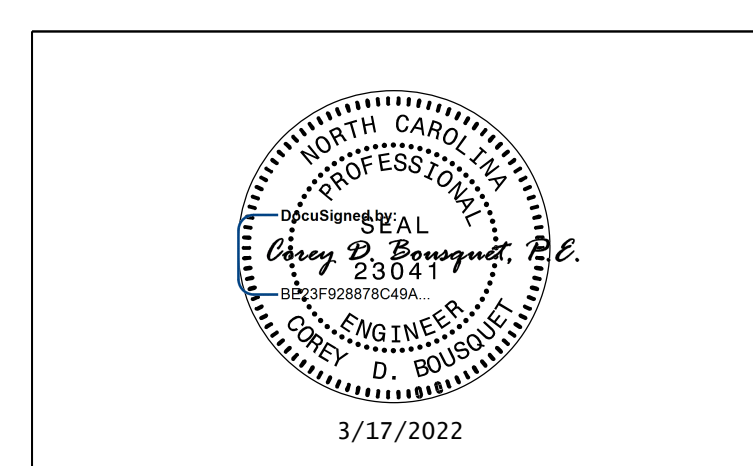

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED



DRAWN BY : SBW DATE : 8-18
 CHECKED BY : DATE :
 DESIGN ENGINEER OF RECORD: DATE :

REVISIONS						SHEET NO.
NO.	BY:	DATE:	NO.	BY:	DATE:	SU-12
1			3			
2			4			