

PROJECT: 32572.1.FS10 REFERENCE: A-0009CB

CONTENTS

SHEET NO.	DESCRIPTION
1	TITLE SHEET
2	LEGEND (SOIL & ROCK)
3	SITE PLAN
4	WALL ENVELOPE
5-9	CROSS SECTIONS
10-12	BORE LOGS
13-15	GEOPHYSICAL TEST RESULTS

STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
DIVISION OF HIGHWAYS
GEOTECHNICAL ENGINEERING UNIT

STRUCTURE
SUBSURFACE INVESTIGATION

COUNTY GRAHAM
 PROJECT DESCRIPTION UPGRADE NC 143 FROM SR 1223 (BEECH CREEK ROAD) TO 0.5 MILES NORTH OF APPALACHIAN TRAIL
 SITE DESCRIPTION RETAINING WALL #18: SHORED MECHANICALLY STABILIZED EARTH (SMSE) WALL N -L- FROM 375+25 RT TO 378+15 RT

STATE	STATE PROJECT REFERENCE NO.	SHEET NO.	TOTAL SHEETS
N.C.	A-0009CB	1	15

CAUTION NOTICE

THE SUBSURFACE INFORMATION AND THE SUBSURFACE INVESTIGATION ON WHICH IT IS BASED WERE MADE FOR THE PURPOSE OF STUDY, PLANNING AND DESIGN, AND NOT FOR CONSTRUCTION OR PAY PURPOSES. THE VARIOUS FIELD BORING LOGS, ROCK CORES AND SOIL TEST DATA AVAILABLE MAY BE REVIEWED OR INSPECTED IN RALEIGH BY CONTACTING THE N. C. DEPARTMENT OF TRANSPORTATION, GEOTECHNICAL ENGINEERING UNIT AT (919) 707-6850. THE SUBSURFACE PLANS AND REPORTS, FIELD BORING LOGS, ROCK CORES AND SOIL TEST DATA ARE NOT PART OF THE CONTRACT.

GENERAL SOIL AND ROCK STRATA DESCRIPTIONS AND INDICATED BOUNDARIES ARE BASED ON A GEOTECHNICAL INTERPRETATION OF ALL AVAILABLE SUBSURFACE DATA AND MAY NOT NECESSARILY REFLECT THE ACTUAL SUBSURFACE CONDITIONS BETWEEN BORINGS OR BETWEEN SAMPLED STRATA WITHIN THE BOREHOLE. THE LABORATORY SAMPLE DATA AND THE IN SITU (IN-PLACE) TEST DATA CAN BE RELIED ON ONLY TO THE DEGREE OF RELIABILITY INHERENT IN THE STANDARD TEST METHOD. THE OBSERVED WATER LEVELS OR SOIL MOISTURE CONDITIONS INDICATED IN THE SUBSURFACE INVESTIGATIONS ARE AS RECORDED AT THE TIME OF THE INVESTIGATION. THESE WATER LEVELS OR SOIL MOISTURE CONDITIONS MAY VARY CONSIDERABLY WITH TIME ACCORDING TO CLIMATIC CONDITIONS INCLUDING TEMPERATURES, PRECIPITATION AND WIND, AS WELL AS OTHER NON-CLIMATIC FACTORS.

THE BIDDER OR CONTRACTOR IS CAUTIONED THAT DETAILS SHOWN ON THE SUBSURFACE PLANS ARE PRELIMINARY ONLY AND IN MANY CASES THE FINAL DESIGN DETAILS ARE DIFFERENT. FOR BIDDING AND CONSTRUCTION PURPOSES, REFER TO THE CONSTRUCTION PLANS AND DOCUMENTS FOR FINAL DESIGN INFORMATION ON THIS PROJECT. THE DEPARTMENT DOES NOT WARRANT OR GUARANTEE THE SUFFICIENCY OR ACCURACY OF THE INVESTIGATION MADE, NOR THE INTERPRETATIONS MADE, OR OPINION OF THE DEPARTMENT AS TO THE TYPE OF MATERIALS AND CONDITIONS TO BE ENCOUNTERED. THE BIDDER OR CONTRACTOR IS CAUTIONED TO MAKE SUCH INDEPENDENT SUBSURFACE INVESTIGATIONS AS HE DEEMS NECESSARY TO SATISFY HIMSELF AS TO CONDITIONS TO BE ENCOUNTERED ON THE PROJECT. THE CONTRACTOR SHALL HAVE NO CLAIM FOR ADDITIONAL COMPENSATION OR FOR AN EXTENSION OF TIME FOR ANY REASON RESULTING FROM THE ACTUAL CONDITIONS ENCOUNTERED AT THE SITE DIFFERING FROM THOSE INDICATED IN THE SUBSURFACE INFORMATION.

- NOTES:
- THE INFORMATION CONTAINED HEREIN IS NOT IMPLIED OR GUARANTEED BY THE N. C. DEPARTMENT OF TRANSPORTATION AS ACCURATE NOR IS IT CONSIDERED PART OF THE PLANS, SPECIFICATIONS OR CONTRACT FOR THE PROJECT.
 - BY HAVING REQUESTED THIS INFORMATION, THE CONTRACTOR SPECIFICALLY WAIVES ANY CLAIMS FOR INCREASED COMPENSATION OR EXTENSION OF TIME BASED ON DIFFERENCES BETWEEN THE CONDITIONS INDICATED HEREIN AND THE ACTUAL CONDITIONS AT THE PROJECT SITE.

- PERSONNEL
- CG2 EXPLORATION
 - BRECCIA
 - N. MCLAREN
 - D. GOODNIGHT
 - C. PIERCY
 - GEL SOLUTIONS

INVESTIGATED BY CG2
 DRAWN BY M. BREWER, P.E.
 CHECKED BY R. KRAL, P.E.
 SUBMITTED BY M. BREWER, P.E.
 DATE MAY 2022

Prepared in the Office of:
 **CAROLINAS GEOTECHNICAL GROUP**
 2400 CROWNPOINT EXECUTIVE DRIVE
 SUITE 800
 CHARLOTTE, NC 28227
 (980) 339-8684





DocuSigned by:
D. Matthew Brewer 6/7/2022
 386129C0A4C1462
 SIGNATURE DATE

**DOCUMENT NOT CONSIDERED FINAL
 UNLESS ALL SIGNATURES COMPLETED**

NORTH CAROLINA DEPARTMENT OF TRANSPORTATION
DIVISION OF HIGHWAYS
GEOTECHNICAL ENGINEERING UNIT
SUBSURFACE INVESTIGATION
SOIL AND ROCK LEGEND, TERMS, SYMBOLS, AND ABBREVIATIONS

SOIL DESCRIPTION										GRADATION										ROCK DESCRIPTION										TERMS AND DEFINITIONS																																																																																																																																																																																												
<p>SOIL IS CONSIDERED UNCONSOLIDATED, SEMI-CONSOLIDATED, OR WEATHERED EARTH MATERIALS THAT CAN BE PENETRATED WITH A CONTINUOUS FLIGHT POWER AUGER AND YIELD LESS THAN 100 BLOWS PER FOOT ACCORDING TO THE STANDARD PENETRATION TEST (AASHTO T 208, ASTM D1586). SOIL CLASSIFICATION IS BASED ON THE AASHTO SYSTEM. BASIC DESCRIPTIONS GENERALLY INCLUDE THE FOLLOWING: CONSISTENCY, COLOR, TEXTURE, MOISTURE, AASHTO CLASSIFICATION, AND OTHER PERTINENT FACTORS SUCH AS MINERALOGICAL COMPOSITION, ANGULARITY, STRUCTURE, PLASTICITY, ETC. FOR EXAMPLE, <i>VERY STIFF, GRAY, SILTY CLAY, MOIST WITH INTERBEDDED FINE SAND LAYERS, HIGHLY PLASTIC, A-7-6</i></p>										<p>WELL GRADED - INDICATES A GOOD REPRESENTATION OF PARTICLE SIZES FROM FINE TO COARSE. UNIFORMLY GRADED - INDICATES THAT SOIL PARTICLES ARE ALL APPROXIMATELY THE SAME SIZE. GAP-GRADED - INDICATES A MIXTURE OF UNIFORM PARTICLE SIZES OF TWO OR MORE SIZES.</p>										<p>HARD ROCK IS NON-COASTAL PLAIN MATERIAL THAT WOULD YIELD SPT REFUSAL IF TESTED, AN INFERRED ROCK LINE INDICATES THE LEVEL AT WHICH NON-COASTAL PLAIN MATERIAL WOULD YIELD SPT REFUSAL. SPT REFUSAL IS PENETRATION BY A SPLIT SPOON SAMPLER EQUAL TO OR LESS THAN 0.1 FOOT PER 60 BLOWS IN NON-COASTAL PLAIN MATERIAL. THE TRANSITION BETWEEN SOIL AND ROCK IS OFTEN REPRESENTED BY A ZONE OF WEATHERED ROCK. ROCK MATERIALS ARE TYPICALLY DIVIDED AS FOLLOWS:</p>										<p>ALLUVIUM (ALLUV.) - SOILS THAT HAVE BEEN TRANSPORTED BY WATER. AQUIFER - A WATER BEARING FORMATION OR STRATA. ARENACEOUS - APPLIED TO ROCKS THAT HAVE BEEN DERIVED FROM SAND OR THAT CONTAIN SAND. ARGILLACEOUS - APPLIED TO ALL ROCKS OR SUBSTANCES COMPOSED OF CLAY MINERALS, OR HAVING A NOTABLE PROPORTION OF CLAY IN THEIR COMPOSITION, SUCH AS SHALE, SLATE, ETC. ARTESIAN - GROUND WATER THAT IS UNDER SUFFICIENT PRESSURE TO RISE ABOVE THE LEVEL AT WHICH IT IS ENCOUNTERED, BUT WHICH DOES NOT NECESSARILY RISE TO OR ABOVE THE GROUND SURFACE. CALCAREOUS (CALC.) - SOILS THAT CONTAIN APPRECIABLE AMOUNTS OF CALCIUM CARBONATE. COLLUVIUM - ROCK FRAGMENTS MIXED WITH SOIL DEPOSITED BY GRAVITY ON SLOPE OR AT BOTTOM OF SLOPE. CORE RECOVERY (REC.) - TOTAL LENGTH OF ALL MATERIAL RECOVERED IN THE CORE BARREL DIVIDED BY TOTAL LENGTH OF CORE RUN AND EXPRESSED AS A PERCENTAGE. DIKE - A TABULAR BODY OF IGNEOUS ROCK THAT CUTS ACROSS THE STRUCTURE OF ADJACENT ROCKS OR CUTS MASSIVE ROCK. DIP - THE ANGLE AT WHICH A STRATUM OR ANY PLANAR FEATURE IS INCLINED FROM THE HORIZONTAL. DIP DIRECTION (DIP AZIMUTH) - THE DIRECTION OR BEARING OF THE HORIZONTAL TRACE OF THE LINE OF DIP, MEASURED CLOCKWISE FROM NORTH. FAULT - A FRACTURE OR FRACTURE ZONE ALONG WHICH THERE HAS BEEN DISPLACEMENT OF THE SIDES RELATIVE TO ONE ANOTHER PARALLEL TO THE FRACTURE. FISSILE - A PROPERTY OF SPLITTING ALONG CLOSELY SPACED PARALLEL PLANES. FLOAT - ROCK FRAGMENTS ON SURFACE NEAR THEIR ORIGINAL POSITION AND DISLOADED FROM PARENT MATERIAL. FLOOD PLAIN (FP) - LAND BORDERING A STREAM, BUILT OF SEDIMENTS DEPOSITED BY THE STREAM. FORMATION (FM) - A MAPPABLE GEOLOGIC UNIT THAT CAN BE RECOGNIZED AND TRACED IN THE FIELD. JOINT - FRACTURE IN ROCK ALONG WHICH NO APPRECIABLE MOVEMENT HAS OCCURRED. LEDGE - A SHELF-LIKE RIDGE OR PROJECTION OF ROCK WHOSE THICKNESS IS SMALL COMPARED TO ITS LATERAL EXTENT. LENS - A BODY OF SOIL OR ROCK THAT THINS OUT IN ONE OR MORE DIRECTIONS. MOTTLED (MOT.) - IRREGULARLY MARKED WITH SPOTS OF DIFFERENT COLORS. MOTTLING IN SOILS USUALLY INDICATES POOR AERATION AND LACK OF GOOD DRAINAGE. PERCHED WATER - WATER MAINTAINED ABOVE THE NORMAL GROUND WATER LEVEL BY THE PRESENCE OF AN INTERVENING IMPERVIOUS STRATUM. RESIDUAL (RES.) SOIL - SOIL FORMED IN PLACE BY THE WEATHERING OF ROCK. ROCK QUALITY DESIGNATION (ROD) - A MEASURE OF ROCK QUALITY DESCRIBED BY TOTAL LENGTH OF ROCK SEGMENTS EQUAL TO OR GREATER THAN 4 INCHES DIVIDED BY THE TOTAL LENGTH OF CORE RUN AND EXPRESSED AS A PERCENTAGE. SAPROLITE (SAP.) - RESIDUAL SOIL THAT RETAINS THE RELIC STRUCTURE OR FABRIC OF THE PARENT ROCK. SILL - AN INTRUSIVE BODY OF IGNEOUS ROCK OF APPROXIMATELY UNIFORM THICKNESS AND RELATIVELY THIN COMPARED WITH ITS LATERAL EXTENT, THAT HAS BEEN EMPLACED PARALLEL TO THE BEDDING OR SCHISTOSITY OF THE INTRUDED ROCKS. SLICKENSIDE - POLISHED AND STRIATED SURFACE THAT RESULTS FROM FRICTION ALONG A FAULT OR SLIP PLANE. STANDARD PENETRATION TEST (PENETRATION RESISTANCE) (SPT) - NUMBER OF BLOWS (IN OR BPF) OF A 140 LB. HAMMER FALLING 30 INCHES REQUIRED TO PRODUCE A PENETRATION OF 1 FOOT INTO SOIL WITH A 2 INCH OUTSIDE DIAMETER SPLIT SPOON SAMPLER. SPT REFUSAL IS PENETRATION EQUAL TO OR LESS THAN 0.1 FOOT PER 60 BLOWS. STRATA CORE RECOVERY (SREC.) - TOTAL LENGTH OF STRATA MATERIAL RECOVERED DIVIDED BY TOTAL LENGTH OF STRATUM AND EXPRESSED AS A PERCENTAGE. STRATA ROCK QUALITY DESIGNATION (SROD) - A MEASURE OF ROCK QUALITY DESCRIBED BY TOTAL LENGTH OF ROCK SEGMENTS WITHIN A STRATUM EQUAL TO OR GREATER THAN 4 INCHES DIVIDED BY THE TOTAL LENGTH OF STRATA AND EXPRESSED AS A PERCENTAGE. TOPSOIL (TS.) - SURFACE SOILS USUALLY CONTAINING ORGANIC MATTER.</p>																																																																																																																																																																																												
<p style="text-align: center;">SOIL LEGEND AND AASHTO CLASSIFICATION</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th>GENERAL CLASS.</th> <th colspan="5">GRANULAR MATERIALS (≤ 35% PASSING #200)</th> <th colspan="5">SILT-CLAY MATERIALS (> 35% PASSING #200)</th> <th colspan="5">ORGANIC MATERIALS</th> </tr> <tr> <th>GROUP CLASS.</th> <th>A-1</th> <th>A-3</th> <th>A-2</th> <th>A-2-6</th> <th>A-2-7</th> <th>A-4</th> <th>A-5</th> <th>A-6</th> <th>A-7</th> <th>A-1, A-2</th> <th>A-3</th> <th>A-4, A-5</th> <th>A-6, A-7</th> <th></th> <th></th> <th></th> </tr> <tr> <th>SYMBOL</th> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <th>% PASSING #10 #40 #200</th> <td>50 MX 30 MX 15 MX</td> <td>50 MX 25 MX 10 MX</td> <td>51 MN 35 MX 35 MX</td> <td>40 MX 41 MN 40 MX 41 MN</td> <td>41 MN 40 MX 41 MN 41 MN</td> <td>40 MX 41 MN 40 MX 41 MN</td> <td>36 MN 36 MN 36 MN</td> <td>36 MN 36 MN 36 MN</td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <th>MATERIAL PASSING #40 LL PI</th> <td colspan="2">-</td> <td>NP</td> <td>40 MX 41 MN</td> <td>40 MX 41 MN</td> <td>40 MX 41 MN</td> <td>40 MX 41 MN</td> <td>40 MX 41 MN</td> <td>40 MX 41 MN</td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <th>GROUP INDEX</th> <td>0</td> <td>0</td> <td>0</td> <td>4 MX</td> <td>8 MX</td> <td>12 MX</td> <td>16 MX</td> <td>NO MX</td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <th>USUAL TYPES OF MAJOR MATERIALS</th> <td colspan="2">STONE FRAGS. GRAVEL, AND SAND</td> <td>FINE SAND</td> <td colspan="2">SILTY OR CLAYEY GRAVEL AND SAND</td> <td>SILTY SOILS</td> <td>CLAYEY SOILS</td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <th>GEN. RATING AS SUBGRADE</th> <td colspan="5">EXCELLENT TO GOOD</td> <td colspan="5">FAIR TO POOR</td> <td>FAIR TO POOR</td> <td>POOR</td> <td>UNSATURABLE</td> <td></td> <td></td> <td></td> </tr> <tr> <td colspan="10">PI OF A-7-5 SUBGROUP IS ≤ LL - 30 ; PI OF A-7-6 SUBGROUP IS > LL - 30</td> <td colspan="10"></td> </tr> </table>										GENERAL CLASS.	GRANULAR MATERIALS (≤ 35% PASSING #200)					SILT-CLAY MATERIALS (> 35% PASSING #200)					ORGANIC MATERIALS					GROUP CLASS.	A-1	A-3	A-2	A-2-6	A-2-7	A-4	A-5	A-6	A-7	A-1, A-2	A-3	A-4, A-5	A-6, A-7				SYMBOL																	% PASSING #10 #40 #200	50 MX 30 MX 15 MX	50 MX 25 MX 10 MX	51 MN 35 MX 35 MX	40 MX 41 MN 40 MX 41 MN	41 MN 40 MX 41 MN 41 MN	40 MX 41 MN 40 MX 41 MN	36 MN 36 MN 36 MN	36 MN 36 MN 36 MN										MATERIAL PASSING #40 LL PI	-		NP	40 MX 41 MN	40 MX 41 MN	40 MX 41 MN	40 MX 41 MN	40 MX 41 MN	40 MX 41 MN									GROUP INDEX	0	0	0	4 MX	8 MX	12 MX	16 MX	NO MX										USUAL TYPES OF MAJOR MATERIALS	STONE FRAGS. GRAVEL, AND SAND		FINE SAND	SILTY OR CLAYEY GRAVEL AND SAND		SILTY SOILS	CLAYEY SOILS											GEN. RATING AS SUBGRADE	EXCELLENT TO GOOD					FAIR TO POOR					FAIR TO POOR	POOR	UNSATURABLE				PI OF A-7-5 SUBGROUP IS ≤ LL - 30 ; PI OF A-7-6 SUBGROUP IS > LL - 30																				<p style="text-align: center;">MINERALOGICAL COMPOSITION</p> <p>MINERAL NAMES SUCH AS QUARTZ, FELDSPAR, MICA, TALC, KAOLIN, ETC. ARE USED IN DESCRIPTIONS WHEN THEY ARE CONSIDERED OF SIGNIFICANCE.</p>										<p style="text-align: center;">WEATHERING</p> <p>FRESH: ROCK FRESH, CRYSTALS BRIGHT, FEW JOINTS MAY SHOW SLIGHT STAINING. ROCK RINGS UNDER HAMMER IF CRYSTALLINE.</p> <p>VERY SLIGHT (IV SLI.): ROCK GENERALLY FRESH, JOINTS STAINED, SOME JOINTS MAY SHOW THIN CLAY COATINGS IF OPEN. CRYSTALS ON A BROKEN SPECIMEN FACE SHINE BRIGHTLY. ROCK RINGS UNDER HAMMER BLOWS IF OF A CRYSTALLINE NATURE.</p> <p>SLIGHT (SLI.): ROCK GENERALLY FRESH, JOINTS STAINED AND DISCOLORATION EXTENDS INTO ROCK UP TO 1 INCH. OPEN JOINTS MAY CONTAIN CLAY. IN GRANITOID ROCKS SOME OCCASIONAL FELDSPAR CRYSTALS ARE DULL AND DISCOLORED. CRYSTALLINE ROCKS RING UNDER HAMMER BLOWS.</p> <p>MODERATE (MOD.): SIGNIFICANT PORTIONS OF ROCK SHOW DISCOLORATION AND WEATHERING EFFECTS. IN GRANITOID ROCKS, MOST FELDSPARS ARE DULL AND DISCOLORED, SOME SHOW CLAY. ROCK HAS DULL SOUND UNDER HAMMER BLOWS AND SHOWS SIGNIFICANT LOSS OF STRENGTH AS COMPARED WITH FRESH ROCK.</p> <p>MODERATELY SEVERE (MOD. SEV.): ALL ROCK EXCEPT QUARTZ DISCOLORED OR STAINED. IN GRANITOID ROCKS, ALL FELDSPARS DULL AND DISCOLORED AND A MAJORITY SHOW KAOLINIZATION. ROCK SHOWS SEVERE LOSS OF STRENGTH AND CAN BE EXCAVATED WITH A GEOLOGIST'S PICK. ROCK GIVES "CLUNK" SOUND WHEN STRUCK. <i>IF TESTED, WOULD YIELD SPT REFUSAL</i></p> <p>SEVERE (SEV.): ALL ROCK EXCEPT QUARTZ DISCOLORED OR STAINED. ROCK FABRIC CLEAR AND EVIDENT BUT REDUCED IN STRENGTH TO STRONG SOIL. IN GRANITOID ROCKS ALL FELDSPARS ARE KAOLINIZED TO SOME EXTENT. SOME FRAGMENTS OF STRONG ROCK USUALLY REMAIN. <i>IF TESTED, WOULD YIELD SPT N VALUES > 100 BPF</i></p> <p>VERY SEVERE (IV SEV.): ALL ROCK EXCEPT QUARTZ DISCOLORED OR STAINED. ROCK FABRIC ELEMENTS ARE DISCERNIBLE BUT MASS IS EFFECTIVELY REDUCED TO SOIL STATUS, WITH ONLY FRAGMENTS OF STRONG ROCK REMAINING. SAPROLITE IS AN EXAMPLE OF ROCK WEATHERED TO A DEGREE THAT ONLY MINOR VESTIGES OF ORIGINAL ROCK FABRIC REMAIN. <i>IF TESTED, WOULD YIELD SPT N VALUES < 100 BPF</i></p> <p>COMPLETE: ROCK REDUCED TO SOIL. ROCK FABRIC NOT DISCERNIBLE, OR DISCERNIBLE ONLY IN SMALL AND SCATTERED CONCENTRATIONS. QUARTZ MAY BE PRESENT AS DIKES OR STRINGERS. SAPROLITE IS ALSO AN EXAMPLE.</p>										<p style="text-align: center;">PERCENTAGE OF MATERIAL</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th></th> <th>GRANULAR SOILS</th> <th>SILT - CLAY SOILS</th> <th>OTHER MATERIAL</th> </tr> <tr> <td>TRACE OF ORGANIC MATTER</td> <td>2 - 3%</td> <td>3 - 5%</td> <td>TRACE 1 - 10%</td> </tr> <tr> <td>LITTLE ORGANIC MATTER</td> <td>3 - 5%</td> <td>5 - 12%</td> <td>LITTLE 10 - 20%</td> </tr> <tr> <td>MODERATELY ORGANIC</td> <td>5 - 10%</td> <td>12 - 20%</td> <td>SOME 20 - 35%</td> </tr> <tr> <td>HIGHLY ORGANIC</td> <td>> 10%</td> <td>> 20%</td> <td>HIGHLY 35% AND ABOVE</td> </tr> </table>											GRANULAR SOILS	SILT - CLAY SOILS	OTHER MATERIAL	TRACE OF ORGANIC MATTER	2 - 3%	3 - 5%	TRACE 1 - 10%	LITTLE ORGANIC MATTER	3 - 5%	5 - 12%	LITTLE 10 - 20%	MODERATELY ORGANIC	5 - 10%	12 - 20%	SOME 20 - 35%	HIGHLY ORGANIC	> 10%	> 20%	HIGHLY 35% AND ABOVE
GENERAL CLASS.	GRANULAR MATERIALS (≤ 35% PASSING #200)					SILT-CLAY MATERIALS (> 35% PASSING #200)					ORGANIC MATERIALS																																																																																																																																																																																																															
GROUP CLASS.	A-1	A-3	A-2	A-2-6	A-2-7	A-4	A-5	A-6	A-7	A-1, A-2	A-3	A-4, A-5	A-6, A-7																																																																																																																																																																																																													
SYMBOL																																																																																																																																																																																																																										
% PASSING #10 #40 #200	50 MX 30 MX 15 MX	50 MX 25 MX 10 MX	51 MN 35 MX 35 MX	40 MX 41 MN 40 MX 41 MN	41 MN 40 MX 41 MN 41 MN	40 MX 41 MN 40 MX 41 MN	36 MN 36 MN 36 MN	36 MN 36 MN 36 MN																																																																																																																																																																																																																		
MATERIAL PASSING #40 LL PI	-		NP	40 MX 41 MN	40 MX 41 MN	40 MX 41 MN	40 MX 41 MN	40 MX 41 MN	40 MX 41 MN																																																																																																																																																																																																																	
GROUP INDEX	0	0	0	4 MX	8 MX	12 MX	16 MX	NO MX																																																																																																																																																																																																																		
USUAL TYPES OF MAJOR MATERIALS	STONE FRAGS. GRAVEL, AND SAND		FINE SAND	SILTY OR CLAYEY GRAVEL AND SAND		SILTY SOILS	CLAYEY SOILS																																																																																																																																																																																																																			
GEN. RATING AS SUBGRADE	EXCELLENT TO GOOD					FAIR TO POOR					FAIR TO POOR	POOR	UNSATURABLE																																																																																																																																																																																																													
PI OF A-7-5 SUBGROUP IS ≤ LL - 30 ; PI OF A-7-6 SUBGROUP IS > LL - 30																																																																																																																																																																																																																										
	GRANULAR SOILS	SILT - CLAY SOILS	OTHER MATERIAL																																																																																																																																																																																																																							
TRACE OF ORGANIC MATTER	2 - 3%	3 - 5%	TRACE 1 - 10%																																																																																																																																																																																																																							
LITTLE ORGANIC MATTER	3 - 5%	5 - 12%	LITTLE 10 - 20%																																																																																																																																																																																																																							
MODERATELY ORGANIC	5 - 10%	12 - 20%	SOME 20 - 35%																																																																																																																																																																																																																							
HIGHLY ORGANIC	> 10%	> 20%	HIGHLY 35% AND ABOVE																																																																																																																																																																																																																							
<p style="text-align: center;">GROUND WATER</p> <p> WATER LEVEL IN BORE HOLE IMMEDIATELY AFTER DRILLING</p> <p> STATIC WATER LEVEL AFTER 24 HOURS</p> <p> PERCHED WATER, SATURATED ZONE, OR WATER BEARING STRATA</p> <p> SPRING OR SEEP</p>										<p style="text-align: center;">MISCELLANEOUS SYMBOLS</p> <p> ROADWAY EMBANKMENT (RE) WITH SOIL DESCRIPTION</p> <p> SOIL SYMBOL</p> <p> ARTIFICIAL FILL (AF) OTHER THAN ROADWAY EMBANKMENT</p> <p> INFERRED SOIL BOUNDARY</p> <p> INFERRED ROCK LINE</p> <p> ALLUVIAL SOIL BOUNDARY</p> <p> DIP & DIP DIRECTION OF ROCK STRUCTURES</p> <p> SPT TEST BORING</p> <p> AUGER BORING</p> <p> CORE BORING</p> <p> MONITORING WELL</p> <p> PIEZOMETER INSTALLATION</p> <p> SLOPE INDICATOR INSTALLATION</p> <p> CONE PENETROMETER TEST</p> <p> SOUNDING ROD</p> <p> TEST BORING WITH CORE</p> <p> SPT N-VALUE</p>																																																																																																																																																																																																																
<p style="text-align: center;">CONSISTENCY OR DENSENESS</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th>PRIMARY SOIL TYPE</th> <th>COMPACTNESS OR CONSISTENCY</th> <th>RANGE OF STANDARD PENETRATION RESISTANCE (N-VALUE)</th> <th>RANGE OF UNCONFINED COMPRESSIVE STRENGTH (TONS/FT²)</th> </tr> <tr> <td>GENERALLY GRANULAR MATERIAL (NON-COHESIVE)</td> <td>VERY LOOSE LOOSE MEDIUM DENSE DENSE VERY DENSE</td> <td>< 4 4 TO 10 10 TO 30 30 TO 50 > 50</td> <td>N/A</td> </tr> <tr> <td>GENERALLY SILT-CLAY MATERIAL (COHESIVE)</td> <td>VERY SOFT SOFT MEDIUM STIFF STIFF VERY STIFF HARD</td> <td>< 2 2 TO 4 4 TO 8 8 TO 15 15 TO 30 > 30</td> <td>< 0.25 0.25 TO 0.5 0.5 TO 1.0 1 TO 2 2 TO 4 > 4</td> </tr> </table>										PRIMARY SOIL TYPE	COMPACTNESS OR CONSISTENCY	RANGE OF STANDARD PENETRATION RESISTANCE (N-VALUE)	RANGE OF UNCONFINED COMPRESSIVE STRENGTH (TONS/FT ²)	GENERALLY GRANULAR MATERIAL (NON-COHESIVE)	VERY LOOSE LOOSE MEDIUM DENSE DENSE VERY DENSE	< 4 4 TO 10 10 TO 30 30 TO 50 > 50	N/A	GENERALLY SILT-CLAY MATERIAL (COHESIVE)	VERY SOFT SOFT MEDIUM STIFF STIFF VERY STIFF HARD	< 2 2 TO 4 4 TO 8 8 TO 15 15 TO 30 > 30	< 0.25 0.25 TO 0.5 0.5 TO 1.0 1 TO 2 2 TO 4 > 4	<p style="text-align: center;">RECOMMENDATION SYMBOLS</p> <p> UNDERCUT</p> <p> SHALLOW UNDERCUT</p> <p> UNCLASSIFIED EXCAVATION - UNSUITABLE WASTE</p> <p> UNCLASSIFIED EXCAVATION - ACCEPTABLE DEGRADABLE ROCK</p> <p> UNCLASSIFIED EXCAVATION - ACCEPTABLE, BUT NOT TO BE USED IN THE TOP 3 FEET OF EMBANKMENT OR BACKFILL</p>																																																																																																																																																																																																				
PRIMARY SOIL TYPE	COMPACTNESS OR CONSISTENCY	RANGE OF STANDARD PENETRATION RESISTANCE (N-VALUE)	RANGE OF UNCONFINED COMPRESSIVE STRENGTH (TONS/FT ²)																																																																																																																																																																																																																							
GENERALLY GRANULAR MATERIAL (NON-COHESIVE)	VERY LOOSE LOOSE MEDIUM DENSE DENSE VERY DENSE	< 4 4 TO 10 10 TO 30 30 TO 50 > 50	N/A																																																																																																																																																																																																																							
GENERALLY SILT-CLAY MATERIAL (COHESIVE)	VERY SOFT SOFT MEDIUM STIFF STIFF VERY STIFF HARD	< 2 2 TO 4 4 TO 8 8 TO 15 15 TO 30 > 30	< 0.25 0.25 TO 0.5 0.5 TO 1.0 1 TO 2 2 TO 4 > 4																																																																																																																																																																																																																							
<p style="text-align: center;">TEXTURE OR GRAIN SIZE</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th>U.S. STD. SIEVE SIZE OPENING (MM)</th> <td>4</td> <td>10</td> <td>40</td> <td>60</td> <td>200</td> <td>270</td> </tr> <tr> <td></td> <td>4.75</td> <td>2.00</td> <td>0.42</td> <td>0.25</td> <td>0.075</td> <td>0.053</td> </tr> <tr> <th>BOULDER (BLDR.)</th> <th>COBBLE (COB.)</th> <th>GRAVEL (GR.)</th> <th>COARSE SAND (CSE. SD.)</th> <th>FINE SAND (F SD.)</th> <th>SILT (SL.)</th> <th>CLAY (CL.)</th> </tr> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <th>GRAIN SIZE</th> <td>MM 305</td> <td>75</td> <td>2.0</td> <td>0.25</td> <td>0.05</td> <td>0.005</td> </tr> <tr> <td></td> <td>IN. 12</td> <td>3</td> <td></td> <td></td> <td></td> <td></td> </tr> </table>										U.S. STD. SIEVE SIZE OPENING (MM)	4	10	40	60	200	270		4.75	2.00	0.42	0.25	0.075	0.053	BOULDER (BLDR.)	COBBLE (COB.)	GRAVEL (GR.)	COARSE SAND (CSE. SD.)	FINE SAND (F SD.)	SILT (SL.)	CLAY (CL.)								GRAIN SIZE	MM 305	75	2.0	0.25	0.05	0.005		IN. 12	3					<p style="text-align: center;">ABBREVIATIONS</p> <p>AR - AUGER REFUSAL BT - BORING TERMINATED CL - CLAY CPT - CONE PENETRATION TEST CSE - COARSE DMT - DILATOMETER TEST DPT - DYNAMIC PENETRATION TEST e - VOID RATIO F - FINE FOSS. - FOSSILIFEROUS FRAC. - FRACTURED, FRACTURES FRAGS. - FRAGMENTS HI. - HIGHLY</p> <p>MED. - MEDIUM MICA - MICACEOUS MOD. - MODERATELY NP - NON PLASTIC ORG. - ORGANIC PMT - PRESSUREMETER TEST SAP. - SAPROLITIC SD. - SAND, SANDY SL. - SILT, SILTY SLI. - SLIGHTLY TCR - TRICONE REFUSAL w - MOISTURE CONTENT V - VERY</p> <p>VST - VANE SHEAR TEST WEA. - WEATHERED γ - UNIT WEIGHT γ_d - DRY UNIT WEIGHT</p> <p>SAMPLE ABBREVIATIONS</p> <p>S - BULK SS - SPLIT SPOON ST - SHELBY TUBE RS - ROCK RT - RECOMPACTED TRIAXIAL CBR - CALIFORNIA BEARING RATIO</p>																																																																																																																																																																						
U.S. STD. SIEVE SIZE OPENING (MM)	4	10	40	60	200	270																																																																																																																																																																																																																				
	4.75	2.00	0.42	0.25	0.075	0.053																																																																																																																																																																																																																				
BOULDER (BLDR.)	COBBLE (COB.)	GRAVEL (GR.)	COARSE SAND (CSE. SD.)	FINE SAND (F SD.)	SILT (SL.)	CLAY (CL.)																																																																																																																																																																																																																				
GRAIN SIZE	MM 305	75	2.0	0.25	0.05	0.005																																																																																																																																																																																																																				
	IN. 12	3																																																																																																																																																																																																																								
<p style="text-align: center;">SOIL MOISTURE - CORRELATION OF TERMS</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th>SOIL MOISTURE SCALE (ATTERBERG LIMITS)</th> <th>FIELD MOISTURE DESCRIPTION</th> <th>GUIDE FOR FIELD MOISTURE DESCRIPTION</th> </tr> <tr> <td>LL - LIQUID LIMIT</td> <td>- SATURATED - (SAT.)</td> <td>USUALLY LIQUID; VERY WET, USUALLY FROM BELOW THE GROUND WATER TABLE</td> </tr> <tr> <td>PLASTIC RANGE (PI)</td> <td>- WET - (W)</td> <td>SEMISOLID; REQUIRES DRYING TO ATTAIN OPTIMUM MOISTURE</td> </tr> <tr> <td>PL - PLASTIC LIMIT</td> <td>- MOIST - (M)</td> <td>SOLID; AT OR NEAR OPTIMUM MOISTURE</td> </tr> <tr> <td>OM - OPTIMUM MOISTURE</td> <td>- DRY - (D)</td> <td>REQUIRES ADDITIONAL WATER TO ATTAIN OPTIMUM MOISTURE</td> </tr> <tr> <td>SL - SHRINKAGE LIMIT</td> <td></td> <td></td> </tr> </table>										SOIL MOISTURE SCALE (ATTERBERG LIMITS)	FIELD MOISTURE DESCRIPTION	GUIDE FOR FIELD MOISTURE DESCRIPTION	LL - LIQUID LIMIT	- SATURATED - (SAT.)	USUALLY LIQUID; VERY WET, USUALLY FROM BELOW THE GROUND WATER TABLE	PLASTIC RANGE (PI)	- WET - (W)	SEMISOLID; REQUIRES DRYING TO ATTAIN OPTIMUM MOISTURE	PL - PLASTIC LIMIT	- MOIST - (M)	SOLID; AT OR NEAR OPTIMUM MOISTURE	OM - OPTIMUM MOISTURE	- DRY - (D)	REQUIRES ADDITIONAL WATER TO ATTAIN OPTIMUM MOISTURE	SL - SHRINKAGE LIMIT			<p style="text-align: center;">EQUIPMENT USED ON SUBJECT PROJECT</p> <p>DRILL UNITS:</p> <p><input type="checkbox"/> CME-45C</p> <p><input type="checkbox"/> CME-550</p> <p><input checked="" type="checkbox"/> CME-550X</p> <p><input type="checkbox"/> VANE SHEAR TEST</p> <p><input type="checkbox"/> PORTABLE HOIST</p> <p><input checked="" type="checkbox"/> DIEDRICH D50</p> <p>ADVANCING TOOLS:</p> <p><input type="checkbox"/> CLAY BITS</p> <p><input type="checkbox"/> 6" CONTINUOUS FLIGHT AUGER</p> <p><input checked="" type="checkbox"/> 8" HOLLOW AUGERS</p> <p><input type="checkbox"/> HARD FACED FINGER BITS</p> <p><input type="checkbox"/> TUNG-CARBIDE INSERTS</p> <p><input type="checkbox"/> CASING <input type="checkbox"/> W/ ADVANCER</p> <p><input type="checkbox"/> TRICONE _____ * STEEL TEETH</p> <p><input type="checkbox"/> TRICONE _____ * TUNG-CARB.</p> <p><input type="checkbox"/> CORE BIT</p> <p>HAMMER TYPE:</p> <p><input checked="" type="checkbox"/> AUTOMATIC <input type="checkbox"/> MANUAL</p> <p>CORE SIZE:</p> <p><input type="checkbox"/> -B _____ <input type="checkbox"/> -H _____</p> <p><input type="checkbox"/> -N _____</p> <p>HAND TOOLS:</p> <p><input type="checkbox"/> POST HOLE DIGGER</p> <p><input type="checkbox"/> HAND AUGER</p> <p><input type="checkbox"/> SOUNDING ROD</p> <p><input type="checkbox"/> VANE SHEAR TEST</p>																																																																																																																																																																																														
SOIL MOISTURE SCALE (ATTERBERG LIMITS)	FIELD MOISTURE DESCRIPTION	GUIDE FOR FIELD MOISTURE DESCRIPTION																																																																																																																																																																																																																								
LL - LIQUID LIMIT	- SATURATED - (SAT.)	USUALLY LIQUID; VERY WET, USUALLY FROM BELOW THE GROUND WATER TABLE																																																																																																																																																																																																																								
PLASTIC RANGE (PI)	- WET - (W)	SEMISOLID; REQUIRES DRYING TO ATTAIN OPTIMUM MOISTURE																																																																																																																																																																																																																								
PL - PLASTIC LIMIT	- MOIST - (M)	SOLID; AT OR NEAR OPTIMUM MOISTURE																																																																																																																																																																																																																								
OM - OPTIMUM MOISTURE	- DRY - (D)	REQUIRES ADDITIONAL WATER TO ATTAIN OPTIMUM MOISTURE																																																																																																																																																																																																																								
SL - SHRINKAGE LIMIT																																																																																																																																																																																																																										
<p style="text-align: center;">PLASTICITY</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th></th> <th>PLASTICITY INDEX (PI)</th> <th>DRY STRENGTH</th> </tr> <tr> <td>NON PLASTIC</td> <td>0-5</td> <td>VERY LOW</td> </tr> <tr> <td>SLIGHTLY PLASTIC</td> <td>6-15</td> <td>SLIGHT</td> </tr> <tr> <td>MODERATELY PLASTIC</td> <td>16-25</td> <td>MEDIUM</td> </tr> <tr> <td>HIGHLY PLASTIC</td> <td>26 OR MORE</td> <td>HIGH</td> </tr> </table>											PLASTICITY INDEX (PI)	DRY STRENGTH	NON PLASTIC	0-5	VERY LOW	SLIGHTLY PLASTIC	6-15	SLIGHT	MODERATELY PLASTIC	16-25	MEDIUM	HIGHLY PLASTIC	26 OR MORE	HIGH	<p style="text-align: center;">ROCK HARDNESS</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th>TERM</th> <th>SPACING</th> <th>TERM</th> <th>THICKNESS</th> </tr> <tr> <td>VERY WIDE</td> <td>MORE THAN 10 FEET</td> <td>VERY THICKLY BEDDED</td> <td>4 FEET</td> </tr> <tr> <td>WIDE</td> <td>3 TO 10 FEET</td> <td>THICKLY BEDDED</td> <td>1.5 - 4 FEET</td> </tr> <tr> <td>MODERATELY CLOSE</td> <td>1 TO 3 FEET</td> <td>THINLY BEDDED</td> <td>0.16 - 1.5 FEET</td> </tr> <tr> <td>CLOSE</td> <td>0.16 TO 1 FOOT</td> <td>VERY THINLY BEDDED</td> <td>0.03 - 0.16 FEET</td> </tr> <tr> <td>VERY CLOSE</td> <td>LESS THAN 0.16 FEET</td> <td>THICKLY LAMINATED</td> <td>0.008 - 0.03 FEET</td> </tr> <tr> <td></td> <td></td> <td>THINLY LAMINATED</td> <td>< 0.008 FEET</td> </tr> </table>										TERM	SPACING	TERM	THICKNESS	VERY WIDE	MORE THAN 10 FEET	VERY THICKLY BEDDED	4 FEET	WIDE	3 TO 10 FEET	THICKLY BEDDED	1.5 - 4 FEET	MODERATELY CLOSE	1 TO 3 FEET	THINLY BEDDED	0.16 - 1.5 FEET	CLOSE	0.16 TO 1 FOOT	VERY THINLY BEDDED	0.03 - 0.16 FEET	VERY CLOSE	LESS THAN 0.16 FEET	THICKLY LAMINATED	0.008 - 0.03 FEET			THINLY LAMINATED	< 0.008 FEET																																																																																																																																																												
	PLASTICITY INDEX (PI)	DRY STRENGTH																																																																																																																																																																																																																								
NON PLASTIC	0-5	VERY LOW																																																																																																																																																																																																																								
SLIGHTLY PLASTIC	6-15	SLIGHT																																																																																																																																																																																																																								
MODERATELY PLASTIC	16-25	MEDIUM																																																																																																																																																																																																																								
HIGHLY PLASTIC	26 OR MORE	HIGH																																																																																																																																																																																																																								
TERM	SPACING	TERM	THICKNESS																																																																																																																																																																																																																							
VERY WIDE	MORE THAN 10 FEET	VERY THICKLY BEDDED	4 FEET																																																																																																																																																																																																																							
WIDE	3 TO 10 FEET	THICKLY BEDDED	1.5 - 4 FEET																																																																																																																																																																																																																							
MODERATELY CLOSE	1 TO 3 FEET	THINLY BEDDED	0.16 - 1.5 FEET																																																																																																																																																																																																																							
CLOSE	0.16 TO 1 FOOT	VERY THINLY BEDDED	0.03 - 0.16 FEET																																																																																																																																																																																																																							
VERY CLOSE	LESS THAN 0.16 FEET	THICKLY LAMINATED	0.008 - 0.03 FEET																																																																																																																																																																																																																							
		THINLY LAMINATED	< 0.008 FEET																																																																																																																																																																																																																							
<p style="text-align: center;">COLOR</p> <p>DESCRIPTIONS MAY INCLUDE COLOR OR COLOR COMBINATIONS (TAN, RED, YELLOW-BROWN, BLUE-BROWN). MODIFIERS SUCH AS LIGHT, DARK, STREAKED, ETC. ARE USED TO DESCRIBE APPEARANCE.</p>										<p style="text-align: center;">INDURATION</p> <p>FOR SEDIMENTARY ROCKS, INDURATION IS THE HARDENING OF MATERIAL BY CEMENTING, HEAT, PRESSURE, ETC.</p> <p>FRIABLE: RUBBING WITH FINGER FREES NUMEROUS GRAINS; GENTLE BLOW BY HAMMER DISINTEGRATES SAMPLE.</p> <p>MODERATELY INDURATED: GRAINS CAN BE SEPARATED FROM SAMPLE WITH STEEL PROBE; BREAKS EASILY WHEN HIT WITH HAMMER.</p> <p>INDURATED: GRAINS ARE DIFFICULT TO SEPARATE WITH STEEL PROBE; DIFFICULT TO BREAK WITH HAMMER.</p> <p>EXTREMELY INDURATED: SHARP HAMMER BLOWS REQUIRED TO BREAK SAMPLE; SAMPLE BREAKS ACROSS GRAINS.</p>																																																																																																																																																																																																																
<p style="text-align: center;">FRACATURE SPACING</p>										<p style="text-align: center;">BEDDING</p>																																																																																																																																																																																																																
ELEVATION: _____ FEET																																																																																																																																																																																																																										
<p>NOTES: SURVEY AND ROADWAY DESIGN FILES PROVIDED BY TGS ENGINEERS ON 11/15/2021</p>																																																																																																																																																																																																																										

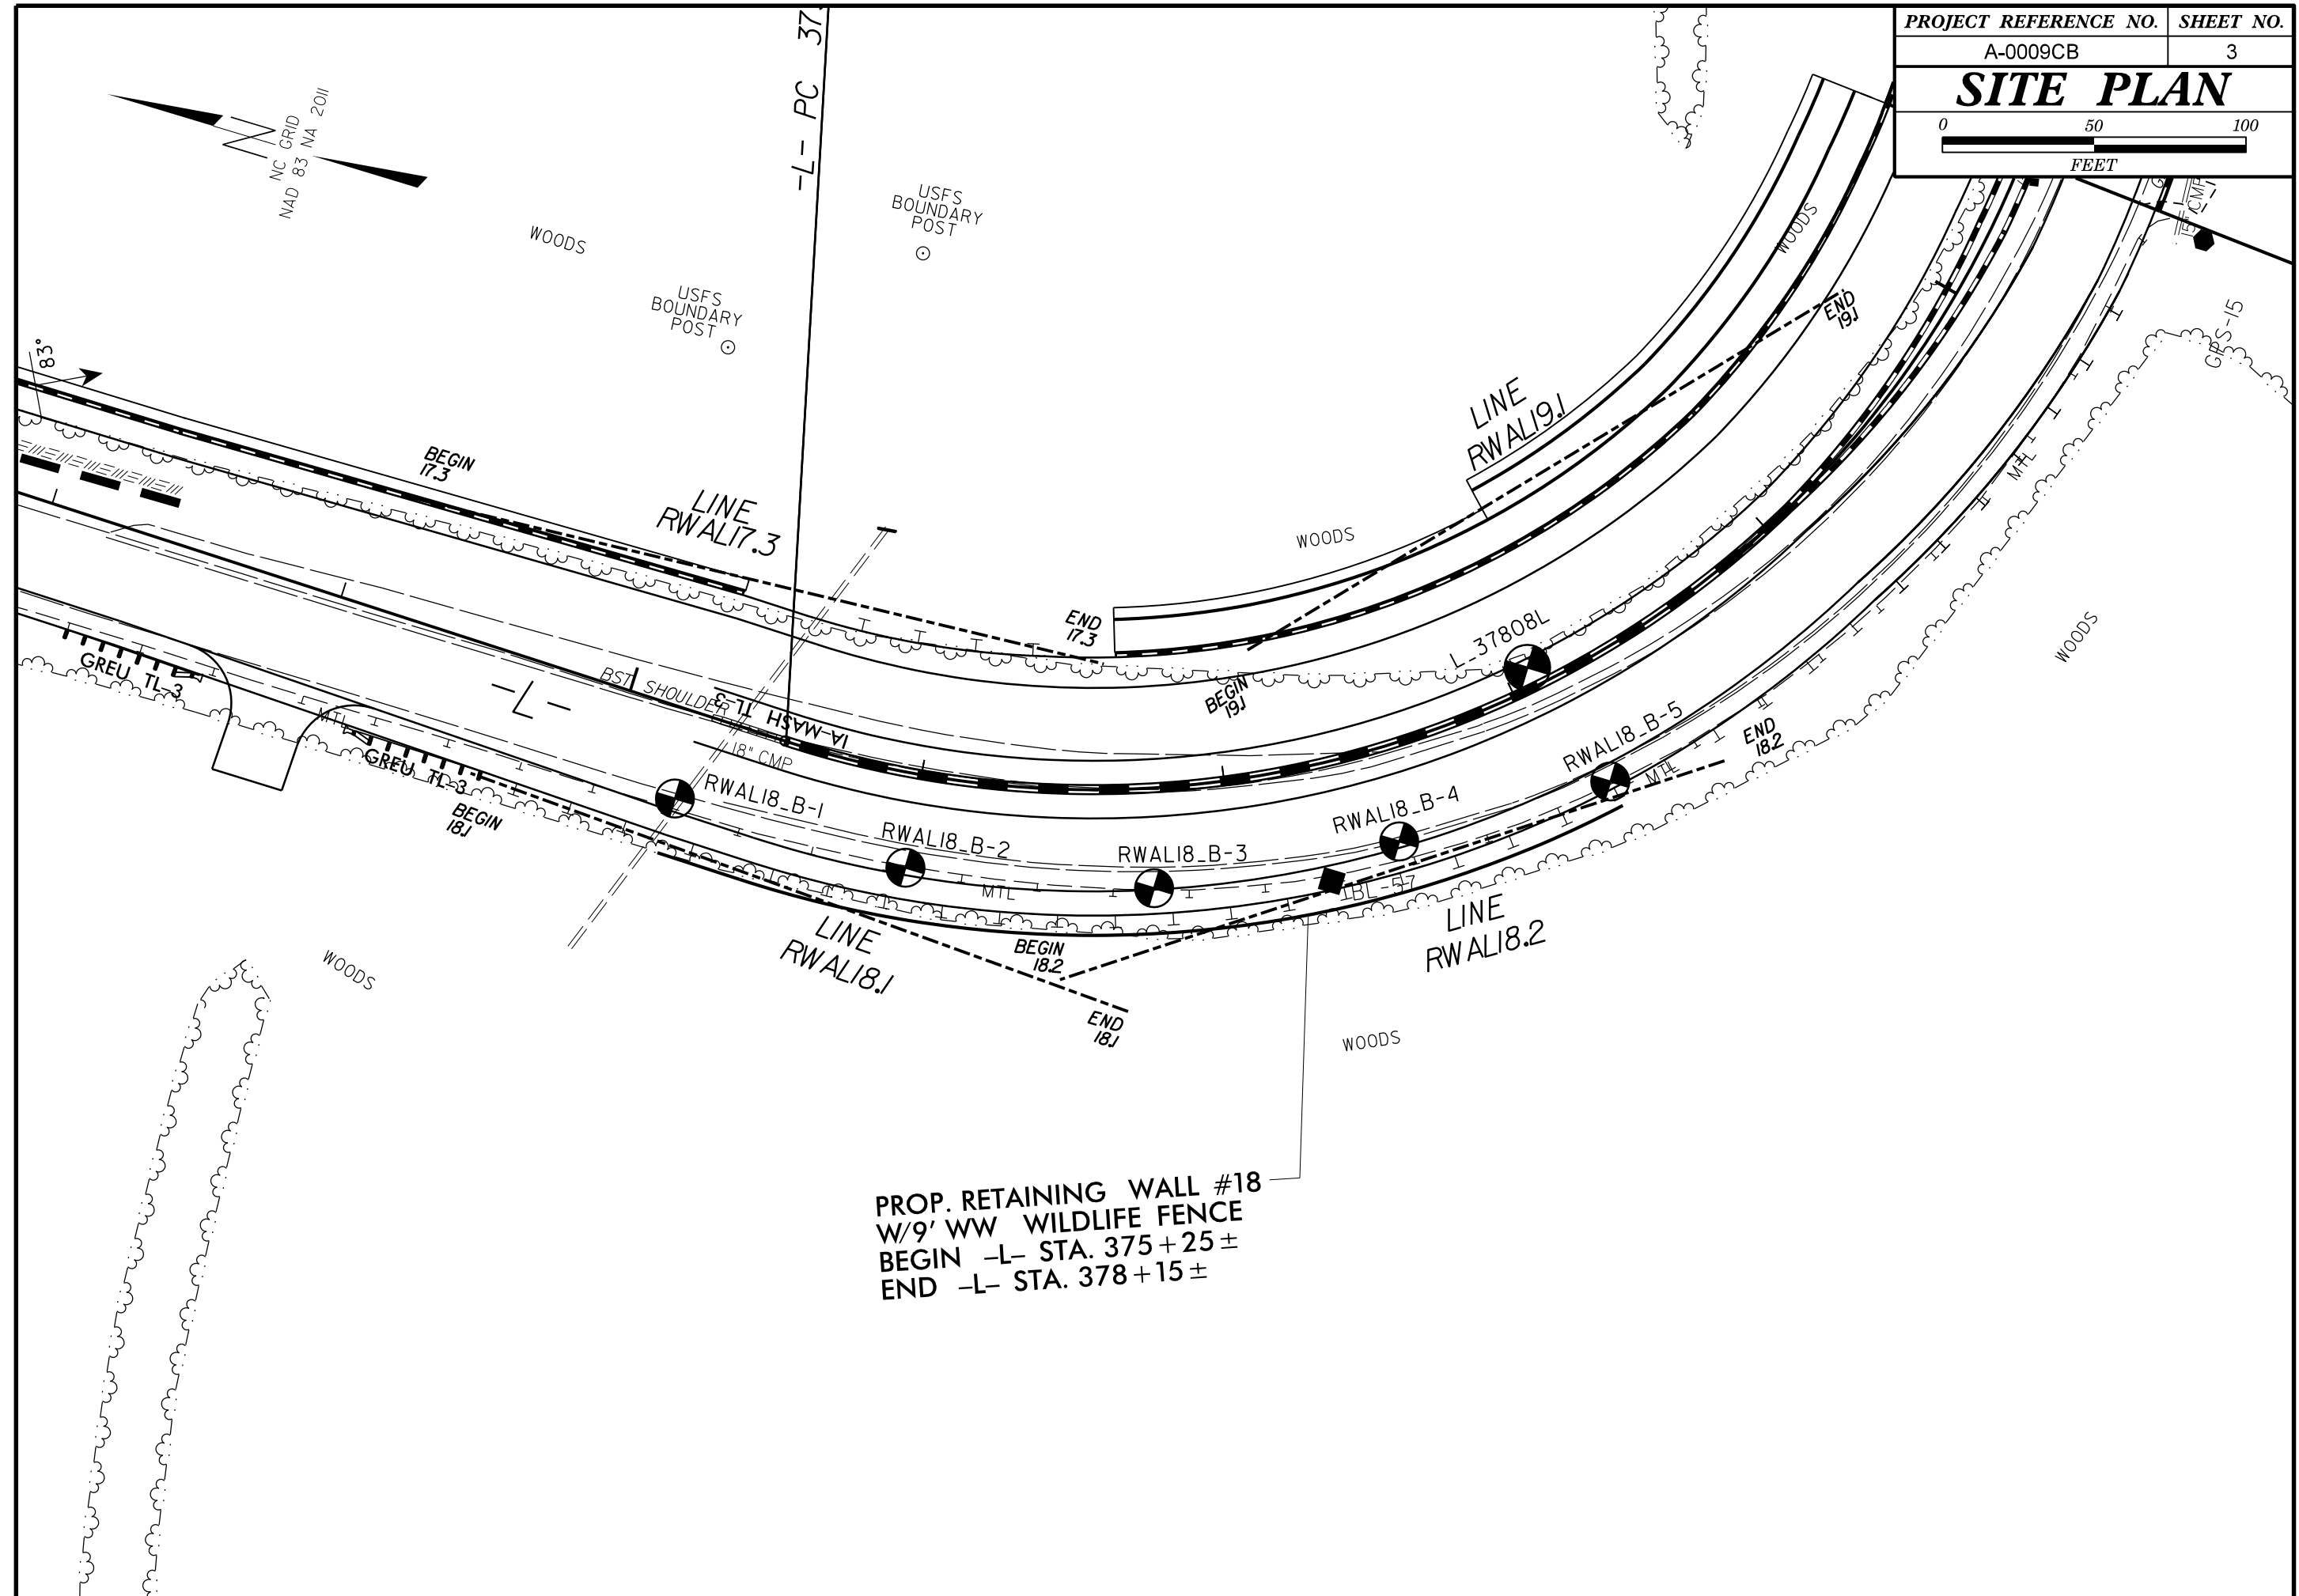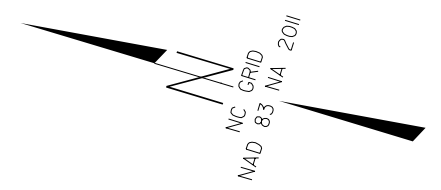


PROP. RETAINING WALL #18
W/9' WW WILDLIFE FENCE
 BEGIN -L- STA. 375+25±
 END -L- STA. 378+15±



Prepared in the Office of:



CAROLINAS
GEOTECHNICAL
GROUP




PROJECT REFERENCE NO. SHEET NO.

A-0009CB 4

RETAINING WALL #18
PROFILE BORINGS PROJECTED
ALONG WALL ENVELOPE

SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.I.	% BY WEIGHT				% PASSING (SIEVES)			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
SS-8009	29' RT	375+25 -L-	38.5' - 40.0'	A-4(0)	26	NP	16	23	46	15	91	82	62	22	-
SS-4108	31' RT	377+50 -L-	28.5' - 30.0'	A-4(0)	28	2	19	30	34	17	82	71	50	17	-

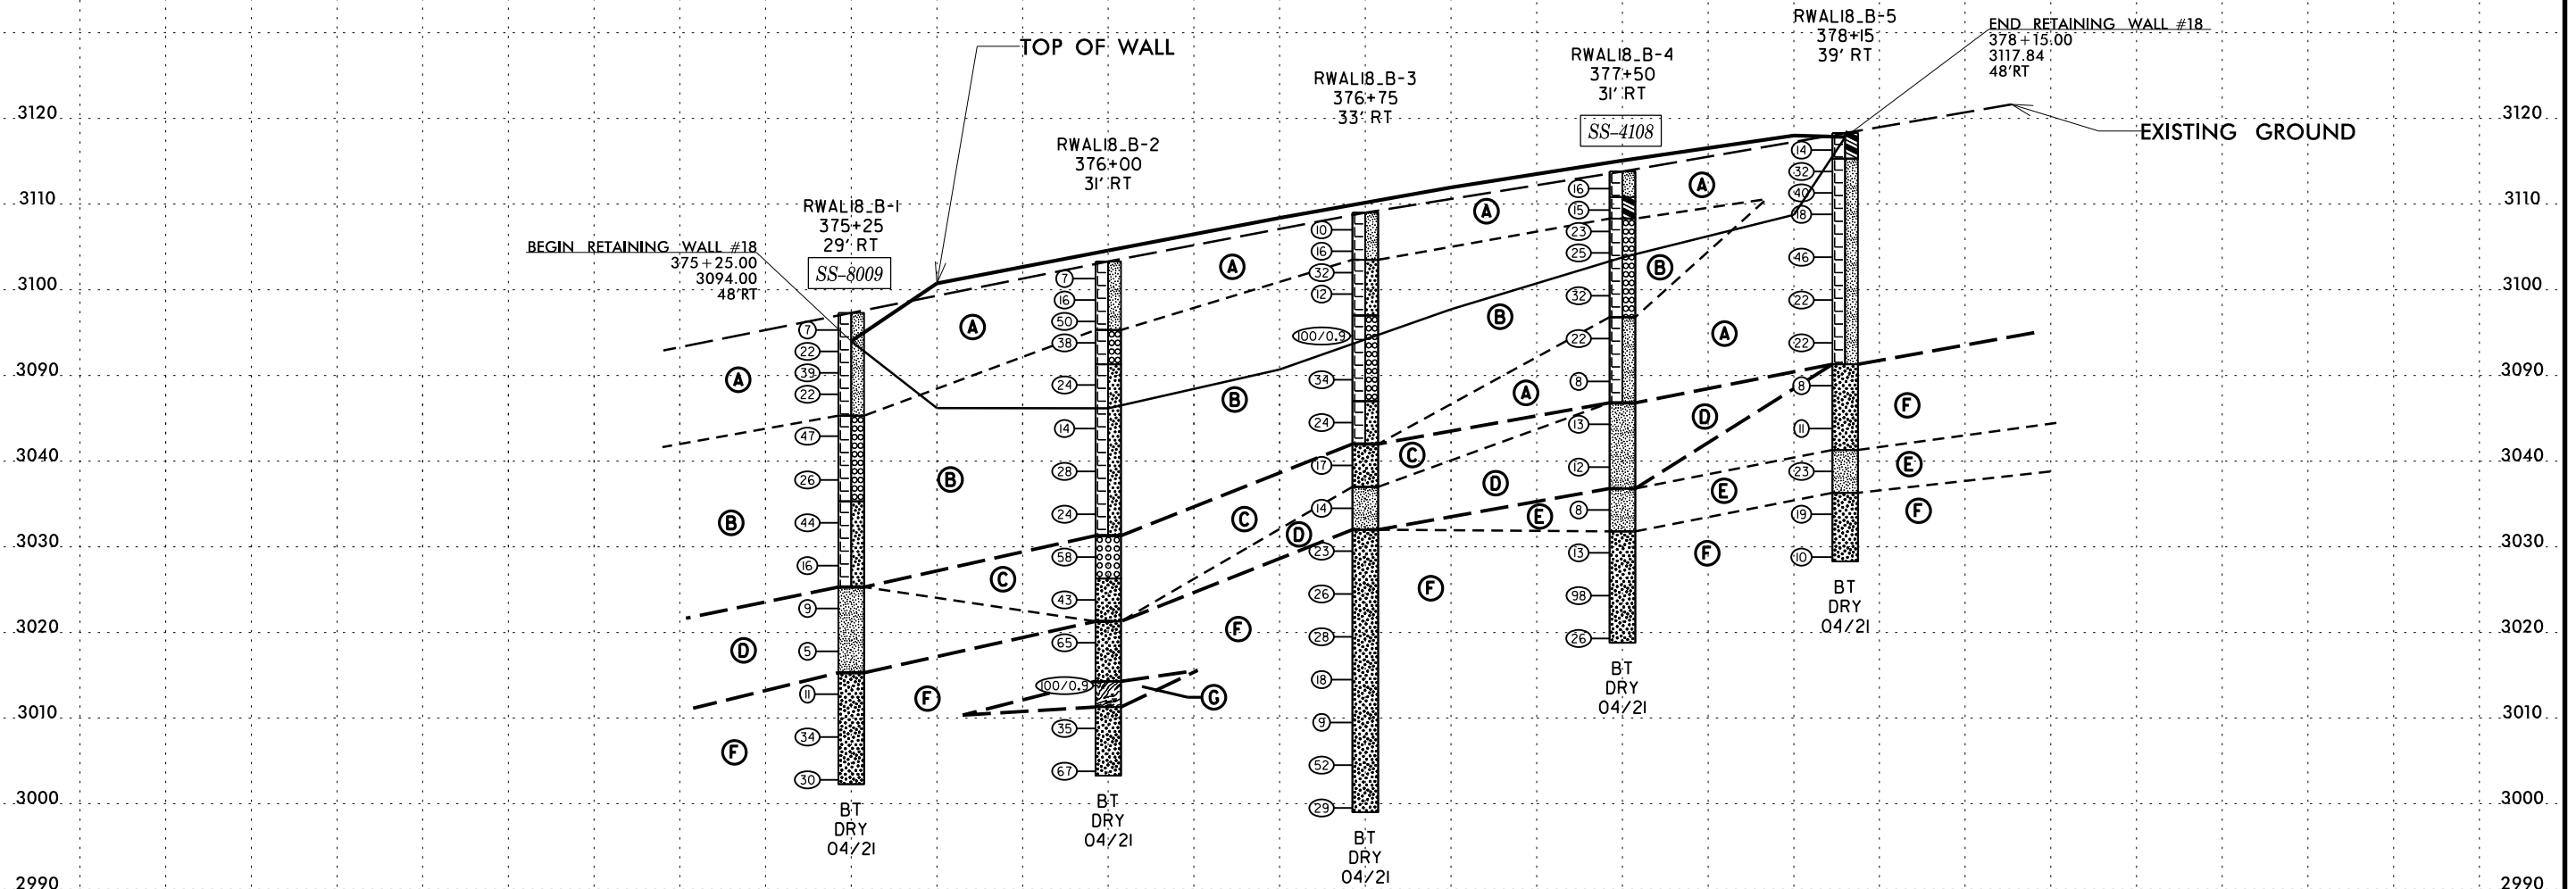

- (A) -ROADWAY EMBANKMENT- MEDIUM STIFF TO HARD, MOIST, BROWN-YELLOW-RED-TAN-ORANGE-GRAY, FINE TO COARSE SANDY SILT (A-4) AND FINE TO COARSE SANDY CLAY (A-6), WITH TRACE TO LITTLE GRAVEL AND TRACE MICA
- (B) -ROADWAY EMBANKMENT- MEDIUM DENSE TO VERY DENSE, MOIST, TAN-BROWN-GRAY, SILTY, GRAVELLY FINE TO COARSE SAND (A-I-B) AND SILTY FINE TO COARSE SAND (A-2-4), WITH TRACE GRAVEL AND ASPHALT FRAGMENTS
- (C) -COLLUVIAL- MEDIUM DENSE TO VERY DENSE, MOIST, BROWN-GRAY, SILTY, GRAVELLY FINE TO COARSE SAND (A-I-B) AND SILTY FINE TO COARSE SAND (A-2-4), WITH TRACE GRAVEL
- (D) -COLLUVIAL- MEDIUM STIFF AND STIFF, MOIST, BROWN-ORANGE-TAN-GRAY, FINE TO COARSE SANDY SILT (A-4), WITH TRACE MANGANESE OXIDE AND GRAVEL
- (E) -RESIDUAL- MEDIUM STIFF TO VERY STIFF, MOIST, TAN-BROWN-GRAY-ORANGE, FINE TO COARSE SANDY SILT (A-4), WITH TRACE GRAVEL-SIZED ROCK FRAGMENTS
- (F) -RESIDUAL- LOOSE TO VERY DENSE, MOIST, TAN-GRAY-BROWN-ORANGE, SILTY FINE TO COARSE SAND (A-2-4), WITH TO TRACE LITTLE GRAVEL-SIZED ROCK FRAGMENTS
- (G) -WEATHERED ROCK- (META-SANDSTONE)


NOTE:
SOIL, WEATHERED ROCK, AND CRYSTALLINE ROCK
LINES ARE BASED ON AN INTERPRETATION OF
BORE HOLE AND SEISMIC REFRACTION DATA AND
SHALL BE CONSIDERED AS APPROXIMATE.

WALL ENVELOPE TAKEN FROM ROADWAY DESIGN PLANS PROVIDED BY TGS ENGINEERS
ON 1/15/21. INFERRED STRATIGRAPHY IS DRAWN THROUGH THE BORING WITH BOTH
PROJECTED ONTO THE PROFILE.

373+00 373+50 374+00 374+50 375+00 375+50 376+00 376+50 377+00 377+50 378+00 378+50 379+00 379+50 380+00


SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.I.	% BY WEIGHT				% PASSING (SIEVES)			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
SS-8009	29' RT	375+25 -L-	38.5' - 40.0'	A-4(0)	26	NP	16	23	46	15	91	82	62	22	-

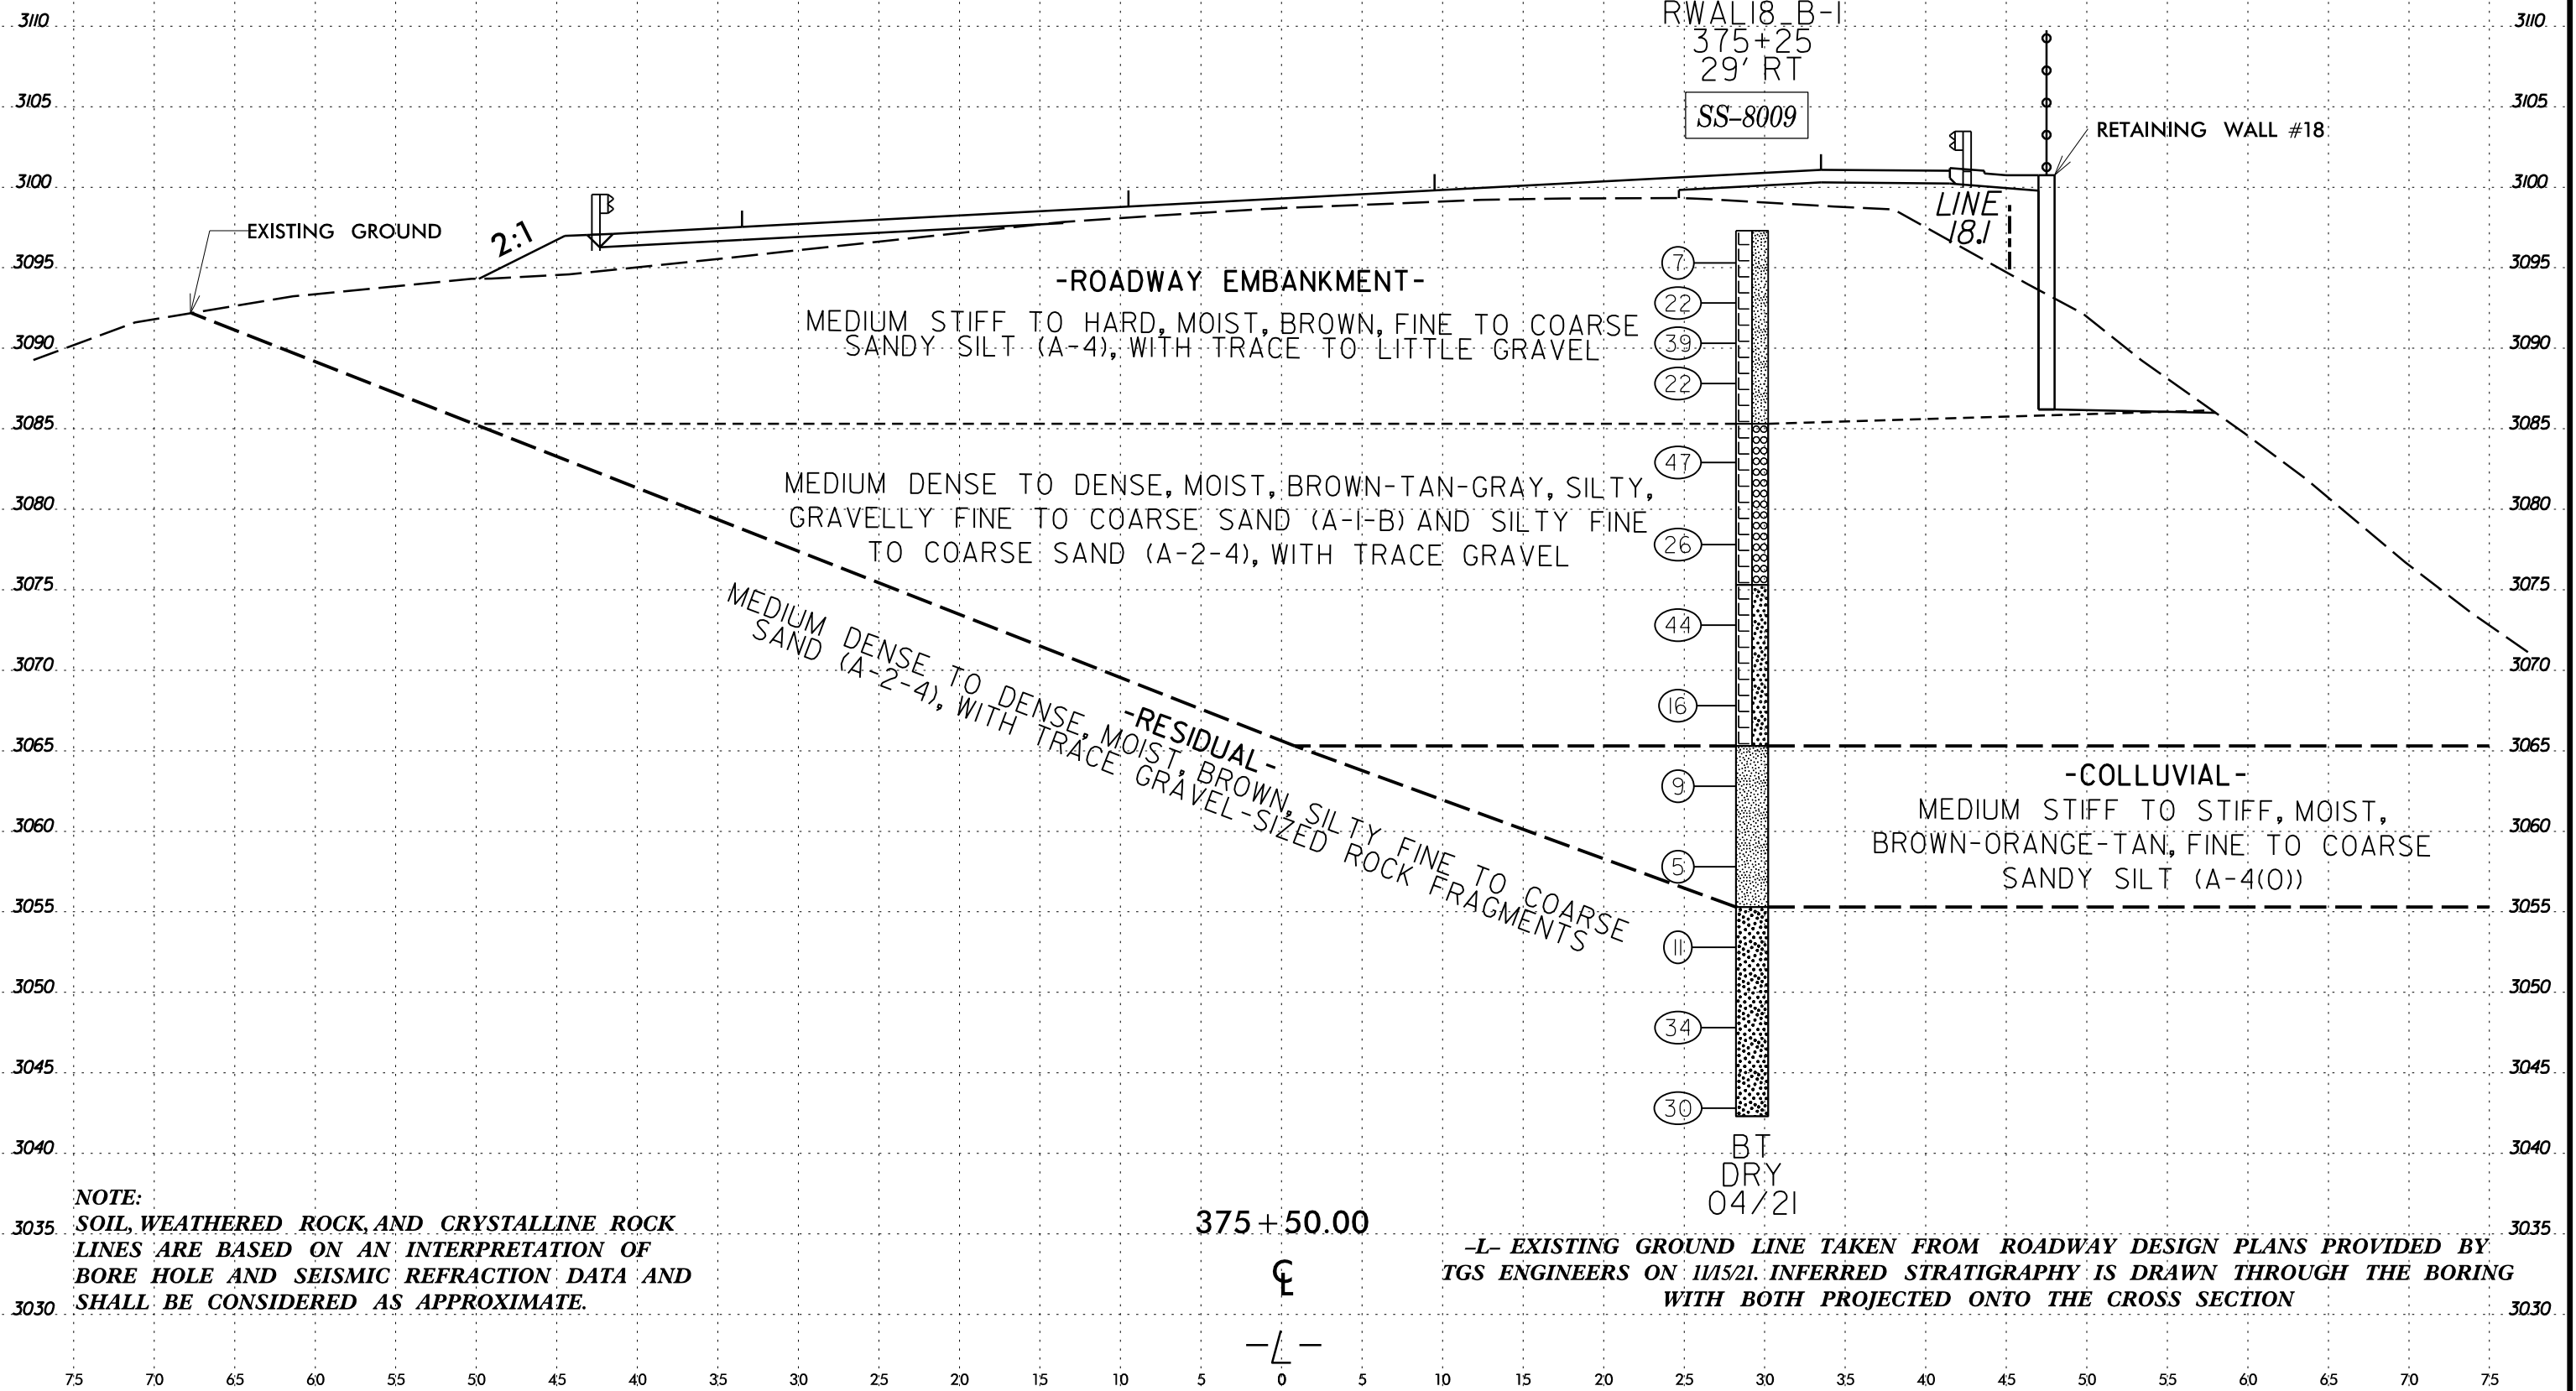

6/23/16
 I:\MAY-2022\1628
 C:\Users\jbriver\OneDrive - Carolines Geotechnical Group, PLLC\Projects\0068 - A-0009CB - Future US 74_TGS\A-0009CB\CADD_GEO\TECH\Site\Sub\A-0009CB_GEO_RWAL18.XSL.dgn
 \$\$\$SUBSERIAL\$\$\$

19-MAY-2022 16:28
 C:\Users\jbriver\OneDrive - Carolines Geotechnical Group, PLLC\Projects\0068 - A-0009CB - Future US 74_TGS\A-0009CB\CADD_GEO\TECH\Site\A-0009CB.GEO_RWAL18.XSL.dgn
 \$\$\$USERNAME\$\$\$

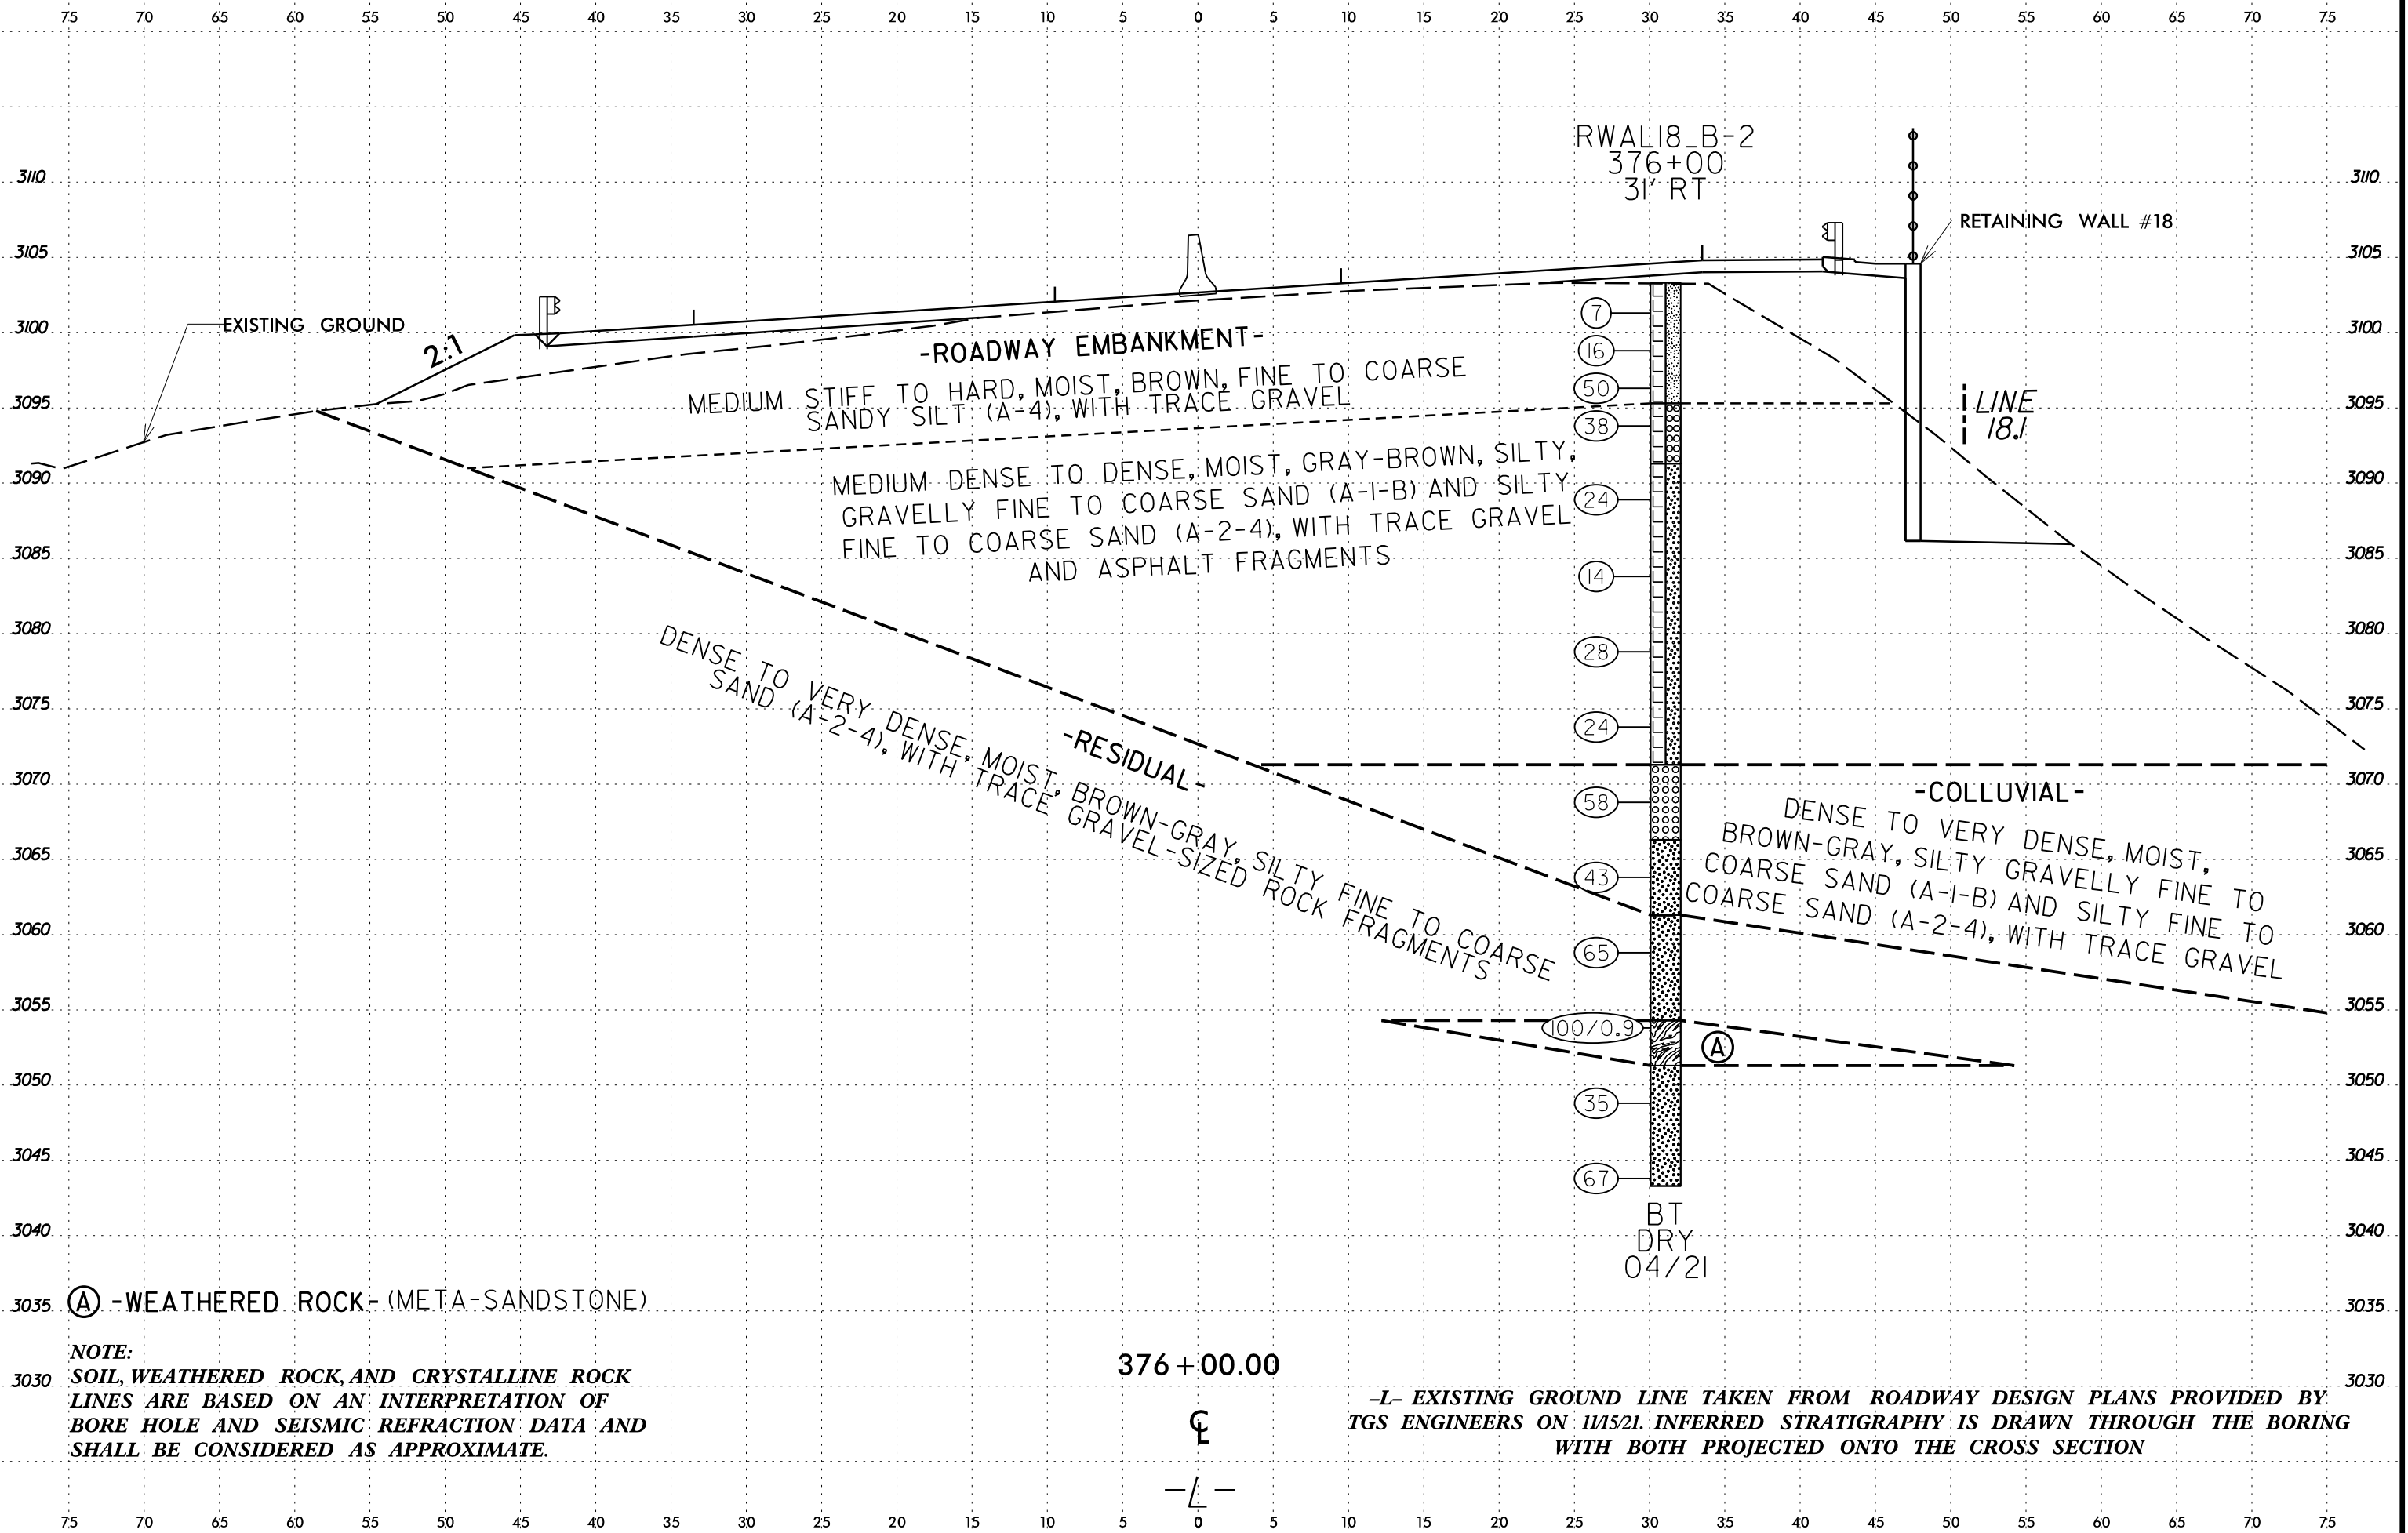

EXISTING GROUND

2:1

-ROADWAY EMBANKMENT-

MEDIUM STIFF TO HARD, MOIST, BROWN, FINE TO COARSE SANDY SILT (A-4), WITH TRACE GRAVEL

MEDIUM DENSE TO DENSE, MOIST, GRAY-BROWN, SILTY, GRAVELLY FINE TO COARSE SAND (A-1-B) AND SILTY FINE TO COARSE SAND (A-2-4), WITH TRACE GRAVEL AND ASPHALT FRAGMENTS

DENSE TO VERY DENSE, MOIST, BROWN-GRAY, SILTY FINE TO COARSE SAND (A-2-4), WITH TRACE GRAVEL-SIZED ROCK FRAGMENTS

-RESIDUAL-

-COLLUVIAL-

DENSE TO VERY DENSE, MOIST, BROWN-GRAY, SILTY GRAVELLY FINE TO COARSE SAND (A-1-B) AND SILTY FINE TO COARSE SAND (A-2-4), WITH TRACE GRAVEL

RWAL18_B-2
376+00
31' RT

RETAINING WALL #18

LINE 18.1

- (7)
- (16)
- (50)
- (38)
- (24)
- (14)
- (28)
- (24)
- (58)
- (43)
- (65)
- (100/0.9)
- (35)
- (67)


BT
DRY
04/21

(A) - WEATHERED ROCK - (META-SANDSTONE)

NOTE:
 SOIL, WEATHERED ROCK, AND CRYSTALLINE ROCK LINES ARE BASED ON AN INTERPRETATION OF BORE HOLE AND SEISMIC REFRACTION DATA AND SHALL BE CONSIDERED AS APPROXIMATE.

-L- EXISTING GROUND LINE TAKEN FROM ROADWAY DESIGN PLANS PROVIDED BY TGS ENGINEERS ON 1/15/21. INFERRED STRATIGRAPHY IS DRAWN THROUGH THE BORING WITH BOTH PROJECTED ONTO THE CROSS SECTION


19-MAY-2022 16:28
 C:\Users\jbriver\OneDrive - Carolines Geotechnical Group, PLLC\Projects\0068 - A-0009CB - Future US 74_TGS\A-0009CB\CADD\GEO\TECH\Site\Sub\A-0009CB.GEO_RWAL18.XSI.dgn
 \$\$\$USERNAME\$\$\$

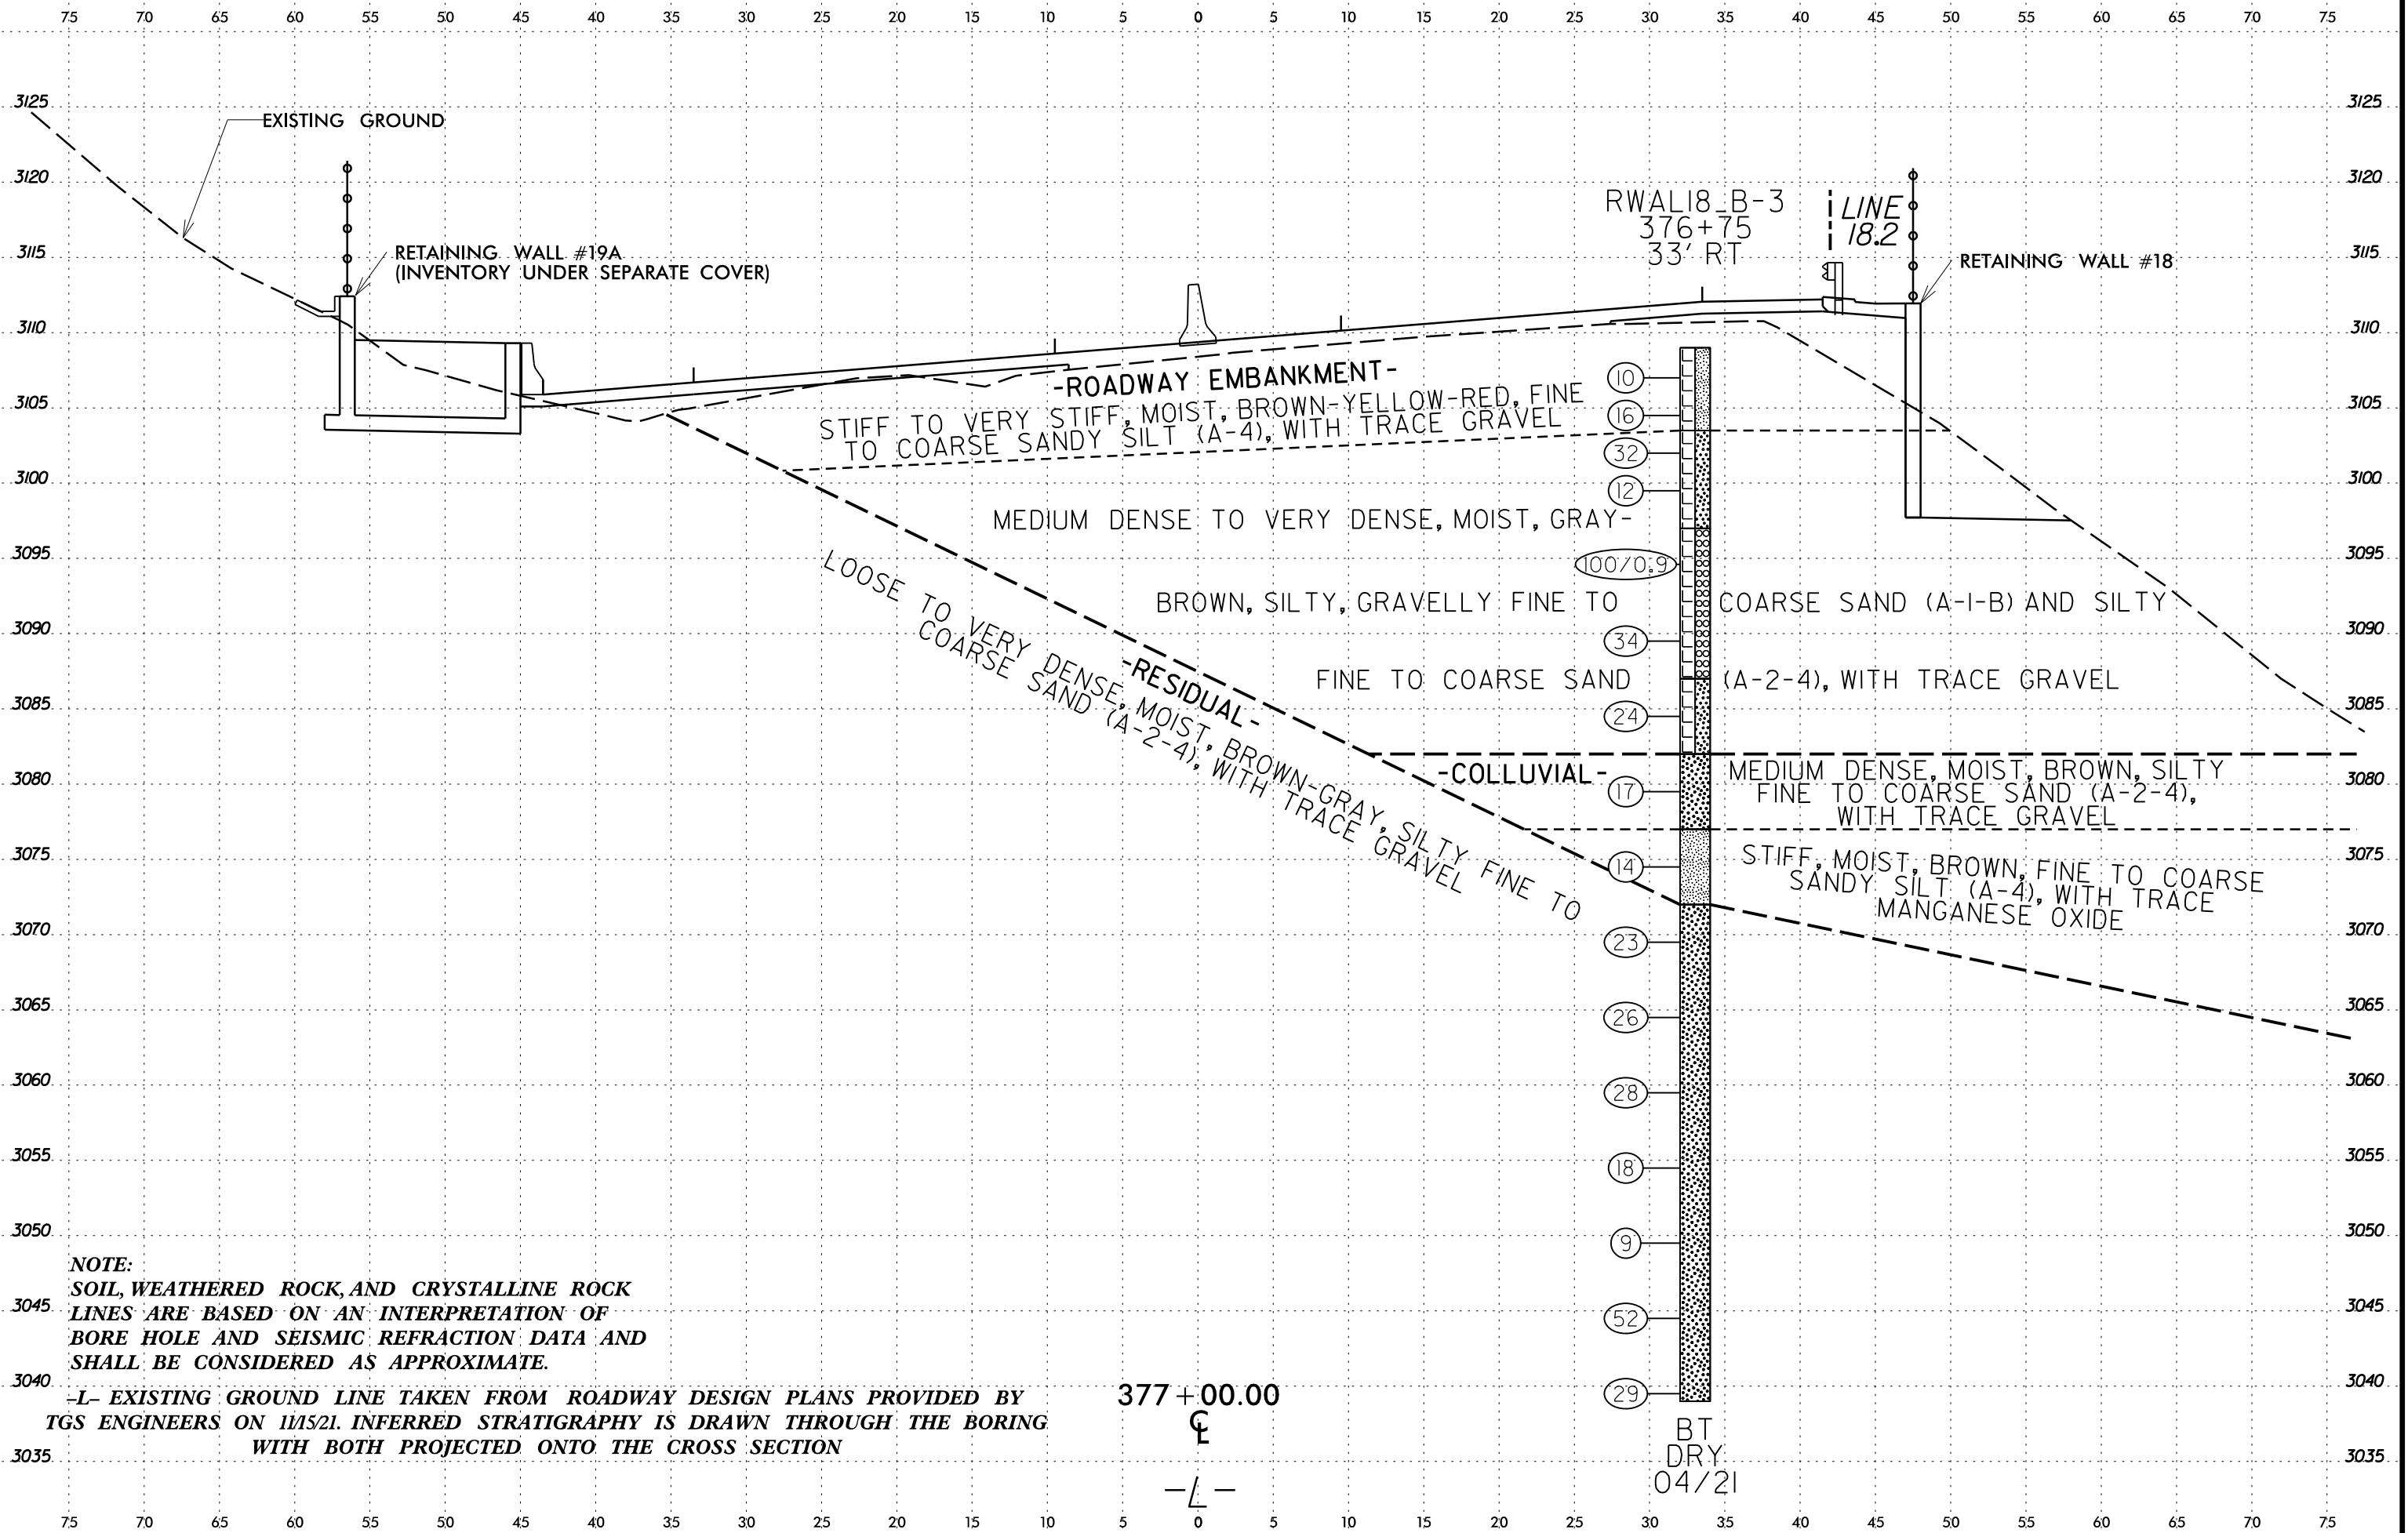

NOTE:
 SOIL, WEATHERED ROCK, AND CRYSTALLINE ROCK LINES ARE BASED ON AN INTERPRETATION OF BORE HOLE AND SEISMIC REFRACTION DATA AND SHALL BE CONSIDERED AS APPROXIMATE.
 -L- EXISTING GROUND LINE TAKEN FROM ROADWAY DESIGN PLANS PROVIDED BY TGS ENGINEERS ON 11/15/21. INFERRED STRATIGRAPHY IS DRAWN THROUGH THE BORING WITH BOTH PROJECTED ONTO THE CROSS SECTION

SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.I.	% BY WEIGHT				% PASSING (SIEVES)			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
SS-4108	31' RT	377+50 -L-	28.5' - 30.0'	A-4(0)	28	2	19	30	34	17	82	71	50	17	-

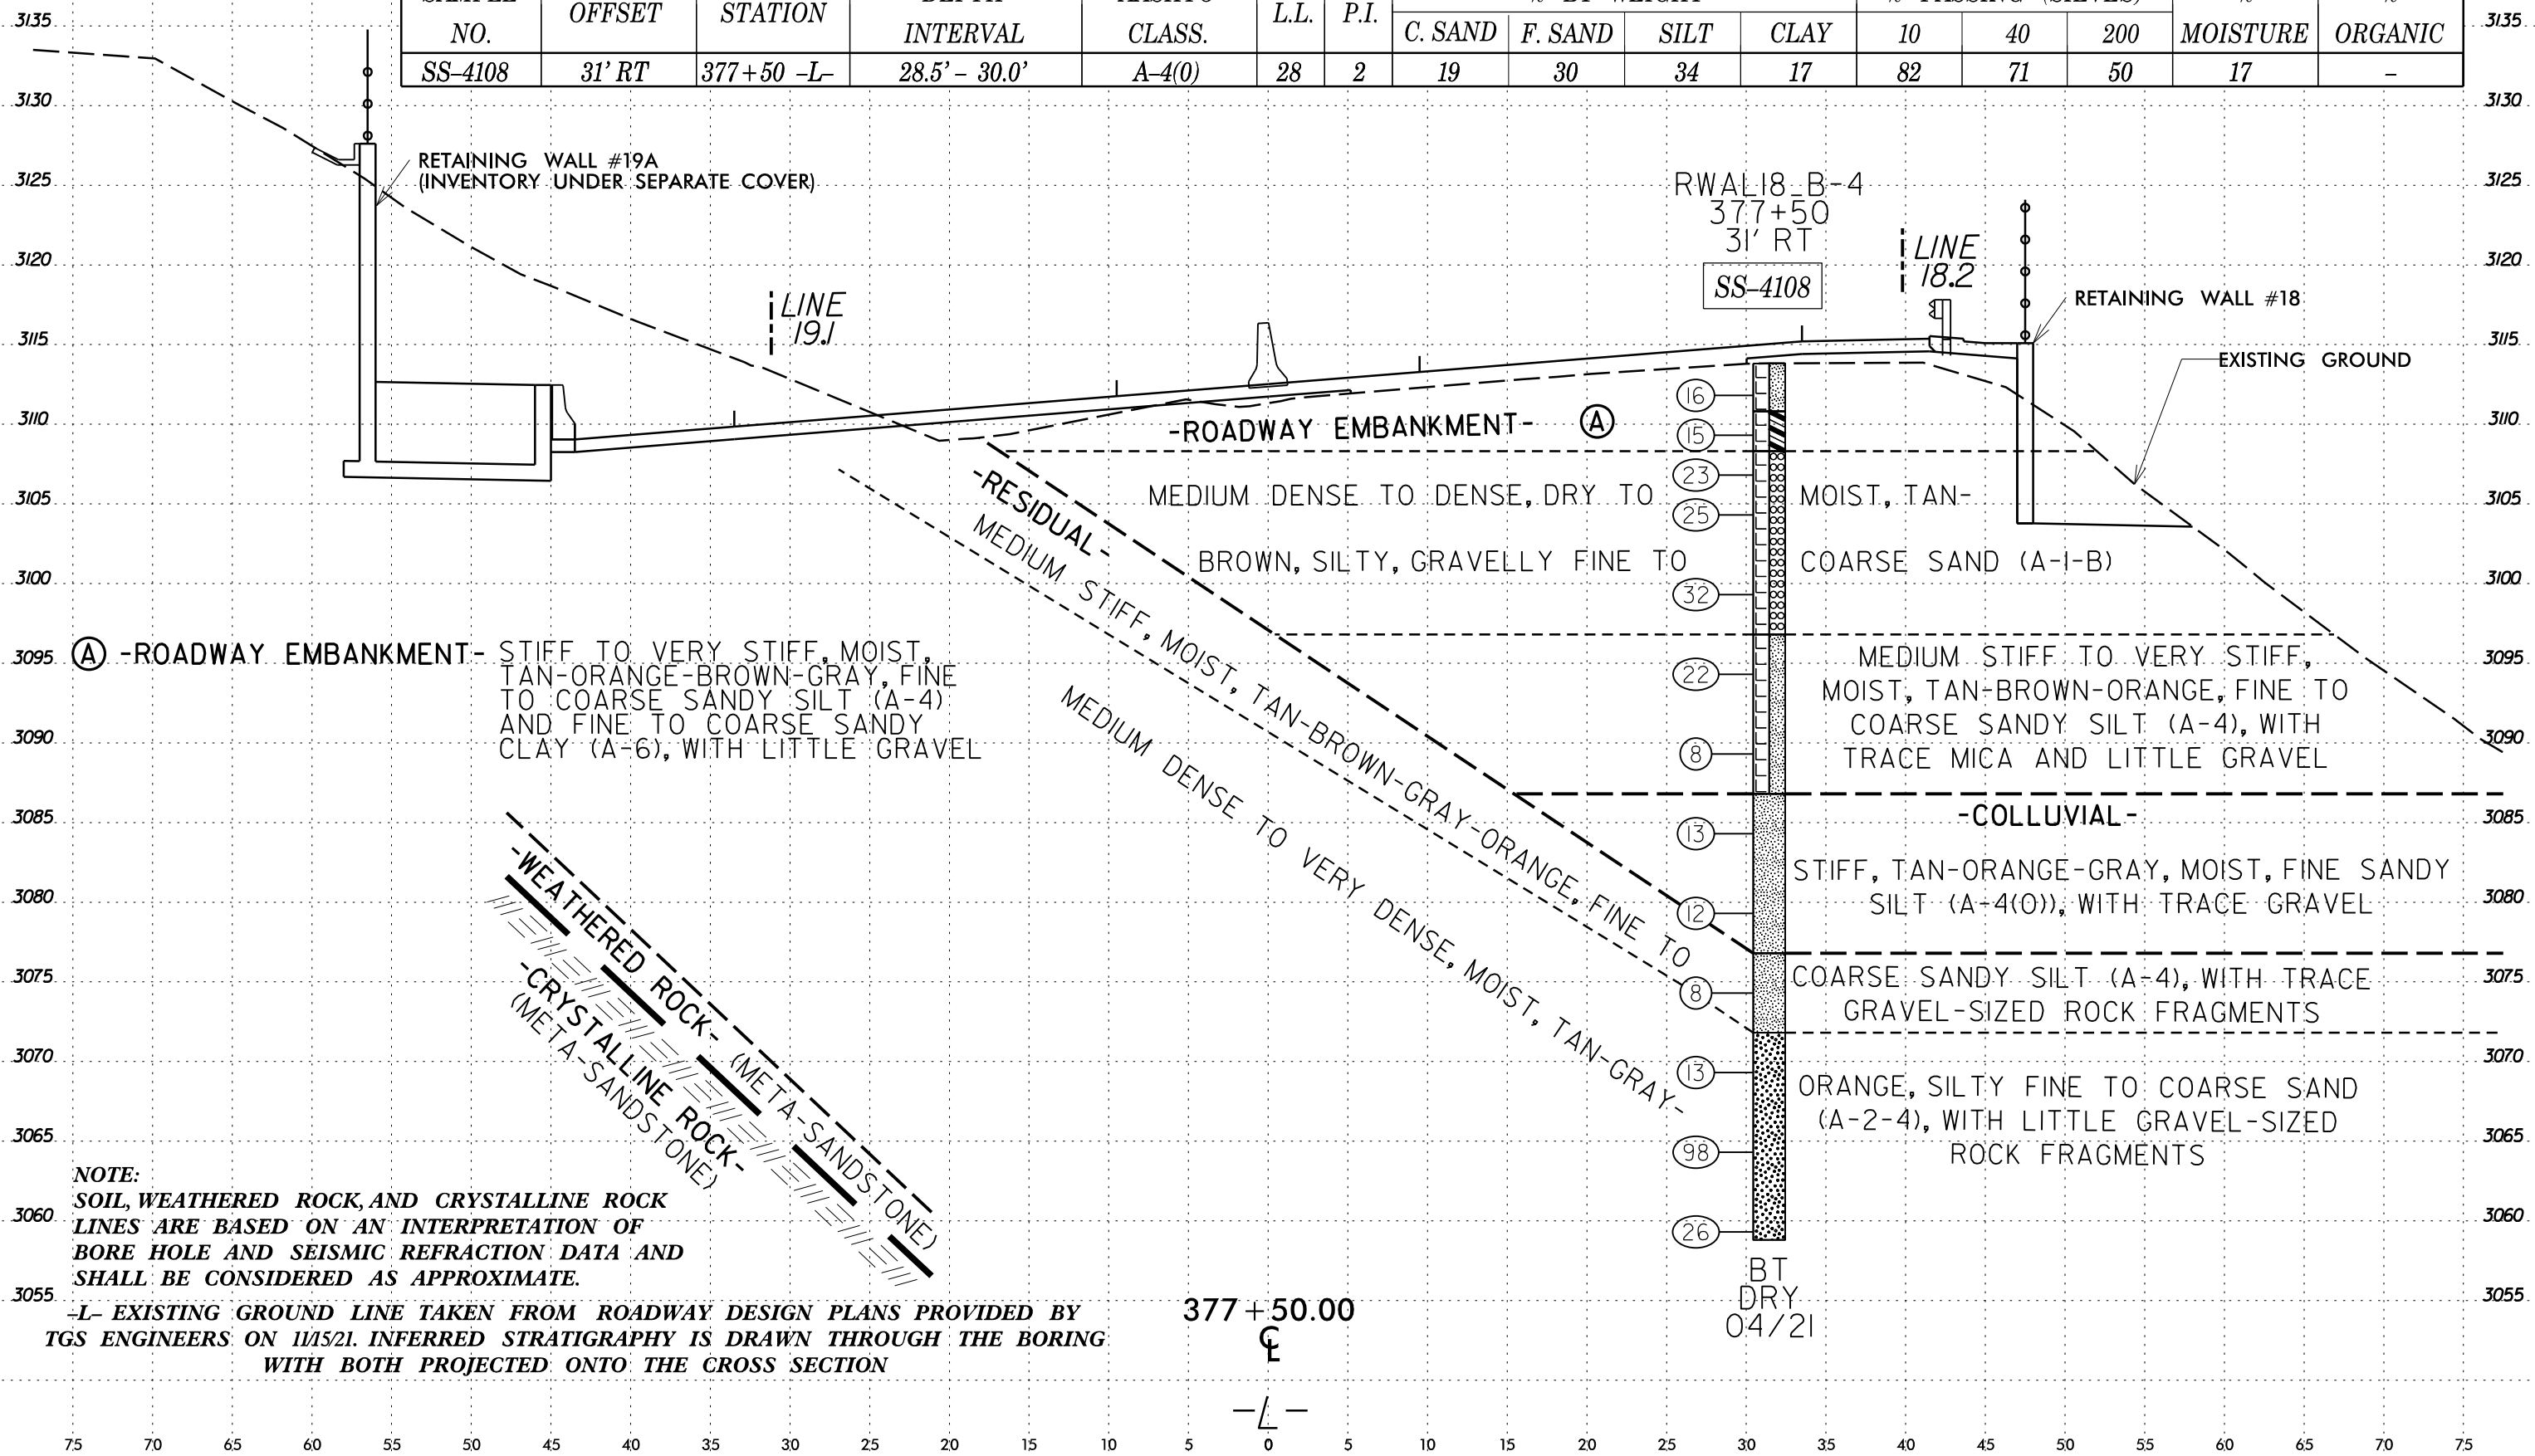


NOTE:
 SOIL, WEATHERED ROCK, AND CRYSTALLINE ROCK LINES ARE BASED ON AN INTERPRETATION OF BORE HOLE AND SEISMIC REFRACTION DATA AND SHALL BE CONSIDERED AS APPROXIMATE.

-L- EXISTING GROUND LINE TAKEN FROM ROADWAY DESIGN PLANS PROVIDED BY TGS ENGINEERS ON 11/15/21. INFERRED STRATIGRAPHY IS DRAWN THROUGH THE BORING WITH BOTH PROJECTED ONTO THE CROSS SECTION

19-MAY-2022 16:28
 C:\Users\jbriver\OneDrive - Carolines Geotechnical Group, PLLC\Projects\0068 - A-0009CB - Future US 74_TGS\A-0009CB\CADD_GEO\TECH\Site\Sub\A-0009CB_GEO_RWAL18.XSL.dgn
 \$\$\$USERNAME\$\$\$

19-MAY-2022 16:28
 C:\Users\jbriver\OneDrive - Carolines Geotechnical Group, PLLC\Projects\0068 - A-0009CB - Future US 74_TGS\A-0009CB\CADD\GEO\TECH\Site\A-0009CB.GEO_RWAL18.XSI.dgn
 \$\$\$USERNAME\$\$\$

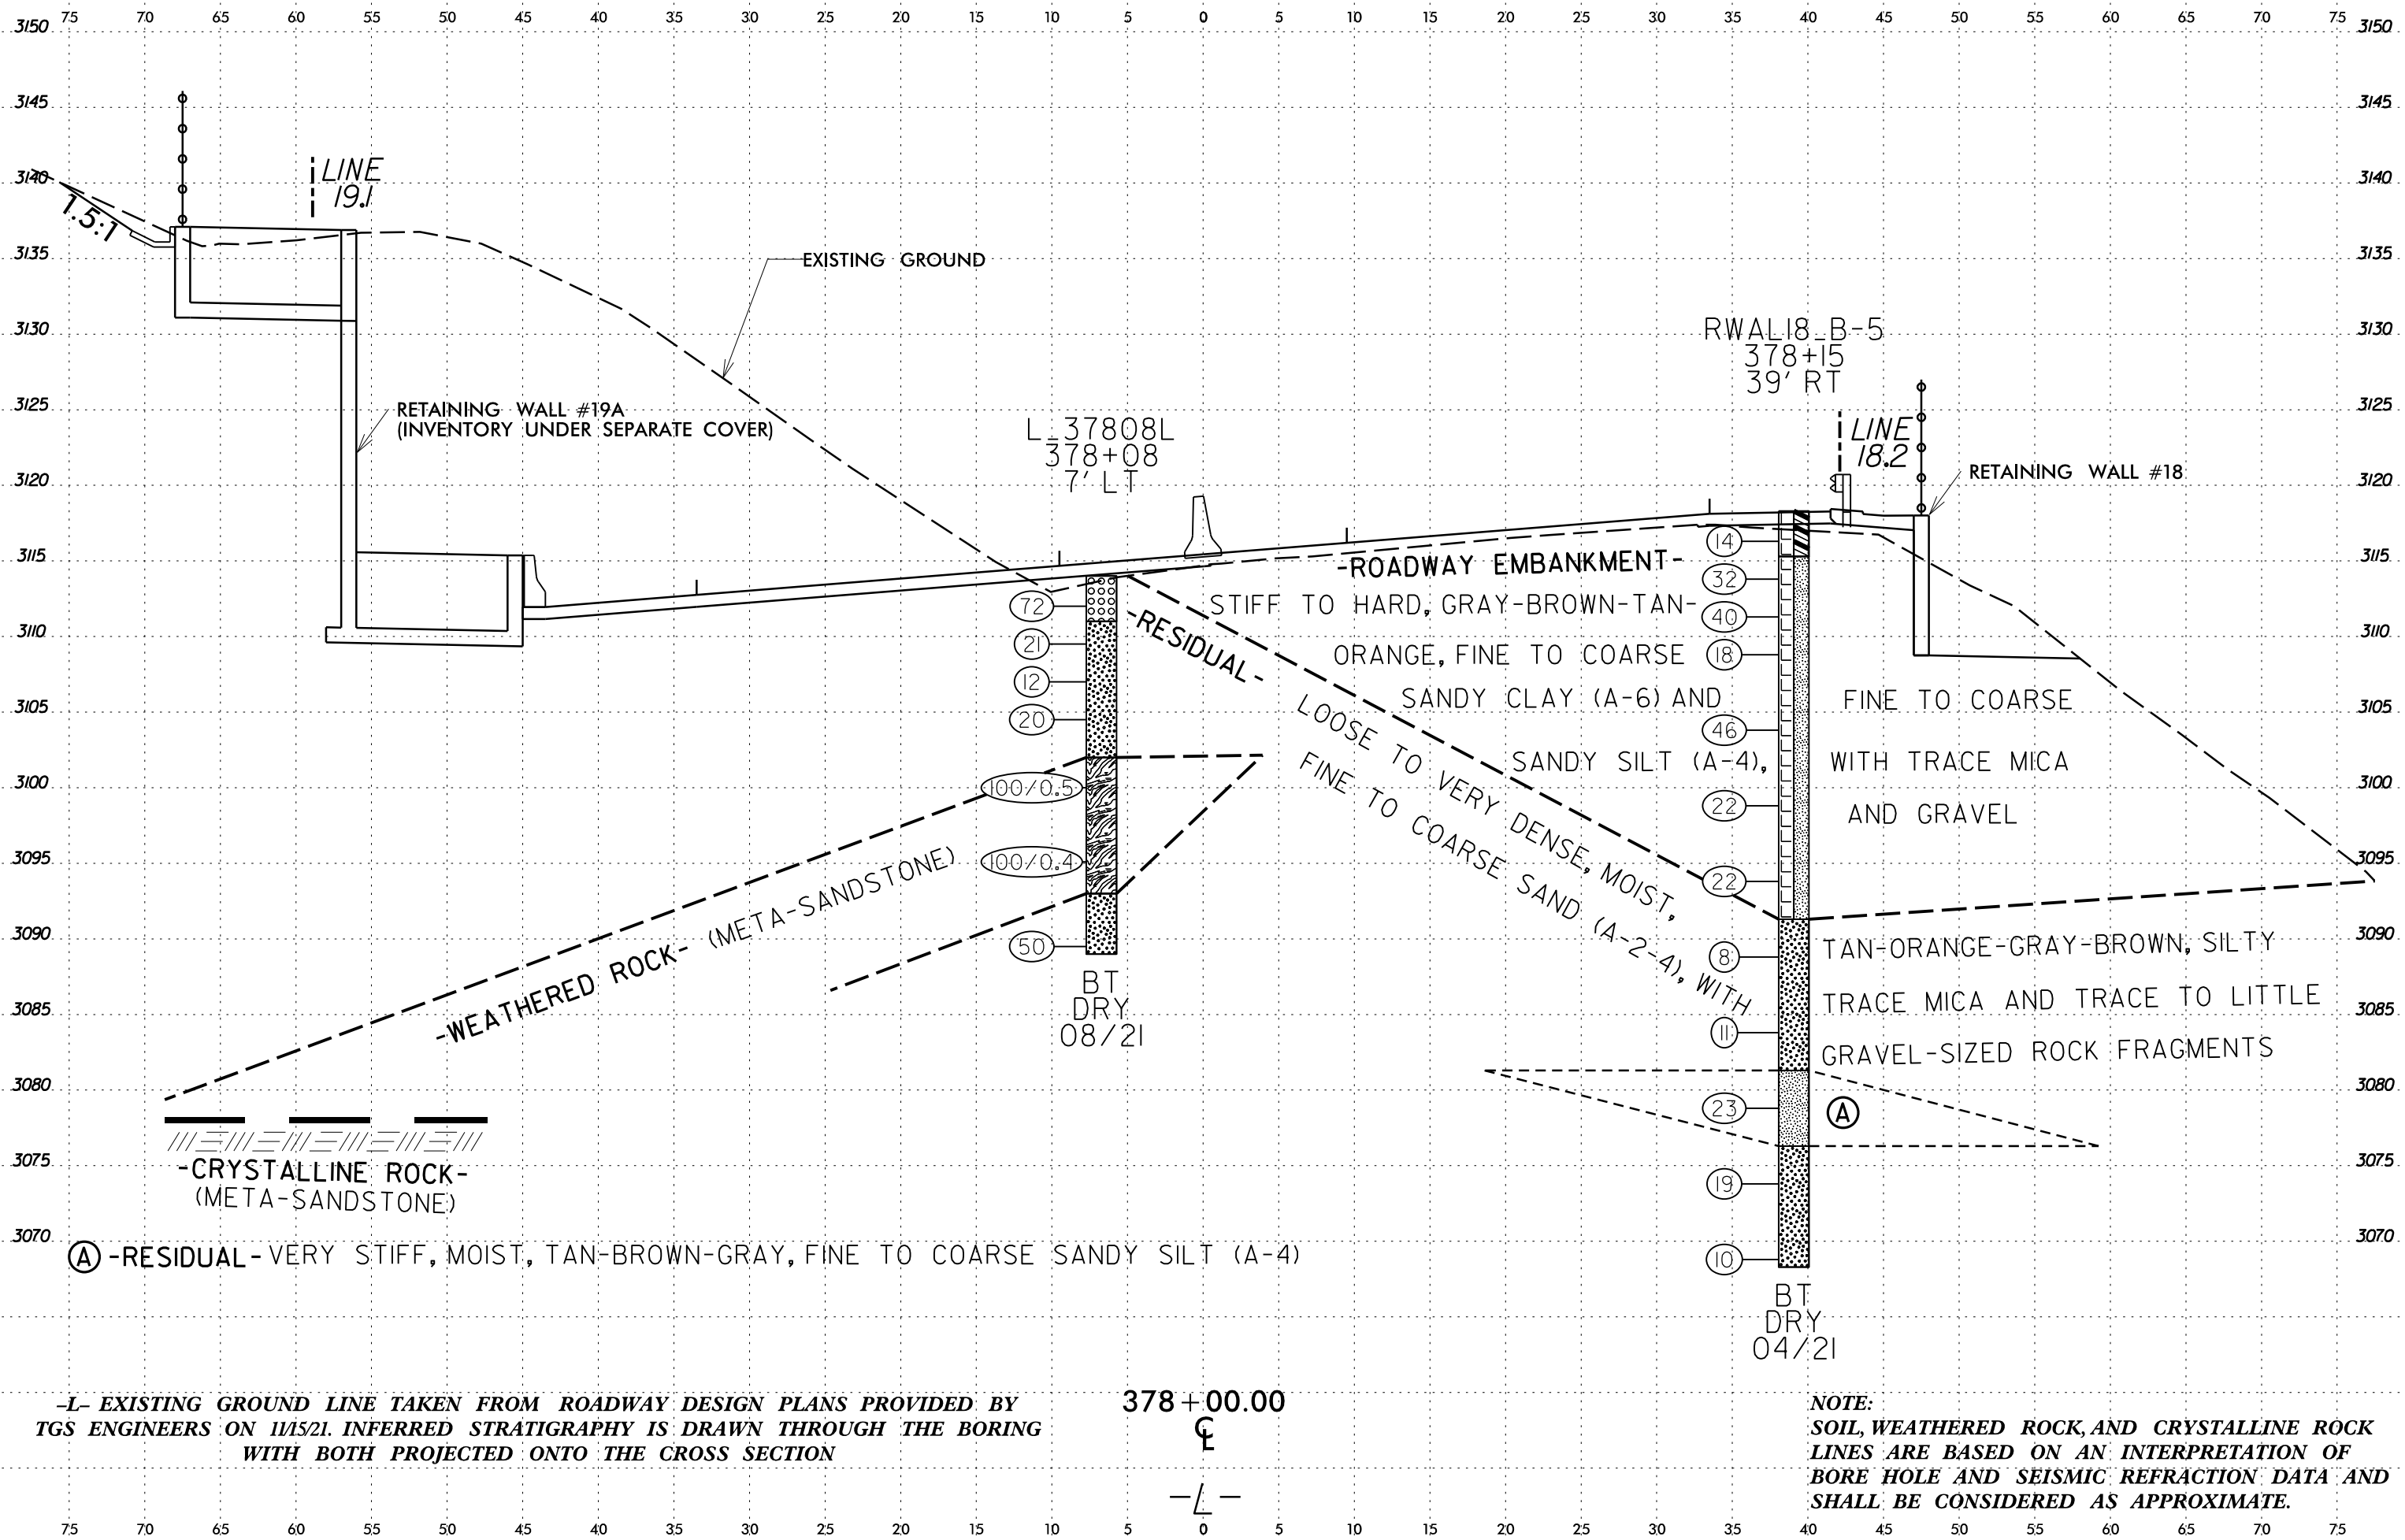

-L- EXISTING GROUND LINE TAKEN FROM ROADWAY DESIGN PLANS PROVIDED BY TGS ENGINEERS ON 11/5/21. INFERRED STRATIGRAPHY IS DRAWN THROUGH THE BORING WITH BOTH PROJECTED ONTO THE CROSS SECTION

NOTE:
 SOIL, WEATHERED ROCK, AND CRYSTALLINE ROCK LINES ARE BASED ON AN INTERPRETATION OF BORE HOLE AND SEISMIC REFRACTION DATA AND SHALL BE CONSIDERED AS APPROXIMATE.

GEOTECHNICAL BORING REPORT BORE LOG

WBS 32572.1.FS10		TIP A-0009CB		COUNTY GRAHAM		GEOLOGIST C. Piercy										
SITE DESCRIPTION Upgrade NC 143 from SR 1223 (Beech Creek Road) to 0.5 Miles North of Appalachian Trail							GROUND WTR (ft)									
BORING NO. RWAL18_B-1		STATION 375+25		OFFSET 29 ft RT		ALIGNMENT L										
COLLAR ELEV. 3,097.3 ft		TOTAL DEPTH 55.0 ft		NORTHING 618,960		EASTING 593,163										
DRILL RIG/HAMMER EFF./DATE BRE9533 CME-550X 78% 03/12/2021			DRILL METHOD H.S. Augers			HAMMER TYPE Automatic										
DRILLER J. Phillips		START DATE 04/26/21		COMP. DATE 04/26/21		SURFACE WATER DEPTH N/A										
ELEV (ft)	DRIVE ELEV (ft)	DEPTH (ft)	BLOW COUNT			BLOWS PER FOOT					SAMP. NO.	MOI	LOG	SOIL AND ROCK DESCRIPTION		
			0.5ft	0.5ft	0.5ft	0	25	50	75	100						ELEV. (ft)
3100																3,097.3 GROUND SURFACE 0.0
3095	3,096.3	1.0	4	3	4							M				ROADWAY EMBANKMENT Medium Stiff to Hard, Brown, Fine to Coarse Sandy SILT (A-4), with trace to little gravel
	3,093.8	3.5	3	10	12							M				
	3,091.3	6.0	7	18	21							M				
3090	3,088.8	8.5	12	13	9							M				
	3,083.8	13.5	20	27	20							M				3,085.3 Medium Dense to Dense, Brown, Silty, Gravelly Fine to Coarse SAND (A-1-b) 12.0
3080	3,078.8	18.5	21	14	12							M				
	3,073.8	23.5	3	16	28							M				3,075.3 Medium Dense to Dense, Brown-Tan-Gray, Silty Fine to Coarse SAND (A-2-4), with trace gravel 22.0
3070	3,068.8	28.5	11	9	7							M				
	3,063.8	33.5	5	6	3							M				3,065.3 COLLUVIAL Medium Stiff to Stiff, Brown-Orange-Tan, Fine to Coarse Sandy SILT (A-4(0)) 32.0
3060	3,058.8	38.5	2	2	3							M				
	3,053.8	43.5	9	6	5							M				3,055.3 RESIDUAL Medium Dense to Dense, Brown, Silty Fine to Coarse SAND (A-2-4), with trace gravel-sized rock fragments 42.0
3050	3,048.8	48.5	14	16	18							M				
	3,043.8	53.5	11	13	17							M				
												M				3,042.3 Boring Terminated at Elevation 3,042.3 ft In Residual Silty Sand (A-2-4) 55.0

WBS 32572.1.FS10		TIP A-0009CB		COUNTY GRAHAM		GEOLOGIST C. Piercy										
SITE DESCRIPTION Upgrade NC 143 from SR 1223 (Beech Creek Road) to 0.5 Miles North of Appalachian Trail							GROUND WTR (ft)									
BORING NO. RWAL18_B-2		STATION 376+00		OFFSET 31 ft RT		ALIGNMENT L										
COLLAR ELEV. 3,103.3 ft		TOTAL DEPTH 60.0 ft		NORTHING 618,880		EASTING 593,163										
DRILL RIG/HAMMER EFF./DATE BRE9533 CME-550X 78% 03/12/2021			DRILL METHOD H.S. Augers			HAMMER TYPE Automatic										
DRILLER J. Phillips		START DATE 04/26/21		COMP. DATE 04/26/21		SURFACE WATER DEPTH N/A										
ELEV (ft)	DRIVE ELEV (ft)	DEPTH (ft)	BLOW COUNT			BLOWS PER FOOT					SAMP. NO.	MOI	LOG	SOIL AND ROCK DESCRIPTION		
			0.5ft	0.5ft	0.5ft	0	25	50	75	100						ELEV. (ft)
3105																3,103.3 GROUND SURFACE 0.0
	3,102.3	1.0	2	4	3							M				ROADWAY EMBANKMENT Medium Stiff to Hard, Brown, Fine to Coarse Sandy SILT (A-4), with trace gravel
3100	3,099.8	3.5	7	9	7							M				
	3,097.3	6.0	4	20	30							M				
3095	3,094.8	8.5	20	17	21							M				3,095.3 Dense, Gray-Brown, Silty, Gravelly Fine to Coarse SAND (A-1-b) 8.0
	3,089.8	13.5	15	12	12							M				3,091.3 Medium Dense, Brown, Silty Fine to Coarse SAND (A-2-4), with trace gravel and asphalt fragments 12.0
3085	3,084.8	18.5	7	6	8							M				
	3,079.8	23.5	4	15	13							M				
3080	3,074.8	28.5	10	14	10							M				
	3,069.8	33.5	11	32	26							M				3,071.3 COLLUVIAL Very Dense, Brown-Gray, Silty, Gravelly Fine to Coarse SAND (A-1-b) 32.0
3070	3,064.8	38.5	15	26	17							M				3,066.3 Dense, Brown, Silty Fine to Coarse SAND (A-2-4), with trace gravel 37.0
	3,059.8	43.5	21	25	40							M				3,061.3 RESIDUAL Very Dense, Brown-Gray, Silty Fine to Coarse SAND (A-2-4), with trace gravel-sized rock fragments 42.0
3060	3,054.8	48.5	15	21	79/0.4							M				3,054.3 WEATHERED ROCK Gray, (META-SANDSTONE) 49.0
	3,049.8	53.5	20	19	16							M				3,051.3 RESIDUAL Dense to Very Dense, Brown-Gray, Silty Fine to Coarse SAND (A-2-4), with trace gravel-sized rock fragments 52.0
3050	3,044.8	58.5	13	44	23							M				3,043.3 Boring Terminated at Elevation 3,043.3 ft In Residual Silty Sand (A-2-4) 60.0

NCDOT BORE DOUBLE A-0009CB_GEO_RDY_GTM.GPJ NC_DOT.GDT 5/10/22

GEOTECHNICAL BORING REPORT

BORE LOG

WBS 32572.1.FS10		TIP A-0009CB		COUNTY GRAHAM		GEOLOGIST C. Piercy										
SITE DESCRIPTION Upgrade NC 143 from SR 1223 (Beech Creek Road) to 0.5 Miles North of Appalachian Trail							GROUND WTR (ft)									
BORING NO. RWAL18_B-3		STATION 376+75		OFFSET 33 ft RT		ALIGNMENT L										
COLLAR ELEV. 3,109.0 ft		TOTAL DEPTH 70.0 ft		NORTHING 618,800		EASTING 593,180										
DRILL RIGHAMMER EFF./DATE BRE9533 CME-550X 78% 03/12/2021				DRILL METHOD H.S. Augers		HAMMER TYPE Automatic										
DRILLER J. Phillips		START DATE 04/27/21		COMP. DATE 04/27/21		SURFACE WATER DEPTH N/A										
ELEV (ft)	DRIVE ELEV (ft)	DEPTH (ft)	BLOW COUNT			BLOWS PER FOOT					SAMP. NO.	LOG	SOIL AND ROCK DESCRIPTION	DEPTH (ft)		
			0.5ft	0.5ft	0.5ft	0	25	50	75	100						
3110														3,109.0	0.0	GROUND SURFACE
	3,108.0	1.0	4	4	6											ROADWAY EMBANKMENT
3105	3,105.5	3.5	8	8	8											Stiff to Very Stiff, Brown-Yellow-Red, Fine to Coarse Sandy SILT (A-4), with trace gravel
	3,103.0	6.0	11	16	16											Medium Dense to Dense, Brown, Silty Fine to Coarse SAND (A-2-4), with trace gravel
3100	3,100.5	8.5	9	7	5											
	3,095.5	13.5	13	87/0.4												Dense to Very Dense, Gray-Brown, Silty, Gravelly Fine to Coarse SAND (A-1-b)
3095	3,090.5	18.5	18	18	16											
	3,085.5	23.5	6	11	13											Medium Dense, Brown, Silty Fine to Coarse SAND (A-2-4), with trace gravel
3085	3,080.5	28.5	4	6	11											
	3,075.5	33.5	5	7	7											COLLUVIAL
3080	3,070.5	38.5	13	11	12											Medium Dense, Brown, Silty Fine to Coarse SAND (A-2-4), with trace gravel
	3,065.5	43.5	15	13	13											Stiff, Brown, Fine to Coarse Sandy SILT (A-4), with trace manganese oxide
3075	3,060.5	48.5	18	14	14											
	3,055.5	53.5	8	8	10											RESIDUAL
3070	3,050.5	58.5	5	4	5											Loose to Very Dense, Brown-Gray, Silty Fine to Coarse SAND (A-2-4), with trace gravel
	3,045.5	63.5	15	23	29											
3065	3,040.5	68.5	9	12	17											
3060																
3055																
3050																
3045																
3040																
																Boring Terminated at Elevation 3,039.0 ft In Residual Silty Sand (A-2-4)

WBS 32572.1.FS10		TIP A-0009CB		COUNTY GRAHAM		GEOLOGIST N. McLaren										
SITE DESCRIPTION Upgrade NC 143 from SR 1223 (Beech Creek Road) to 0.5 Miles North of Appalachian Trail							GROUND WTR (ft)									
BORING NO. RWAL18_B-4		STATION 377+50		OFFSET 31 ft RT		ALIGNMENT L										
COLLAR ELEV. 3,113.8 ft		TOTAL DEPTH 55.0 ft		NORTHING 618,727		EASTING 593,218										
DRILL RIGHAMMER EFF./DATE CG20446 Diedrich D50 83% 06/16/2020				DRILL METHOD H.S. Augers		HAMMER TYPE Automatic										
DRILLER J. Estep		START DATE 04/26/21		COMP. DATE 04/26/21		SURFACE WATER DEPTH N/A										
ELEV (ft)	DRIVE ELEV (ft)	DEPTH (ft)	BLOW COUNT			BLOWS PER FOOT					SAMP. NO.	LOG	SOIL AND ROCK DESCRIPTION	DEPTH (ft)		
			0.5ft	0.5ft	0.5ft	0	25	50	75	100						
3115														3,113.8	0.0	GROUND SURFACE
	3,112.8	1.0	5	6	10											ROADWAY EMBANKMENT
3110	3,110.3	3.5	5	5	10											Very Stiff, Tan-Orange-Brown, Fine to Coarse Sandy SILT (A-4), with little gravel
	3,107.8	6.0	19	17	6											Stiff, Tan-Gray-Brown, Fine to Coarse Sandy CLAY (A-6), with little gravel
3105	3,105.3	8.5	13	14	11											Medium Dense to Dense, Tan-Brown, Silty, Gravelly Fine to Coarse SAND (A-1-b)
	3,100.3	13.5	13	14	18											
3100	3,095.3	18.5	16	11	11											
	3,090.3	23.5	5	3	5											Medium Stiff to Very Stiff, Tan-Brown-Orange, Fine to Coarse Sandy SILT (A-4), with trace mica and little gravel
3095	3,085.3	28.5	8	7	6											
	3,080.3	33.5	4	5	7											
3090	3,075.3	38.5	6	4	4											
	3,070.3	43.5	2	4	9											COLLUVIAL
3085	3,065.3	48.5	23	69	29											Stiff, Tan-Orange-Gray, Fine Sandy SILT (A-4(0)), with trace gravel
	3,060.3	53.5	6	14	12											
3080																
3075																RESIDUAL
																Medium Stiff, Tan-Brown-Gray-Orange, Fine to Coarse Sandy SILT (A-4), with trace gravel-sized rock fragments
3070																
																Medium Dense to Very Dense, Tan-Gray-Orange, Silty Fine to Coarse SAND (A-2-4), with little gravel-sized rock fragments
3065																
3060																
																Boring Terminated at Elevation 3,058.8 ft In Residual Silty Sand (A-2-4)

NCDOT BORE DOUBLE A-0009CB GEO_RDY_GTM.GPJ NC_DOT.GDT 5/10/22

GEOTECHNICAL BORING REPORT


BORE LOG

WBS 32572.1.FS10		TIP A-0009CB		COUNTY GRAHAM		GEOLOGIST D. Goodnight										
SITE DESCRIPTION Upgrade NC 143 from SR 1223 (Beech Creek Road) to 0.5 Miles North of Appalachian Trail							GROUND WTR (ft)									
BORING NO. L_37808L		STATION 378+08		OFFSET 7 ft LT		ALIGNMENT L										
COLLAR ELEV. 3,114.0 ft		TOTAL DEPTH 25.0 ft		NORTHING 618,703		EASTING 593,285										
DRILL RIGHAMMER EFF./DATE FIVE9553 CME-550X 80% 03/12/2021				DRILL METHOD H.S. Augers		HAMMER TYPE Automatic										
DRILLER J. Phillips		START DATE 08/13/21		COMP. DATE 08/13/21		SURFACE WATER DEPTH N/A										
ELEV (ft)	DRIVE ELEV (ft)	DEPTH (ft)	BLOW COUNT			BLOWS PER FOOT					SAMP. NO.	LOG	SOIL AND ROCK DESCRIPTION	DEPTH (ft)		
			0.5ft	0.5ft	0.5ft	0	25	50	75	100						
3115														3,114.0	0.0	GROUND SURFACE
	3,113.0	1.0	27	30	42											RESIDUAL
	3,110.5	3.5	4	8	13									3,111.0	3.0	Very Dense, Gray, Fine to Coarse Sandy GRAVEL (A-1-A)
3110	3,108.0	6.0	4	4	8											Medium Dense, Tan, Silty Fine SAND (A-2-4)
3105	3,105.5	8.5	3	7	13											
3100	3,100.5	13.5	100/0.5													WEATHERED ROCK
	3,095.5	18.5	100/0.4													Tan-Gray, (META-SANDSTONE)
3095	3,090.5	23.5														RESIDUAL
3090																Dense, Tan-Gray, Silty Fine SAND (A-2-4), with trace gravel-sized rock fragments
																Boring Terminated at Elevation 3,089.0 ft In Residual Silty Sand (A-2-4)

WBS 32572.1.FS10		TIP A-0009CB		COUNTY GRAHAM		GEOLOGIST N. McLaren										
SITE DESCRIPTION Upgrade NC 143 from SR 1223 (Beech Creek Road) to 0.5 Miles North of Appalachian Trail							GROUND WTR (ft)									
BORING NO. RWAL18_B-5		STATION 378+15		OFFSET 39 ft RT		ALIGNMENT L										
COLLAR ELEV. 3,118.3 ft		TOTAL DEPTH 50.0 ft		NORTHING 618,666		EASTING 593,257										
DRILL RIGHAMMER EFF./DATE CG20446 Diedrich D50 83% 06/16/2020				DRILL METHOD H.S. Augers		HAMMER TYPE Automatic										
DRILLER J. Estep		START DATE 04/26/21		COMP. DATE 04/26/21		SURFACE WATER DEPTH N/A										
ELEV (ft)	DRIVE ELEV (ft)	DEPTH (ft)	BLOW COUNT			BLOWS PER FOOT					SAMP. NO.	LOG	SOIL AND ROCK DESCRIPTION	DEPTH (ft)		
			0.5ft	0.5ft	0.5ft	0	25	50	75	100						
3120														3,118.3	0.0	GROUND SURFACE
	3,117.3	1.0	7	7	7											ROADWAY EMBANKMENT
3115	3,114.8	3.5	5	14	18									3,115.3	3.0	Stiff, Gray-Brown-Tan, Fine to Coarse Sandy CLAY (A-6), with trace gravel and mica
	3,112.3	6.0	24	21	19											Very Stiff to Hard, Tan-Orange-Gray-Brown, Fine to Coarse Sandy SILT (A-4), with trace mica and gravel
3110	3,109.8	8.5	10	9	9											
3105	3,104.8	13.5	13	23	23											
3100	3,099.8	18.5	19	14	8											
3095	3,094.8	23.5	21	13	9											
3090	3,089.8	28.5	14	4	4											RESIDUAL
	3,084.8	33.5	4	4	7											Loose to Medium Dense, Tan-Orange-Gray-Brown, Silty Fine to Coarse SAND (A-2-4), with trace mica and gravel-sized rock fragments
3085																
3080	3,079.8	38.5	9	10	13									3,081.3	37.0	Very Stiff, Tan-Brown-Gray, Fine to Coarse Sandy SILT (A-4)
3075	3,074.8	43.5	5	9	10									3,076.3	42.0	Loose to Medium Dense, Tan-Gray-Brown, Silty Fine to Coarse SAND (A-2-4), with little gravel-sized rock fragments
3070	3,069.8	48.5	7	5	5									3,068.3	50.0	Boring Terminated at Elevation 3,068.3 ft In Residual Silty Sand (A-2-4)

NCDOT BORE DOUBLE A-0009CB_GEO_RDY_GTM.GPJ NC_DOT.GDT 5/10/22

GEOPHYSICAL TEST RESULTS – SEISMIC REFRACTION LINE 18.1

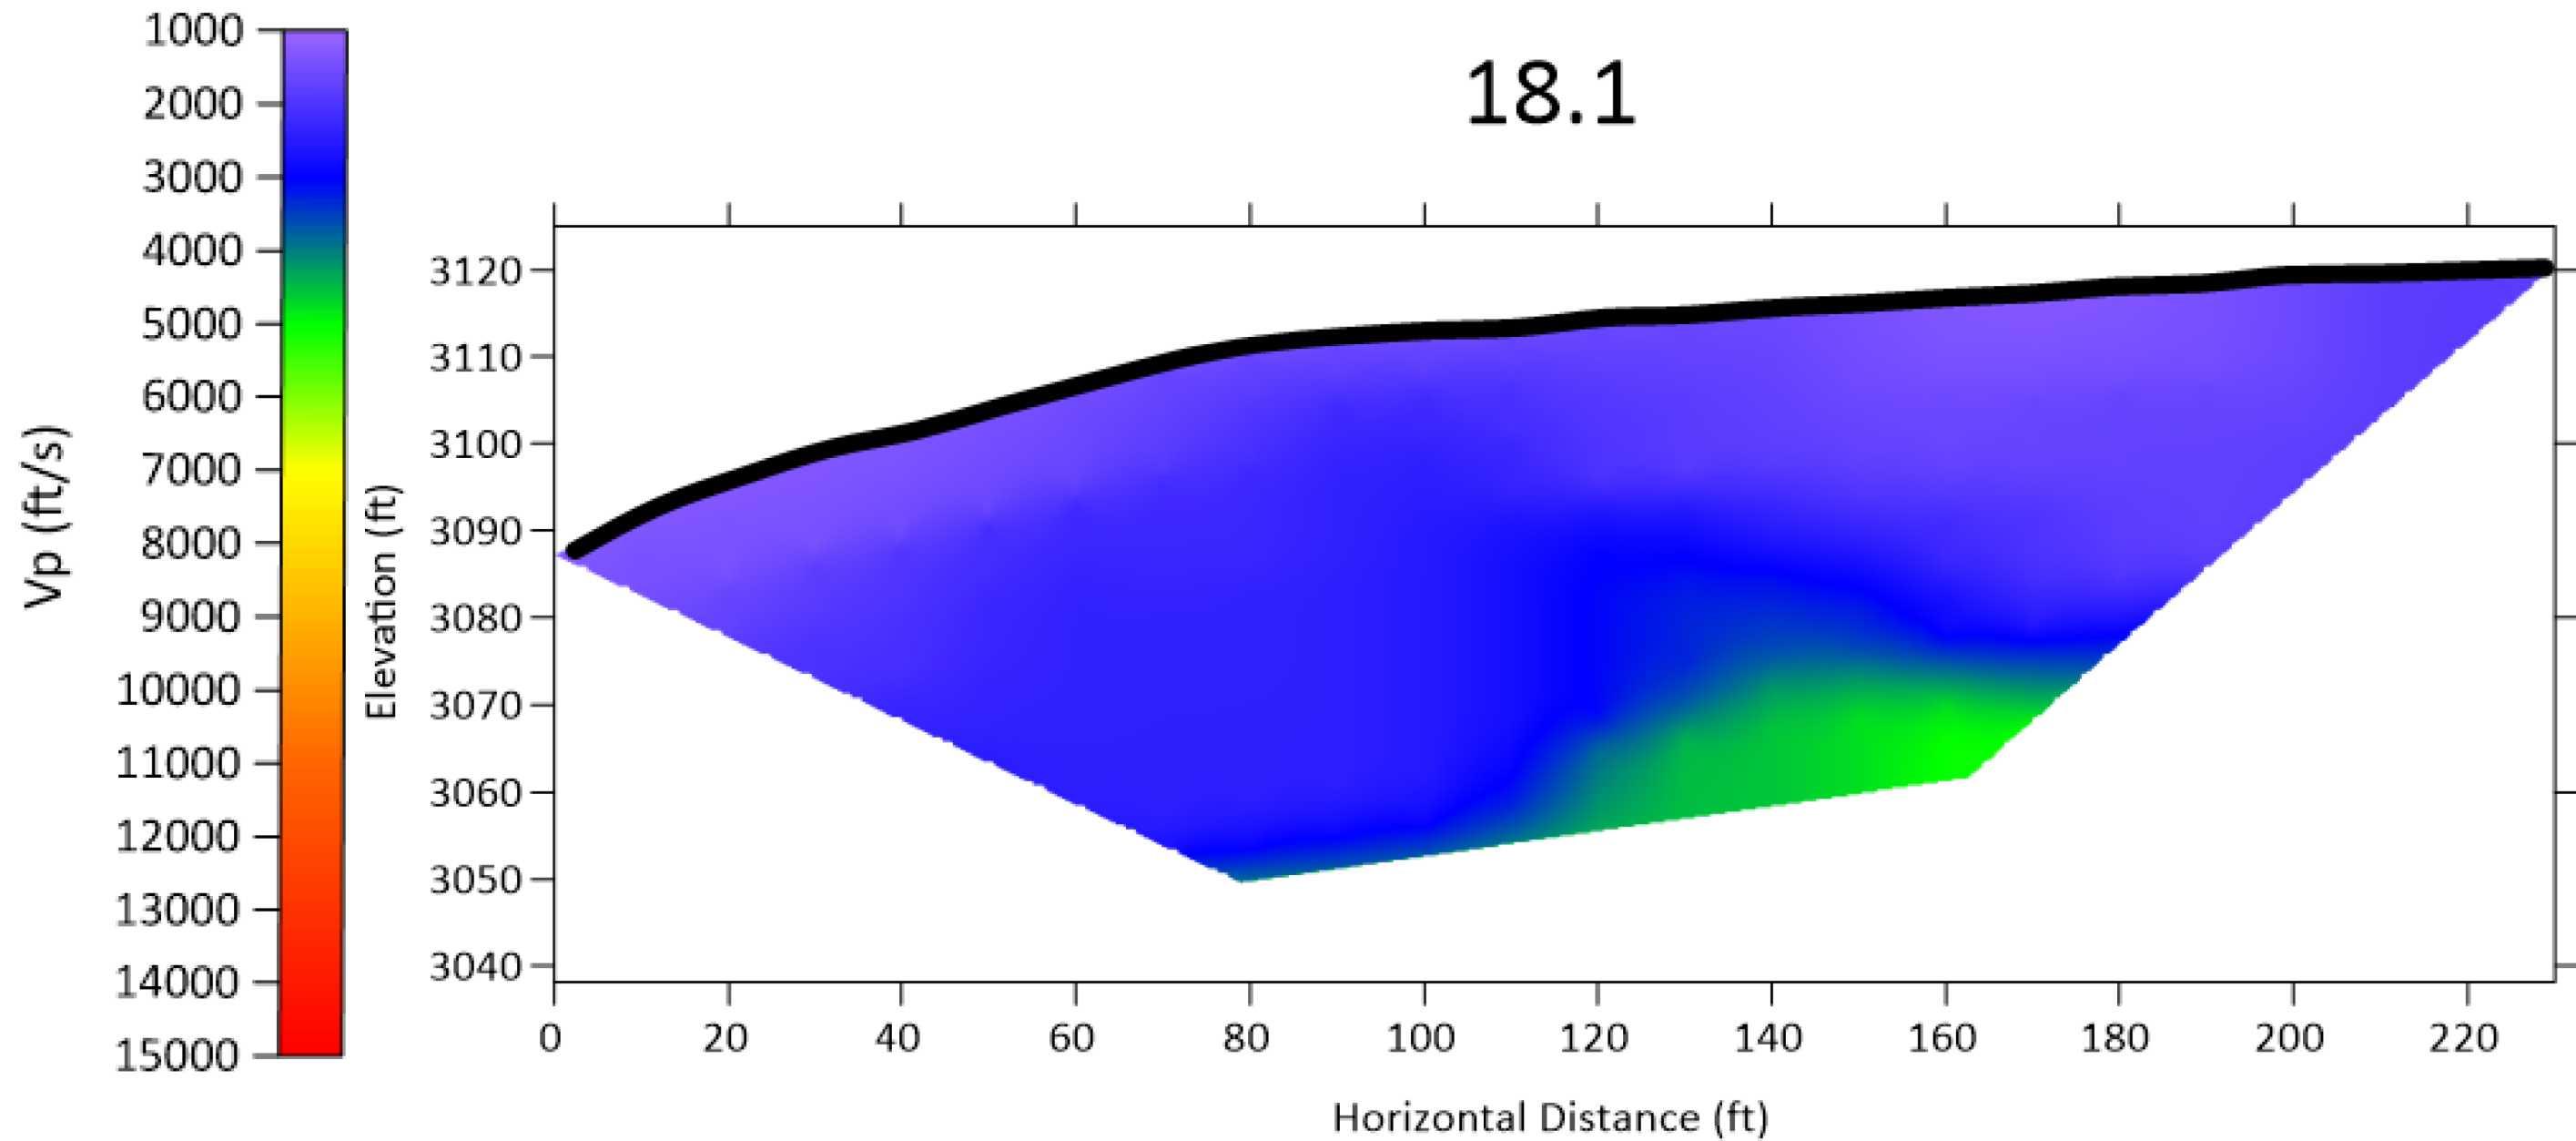


GEOPHYSICAL TESTING PERFORMED BY GEL SOLUTIONS. REFERENCE "SEISMIC REFRACTION SURVEY FOR EVALUATION OF ROCK" DATED 10/01/2021

CG2 ESTIMATED WAVE SPEED FOR WEATHERED ROCK: 4,500 FT/SEC

CG2 ESTIMATED WAVE SPEED FOR CRYSTALLINE ROCK: 7,500 FT/SEC

GEOPHYSICAL TEST RESULTS – SEISMIC REFRACTION LINE 18.2

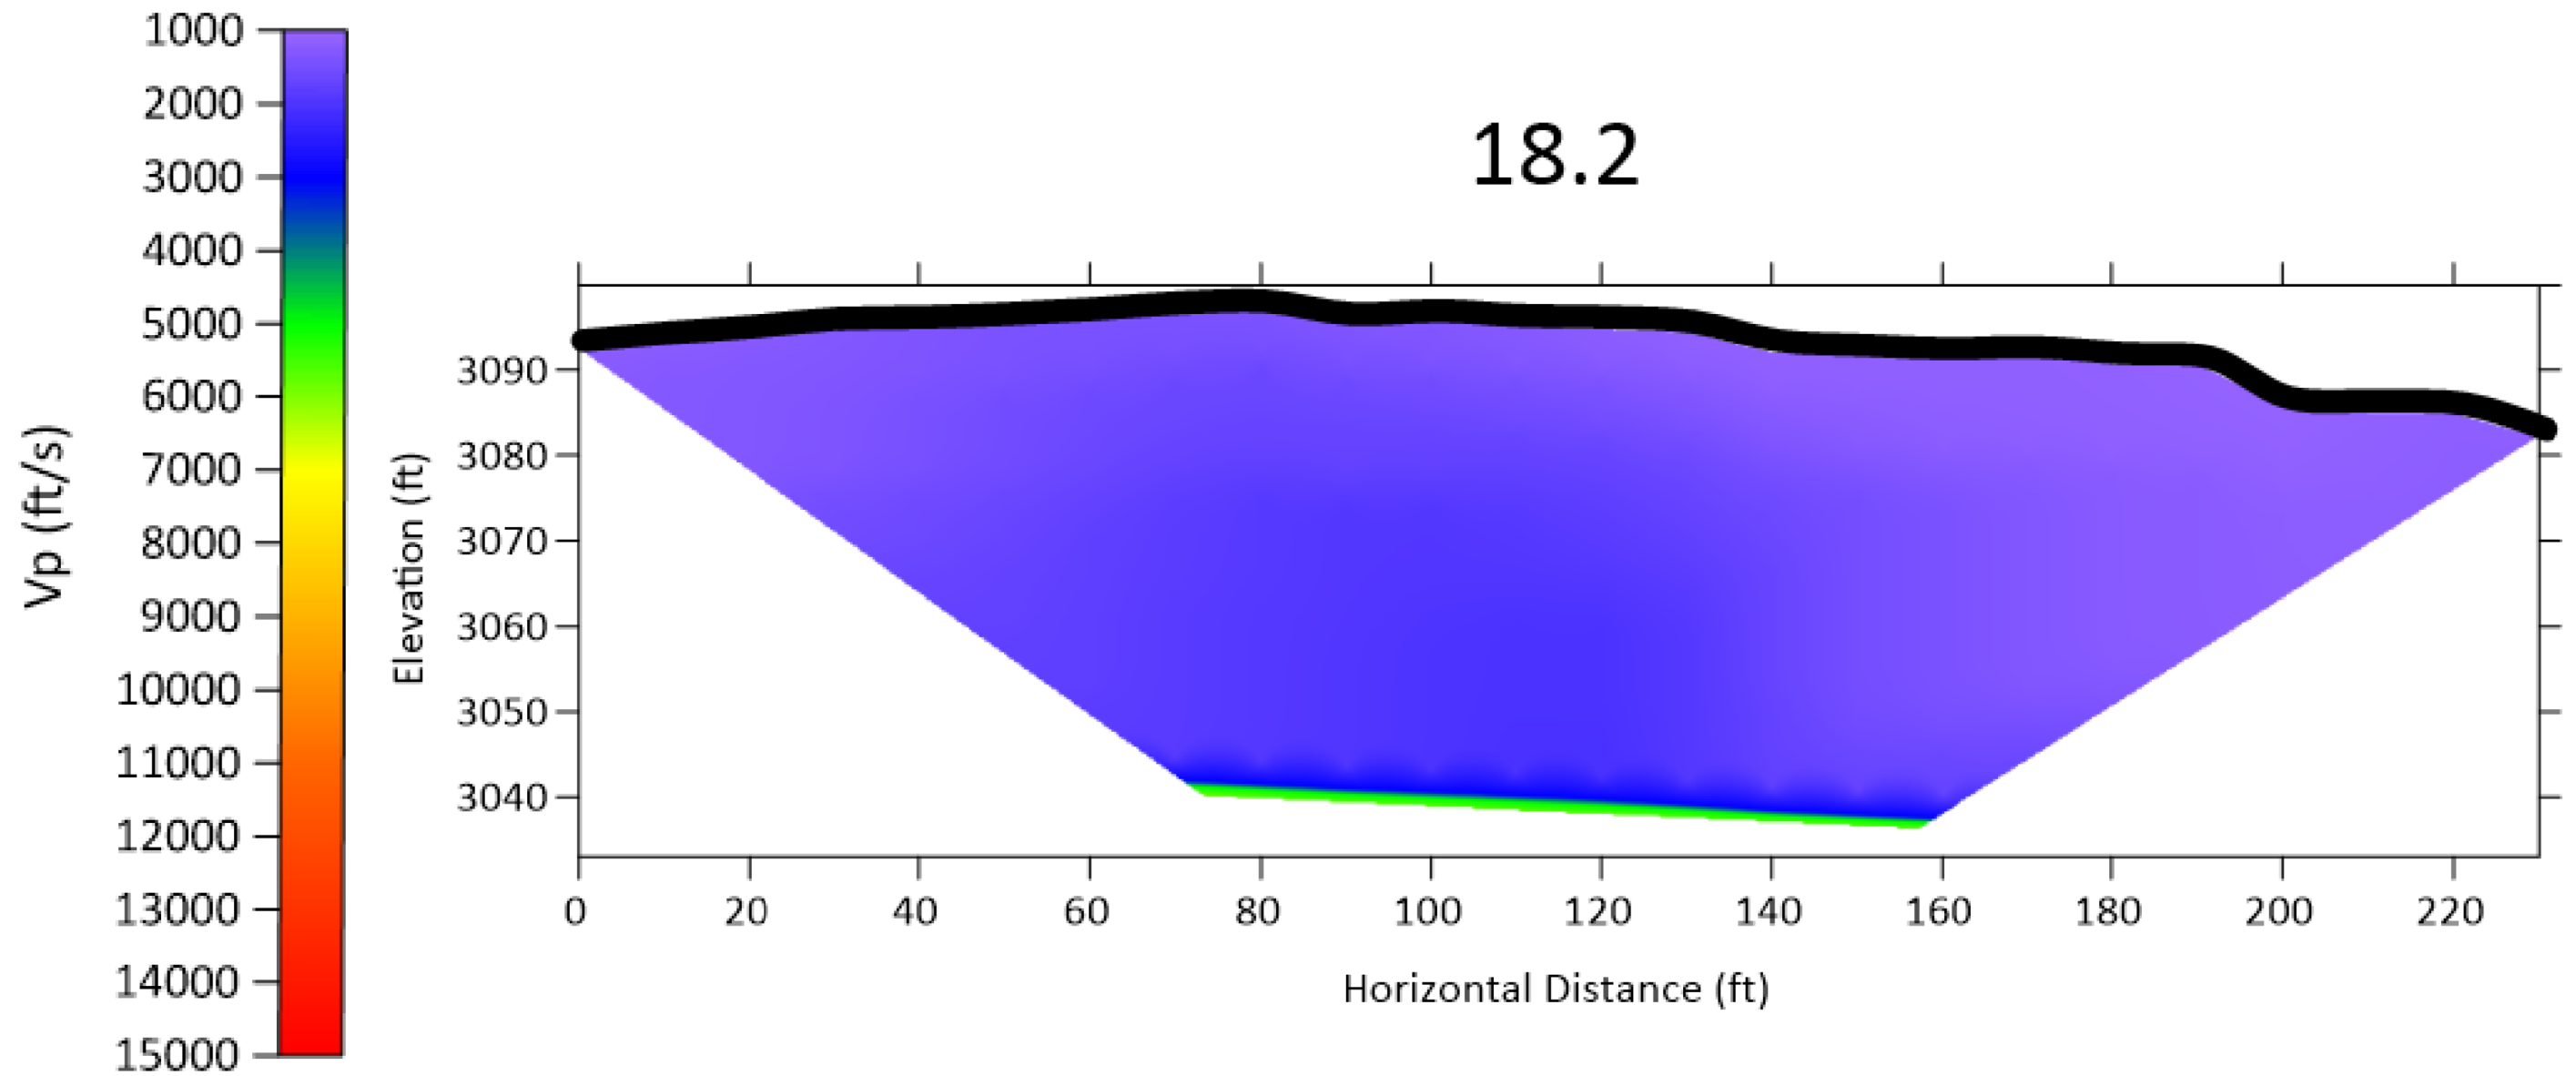


GEOPHYSICAL TESTING PERFORMED BY GEL SOLUTIONS. REFERENCE "SEISMIC REFRACTION SURVEY FOR EVALUATION OF ROCK" DATED 10/01/2021

CG2 ESTIMATED WAVE SPEED FOR WEATHERED ROCK: 4,500 FT/SEC

CG2 ESTIMATED WAVE SPEED FOR CRYSTALLINE ROCK: 7,500 FT/SEC

GEOPHYSICAL TEST RESULTS – SEISMIC REFRACTION LINE 19.1

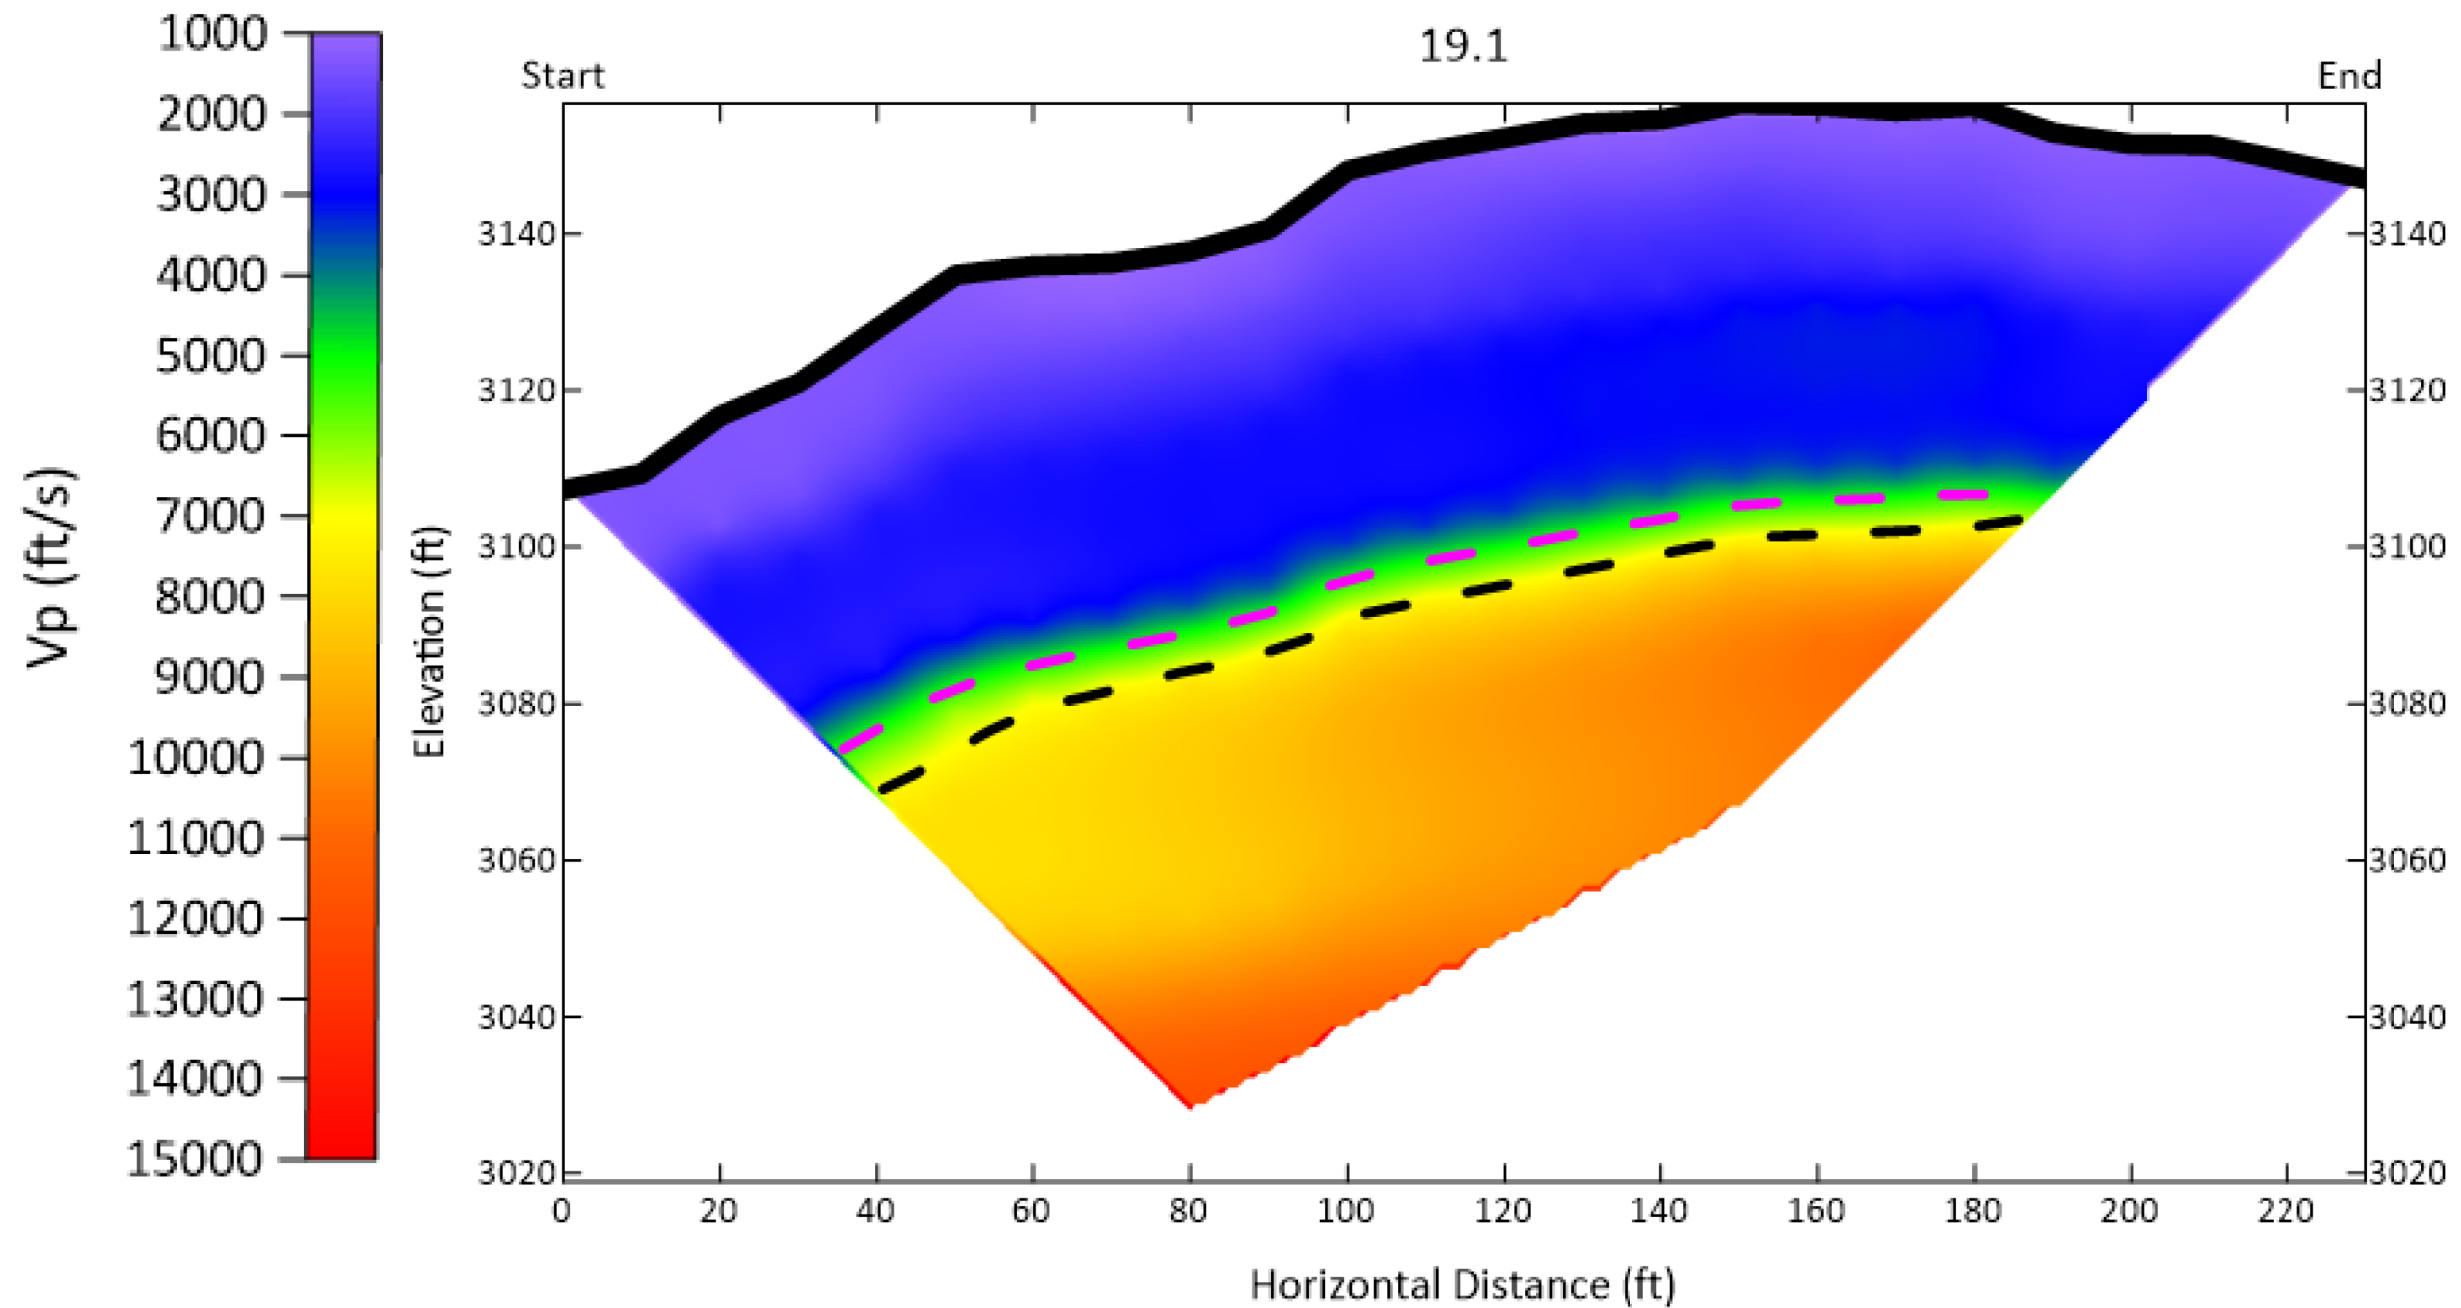

GEOPHYSICAL TESTING PERFORMED BY GEL SOLUTIONS. REFERENCE "SEISMIC REFRACTION SURVEY FOR EVALUATION OF ROCK" DATED 10/01/2021

CG2 ESTIMATED WAVE SPEED FOR WEATHERED ROCK: 4,500 FT/SEC

CG2 ESTIMATED WAVE SPEED FOR CRYSTALLINE ROCK: 7,500 FT/SEC