


HINDE ENGINEERING
 License No. C-2639
 401 Harrison Oaks Blvd., Suite 220 Cary, NC 27513

**DOCUMENT NOT CONSIDERED FINAL
 UNLESS ALL SIGNATURES COMPLETED**

PROJECT REFERENCE NO. Y-4810K	SHEET NO. UC-5
DESIGNED BY: JKC	
DRAWN BY: JNA	
CHECKED BY: JKC	
APPROVED BY: CLS	
REVISED:	
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151	
UTILITY CONSTRUCTION PLANS ONLY	

UTILITY CONSTRUCTION

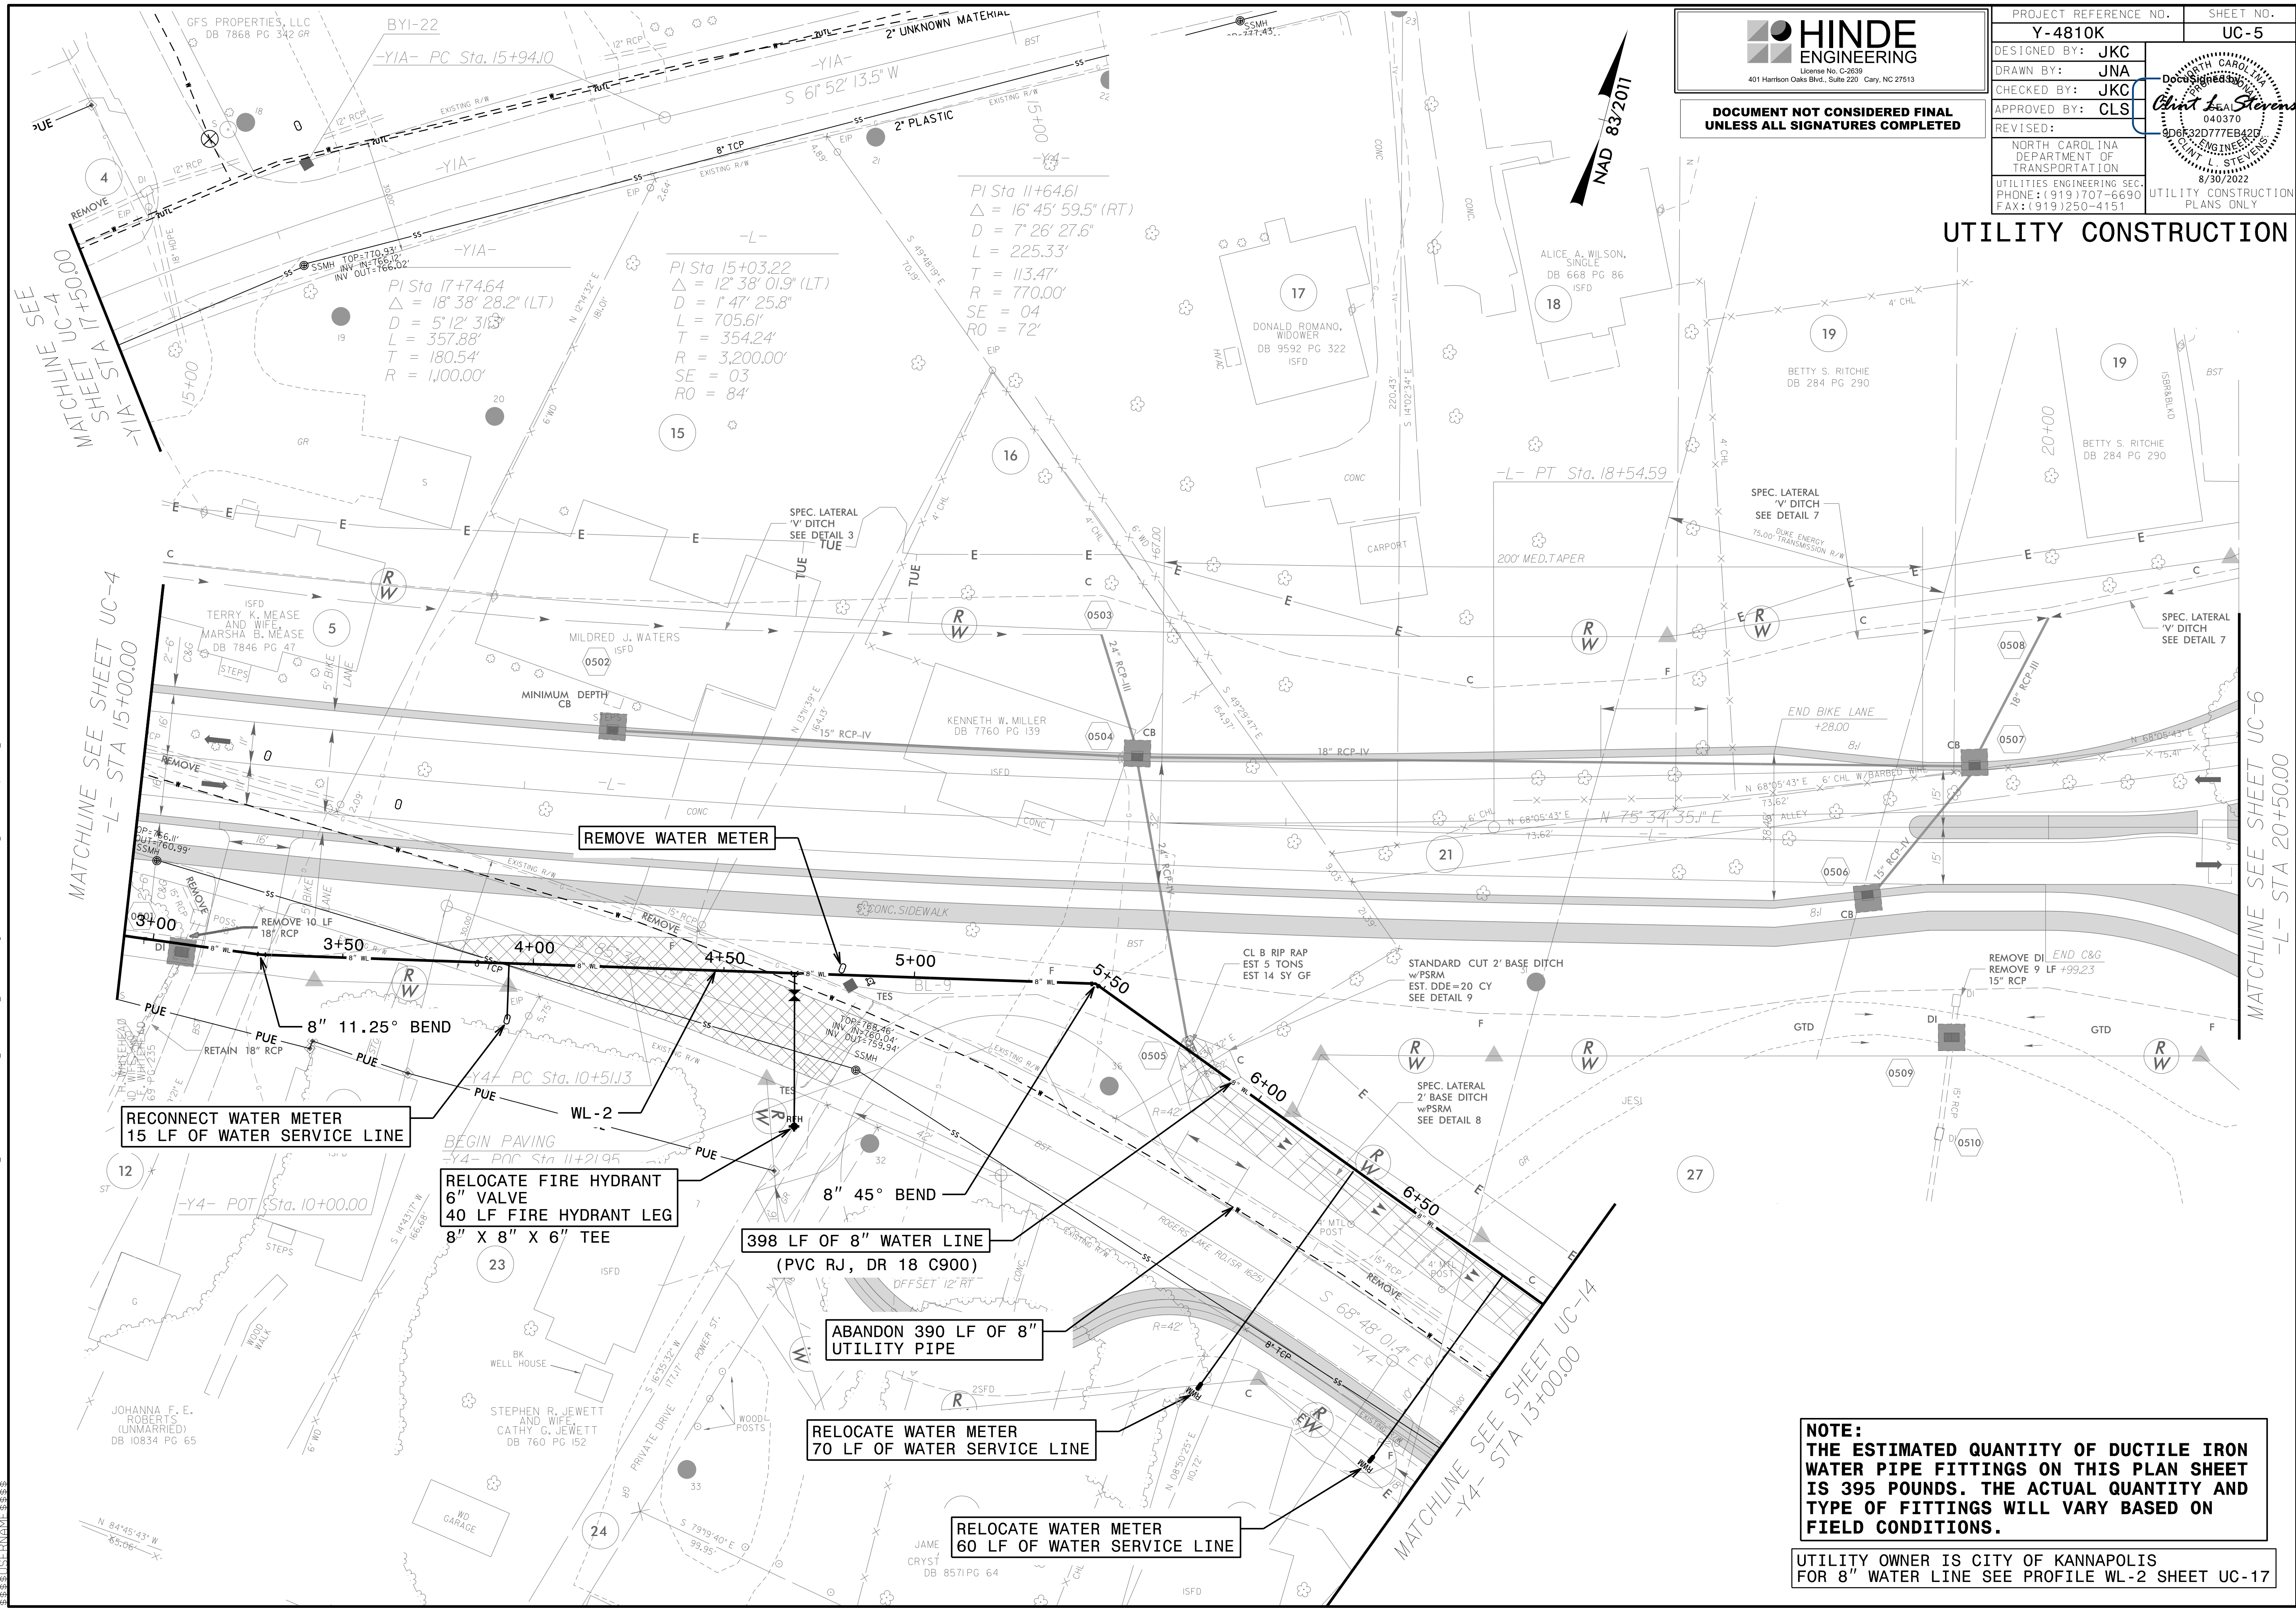

20 AUG 2022 12:52 PROJECTS\2017\A2017401.0000\NCDOT\Y-4810K\Design\Utilities\Engineering\UC-Proj\Y4810K-ut-rdy5_UC05_psh.dgn
 3:58:51 PM

- REMOVE WATER METER**
- RECONNECT WATER METER
15 LF OF WATER SERVICE LINE**
- RELOCATE FIRE HYDRANT
6" VALVE
40 LF FIRE HYDRANT LEG
8" X 8" X 6" TEE**
- 398 LF OF 8" WATER LINE
(PVC RJ, DR 18 C900)**
- ABANDON 390 LF OF 8" UTILITY PIPE**
- RELOCATE WATER METER
70 LF OF WATER SERVICE LINE**
- RELOCATE WATER METER
60 LF OF WATER SERVICE LINE**

NOTE:
 THE ESTIMATED QUANTITY OF DUCTILE IRON WATER PIPE FITTINGS ON THIS PLAN SHEET IS 395 POUNDS. THE ACTUAL QUANTITY AND TYPE OF FITTINGS WILL VARY BASED ON FIELD CONDITIONS.

UTILITY OWNER IS CITY OF KANNAPOLIS
 FOR 8" WATER LINE SEE PROFILE WL-2 SHEET UC-17