

HINDE ENGINEERING
 License No. C-2639
 401 Harrison Oaks Blvd., Suite 220 Cary, NC 27513


**DOCUMENT NOT CONSIDERED FINAL
 UNLESS ALL SIGNATURES COMPLETED**

| | |
|-----------------------------------------|--------------------------------------------------------------------------|
| PROJECT REFERENCE NO. Y-4810K | SHEET NO. UC-12 |
| DESIGNED BY: JKC | |
| DRAWN BY: JNA | |
| CHECKED BY: JKC | |
| APPROVED BY: CLS | |
| REVISED: | UTILITY ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151 |
| UTILITY CONSTRUCTION PLANS ONLY | |

UTILITY CONSTRUCTION

NOTE:
 THE ESTIMATED QUANTITY OF DUCTILE IRON WATER PIPE FITTINGS ON THIS PLAN SHEET IS 435 POUNDS. THE ACTUAL QUANTITY AND TYPE OF FITTINGS WILL VARY BASED ON FIELD CONDITIONS.

UTILITY OWNER IS CITY OF KANNAPOLIS
 FOR 8" WATER LINE SEE PROFILE WL-1B SHEET UC-20
 FOR 8" GRAVITY SEWER LINE SEE PROFILE SL-1 SHEET UC-24

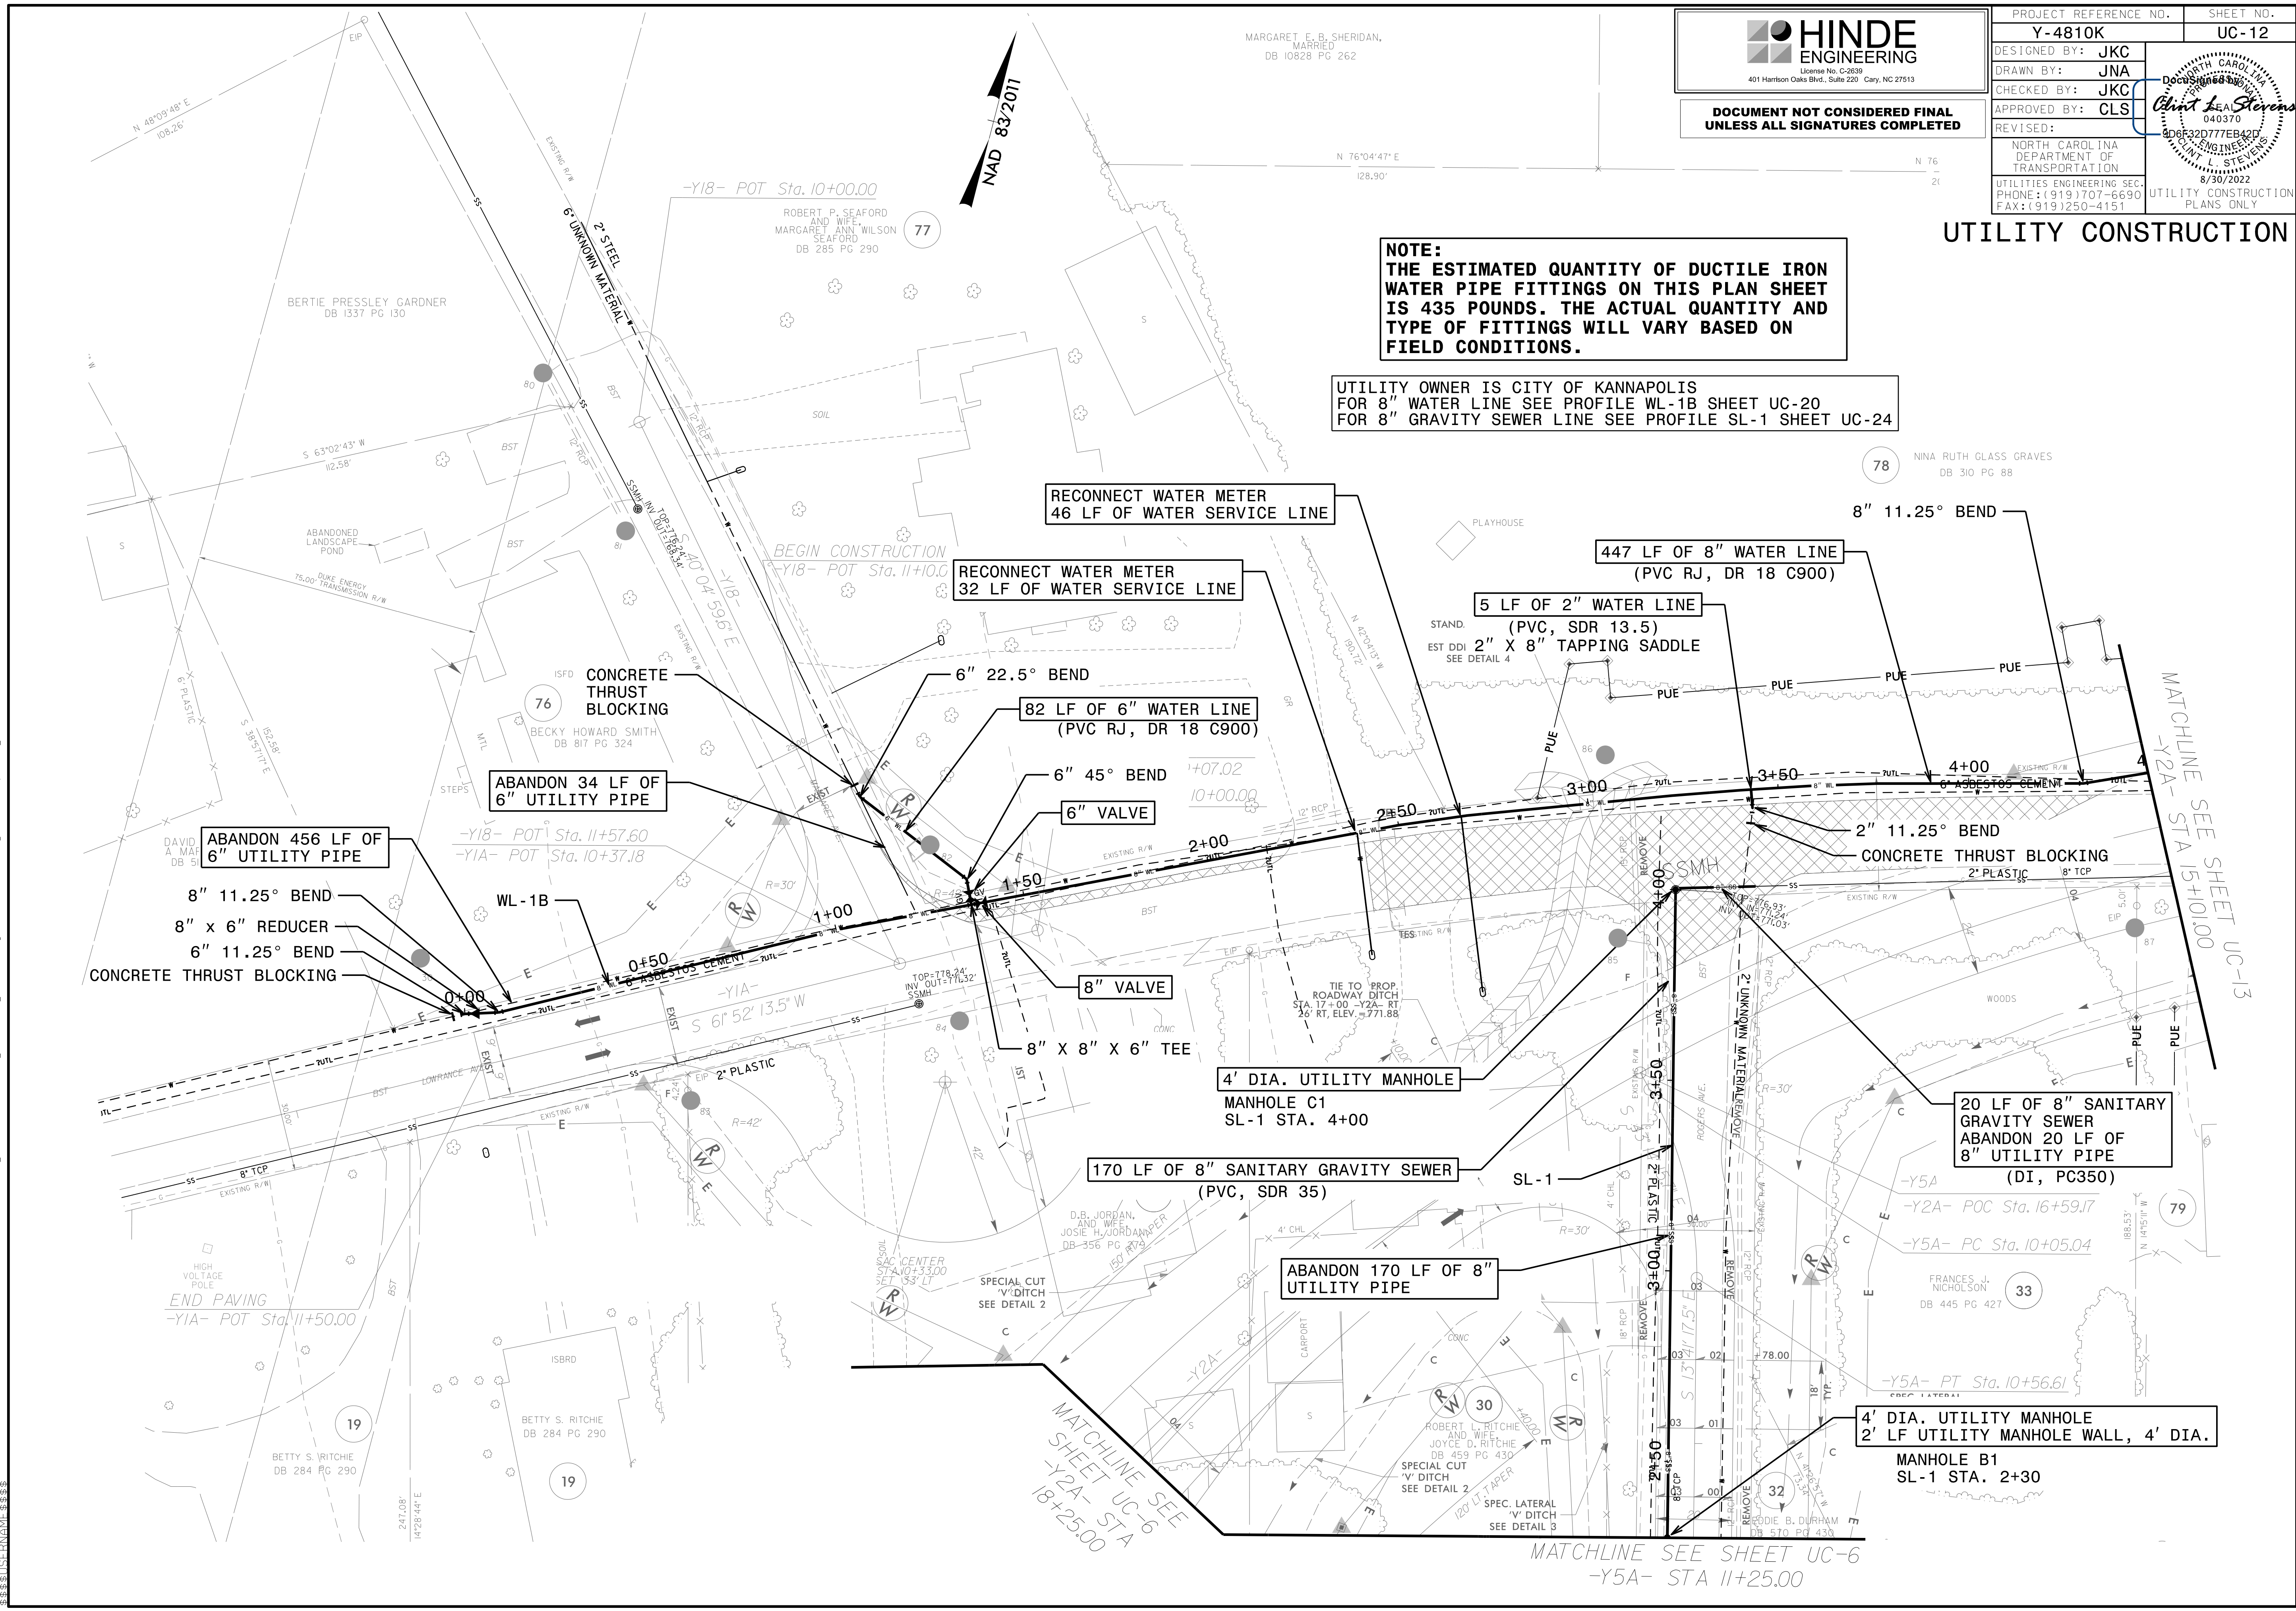

20-AUG-2022 12:53:33 PROJECTS\2017\A2017401.000\NCDOT_Y-4810K\Design\Utilities\Engineering\UC-Proj\Y4810K-ut_r-dj12_UC12_psh.dgn
 20-AUG-2022 12:53:33 PROJECTS\2017\A2017401.000\NCDOT_Y-4810K\Design\Utilities\Engineering\UC-Proj\Y4810K-ut_r-dj12_UC12_psh.dgn
 20-AUG-2022 12:53:33 PROJECTS\2017\A2017401.000\NCDOT_Y-4810K\Design\Utilities\Engineering\UC-Proj\Y4810K-ut_r-dj12_UC12_psh.dgn