DocuSign Envelope ID: FFF4C5B7-D33A-463E-8468-E6A8F76E950C

NOTES:

1. CONTRACTOR SHALL VERIFY THAT VALVE TO BE ABANDONED IS A BRANCH VALVE FOR 10" UTILITY PIPE TO BE ABANDONED AND NOT A LIVE VALVE FOR THE 12" WATERLINE TO REMAIN PRIOR TO ABANDONEMENT

NOTE:
THE ESTIMATED QUANTITY OF DUCTILE IRON WATER PIPE FITTINGS ON THIS PLAN SHEET IS 1,580 POUNDS. THE ACTUAL QUANTITY AND TYPE OF FITTINGS WILL VARY BASED ON FIELD CONDITIONS.

Kimley»Horn ©2020
421 FAYETTEVILLE STREET, SUITE 600
RALEIGH, NC 27601

RIGHT-OF-WAY REV.
CONST. REV.

PROJECT REFERENCE NO.	SHEET NO.
U-5724	UC-10

UTILITY DESIGN ENGINEER

NORTH CAROLINA PROFESSIONAL ENGINEER SEAL 045249 NATHANIEL L. HARVEY
Signed by: Nathaniel L. Harvey
3/16/2020

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

NAD 83/NSRS 2011
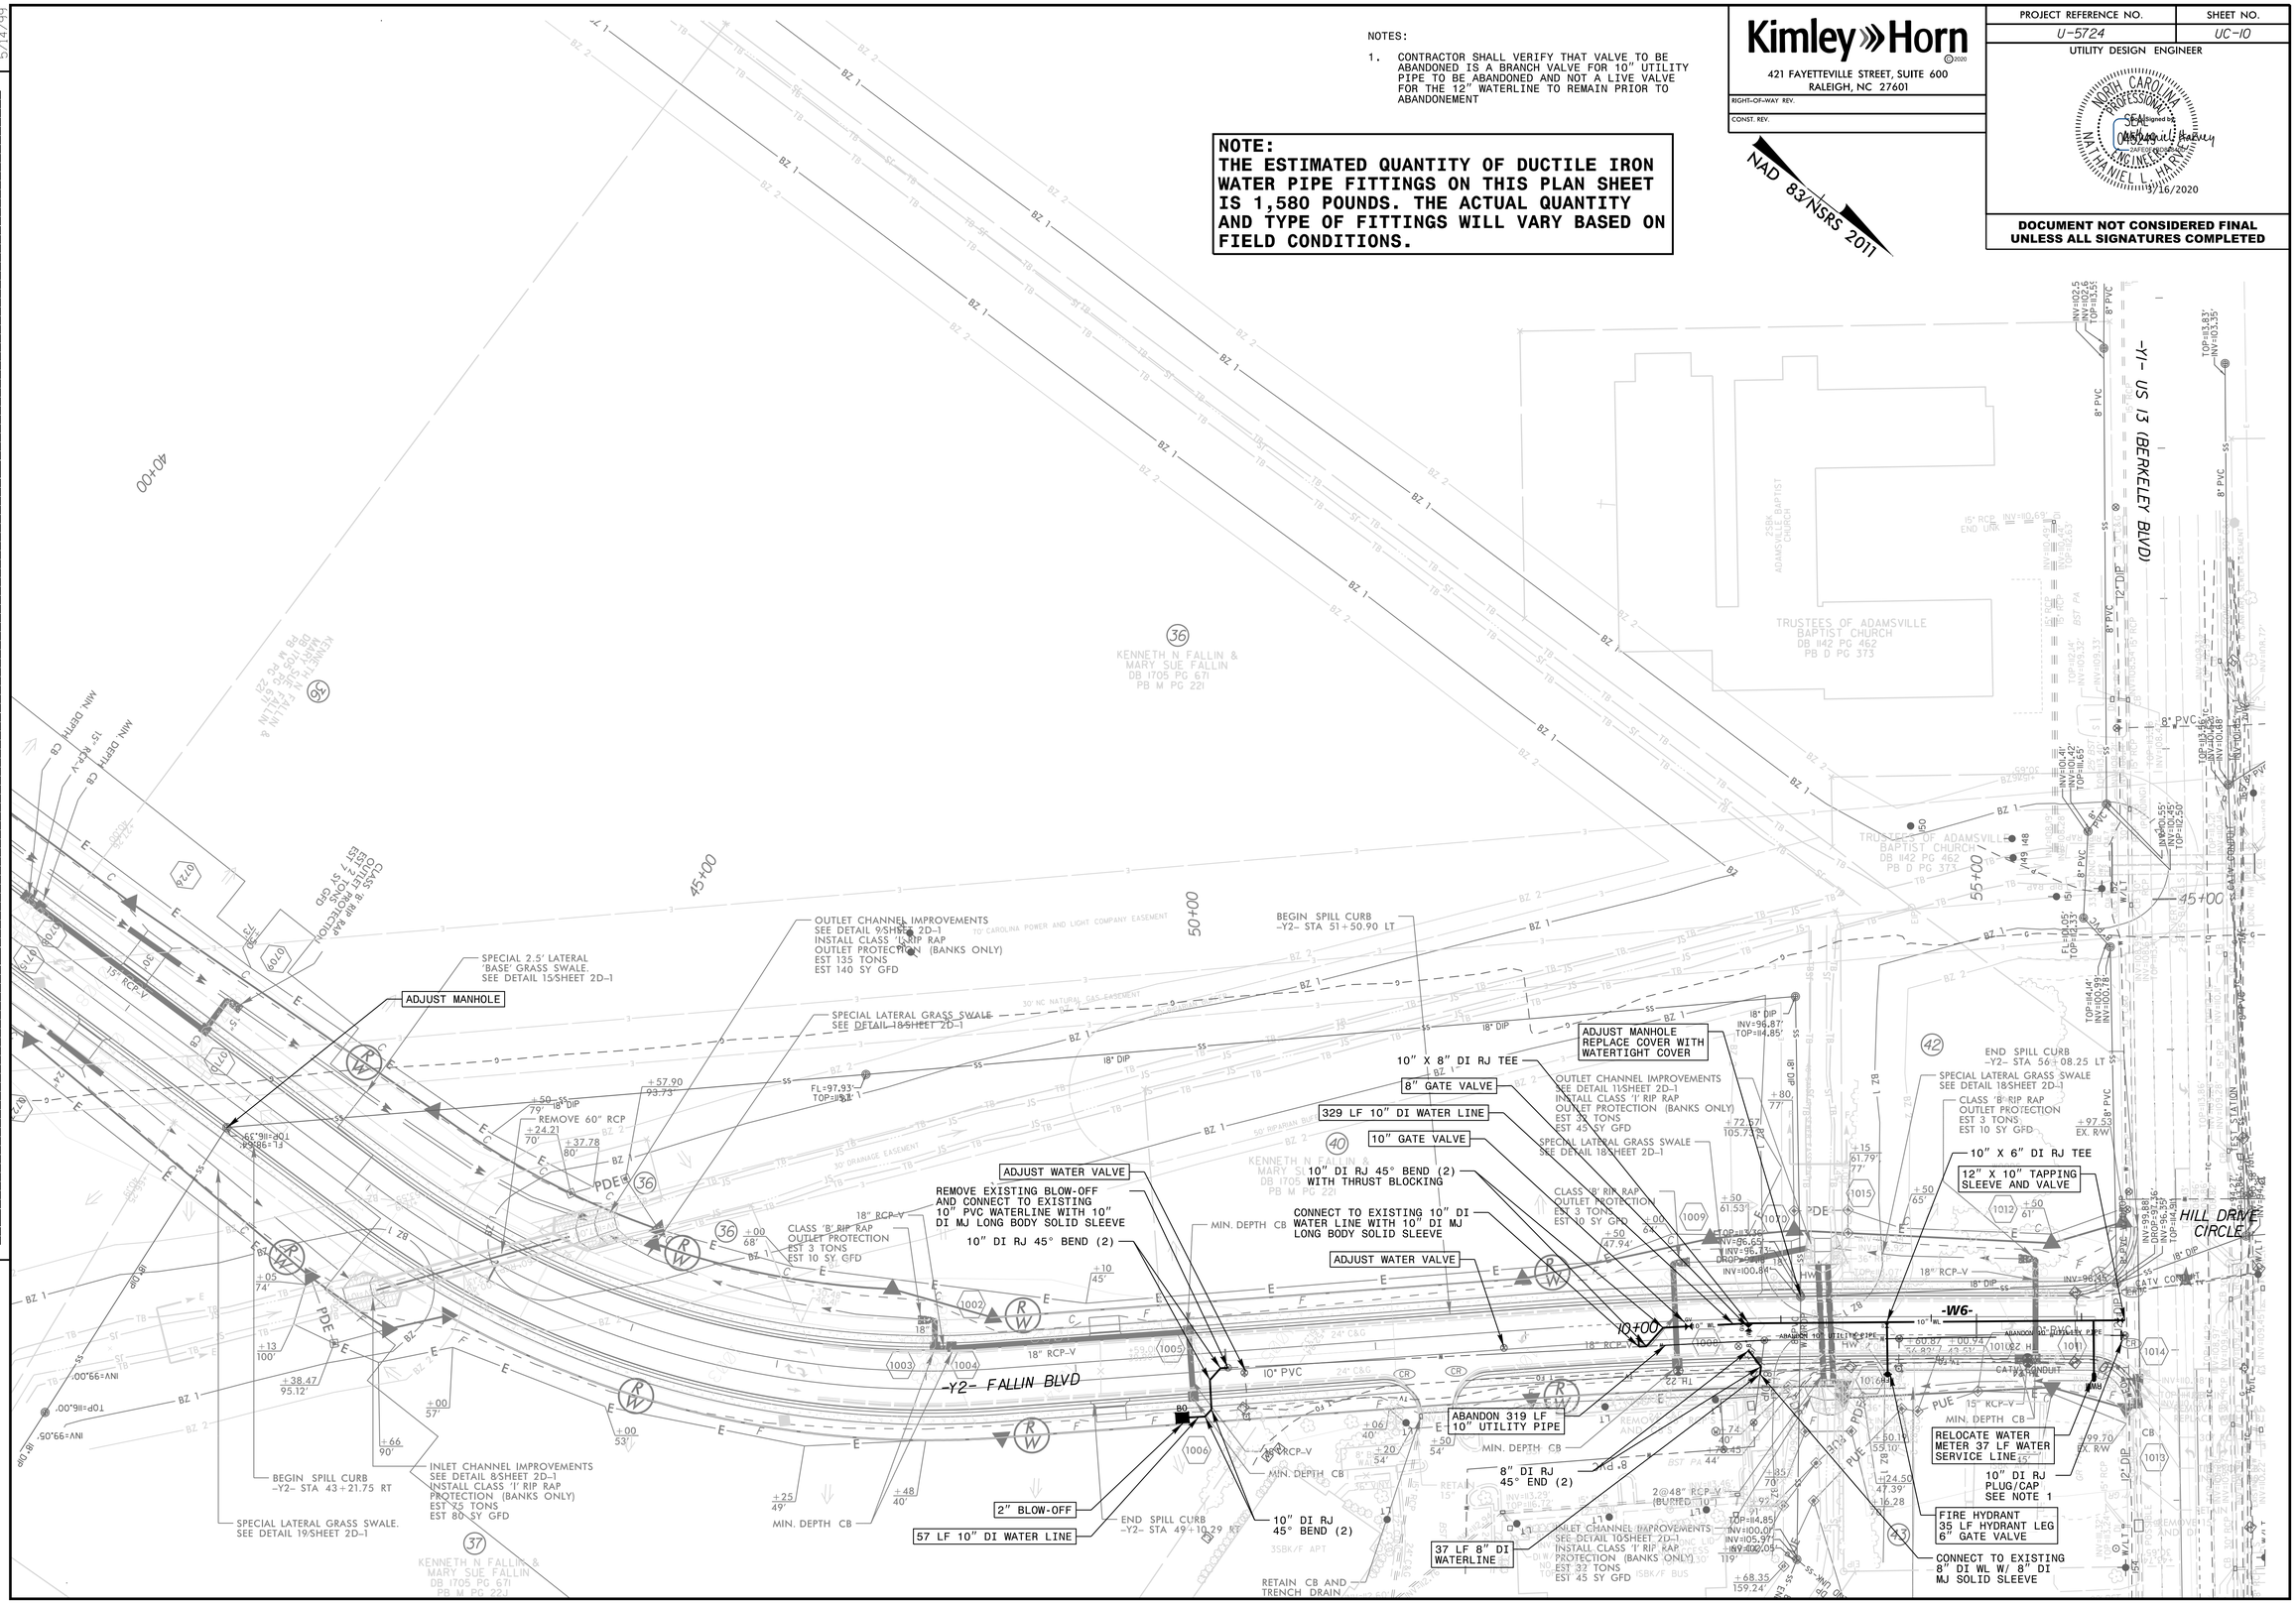
REVISIONS