

**This electronic collection of documents is provided
for the convenience of the user
and is Not a Certified Document –**

**The documents contained herein were originally issued
and sealed by the individuals whose names and license
numbers appear on each page, on the dates appearing
with their signature on that page.**


**This file or an individual page
shall not be considered a certified document.**

09/08/2022

PROJECT: B-5652

CONTRACT: C204477

See Sheet 1A For Index of Sheets
See Sheet 1B For Conventional Symbols

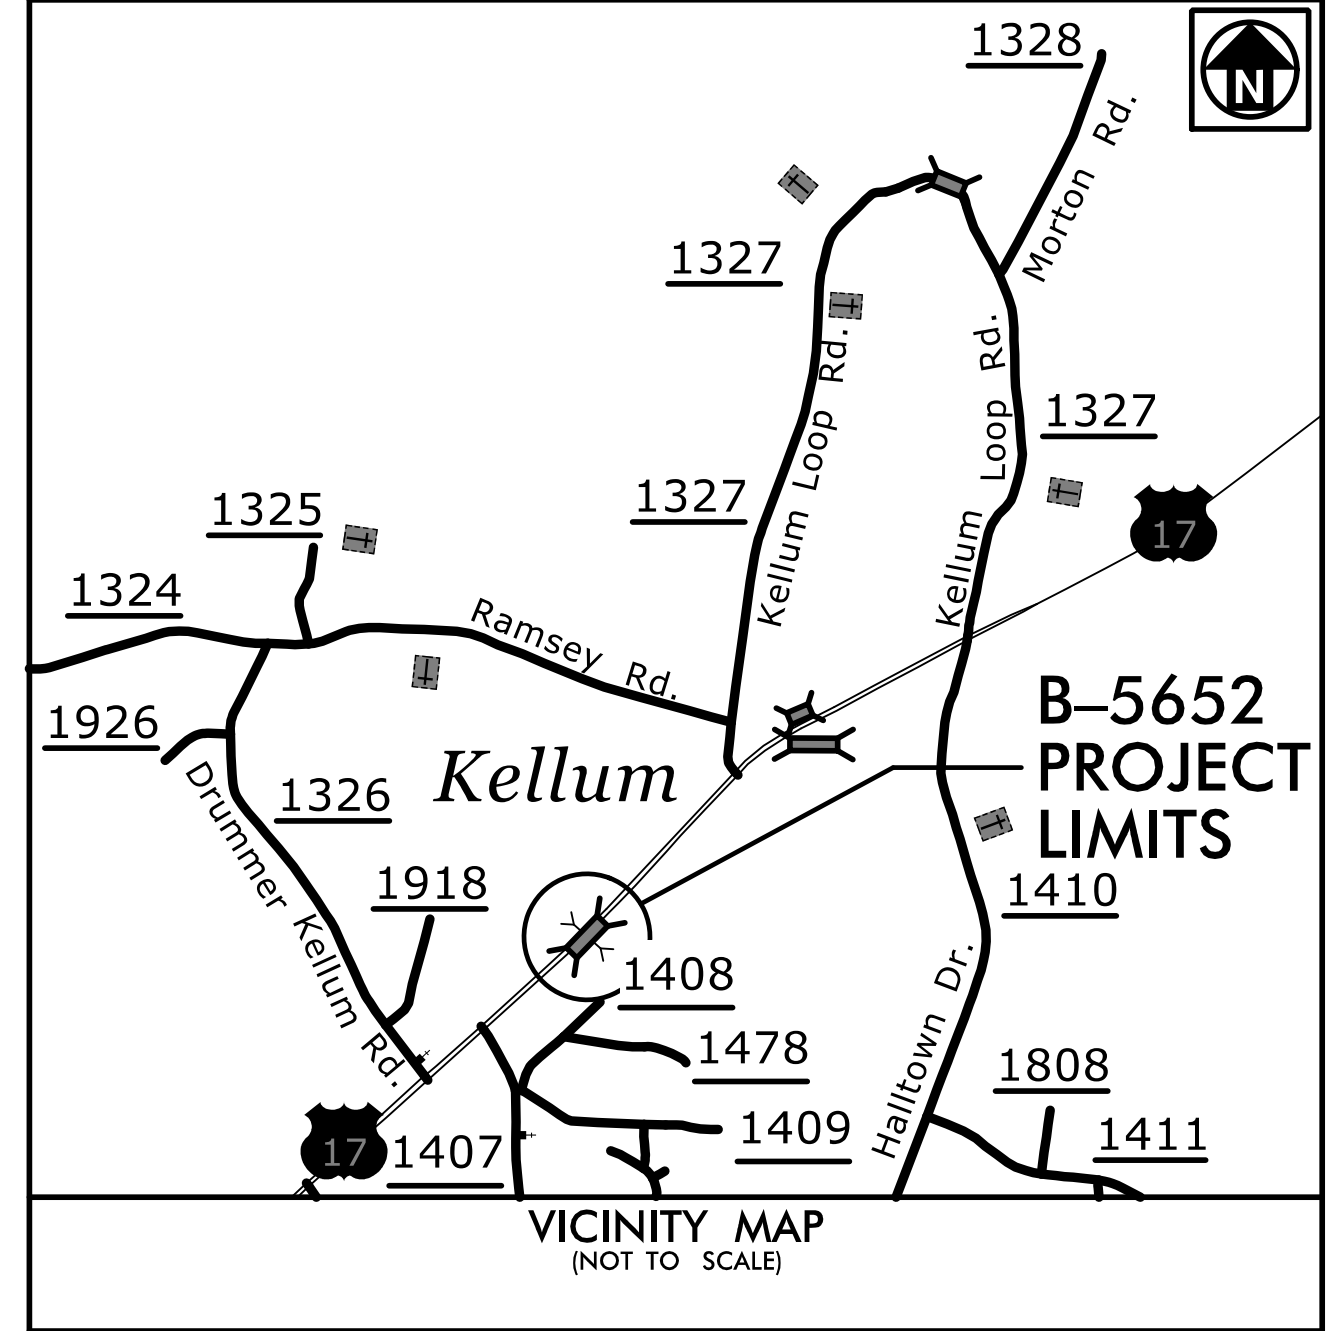

STATE OF NORTH CAROLINA
DIVISION OF HIGHWAYS



ONSLOW COUNTY

LOCATION: BRIDGE NO. 33 OVER WOLF SWAMP
ON US 17

TYPE OF WORK: GRADING, PAVING, DRAINAGE AND STRUCTURE

STRUCTURE PLANS

STATE	STATE PROJECT REFERENCE NO.	SHEET NO.	TOTAL SHEETS
N.C.	B-5652	1	26
STATE PROJ. NO.	F.A. PROJ. NO.	DESCRIPTION	
45607.1.1		P.E.	
45607.2.1		RW, UTL	
45607.3.1		CONST.	

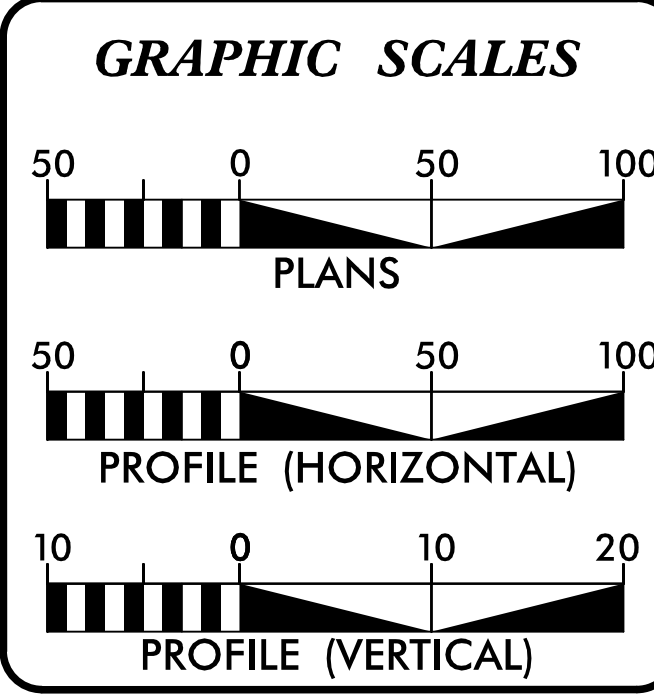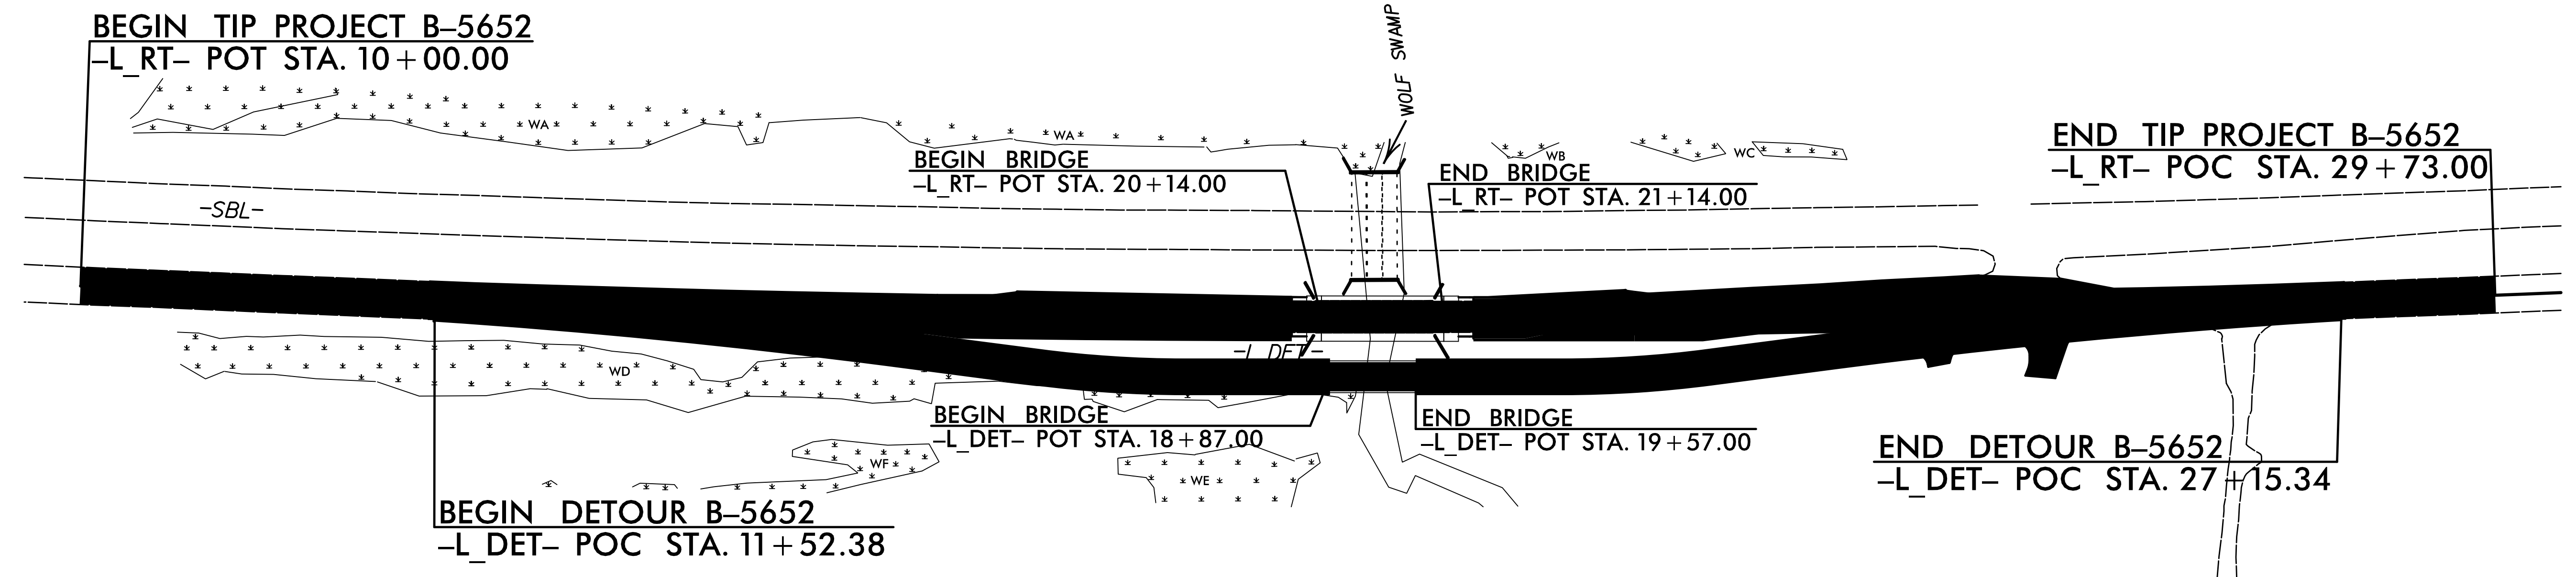

DESIGN DATA

ADT 2022 =	16,900
ADT 2040 =	22,300
K =	9 %
D =	55 %
T =	5 %*
V =	60 MPH
* TTST =	2% DUAL 3%
STATEWIDE TIER	
FUNCTIONAL CLASS	ARTERIAL

PROJECT LENGTH

LENGTH ROADWAY TIP PROJECT	=	0.355 MILES
LENGTH STRUCTURE TIP PROJECT	=	0.019 MILES
TOTAL LENGTH TIP PROJECT	=	0.374 MILES

PLANS PREPARED FOR NCDOT BY:

M M
MOTT MACDONALD
Fuquay-Varina, NC 27526
(919) 552-2253
(919) 552-2254 (Fax)
www.mottmac.com/americas
LICENSE NO. F-0669

SUNGATE DESIGN GROUP, P.A.
905 JONES FRANKLIN ROAD
RALEIGH, NORTH CAROLINA 27608
TEL (919) 855-2245
ENG FIRM LICENSE NO. C-4890

2018 STANDARD SPECIFICATIONS

RIGHT OF WAY DATE:
NOVEMBER 22, 2021

LETTING DATE:
DECEMBER 20, 2022

MICHAEL PEKAREK, PE
PROJECT ENGINEER
PEF ENGINEER

JOSH DALTON, PE
HYDRAULIC ENGINEER
PEF ENGINEER

DAVID STUTTS, PE
NCDOT BRIDGE PROGRAM MANAGER

ENGINEER

9/14/2022 | 5:22 AM PDT

DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED


PLANS PREPARED BY:

5640 Dillard Drive, Suite 200
Cary, NC 27518

LICENSURE NO. C-4434

\$\$\$ SYSTEM \$\$\$
\$\$\$ DGN \$\$\$
\$\$\$ USERNAME \$\$\$


9/14/2022 8:05:52 AM P:\ Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401_B5652-SMU_CD_660033.dgn

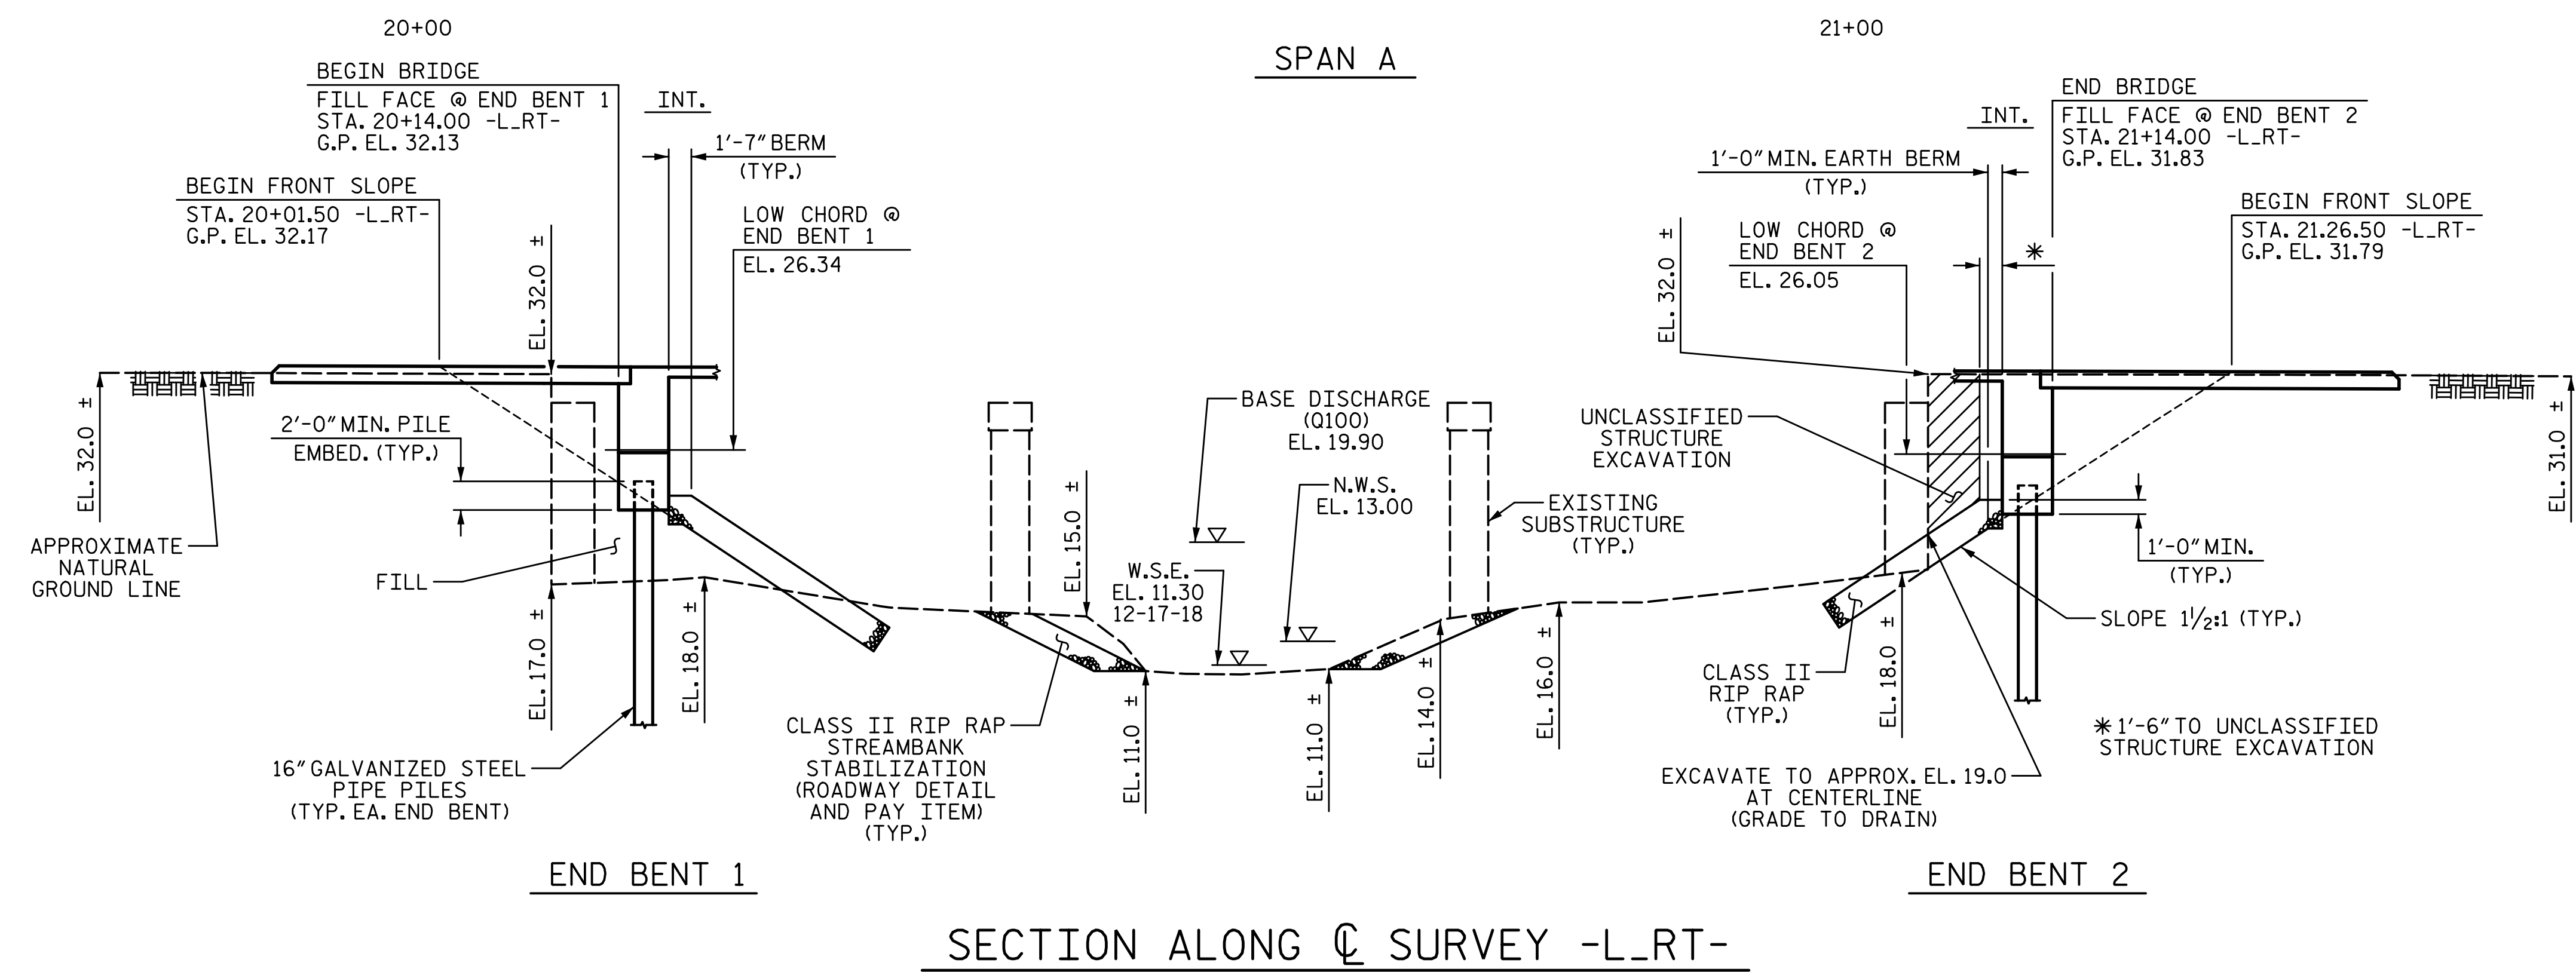

(+).0.8375%	(-).0.3042%
PVI STA. 19+10.00 EL. = 32.45 VC = 190'	
GRADE DATA -L-RT-	

HYDRAULIC DATA:	
DESIGN DISCHARGE	= 1403 CFS
FREQUENCY OF DESIGN FLOOD	= 50 YEAR
DESIGN HIGH WATER ELEVATION	= 19.3
DRAINAGE AREA	= 5.26 SQ. MI.
BASE DISCHARGE (Q 100)	= 1849 CFS
BASE HIGH WATER ELEVATION	= 19.9
OVERTOPPING FLOOD DATA:	
OVERTOPPING DISCHARGE	= >3280 CFS
FREQUENCY OF OVERTOPPING FLOOD	= >500 YEAR
OVERTOPPING FLOOD ELEVATION	= 30.6 **
** OVERTOPPING OCCURS AT CENTERLINE AT STA. 23+15.00 -L-RT-	

HORIZONTAL CURVE DATA	
PI STA. 16+30.02 -L-RT-	
$\Delta = 2^{\circ}-08'-27.3"$ (LT.)	
$D = 0^{\circ}-18'-05.6"$	
$L = 709.96'$	
$T = 355.02'$	
$R = 19000.00'$	
PI STA. 22+54.50 -L-RT-	
$\Delta = 1^{\circ}-07'-55.5"$ (LT.)	
$D = 0^{\circ}-28'-24.7"$	
$L = 239.08'$	
$T = 119.54'$	
$R = 12100.00'$	

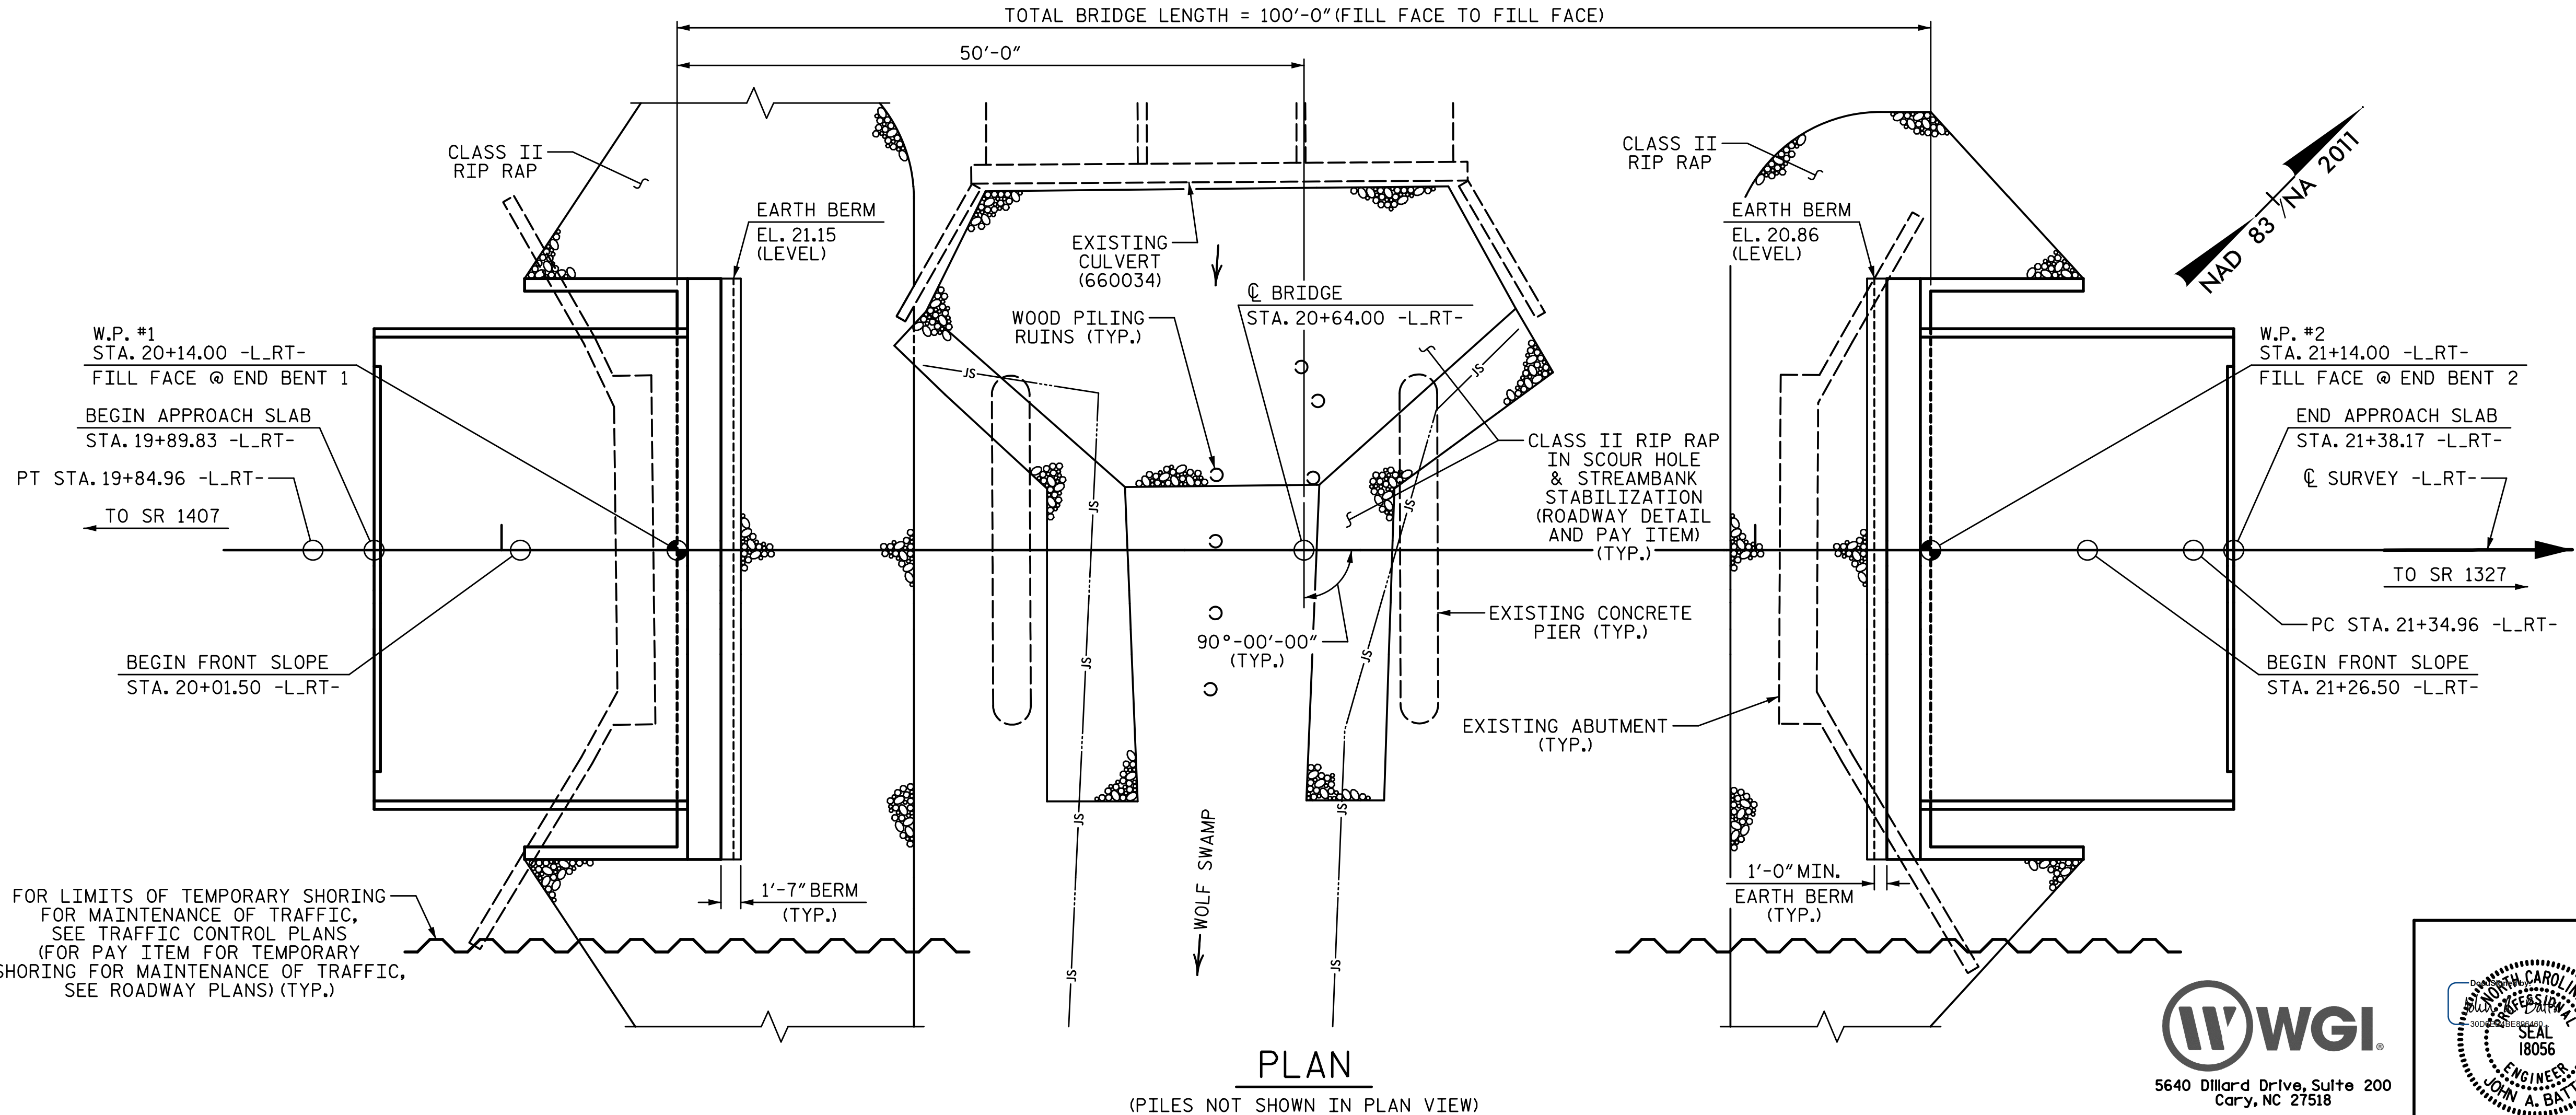


I HEREBY CERTIFY THESE PLANS ARE THE AS-BUILT PLANS

PROJECT NO. B-5652
 ONSLOW COUNTY
 STATION: 20+64.00 -L-RT-

SHEET 1 OF 4 REPLACES BRIDGE #660033

STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH

GENERAL DRAWING
 FOR BRIDGE ON US 17 NB
 OVER WOLF SWAMP
 BETWEEN SR 1407 AND SR 1327

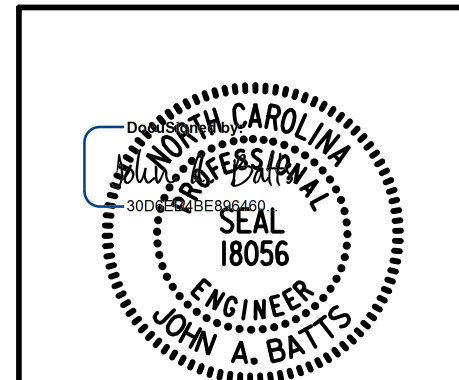


DRAWN BY: T. BANKOVICH	DATE: 5-22
CHECKED BY: J.A. BATTS	DATE: 5-22
DESIGN ENGINEER OF RECORD: J.A. BATTS	DATE: 5-22

REVISIONS						SHEET NO.
NO.	BY:	DATE:	NO.	BY:	DATE:	S-2
1			3			TOTAL SHEETS
2			4			26

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

9/14/2022 8:05:52 AM P:\Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401_B5652_SMU_FL_660033.dgn

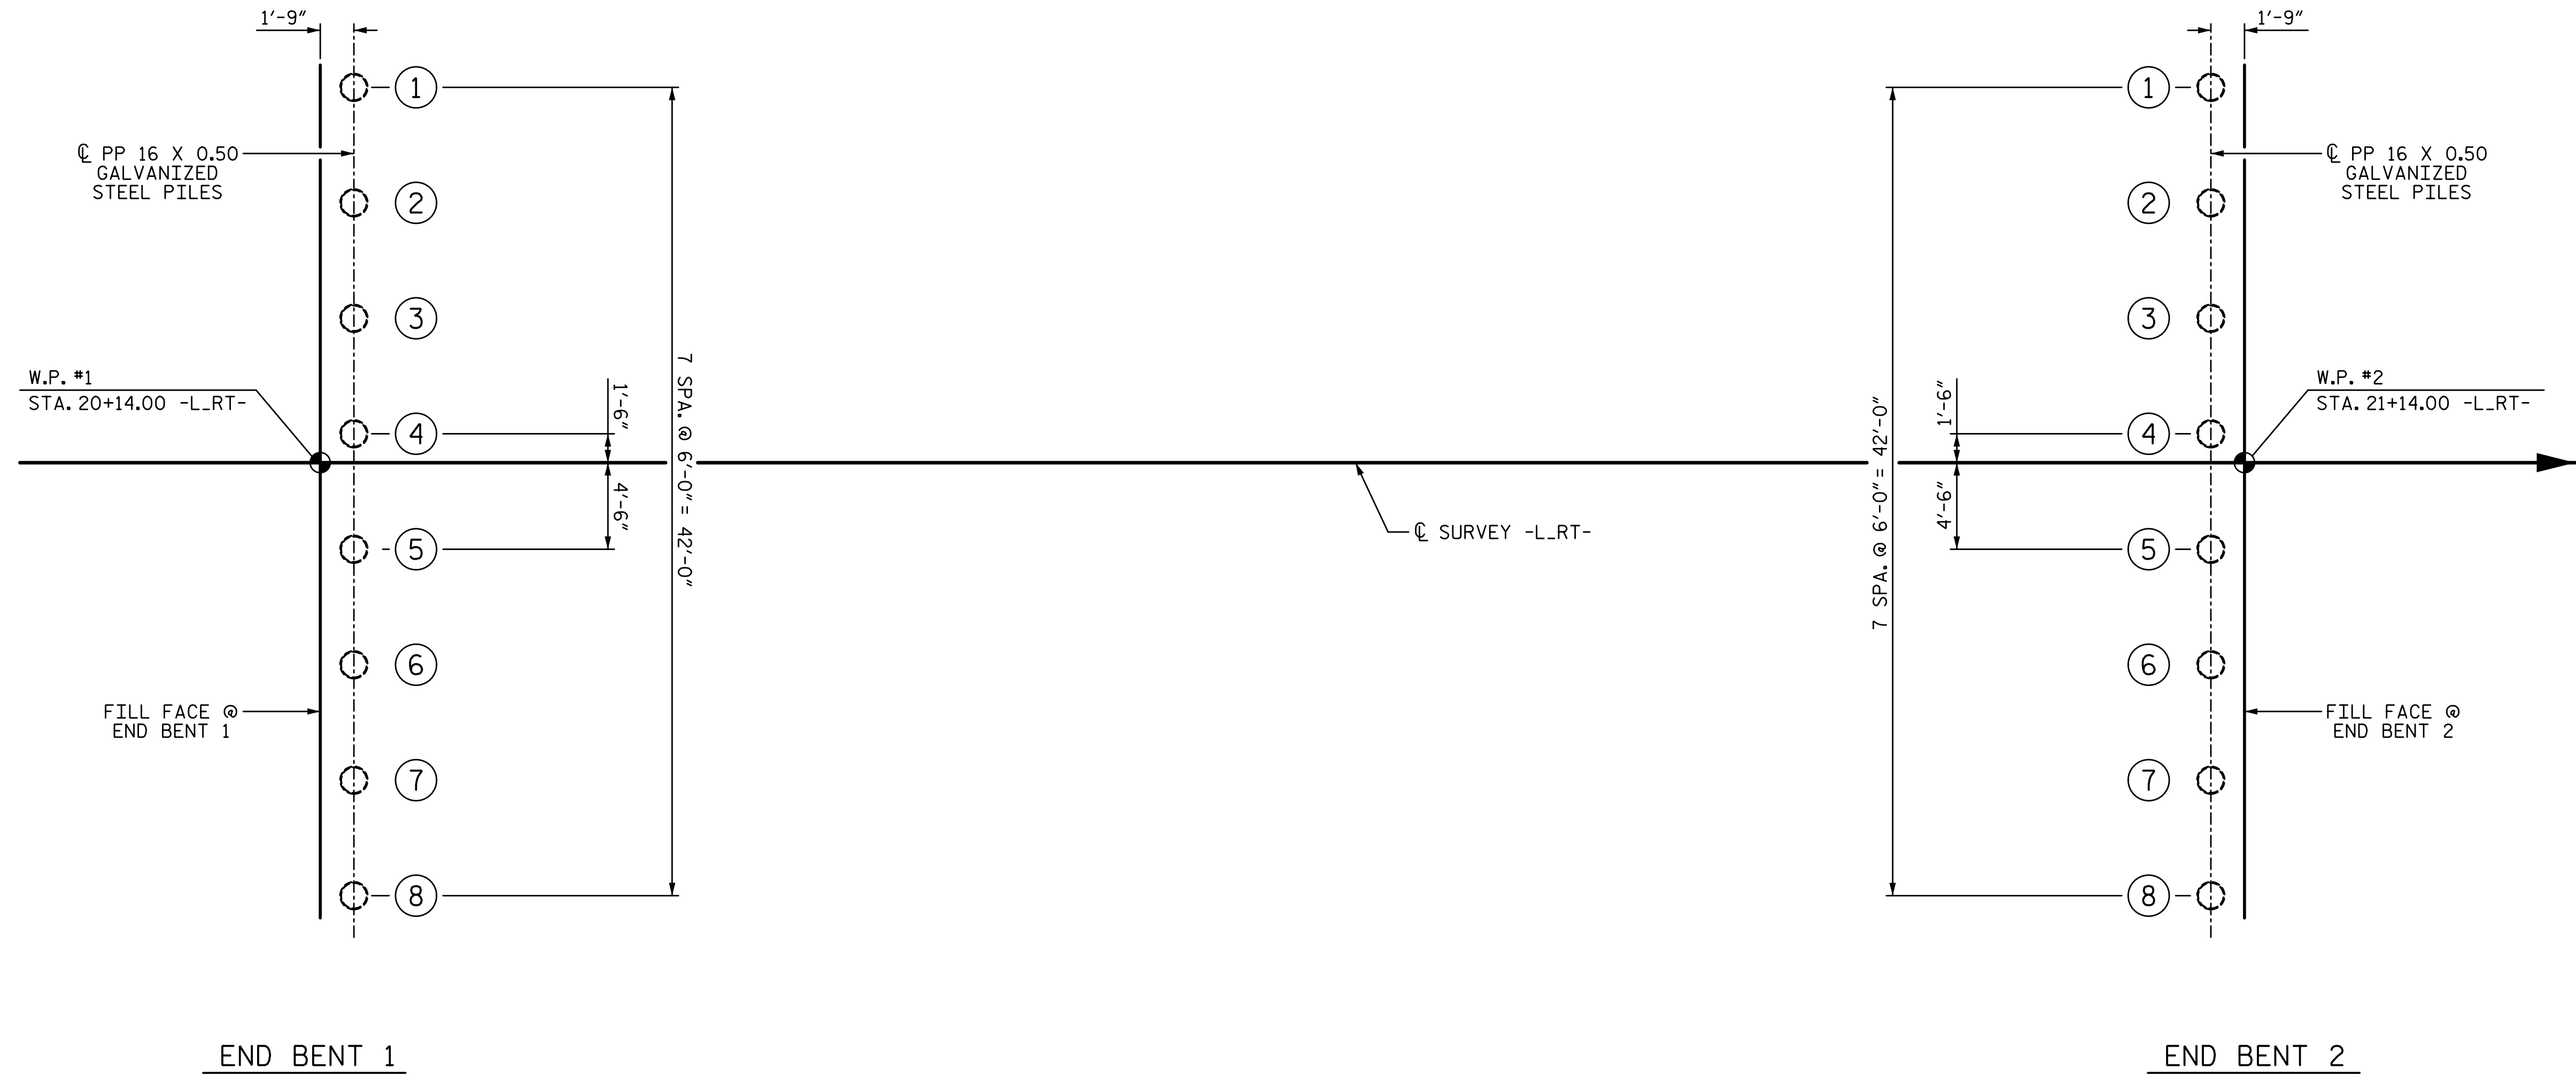

FOUNDATION LAYOUT

(ALL PILES ARE PP 16 X 0.50 GALVANIZED STEEL PILES)
(DIMENSIONS LOCATING PILES ARE SHOWN TO THE CENTERLINE OF PILES)

FOUNDATION NOTES:


- FOR PILES, SEE SECTION 450 OF THE STANDARD SPECIFICATIONS.
- PILES AT END BENT 1 ARE DESIGNED FOR A FACTORED RESISTANCE OF 110 TONS PER PILE.
- DRIVE PILES AT END BENT 1 TO A REQUIRED DRIVING RESISTANCE OF 185 TONS PER PILE.
- PIPE PILE PLATES ARE REQUIRED FOR STEEL PIPE PILES AT END BENT 1. USE PIPE PILE PLATES WITH A DIAMETER EQUAL TO THE PIPE PILE DIAMETER. FOR STEEL PIPE PILE PLATES, SEE SECTION 450 OF THE STANDARD SPECIFICATIONS.
- PILES AT END BENT 2 ARE DESIGNED FOR A FACTORED RESISTANCE OF 110 TONS PER PILE.
- DRIVE PILES AT END BENT 2 TO A REQUIRED DRIVING RESISTANCE OF 185 TONS PER PILE.
- PIPE PILE PLATES ARE REQUIRED FOR STEEL PIPE PILES AT END BENT 2. USE PIPE PILE PLATES WITH A DIAMETER EQUAL TO THE PIPE PILE DIAMETER. FOR STEEL PIPE PILE PLATES, SEE SECTION 450 OF THE STANDARD SPECIFICATIONS.
- TESTING PILES WITH THE PDA DURING DRIVING, RESTRIKING OR REDRIVING MAY BE REQUIRED. THE ENGINEER WILL DETERMINE THE NEED FOR PDA TESTING. FOR PDA TESTING, SEE SECTION 450 OF THE STANDARD SPECIFICATIONS.

PROJECT NO. B-5652
ONLOW COUNTY
 STATION: 20+64.00 -L-RT-

SHEET 2 OF 4

STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH

GENERAL DRAWING
 FOR BRIDGE ON US 17 NB
 OVER WOLF SWAMP
 BETWEEN SR 1407 AND SR 1327

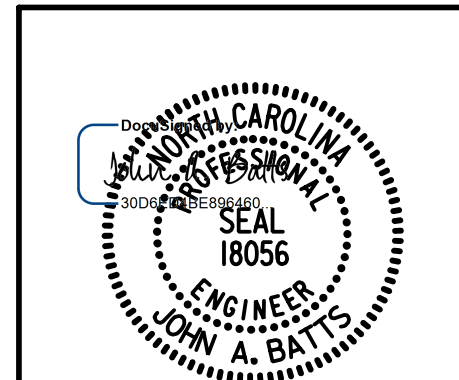


DRAWN BY: S.D. COOPER	DATE: 5-22
CHECKED BY: J.A. BATTS	DATE: 5-22
DESIGN ENGINEER OF RECORD: J.A. BATTS	DATE: 5-22

REVISIONS						SHEET NO.
NO.	BY:	DATE:	NO.	BY:	DATE:	S-3
1			3			TOTAL SHEETS
2			4			26

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

9/14/2022 8:05:53 AM P:\Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401_B5652-SMU_CD_660033.dgn

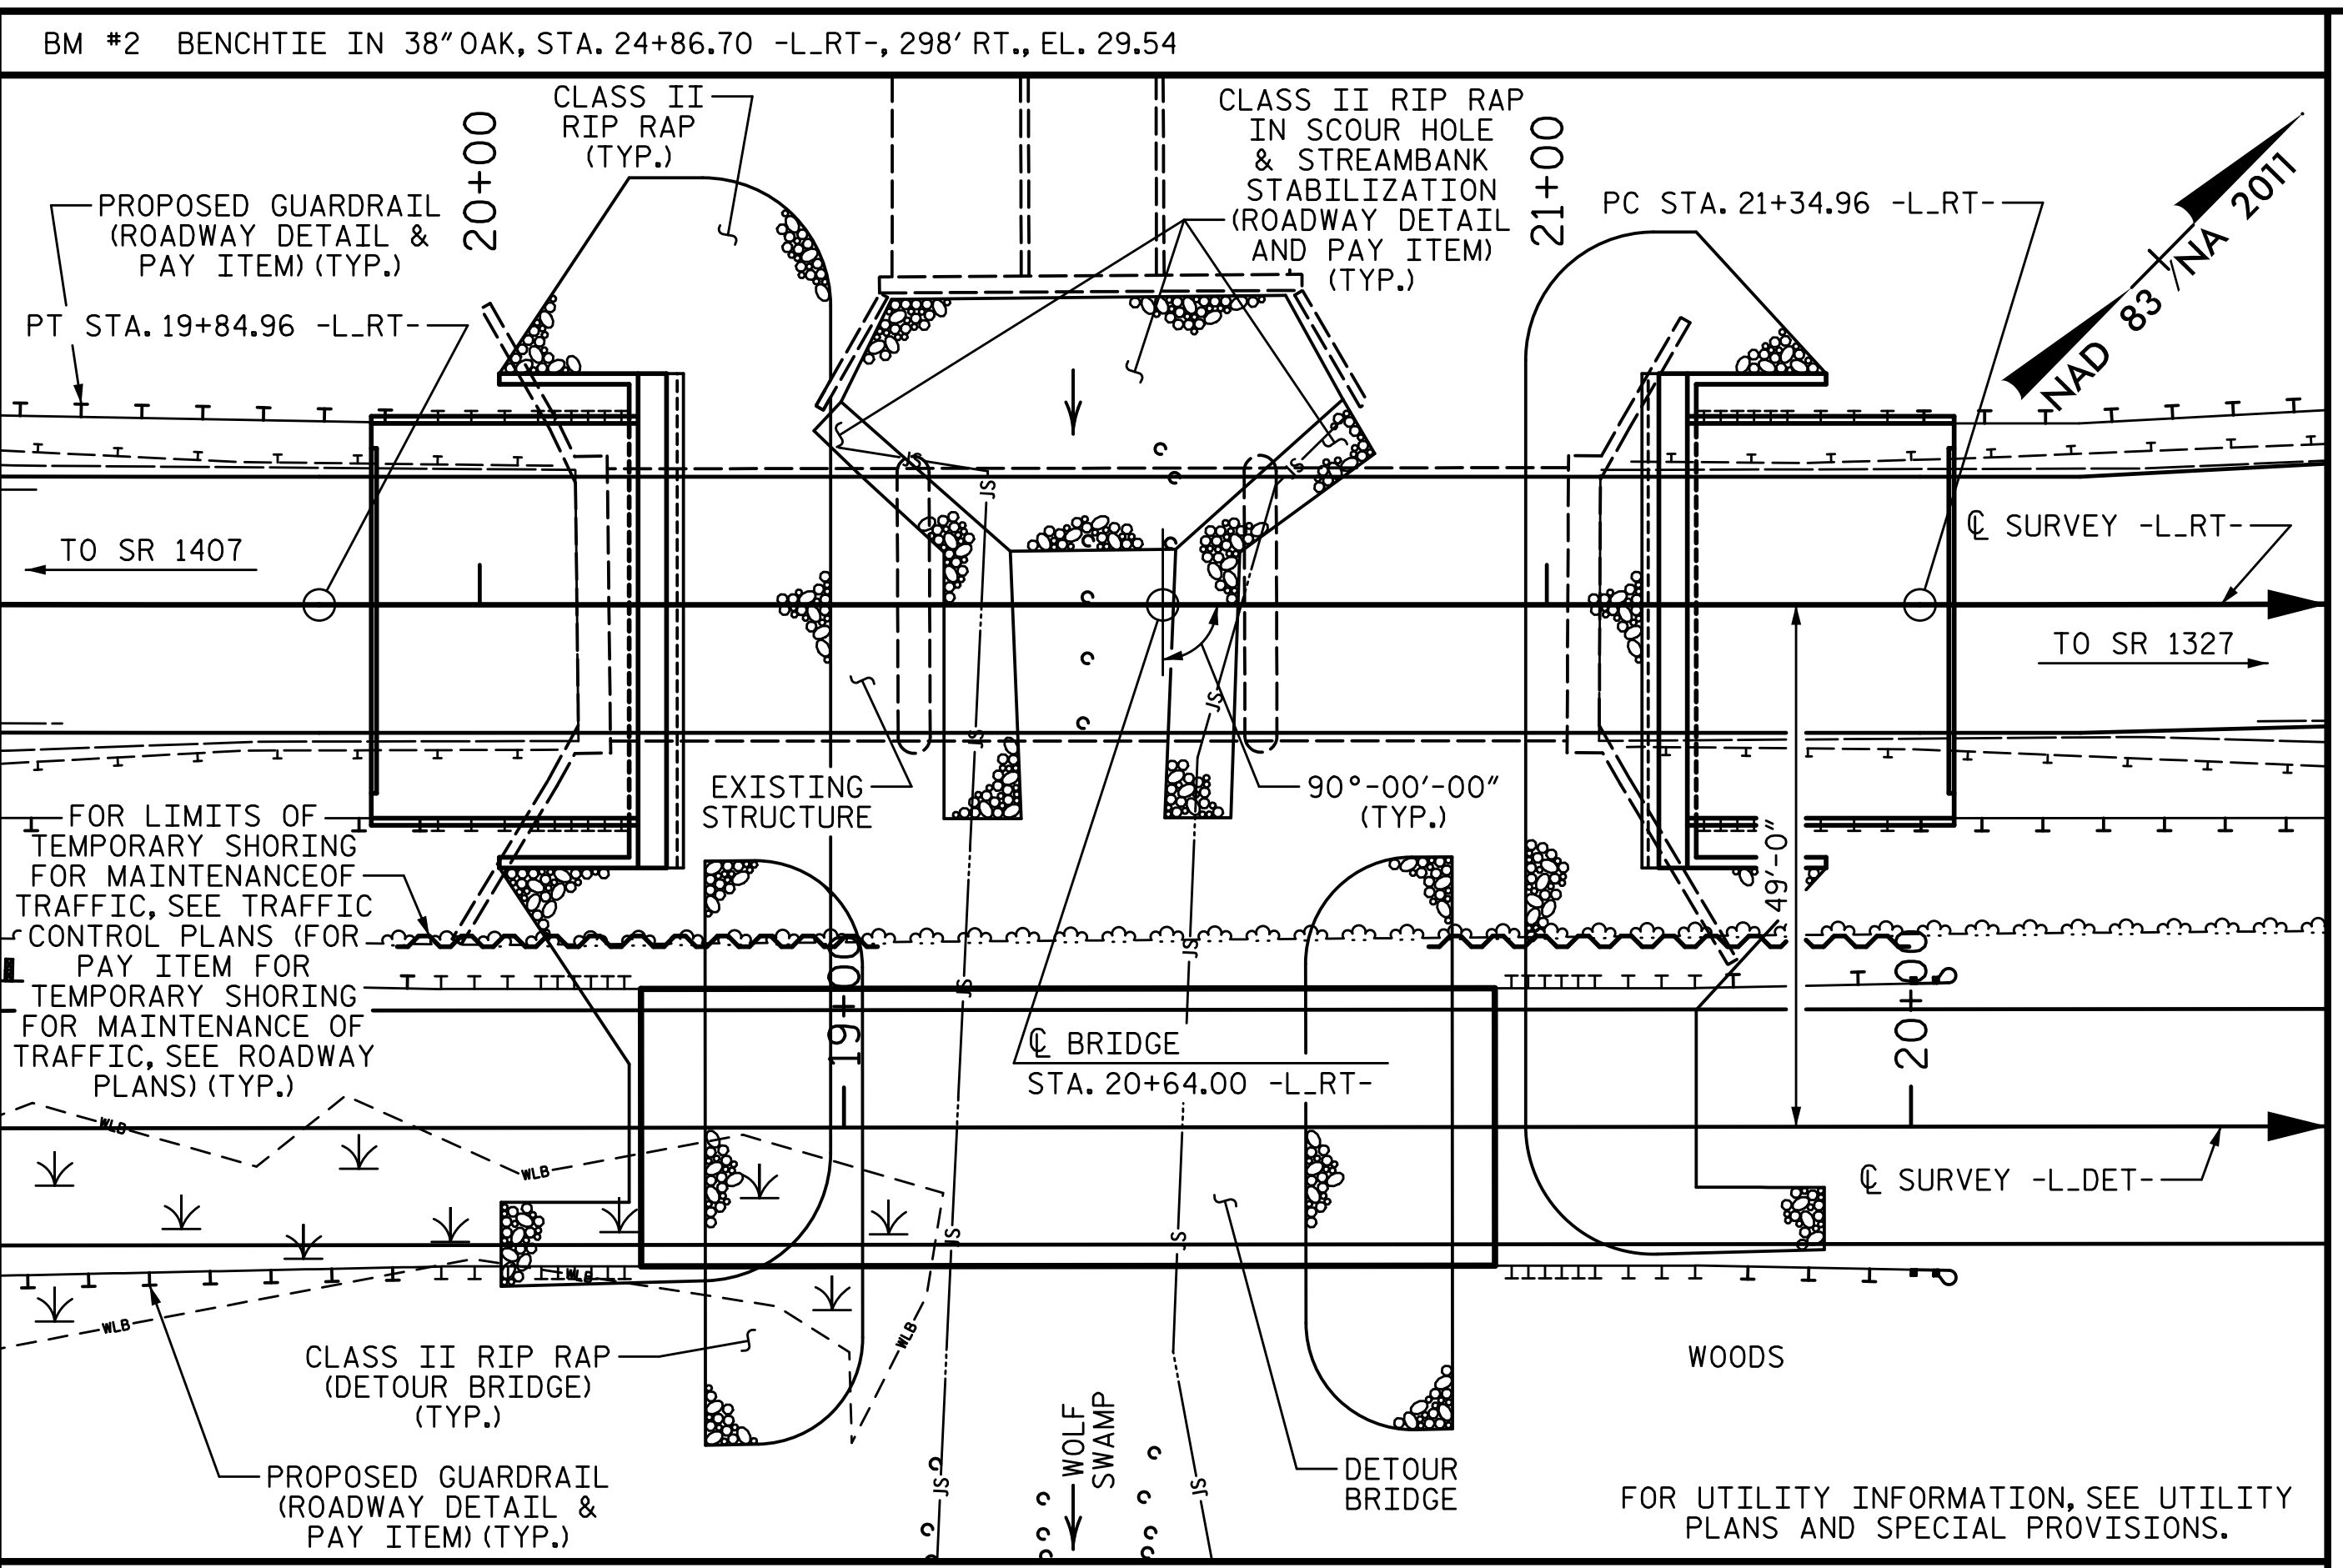

LOCATION SKETCH

NOTES:

- ASSUMED LIVE LOAD = HL-93 OR ALTERNATE LOADING.
- THIS BRIDGE HAS BEEN DESIGNED IN ACCORDANCE WITH THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS.
- THIS BRIDGE IS LOCATED IN SEISMIC ZONE 1.
- THIS STRUCTURE CONTAINS THE NECESSARY CORROSION PROTECTION REQUIRED FOR A CORROSIVE SITE.
- FOR EROSION CONTROL MEASURES, SEE EROSION CONTROL PLANS.
- THE EXISTING STRUCTURE CONSISTING OF 3 SPANS, 1 SPAN @ 31'-7", 1 @ 32'-6" AND 1 @ 31'-10" SHALL BE REMOVED. THE SUPERSTRUCTURE HAS A CLEAR ROADWAY WIDTH OF 26'-0" WITH REINFORCED CONCRETE DECK GIRDERS. THE END BENTS CONSIST OF REINFORCED CONCRETE INTEGRAL CAP ABUTMENTS. THE INTERIOR BENTS CONSIST OF REINFORCED CONCRETE POST AND BEAM AND WEB PIERS. REMOVE EXISTING PIERS TO FOOTINGS.
- THE SUBSTRUCTURE OF THE EXISTING BRIDGE INDICATED ON THE PLANS IS FROM THE BEST INFORMATION AVAILABLE. SINCE THIS INFORMATION IS SHOWN FOR THE CONVENIENCE OF THE CONTRACTOR, THE CONTRACTOR SHALL HAVE NO CLAIM WHATSOEVER AGAINST THE DEPARTMENT OF TRANSPORTATION FOR ANY DELAYS OR ADDITIONAL COST INCURRED BASED ON DIFFERENCES BETWEEN THE EXISTING BRIDGE SUBSTRUCTURE SHOWN ON THE PLANS AND THE ACTUAL CONDITIONS AT THE PROJECT SITE.
- FOR SUBMITTAL OF WORKING DRAWINGS, SEE SPECIAL PROVISIONS.
- FOR FALSEWORK AND FORMWORK, SEE SPECIAL PROVISIONS.
- FOR CRANE SAFETY, SEE SPECIAL PROVISIONS.
- FOR GROUT FOR STRUCTURES, SEE SPECIAL PROVISIONS.
- NEEDLE BEAMS WILL NOT BE ALLOWED UNLESS OTHERWISE CALLED FOR ON THE PLANS OR APPROVED BY THE ENGINEER.
- FOR ASBESTOS ASSESSMENT FOR BRIDGE DEMOLITION AND RENOVATION ACTIVITIES, SEE SPECIAL PROVISIONS.
- FOR LIMITS OF TEMPORARY SHORING FOR MAINTENANCE OF TRAFFIC, SEE TRAFFIC CONTROL PLANS. FOR PAY ITEM FOR TEMPORARY SHORING FOR MAINTENANCE OF TRAFFIC, SEE ROADWAY PLANS.
- REMOVABLE FORMS MAY BE USED IN LIEU OF METAL STAY-IN-PLACE FORMS IN ACCORDANCE WITH ARTICLE 420-3 OF THE STANDARD SPECIFICATIONS.
- REMOVAL OF THE EXISTING BRIDGE SHALL BE PERFORMED IN A MANNER THAT PREVENTS DEBRIS FROM FALLING INTO THE WATER. THE CONTRACTOR SHALL SUBMIT DEMOLITION PLANS FOR REVIEW AND REMOVE THE BRIDGE IN ACCORDANCE WITH ARTICLE 402-2 OF THE STANDARD SPECIFICATIONS.
- CLASS AA CONCRETE SHALL BE USED IN CAST-IN-PLACE END BENT CAPS AND SHALL CONTAIN CALCIUM NITRITE CORROSION INHIBITOR.
- THE CONTRACTOR WILL BE REQUIRED TO CONSTRUCT, MAINTAIN, AND AFTERWARDS REMOVE A TEMPORARY STRUCTURE AT STA. 19+22.00 -LDET- FOR USE DURING CONSTRUCTION OF THE PROPOSED STRUCTURE. FOR CONSTRUCTION, MAINTENANCE AND REMOVAL OF TEMPORARY STRUCTURE, SEE SPECIAL PROVISIONS.
- THE BRIDGE RAILS ON THE TEMPORARY STRUCTURE SHALL BE DESIGNED FOR THE AASHTO LRFD TEST LEVEL 3 (TL-3) CRASH TEST CRITERIA. FOR CONSTRUCTION, MAINTENANCE AND REMOVAL OF TEMPORARY STRUCTURE, SEE SPECIAL PROVISIONS.
- PRESTRESSED CONCRETE DECK PANELS MAY BE USED IN LIEU OF METAL STAY-IN-PLACE FORMS IN ACCORDANCE WITH ARTICLE 420-3 OF THE STANDARD SPECIFICATIONS.
- FOR OTHER DESIGN DATA AND GENERAL NOTES, SEE SHEET SN.
- THIS STRUCTURE HAS BEEN DESIGNED IN ACCORDANCE WITH "HEC 18-EVALUATING SCOUR AT BRIDGES."
- THE MATERIAL SHOWN IN THE CROSS-HATCHED AREA SHALL BE EXCAVATED FOR A DISTANCE OF 25 FT EACH SIDE OF CENTERLINE ROADWAY AS DIRECTED BY THE ENGINEER. THIS WORK WILL BE PAID FOR AT THE CONTRACT LUMP SUM PRICE FOR UNCLASSIFIED STRUCTURE EXCAVATION. SEE SECTION 412 OF THE STANDARD SPECIFICATIONS.
- ALL METALLIZED SURFACES SHALL RECEIVE A SEAL COATING AS SPECIFIED IN TABLE 2 OF THE DEPARTMENTS THERMAL SPRAYED COATINGS (METALLIZATION) PROGRAM. FOR THERMAL SPRAYED COATINGS, SEE SPECIAL PROVISIONS.
- ALL BAR SUPPORTS USED IN THE (BARRIER RAIL, PARAPET, SIDEWALK, DECK, BENT CAPS, COLUMNS, PILE CAPS, FOOTINGS) AND ALL INCIDENTAL REINFORCING STEEL SHALL BE EPOXY COATED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

TOTAL BILL OF MATERIAL										
	CONST., MAINT., & REMOVAL OF TEMPORARY STRUCTURE	REMOVAL OF EXISTING STRUCTURE	ASBESTOS ASSESSMENT	PDA TESTING	UNCLASSIFIED STRUCTURE EXCAVATION	REINFORCED CONCRETE DECK SLAB	GROOVING BRIDGE FLOORS	CLASS AA CONCRETE	BRIDGE APPROACH SLABS	REINFORCING STEEL
	LS	LS	LS	EA	LS	SF	SF	CY	LS	LB
SUPERSTRUCTURE						3,958	4,973			
END BENT 1								36.7		5,049
END BENT 2								36.7		5,049
TOTAL	LS	LS	LS	1	LS	3,958	4,973	73.4	LS	10,098

TOTAL BILL OF MATERIAL											
	54" PRESTRESSED CONCRETE GIRDER		PILE DRIVING EQUIPMENT SETUP FOR PP 16 X 0.50 GALV. STEEL PILES	PP 16 X 0.50 GALV. STEEL PILES		PIPE PILE PLATES	PILE REDRIVES	CONCRETE BARRIER RAIL	RIP RAP CLASS II (2'-0" THICK)	GEOTEXTILE FOR DRAINAGE	ELASTOMERIC BEARINGS
	NO.	LF	EA	NO.	LF	EA	EA	LF	TON	SY	LS
SUPERSTRUCTURE	5	489.58						196.67			LS
END BENT 1			8	8	400	8	4		210	235	
END BENT 2			8	8	440	8	4		155	175	
TOTAL	5	489.58	16	16	840	16	8	196.67	365	410	LS


PROJECT NO. B-5652
ONLOW COUNTY
 STATION: 20+64.00 -L-RT-

SHEET 3 OF 4

STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH

GENERAL DRAWING

FOR BRIDGE ON US 17 NB
 OVER WOLF SWAMP
 BETWEEN SR 1407 AND SR 1327

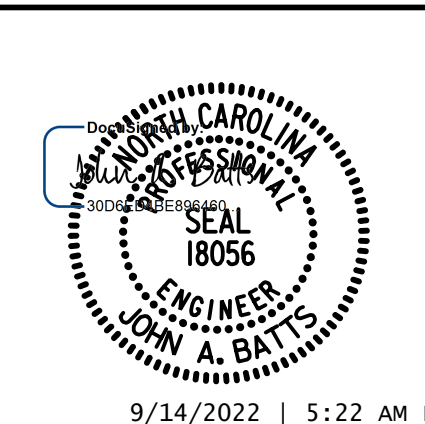

DRAWN BY: T. BANKOVICH DATE: 5-22
 CHECKED BY: J.A. BATTS DATE: 5-22
 DESIGN ENGINEER OF RECORD: J.A. BATTS DATE: 5-22

REVISIONS						SHEET NO.
NO.	BY:	DATE:	NO.	BY:	DATE:	S-4
1			3			TOTAL SHEETS
2			4			26

DOCUMENT NOT CONSIDERED FINAL
 UNLESS ALL SIGNATURES COMPLETED

9/14/2022 8:05:54 AM P:\Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401-B5652-SMU_CD-660033.dgn

LOAD AND RESISTANCE FACTOR RATING (LRFR) SUMMARY FOR PRESTRESSED CONCRETE GIRDERS

LEVEL	VEHICLE	WEIGHT (W) (TONS)	CONTROLLING LOAD RATING #	MINIMUM RATING FACTORS (RF)	TONS = W x RF	STRENGTH I LIMIT STATE										SERVICE III LIMIT STATE					COMMENT NUMBER			
						MOMENT					SHEAR					MOMENT								
						LIVE-LOAD FACTORS (γ _{LL})	DISTRIBUTION FACTORS (DF)	RATING FACTOR	SPAN	GIRDER LOCATION	DISTANCE FROM LEFT END OF SPAN (FT)	DISTRIBUTION FACTORS (DF)	RATING FACTOR	SPAN	GIRDER LOCATION	DISTANCE FROM LEFT END OF SPAN (FT)	LIVE-LOAD FACTORS (γ _{LL})	DISTRIBUTION FACTORS (DF)	RATING FACTOR	SPAN		GIRDER LOCATION	DISTANCE FROM LEFT END OF SPAN (FT)	
DESIGN LOAD RATING	HL-93 (INVENTORY)	N/A	①	1.10	--	1.75	0.753	1.60	A	EL	48.25	0.861	1.10	A	I	9.65	0.80	0.707	1.40	A	I	48.25		
	HL-93 (OPERATING)	N/A		1.62	--	1.35	0.753	2.07	A	EL	48.25	0.861	1.62	A	I	9.65	N/A	--	--	--	--	--		
	HS-20 (INVENTORY)	36.000	②	1.67	60.1	1.75	0.753	2.21	A	EL	48.25	0.861	1.67	A	I	9.65	0.80	0.707	1.94	A	I	48.25		
	HS-20 (OPERATING)	36.000		2.31	83.2	1.35	0.753	2.87	A	EL	48.25	0.861	2.31	A	I	9.65	N/A	--	--	--	--	--		
LEGAL LOAD RATING	SINGLE VEHICLE (SV)	SNSH	13.500		3.67	49.5	1.40	0.753	6.54	A	EL	48.25	0.861	5.73	A	I	9.65	0.80	0.707	3.67	A	I	48.25	
		SNGARBS2	20.000		2.66	53.2	1.40	0.753	4.74	A	EL	48.25	0.861	3.96	A	I	9.65	0.80	0.707	2.66	A	I	48.25	
		SNAGRIS2	22.000		2.49	54.8	1.40	0.753	4.44	A	EL	48.25	0.861	3.64	A	I	9.65	0.80	0.707	2.49	A	I	48.25	
		SNCOTTS3	27.250		1.82	49.6	1.40	0.753	3.25	A	EL	48.25	0.861	2.76	A	I	9.65	0.80	0.707	1.82	A	I	48.25	
		SNAGGRS4	34.925		1.50	52.4	1.40	0.753	2.67	A	EL	48.25	0.861	2.22	A	I	9.65	0.80	0.707	1.50	A	I	48.25	
		SNS5A	35.550		1.47	52.3	1.40	0.753	2.61	A	EL	48.25	0.861	2.23	A	I	9.65	0.80	0.707	1.47	A	I	48.25	
		SNS6A	39.950		1.33	53.1	1.40	0.753	2.37	A	EL	48.25	0.861	2.00	A	I	9.65	0.80	0.707	1.33	A	I	48.25	
		SNS7B	42.000		1.27	53.3	1.40	0.753	2.26	A	EL	48.25	0.861	1.92	A	I	9.65	0.80	0.707	1.27	A	I	48.25	
	TRUCK TRACTOR SEMI-TRAILER (TTST)	TNAGRIT3	33.000		1.62	53.5	1.40	0.753	2.89	A	EL	48.25	0.861	2.43	A	I	9.65	0.80	0.707	1.62	A	I	48.25	
		TNT4A	33.075		1.63	53.9	1.40	0.753	2.90	A	EL	48.25	0.861	2.38	A	I	9.65	0.80	0.707	1.63	A	I	48.25	
		TNT6A	41.600		1.32	54.9	1.40	0.753	2.35	A	EL	48.25	0.861	2.05	A	I	9.65	0.80	0.707	1.32	A	I	48.25	
		TNT7A	42.000		1.32	55.4	1.40	0.753	2.35	A	EL	48.25	0.861	2.01	A	I	9.65	0.80	0.707	1.32	A	I	48.25	
		TNT7B	42.000		1.35	56.7	1.40	0.753	2.41	A	EL	48.25	0.861	1.88	A	I	9.65	0.80	0.707	1.35	A	I	48.25	
		TNAGRIT4	43.000		1.30	55.9	1.40	0.753	2.31	A	EL	48.25	0.861	1.80	A	I	9.65	0.80	0.707	1.30	A	I	48.25	
TNAGT5A	45.000		1.23	55.4	1.40	0.753	2.19	A	EL	48.25	0.861	1.76	A	I	9.65	0.80	0.707	1.23	A	I	48.25			
TNAGT5B	45.000	③	1.22	54.9	1.40	0.753	2.17	A	EL	48.25	0.861	1.68	A	I	9.65	0.80	0.707	1.22	A	I	48.25			

LOAD FACTORS:

DESIGN LOAD RATING FACTORS	LIMIT STATE	γ _{DC}	γ _{DW}
	STRENGTH I	1.25	1.50
	SERVICE III	1.00	1.00

NOTES:

MINIMUM RATING FACTORS ARE BASED ON THE STRENGTH I AND SERVICE III LIMIT STATES.

ALLOWABLE STRESSES FOR SERVICE III LIMIT STATE ARE AS REQUIRED FOR DESIGN.

COMMENTS:

1. DISTANCE FROM LEFT END OF SPAN IS MEASURED FROM \mathcal{C} BEARING.
2. BEARING TO BEARING LENGTH OF ALL GIRDERS = 96'-6"

⊕ CONTROLLING LOAD RATING

① DESIGN LOAD RATING (HL-93)


② DESIGN LOAD RATING (HS-20)

③ LEGAL LOAD RATING **

** SEE CHART FOR VEHICLE TYPE

GIRDER LOCATION


I - INTERIOR GIRDER
EL - EXTERIOR LEFT GIRDER
ER - EXTERIOR RIGHT GIRDER

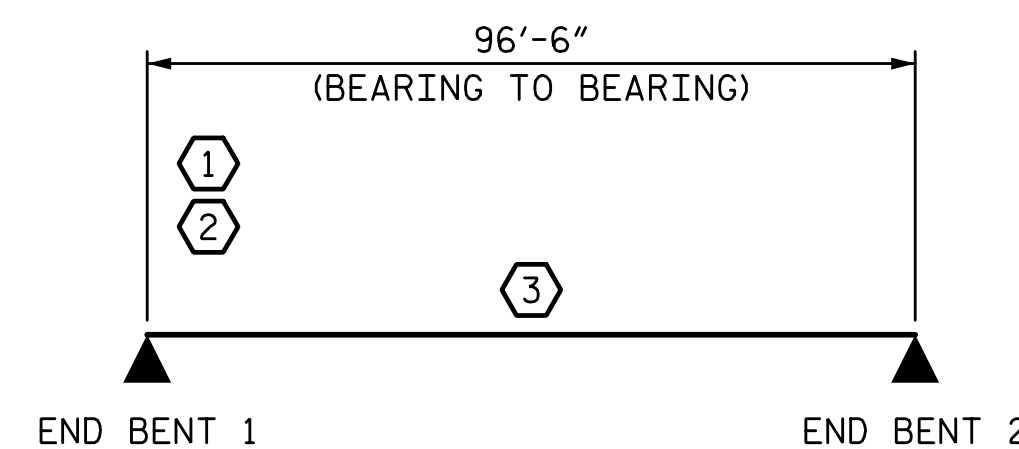

SPAN A
LRFR SUMMARY

PROJECT NO. B-5652
ONLOW COUNTY
 STATION: 20+64.00 -L-RT-

SHEET 4 OF 4

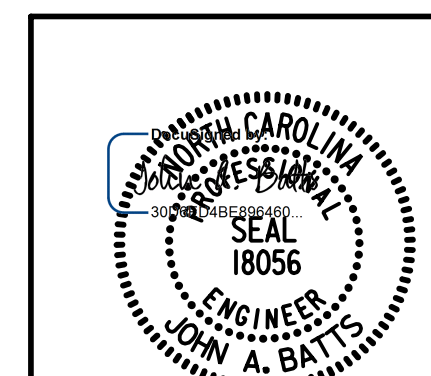


STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH
GENERAL DRAWING
LRFR SUMMARY FOR
PRESTRESSED
CONCRETE GIRDERS
 (NON-INTERSTATE TRAFFIC)

DRAWN BY: T. BANKOVICH DATE: 5-22
 CHECKED BY: J.A. BATTS DATE: 5-22
 DESIGN ENGINEER OF RECORD: J.A. BATTS DATE: 5-22

REVISIONS						SHEET NO.
NO.	BY:	DATE:	NO.	BY:	DATE:	S-5
1			3			TOTAL SHEETS
2			4			26


**DOCUMENT NOT CONSIDERED FINAL
 UNLESS ALL SIGNATURES COMPLETED**

9/14/2022 8:05:55 AM P:\Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401_B5652_SMU_TS_660033.dgn

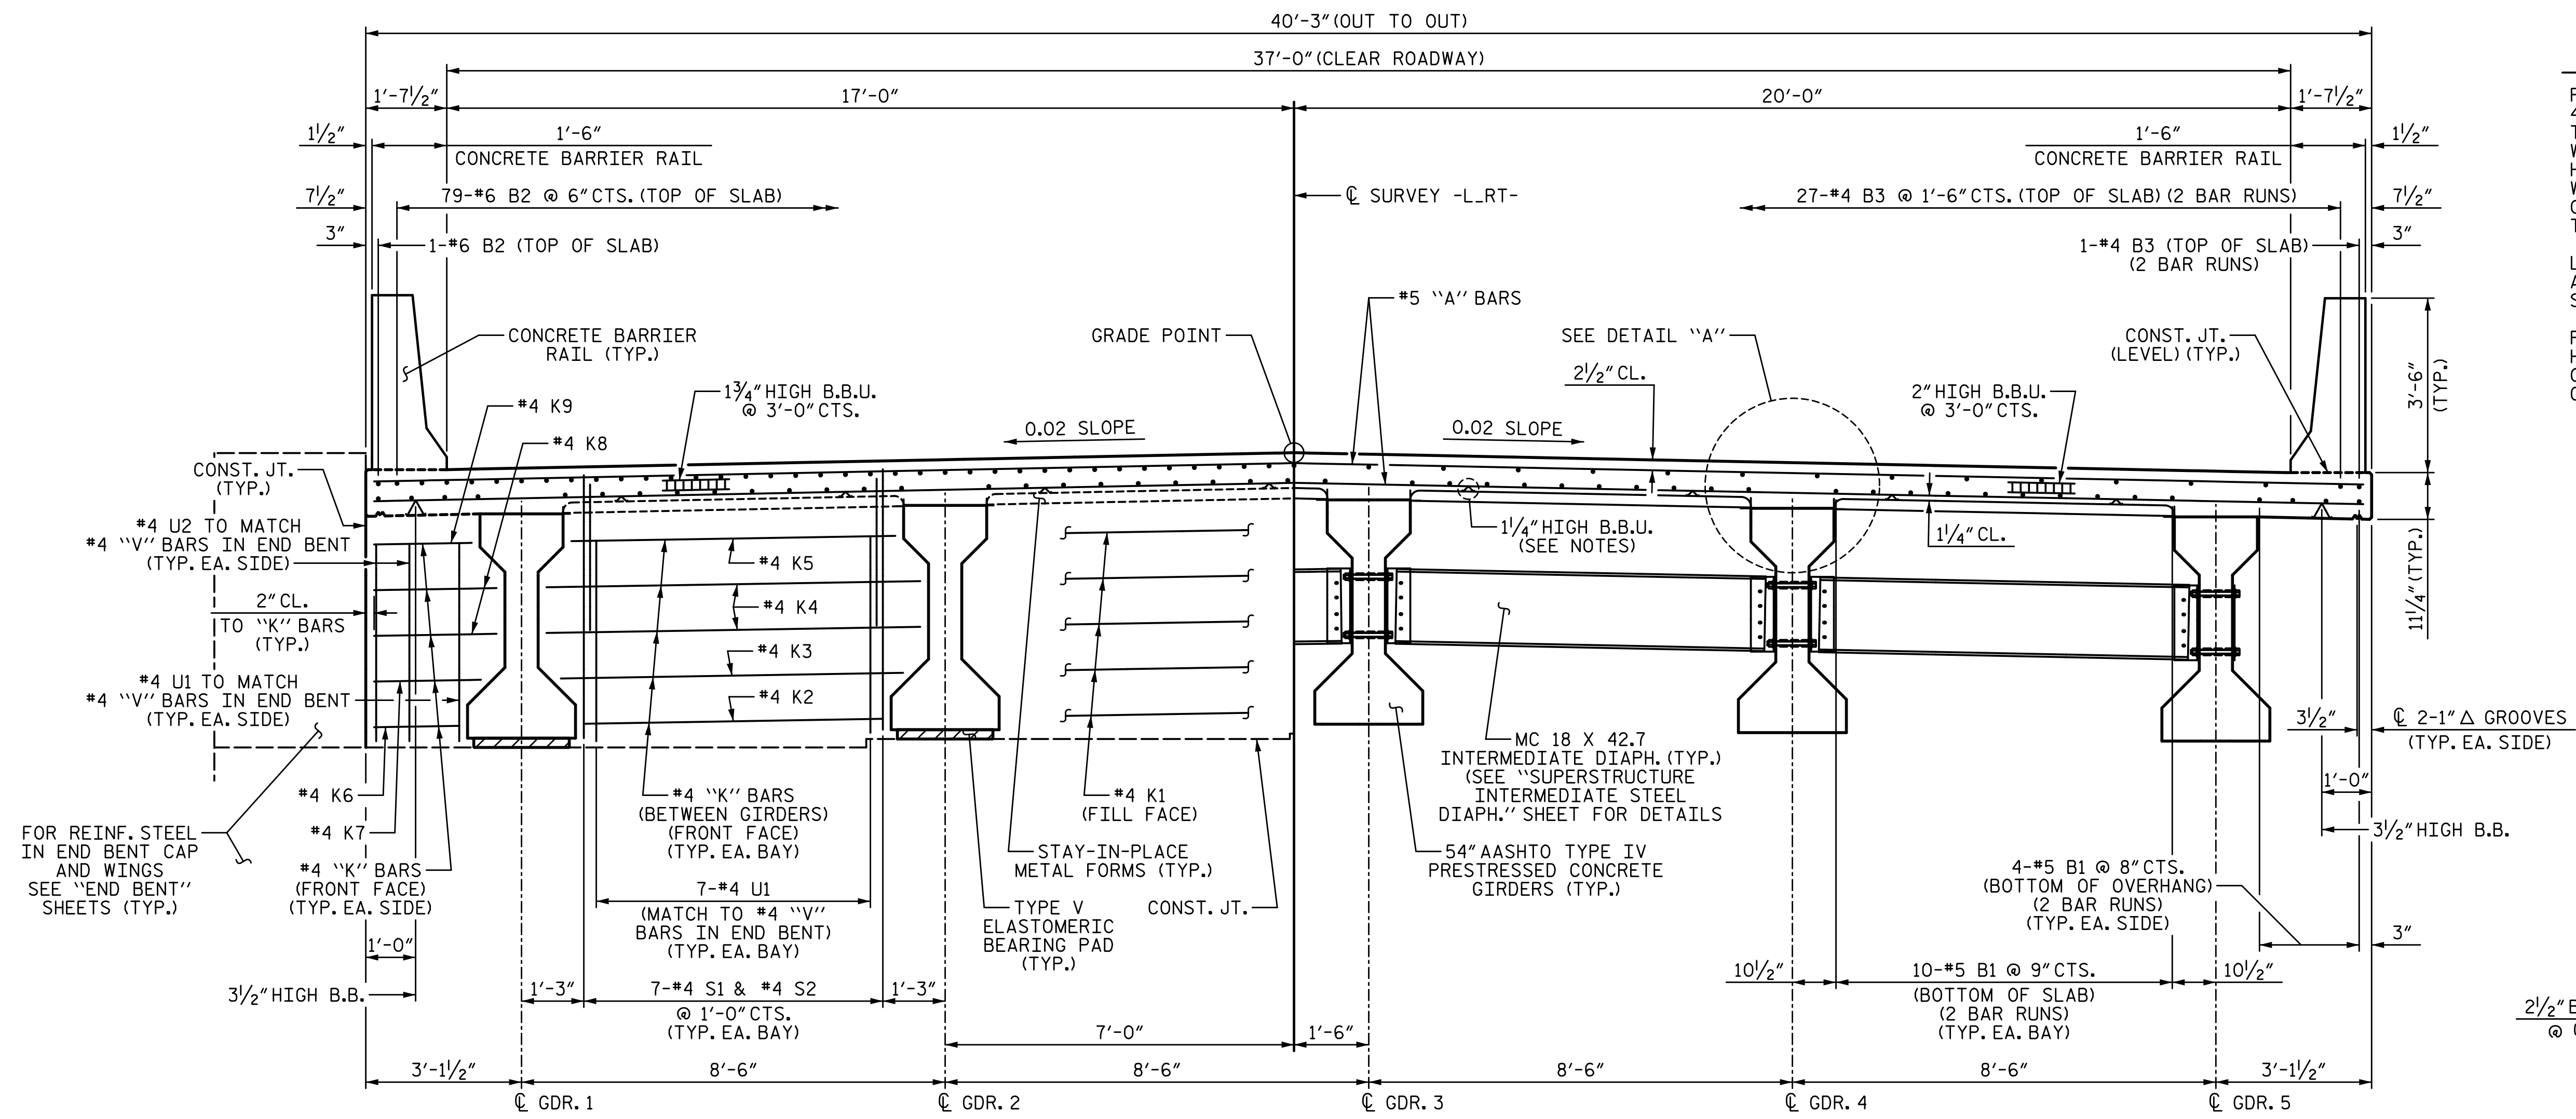


PARTIAL TYPICAL SECTION
(SHOWING INTEGRAL END BENT)

PARTIAL TYPICAL SECTION
(SHOWING INTERMEDIATE DIAPHRAGMS)

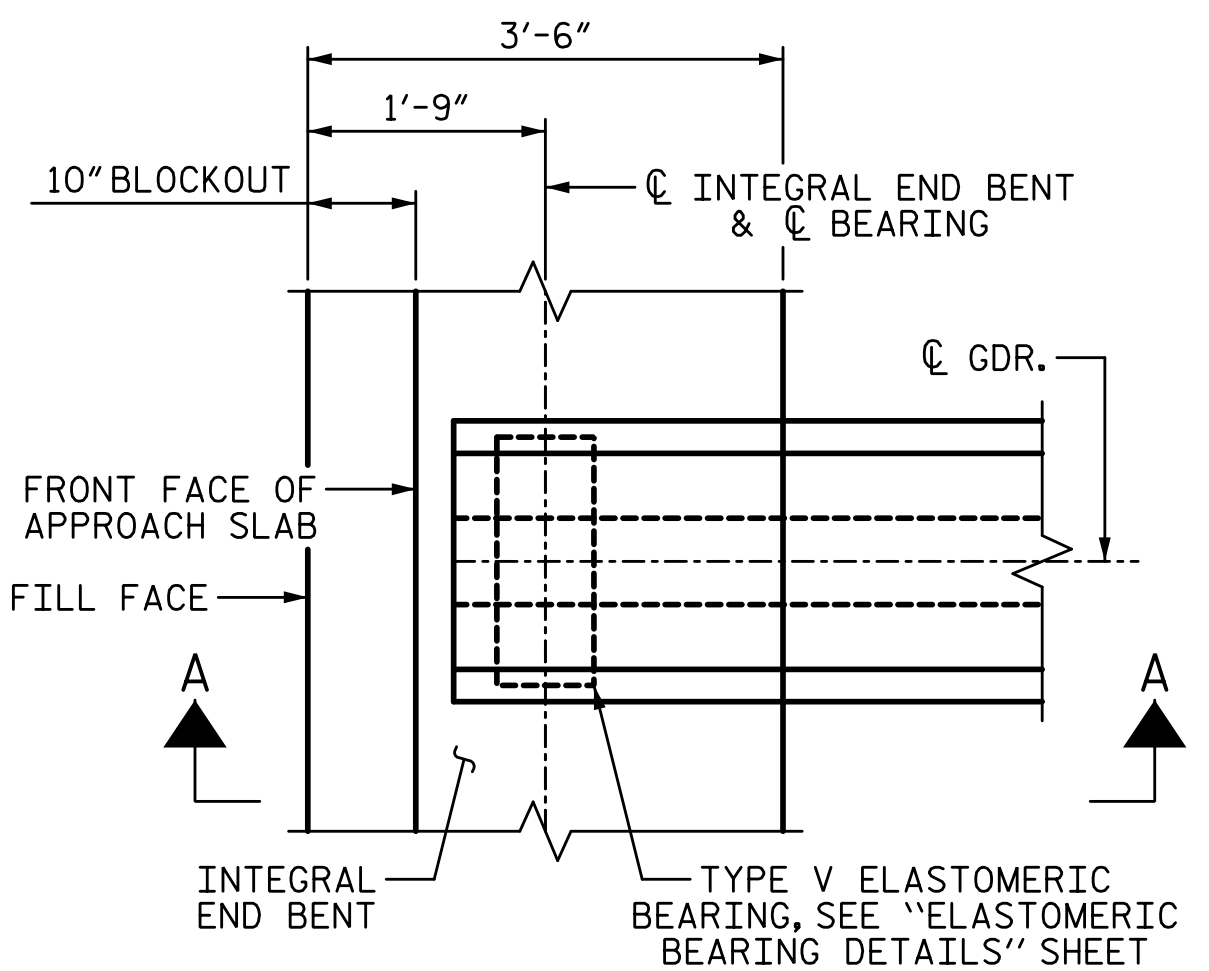


PLAN DETAIL OF END BENT
(END BENT 1 SHOWN, END BENT 2 SIMILAR)
('S' BARS IN GIRDER NOT SHOWN FOR CLARITY)

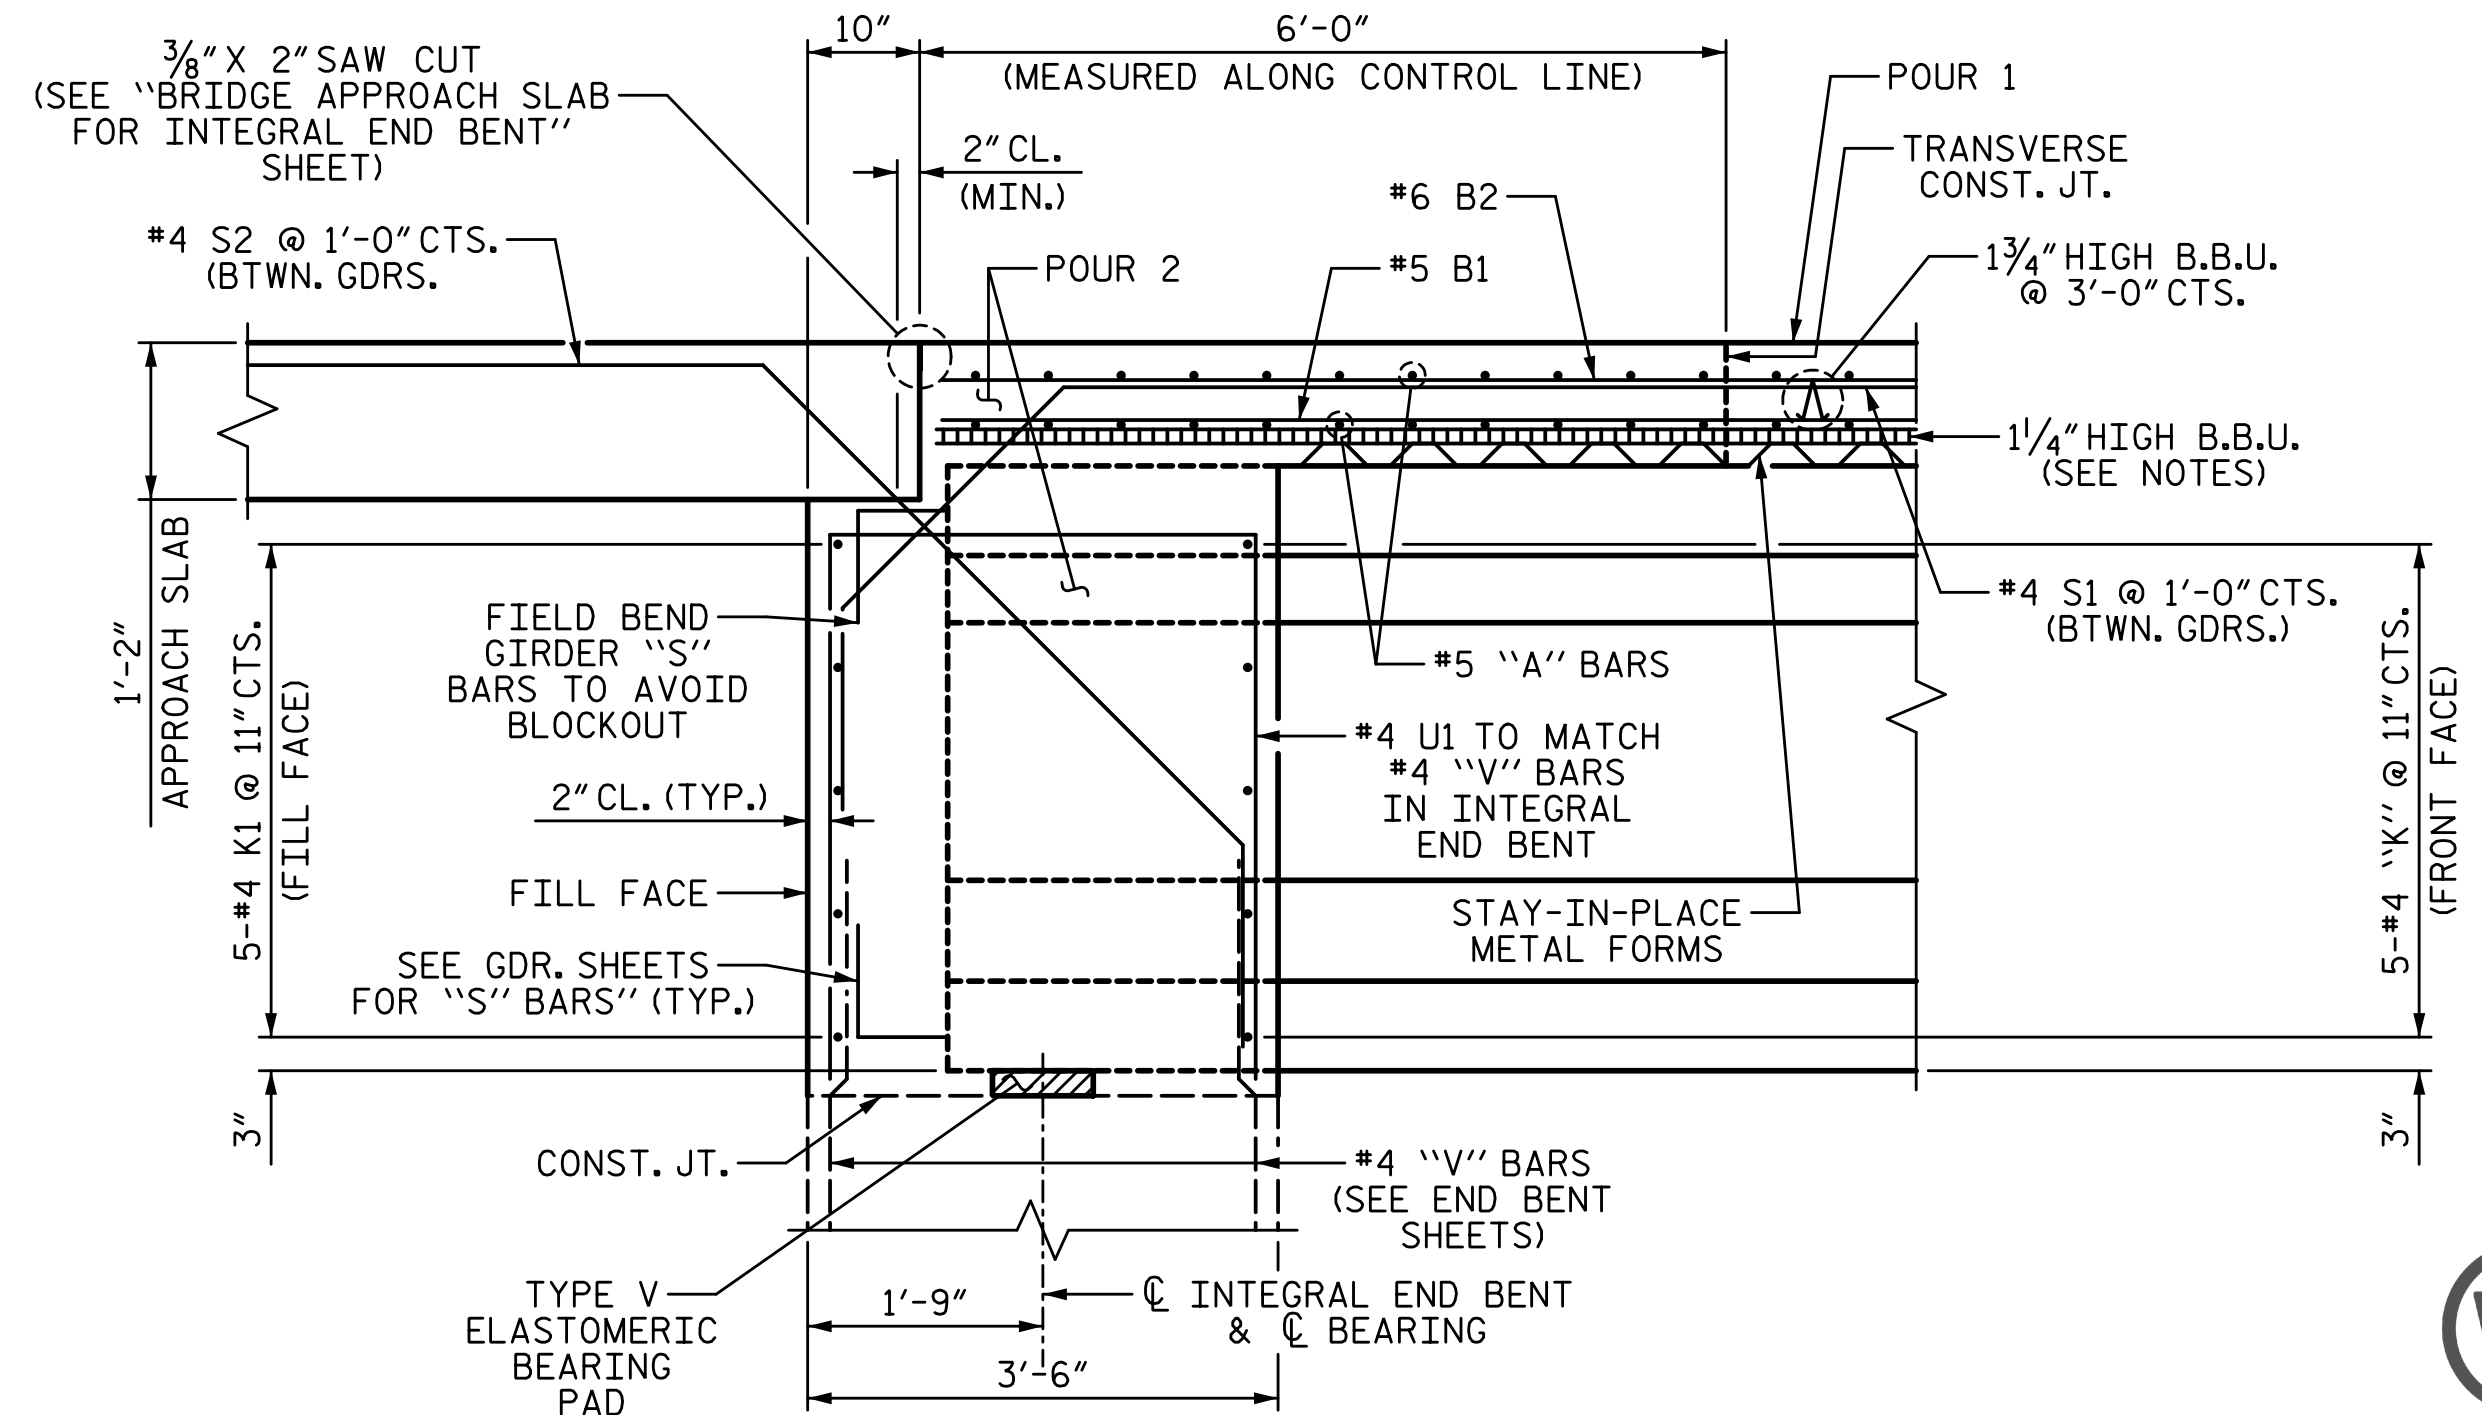

SECTION A-A
SECTION THROUGH INTEGRAL END BENT DIAPHRAGM
(SEE END BENT SHEETS FOR INTEGRAL END BENT REINFORCING DETAILS)
(END BENT 1 SHOWN, END BENT 2 SIMILAR)


NOTES:
PROVIDE 1 1/4" HIGH BEAM BOLSTERS UPPER AT 4'-0" CTS. ATOP THE STAY-IN-PLACE METAL FORMS TO SUPPORT THE BOTTOM MAT OF "A" BARS. WHEN USING REMOVABLE FORMS, PROVIDE CONTINUOUS HIGH CHAIRS FOR METAL DECK (C.H.C.M.) @ 4'-0" CTS. WITH A HEIGHT TO SUPPORT THE BOTTOM MAT OF "A" BARS A CLEAR DISTANCE OF 2 1/2" ABOVE THE TOP OF THE REMOVABLE FORM.
LONGITUDINAL STEEL MAY BE SHIFTED SLIGHTLY, AS NECESSARY, TO AVOID INTERFERENCE WITH STIRRUPS IN PRESTRESSED CONCRETE GIRDERS.
PREVIOUSLY CAST CONCRETE IN THE SPAN SHALL HAVE ATTAINED A MINIMUM COMPRESSIVE STRENGTH OF 3,000 PSI BEFORE ADDITIONAL CONCRETE IS CAST IN THE SPAN.

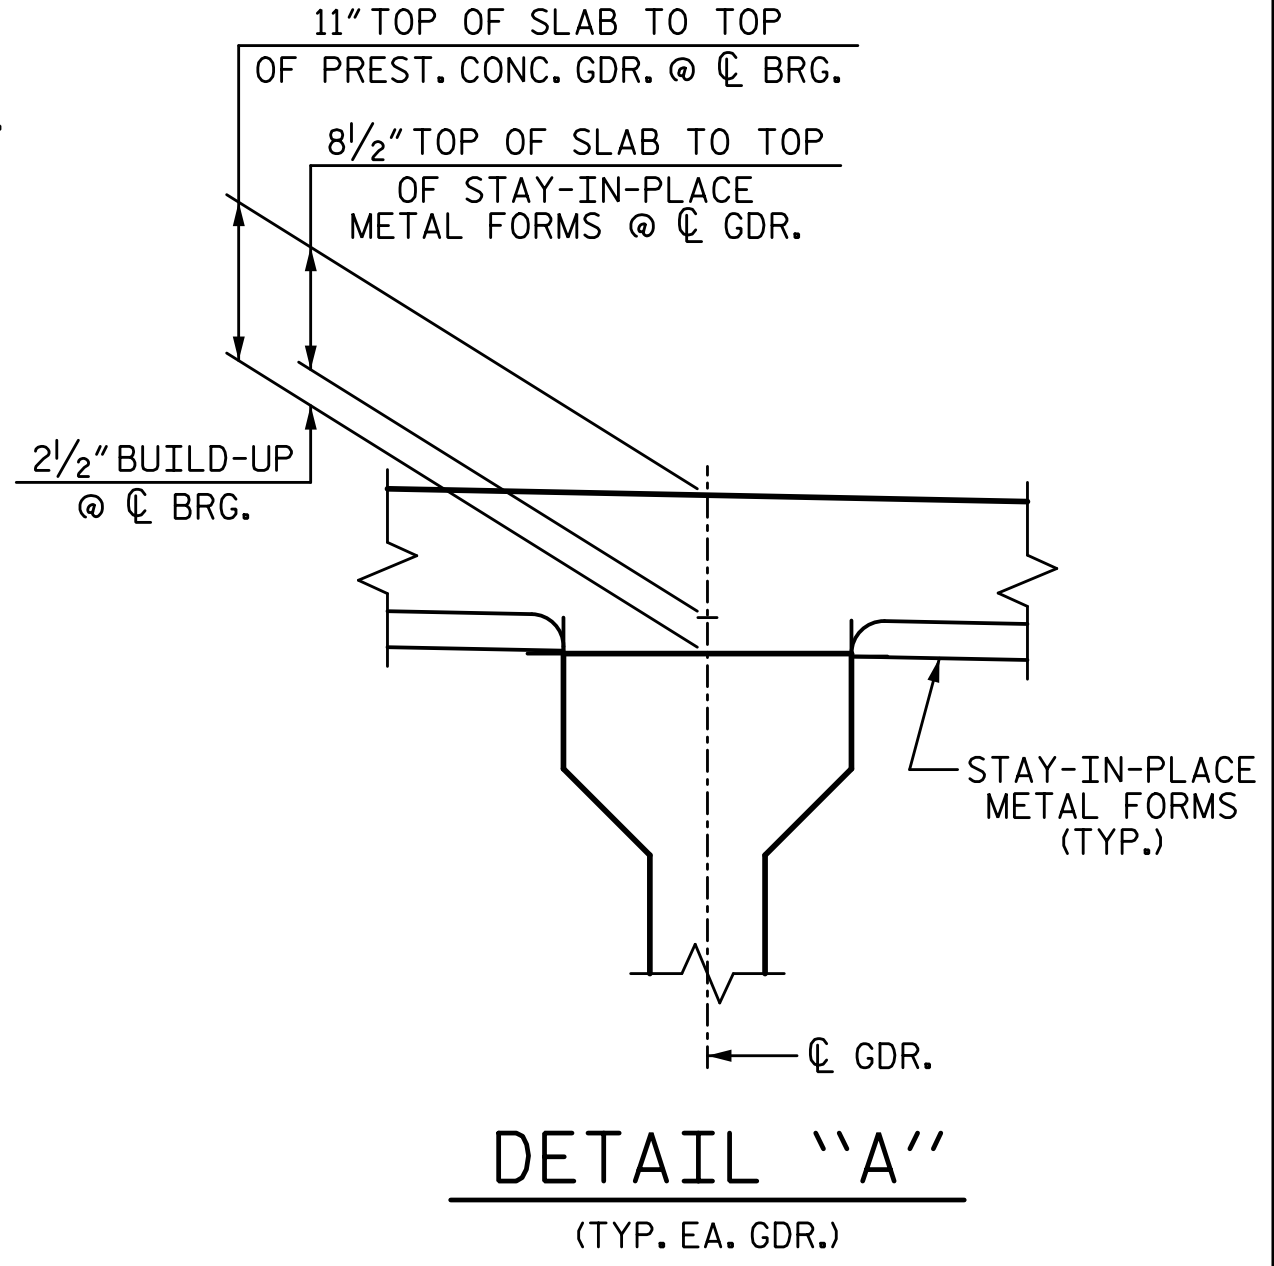

DETAIL "A"
(TYP. EA. GDR.)

PROJECT NO. B-5652
ONLOW COUNTY
STATION: 20+64.00 -L-RT-

STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH
SUPERSTRUCTURE
TYPICAL SECTION

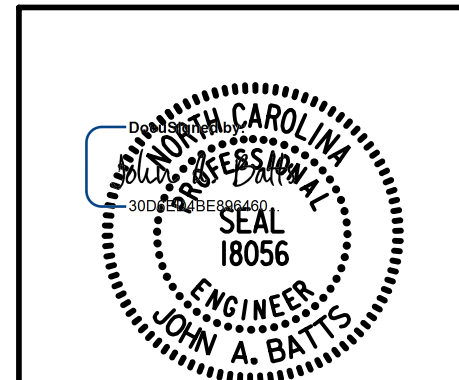

W WGI
5640 Dillard Drive, Suite 200
Cary, NC 27518
LICENSURE NO. C-4434

DRAWN BY: T. BANKOVICH DATE: 5-22
CHECKED BY: J.A. BATTS DATE: 5-22
DESIGN ENGINEER OF RECORD: J.A. BATTS DATE: 5-22


REVISIONS				SHEET NO.	
NO.	BY:	DATE:	NO.	BY:	DATE:
1			3		
2			4		

TOTAL SHEETS: 26

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

9/14/2022 8:05:55 AM P:\Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401_B5652_SMU_S_660033.dgn


NOTES:
 FOR SECTION A-A, SEE "TYPICAL SECTION" SHEET.
 FOR LOCATIONS OF INTERMEDIATE DIAPHRAGMS SEE "FRAMING PLAN" SHEET.
 FOR POUR SEQUENCE AND LOCATION OF TRANSVERSE CONSTRUCTION JOINTS, SEE "BILL OF MATERIAL" SHEET.
 SEE "CONCRETE BARRIER RAIL" SHEETS FOR ADDITIONAL REINFORCING STEEL IN SLAB AND BARRIER RAIL.

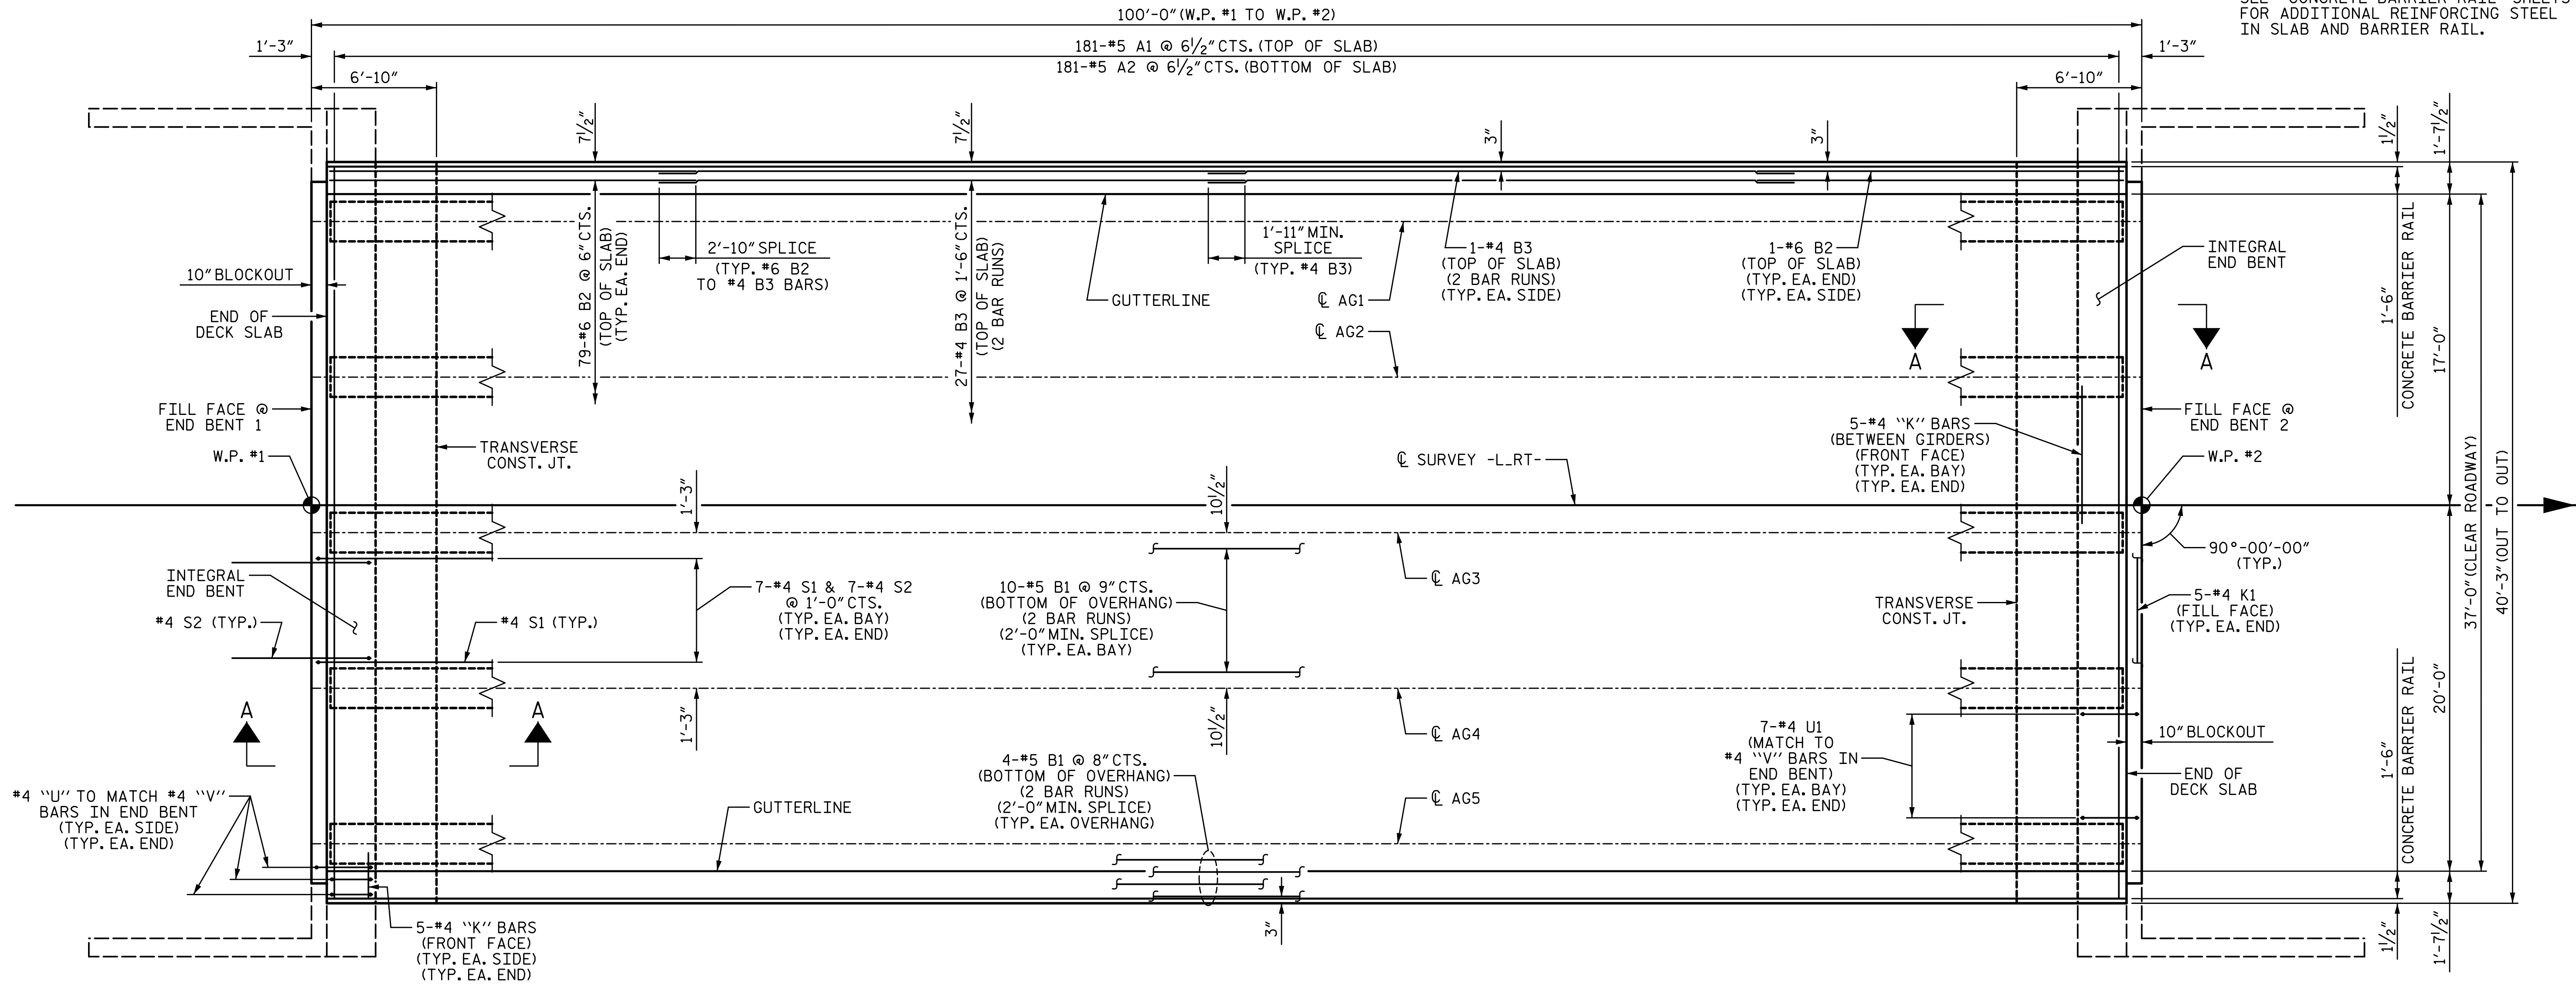

PLAN OF SPAN A

PROJECT NO. B-5652
ONLOW COUNTY
 STATION: 20+64.00 -L-RT-

DRAWN BY: T. BANKOVICH DATE: 5-22
 CHECKED BY: J.A. BATTS DATE: 5-22
 DESIGN ENGINEER OF RECORD: J.A. BATTS DATE: 5-22

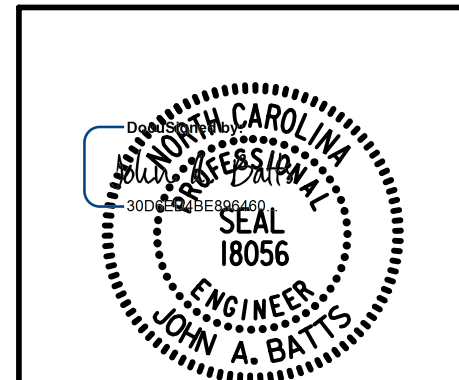

STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH
 SUPERSTRUCTURE


PLAN OF SPAN A

REVISIONS						SHEET NO.
NO.	BY:	DATE:	NO.	BY:	DATE:	S-7
1			3			TOTAL SHEETS
2			4			26

LICENSURE NO. C-4434
 DOCUMENT NOT CONSIDERED FINAL
 UNLESS ALL SIGNATURES COMPLETED

9/14/2022 8:05:56 AM P:\Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401_B5652_SMU_FP_660033.dgn

NOTES:
 FOR DIAPHRAGM DETAILS, SEE "INTERMEDIATE STEEL DIAPHRAGMS FOR TYPE IV PRESTRESSED CONCRETE GIRDERS" SHEET.

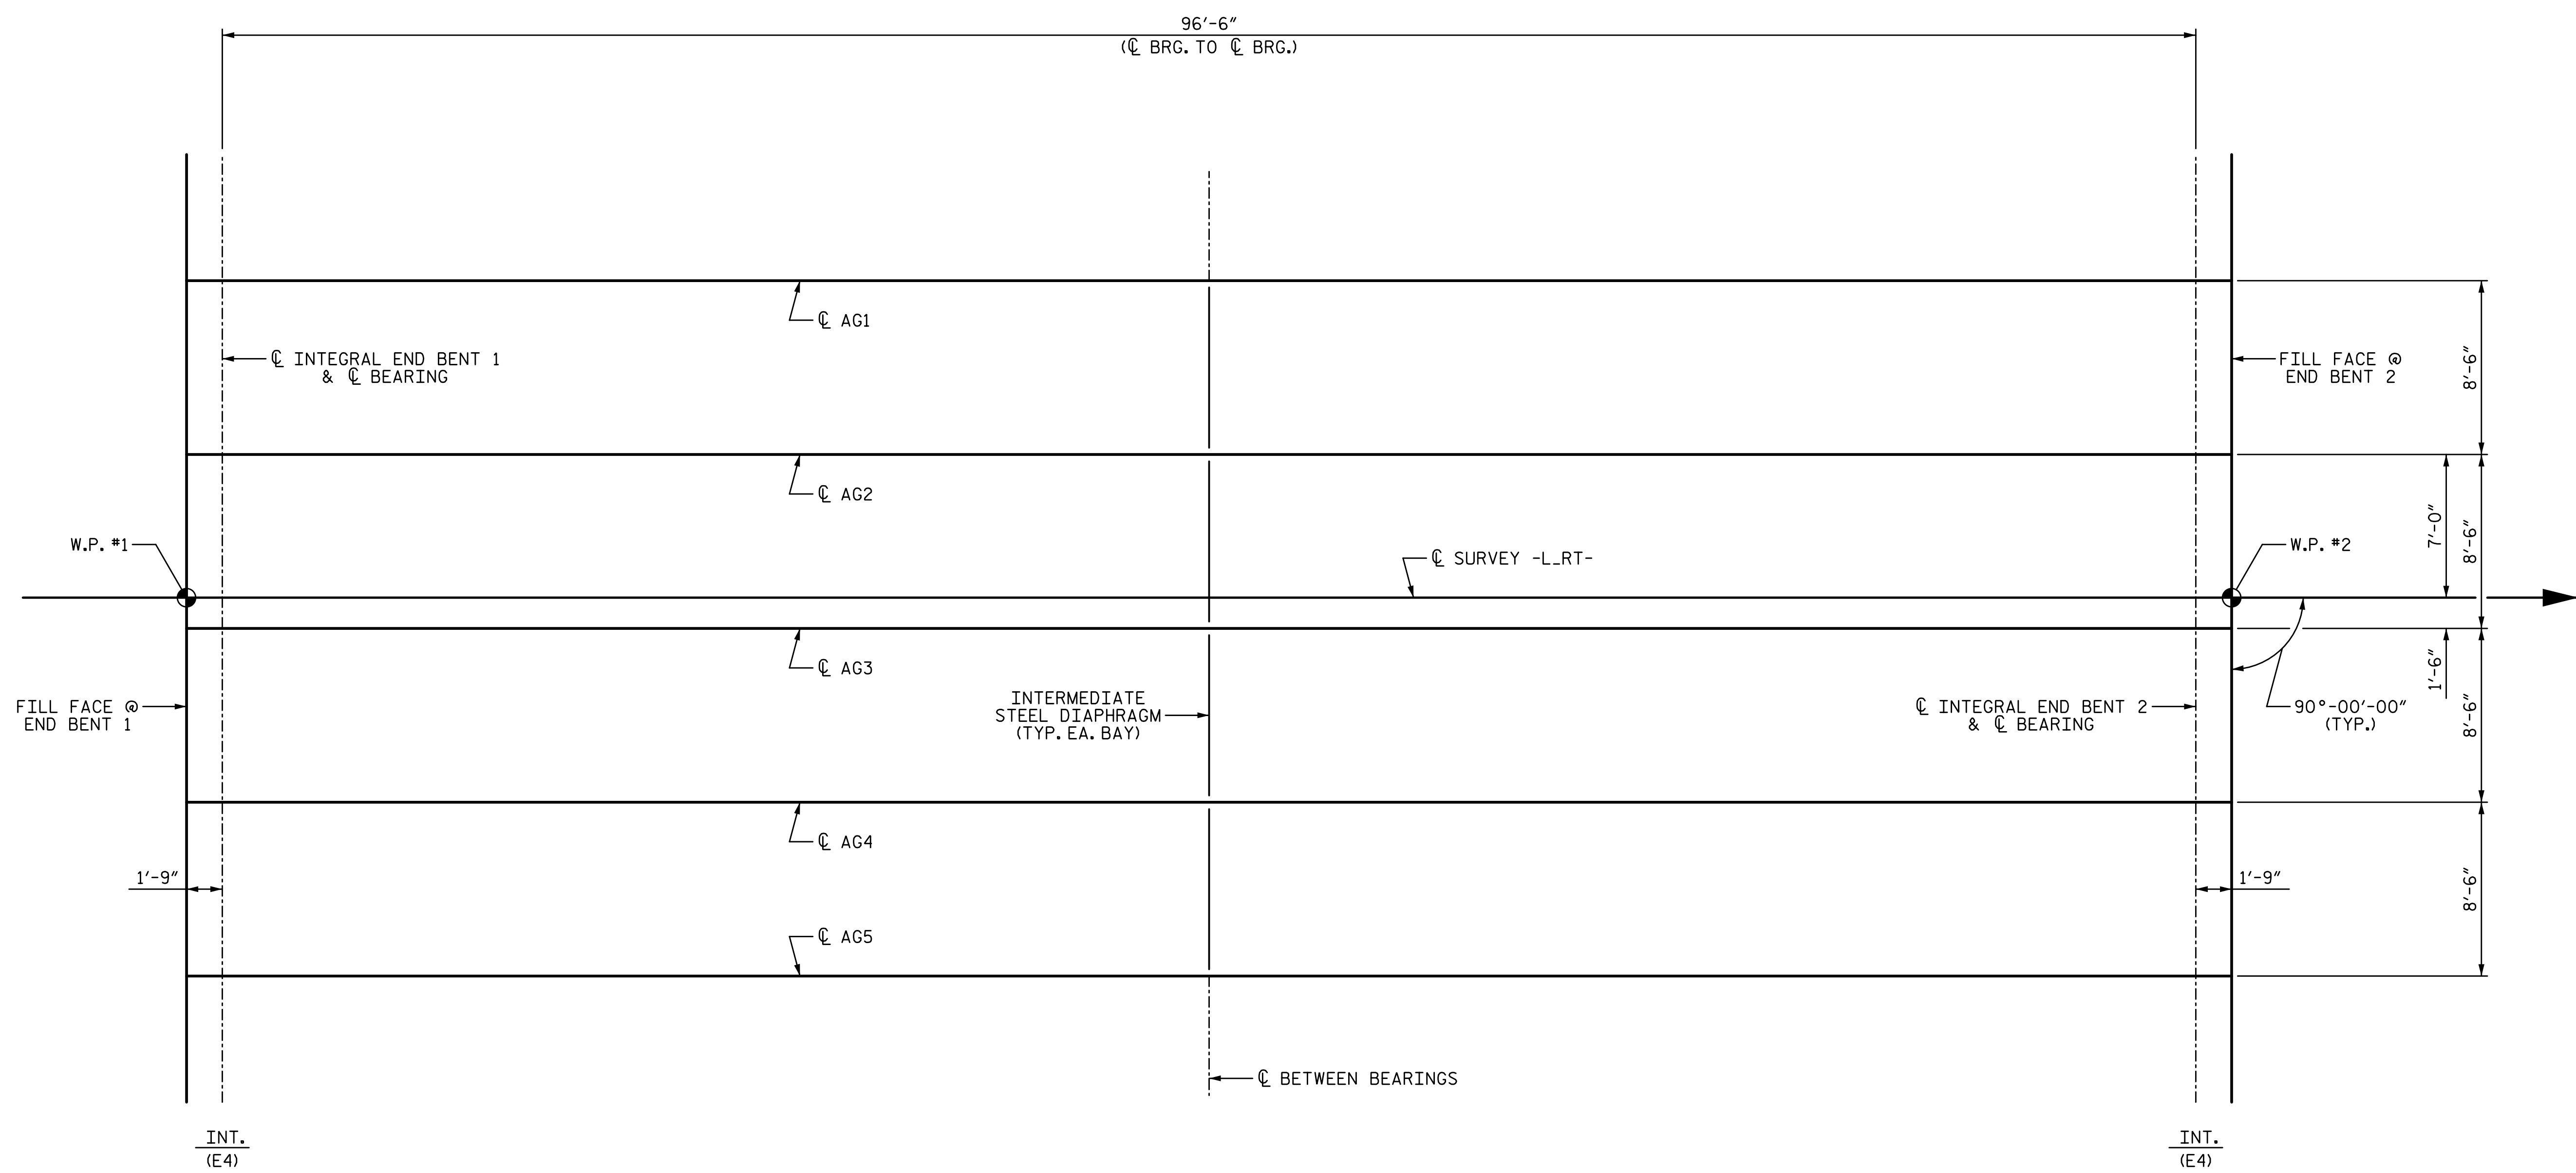


SPAN A
FRAMING PLAN

PROJECT NO. B-5652
ONLOW COUNTY
 STATION: 20+64.00 -L-RT-

STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH
 SUPERSTRUCTURE

FRAMING PLAN

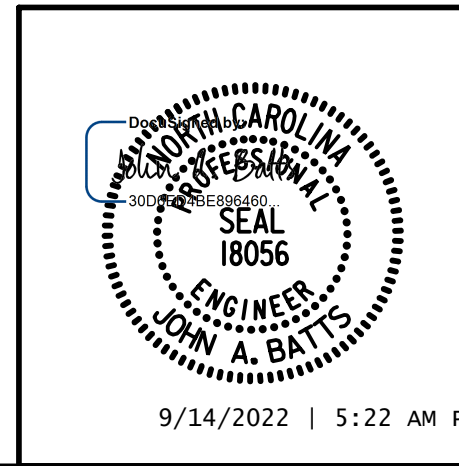


DRAWN BY: <u>T. BANKOVICH</u>	DATE: <u>5-22</u>
CHECKED BY: <u>J.A. BATTS</u>	DATE: <u>5-22</u>
DESIGN ENGINEER OF RECORD: <u>J.A. BATTS</u>	DATE: <u>5-22</u>

REVISIONS						SHEET NO.
NO.	BY:	DATE:	NO.	BY:	DATE:	S-8
1			3			TOTAL SHEETS
2			4			26


**DOCUMENT NOT CONSIDERED FINAL
 UNLESS ALL SIGNATURES COMPLETED**

9/14/2022 8:05:57 AM P:\Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401_B5652_SMU_C_660033.dgn

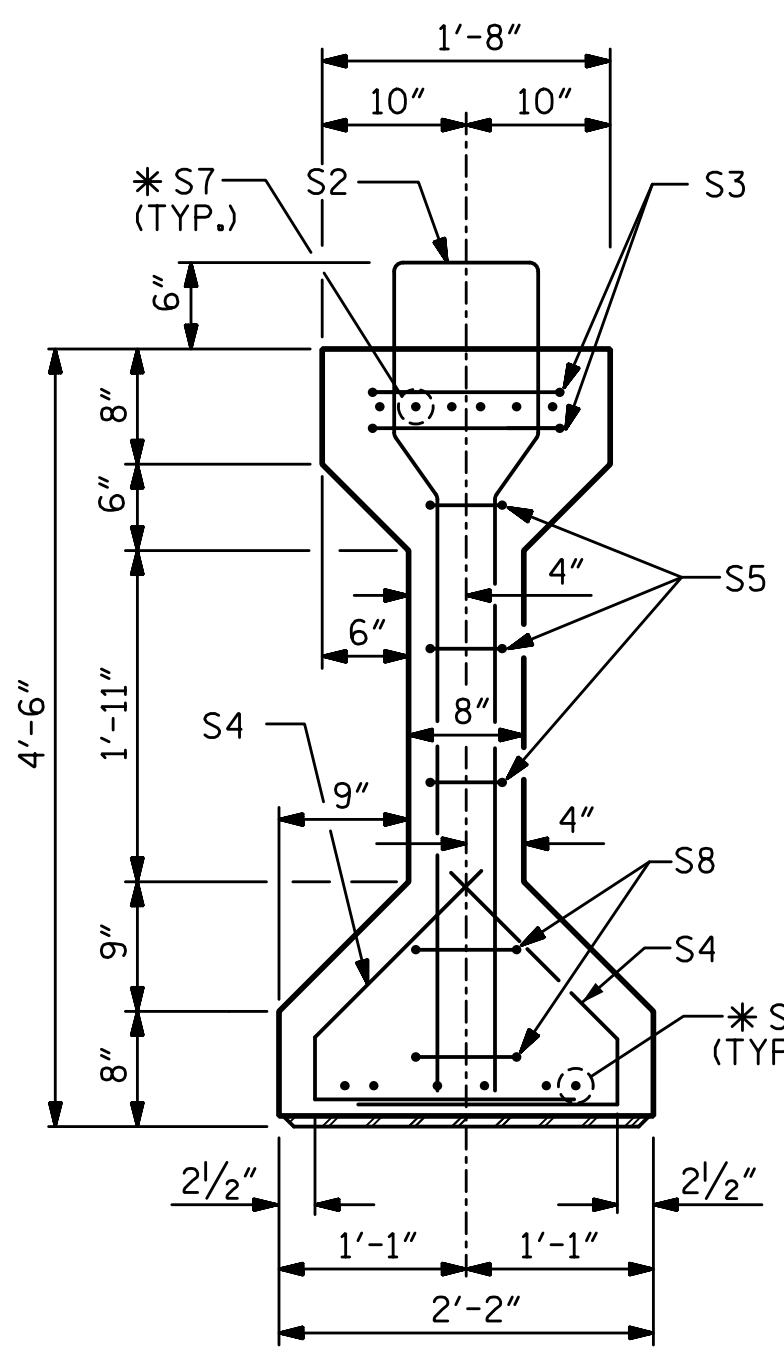


SECTION A-A


* FOR S7 BARS, SEE
DETAIL 'A' OF
PRESTRESSED
CONCRETE GIRDER
DETAILS SHEET

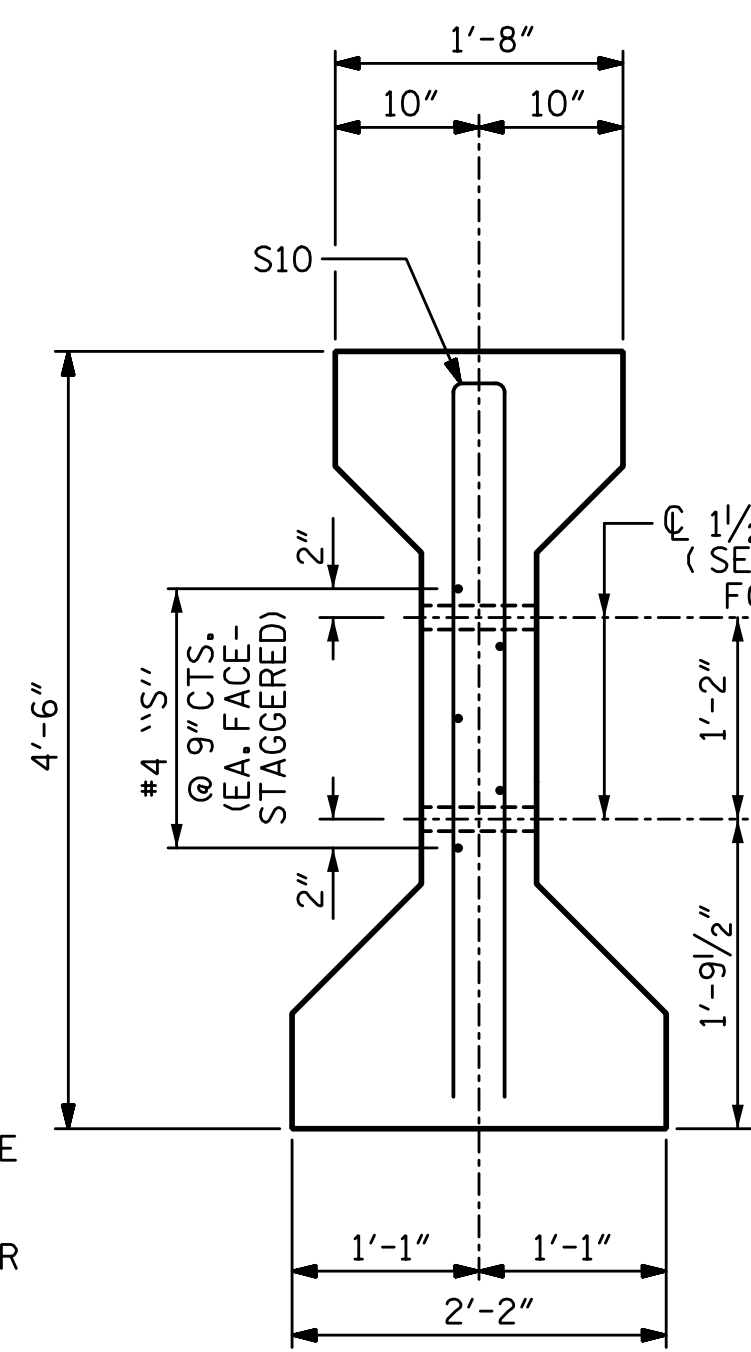

SECTION B-B
(S1 BARS NOT SHOWN)

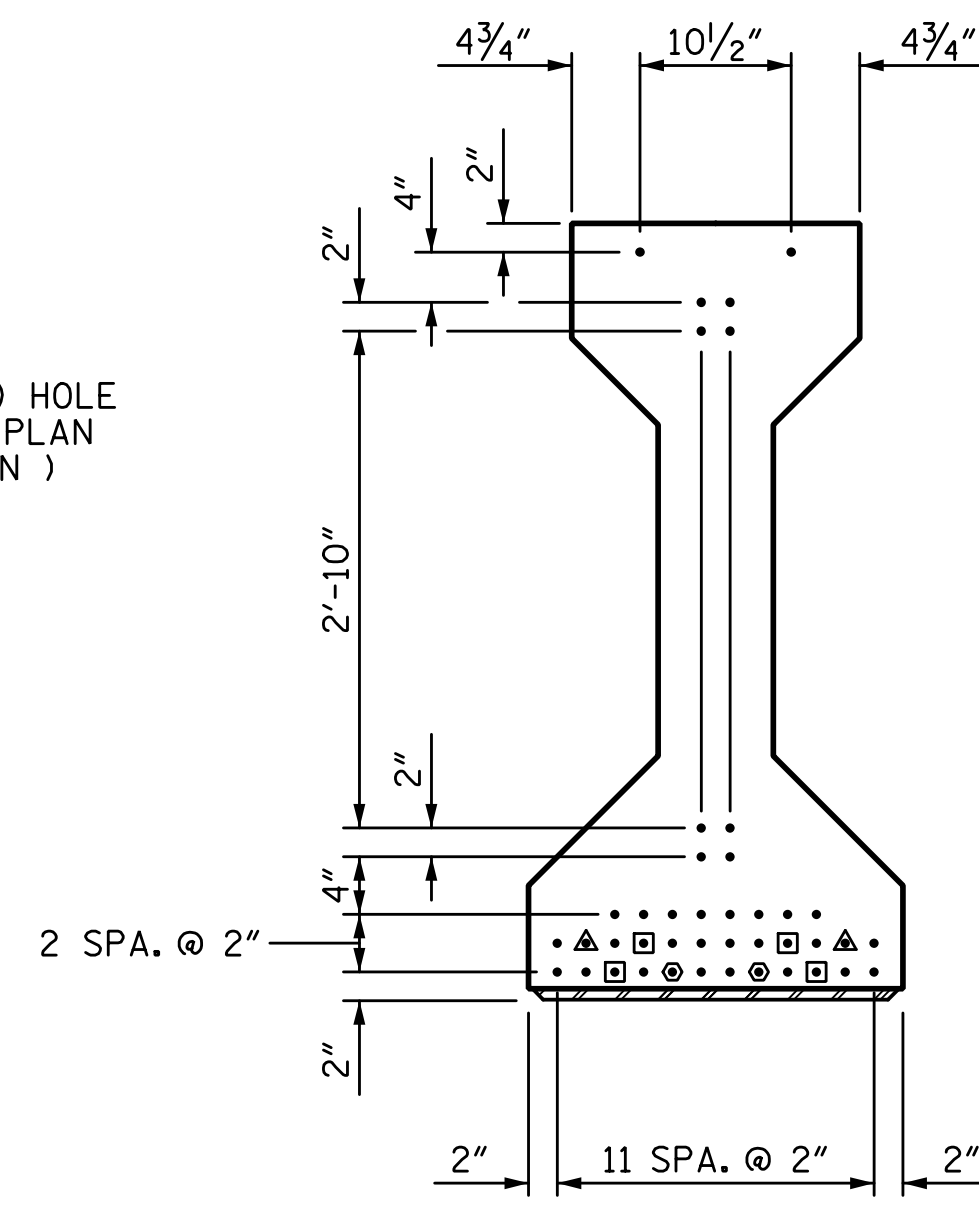


AT END OF GIRDER

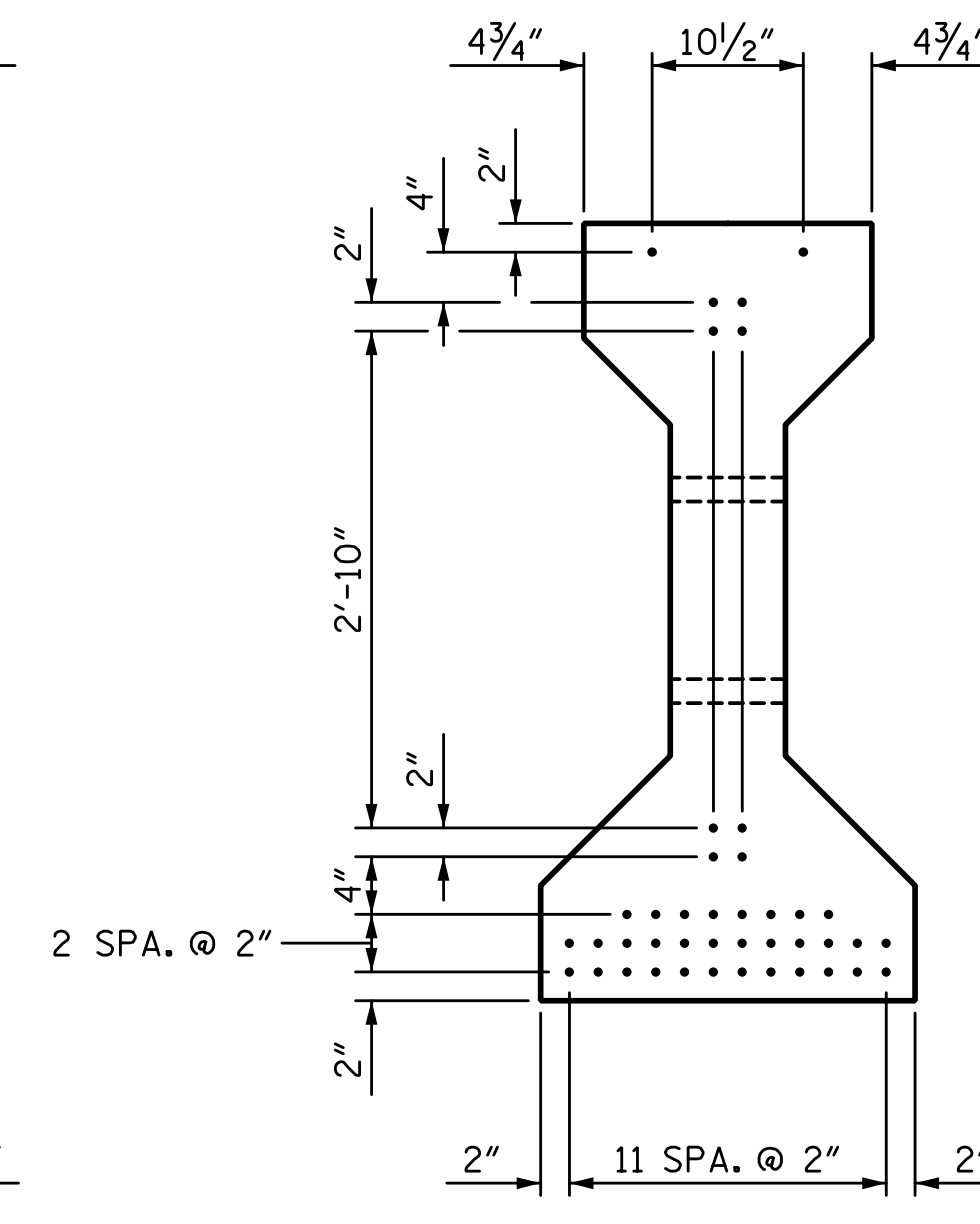


AT C OF GIRDER

0.6" Ø LOW RELAXATION STRAND LAYOUT


- FULLY BONDED STRAND
- ▲ STRAND DEBONDED FOR 6'-0" FROM END OF GIRDER
- STRAND DEBONDED FOR 12'-0" FROM END OF GIRDER
- STRAND DEBONDED FOR 24'-0" FROM END OF GIRDER

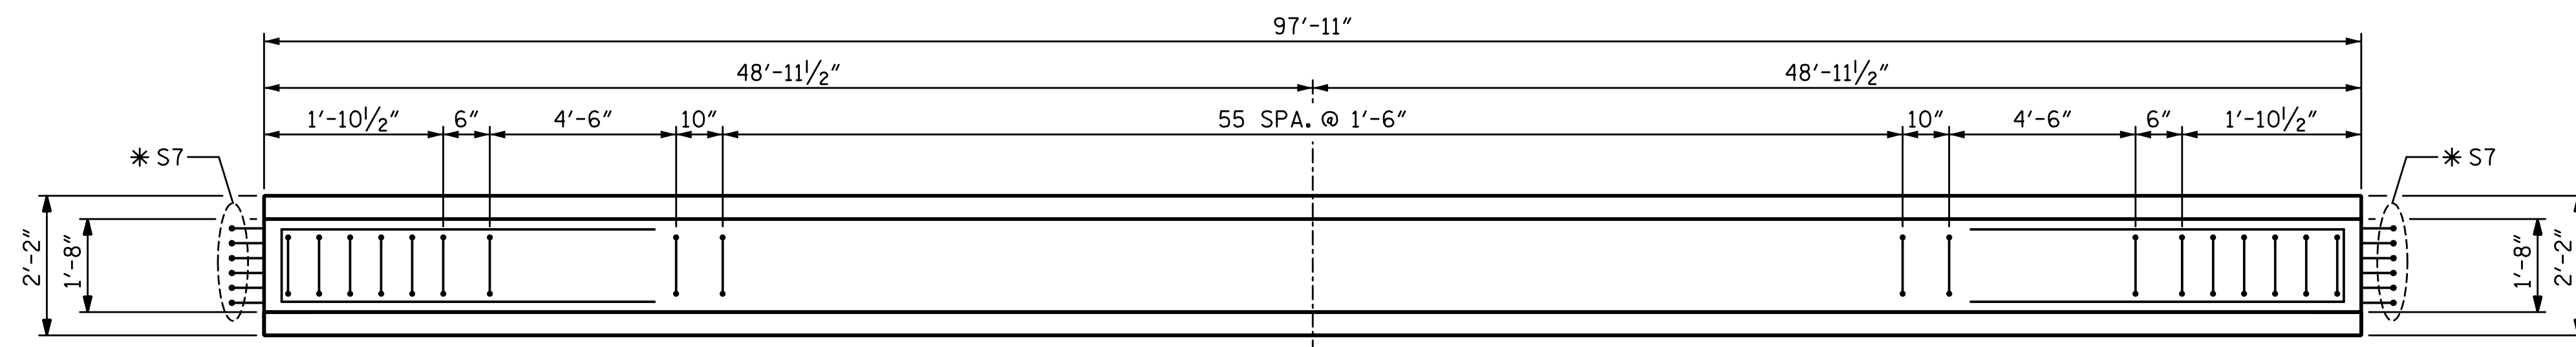

PLAN OF GIRDER

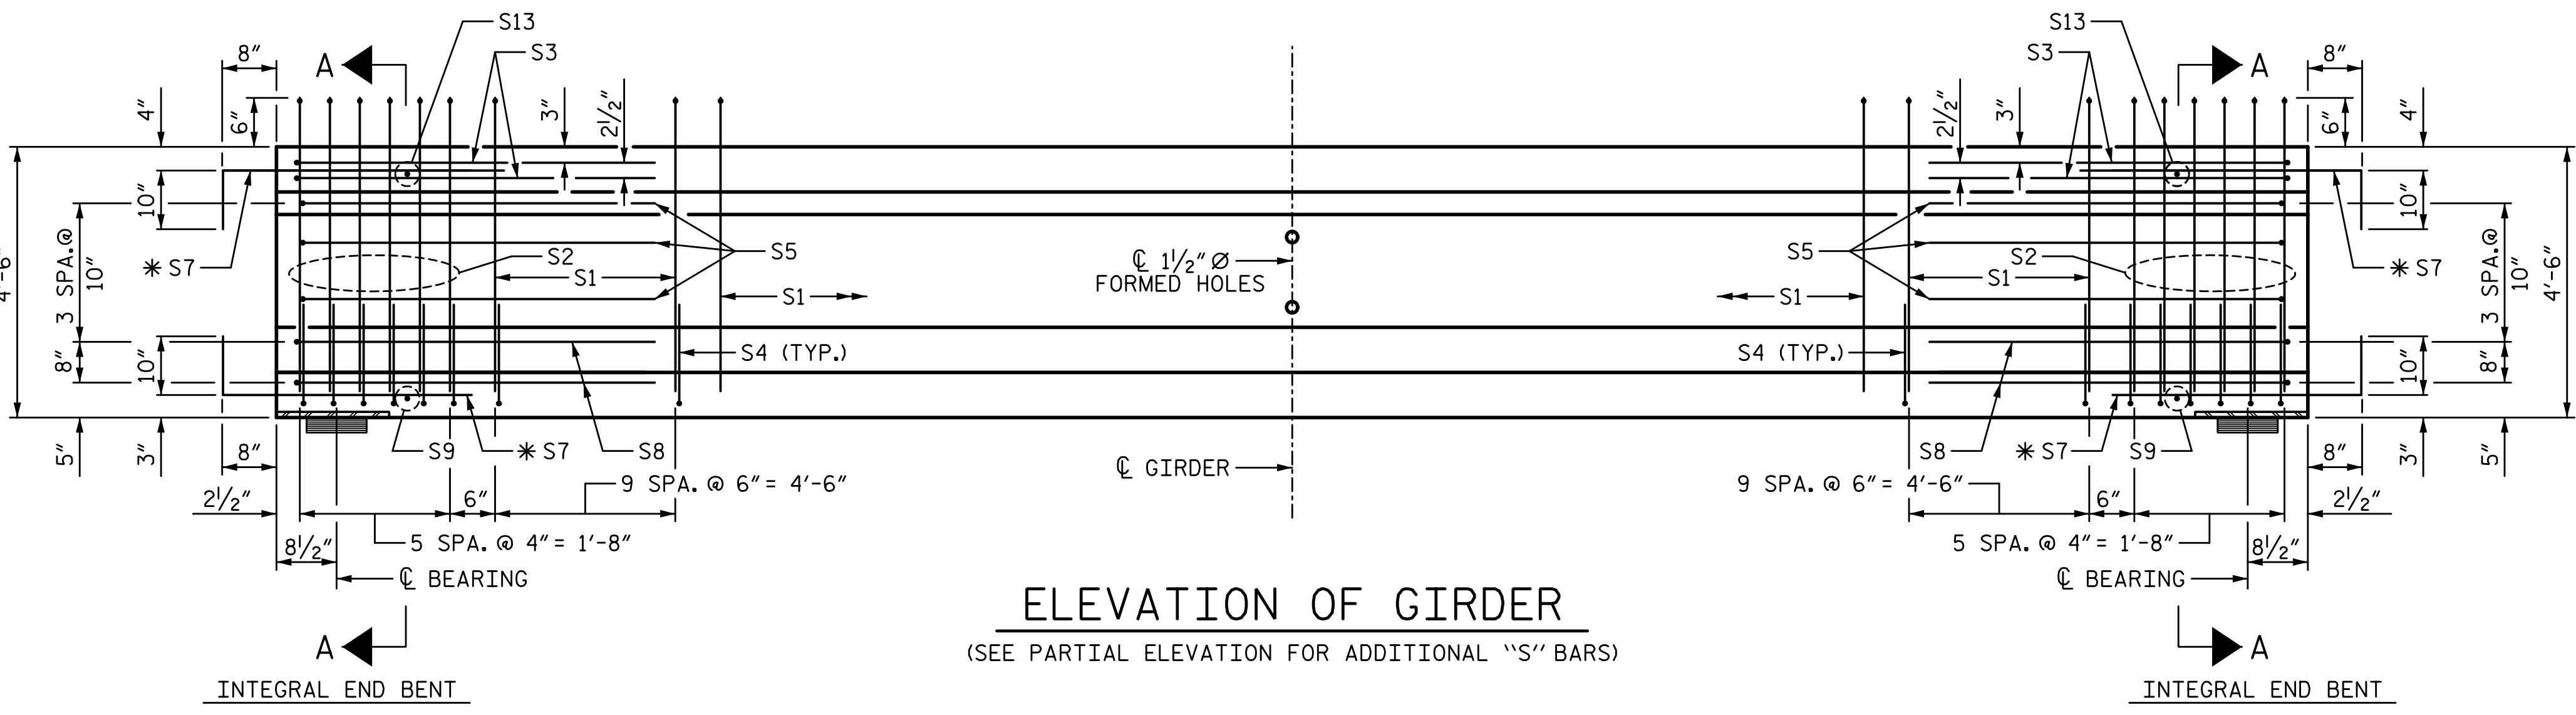

ELEVATION OF GIRDER
(SEE PARTIAL ELEVATION FOR ADDITIONAL "S" BARS)

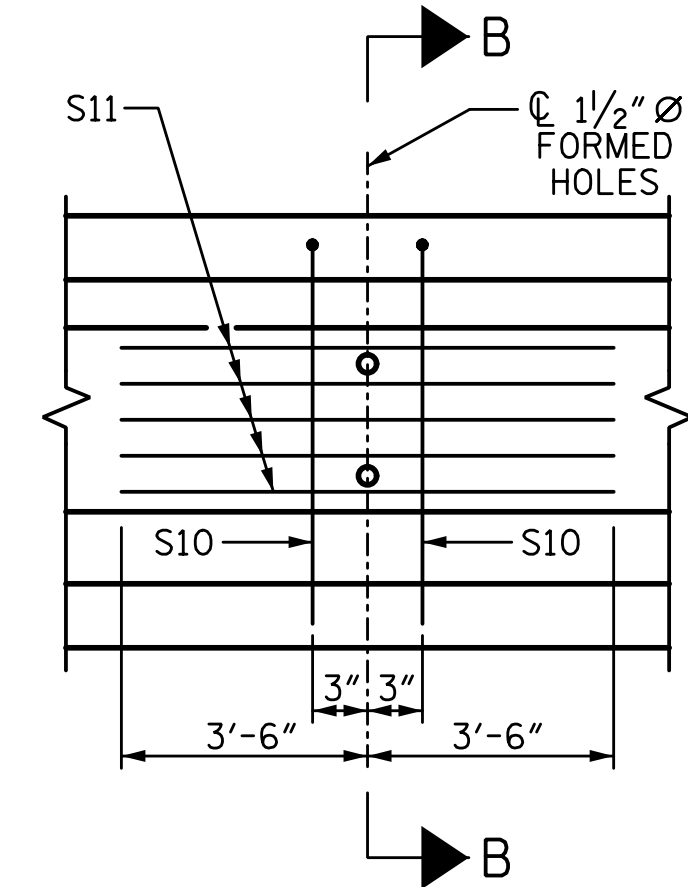

PARTIAL ELEVATION
SHOWING INTERMEDIATE DIAPHRAGM
REINFORCING STEEL FOR ALL GIRDERS

0.6" Ø L. R. GRADE 270 STRANDS


AREA (SQUARE INCHES)	ULTIMATE STRENGTH (LBS. PER STRAND)	APPLIED PRESTRESS (LBS. PER STRAND)
0.217	58,600	43,950

REINFORCING STEEL FOR ONE GIRDER

BAR	NO.	SIZE	TYPE	LENGTH	WEIGHT
S1	76	#4	1	10'-8"	542
S2	12	#4	1	10'-8"	192
S3	4	#4	2	9'-1"	24
S4	64	#4	3	3'-5"	146
S5	6	#4	2	8'-5"	34
* S7	24	#5	STR	3'-8"	92
S8	4	#4	2	8'-7"	23
S9	2	#3	STR	1'-10"	1
S10	2	#5	2	8'-8"	18
S11	5	#4	STR	7'-0"	23
S13	2	#3	STR	1'-4"	1

* NOTE: S7 BARS SHALL BE BENT BEFORE SHIPMENT. HEAT BENDING SHALL NOT BE ALLOWED.

BAR TYPES

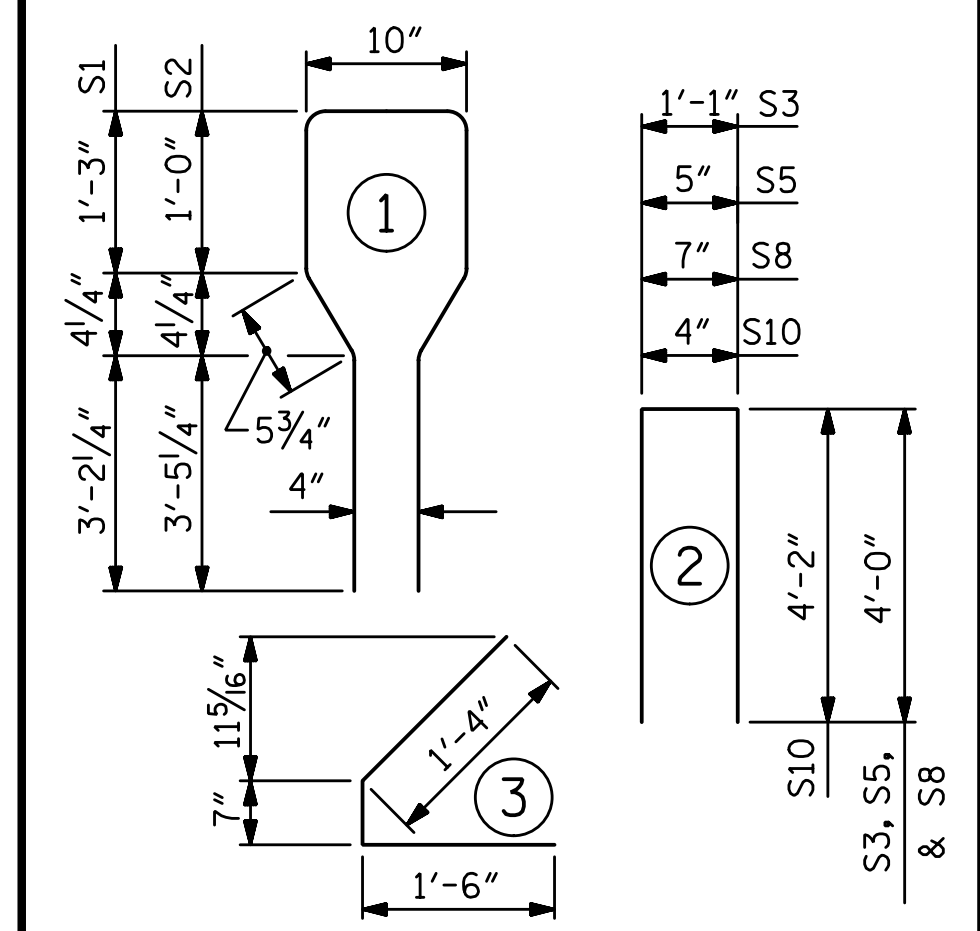

ALL BAR DIMENSIONS ARE OUT-TO-OUT

QUANTITIES FOR ONE GIRDER


SPAN A	REINFORCING STEEL	7,500 PSI CONCRETE	0.6" Ø L. R. STRANDS
	LB.	C.Y.	No.
ALL GIRDERS	1096	19.9	42

GIRDERS REQUIRED

NUMBER	LENGTH	TOTAL LENGTH
5	97'-11"	489'-7"

PROJECT NO. B-5652
ONLOW COUNTY
 STATION: 20+64.00 -L-RT-

STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH
 SUPERSTRUCTURE
 AASHTO TYPE IV
 PRESTRESSED CONCRETE
 GIRDER

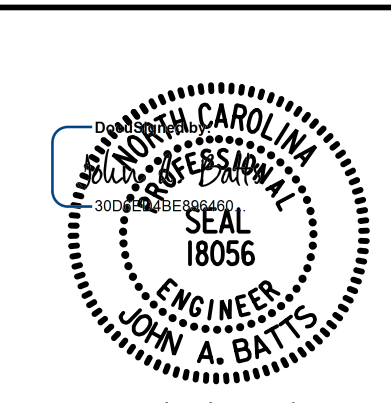

LICENSURE NO. C-4434

9/14/2022 | 5:22 AM




DRAWN BY: T. BANKOVICH DATE: 5-22
 CHECKED BY: J.A. BATTS DATE: 5-22
 DESIGN ENGINEER OF RECORD: J.A. BATTS DATE: 5-22

REVISIONS				SHEET NO.	
NO.	BY:	DATE:	NO.	BY:	DATE:
1			3		
2			4		

DOCUMENT NOT CONSIDERED FINAL
 UNLESS ALL SIGNATURES COMPLETED

TOTAL SHEETS: 26

9/14/2022 8:05:58 AM P:\Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401-B5652-SMU_DL_660033.dgn

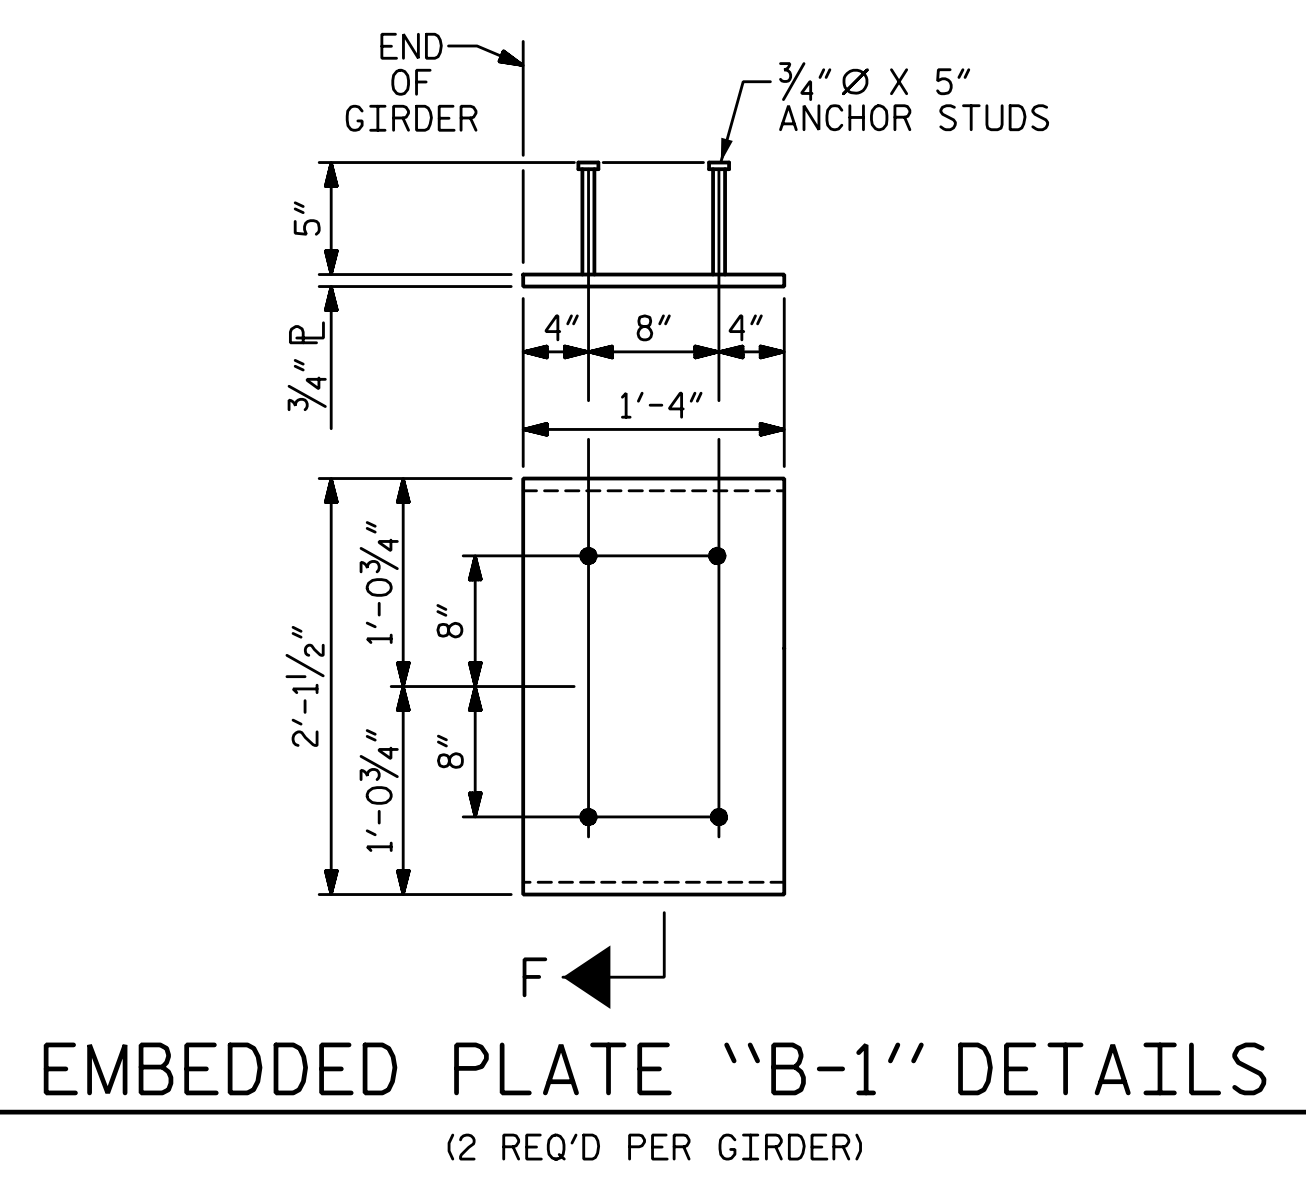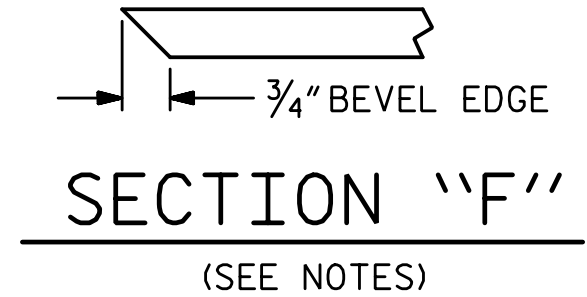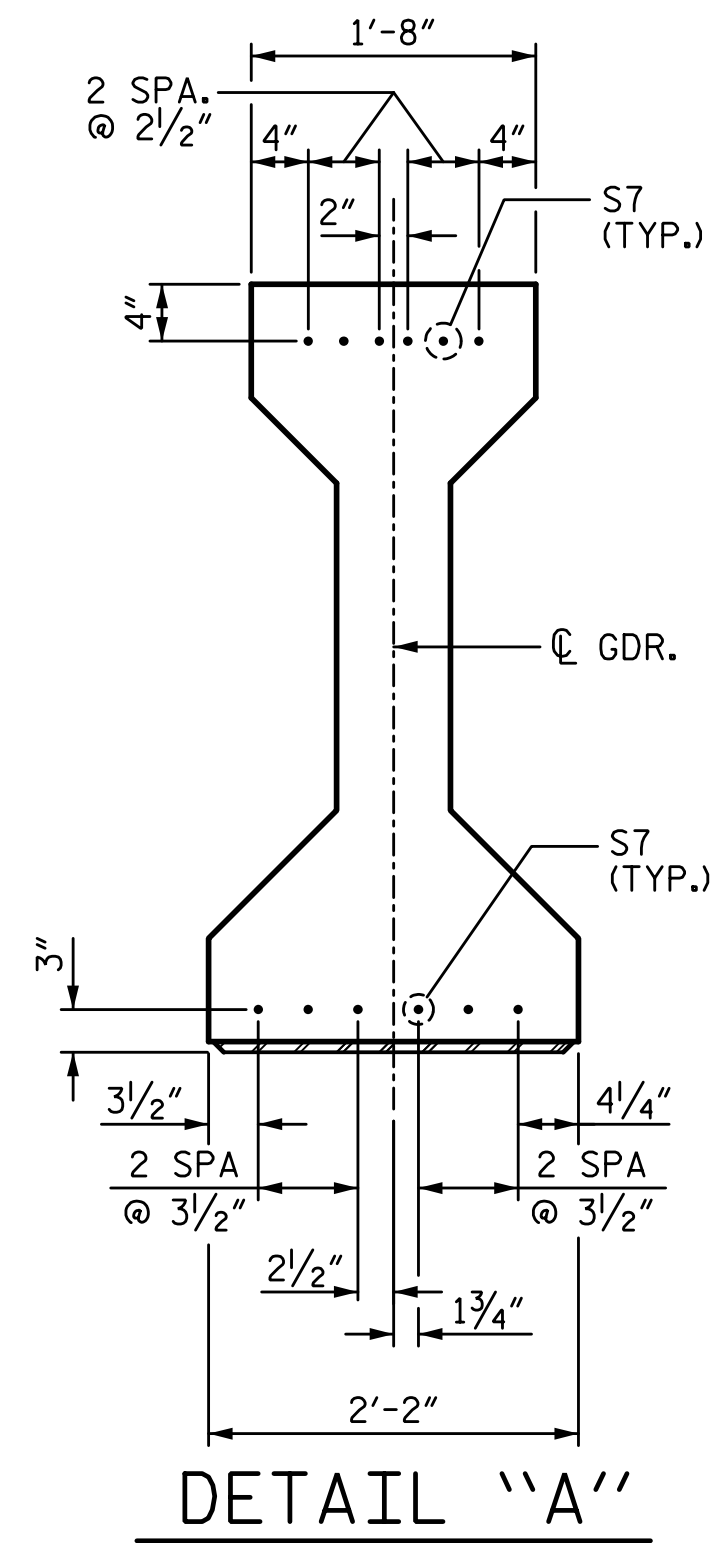

NOTES:

ALL PRESTRESSING STRANDS SHALL BE 7-WIRE LOW-RELAXATION GRADE 270 STRANDS AND SHALL CONFORM TO AASHTO M203 EXCEPT FOR SAMPLING REQUIREMENTS WHICH SHALL BE IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

ALL REINFORCING STEEL SHALL BE GRADE 60.

EMBEDDED PLATE "B-1" SHALL BE GALVANIZED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

ANCHOR STUDS SHALL CONFORM TO AASHTO M169 GRADES 1010 THROUGH 1020 OR APPROVED EQUAL, AND SHALL MEET THE TYPE "B" REQUIREMENTS OF SUBSECTION 7.3 OF THE ANSI/AASHTO/AWS D1.5 BRIDGE WELDING CODE.

AT ENDS OF GIRDERS TO BE EMBEDDED IN CONCRETE DIAPHRAGMS OR END WALLS, PRESTRESSING STRANDS MAY EXTEND A MAXIMUM OF 2" BEYOND THE GIRDER ENDS. OTHERWISE, PRESTRESSING STRANDS SHALL BE CUT FLUSH WITH THE GIRDER ENDS.

THE TRANSFER OF LOAD FROM THE ANCHORAGES TO THE GIRDER SHALL BE DONE WHEN CONCRETE HAS REACHED A COMPRESSIVE STRENGTH OF NOT LESS THAN 6000 PSI.

DEPENDING ON THE TYPE OF SYSTEM USED TO SUPPORT THE DECK SLAB FORMS, PRESET ANCHORS MAY BE NECESSARY IN THE PRESTRESSED CONCRETE GIRDER.

THE TOP SURFACE OF THE GIRDER, EXCLUDING THE OUTSIDE 4", SHALL BE RAKED TO A DEPTH OF 1/4".

THE CONTRACTOR HAS THE OPTION TO PROVIDE, AT NO ADDITIONAL COST TO THE DEPARTMENT, 2 ADDITIONAL STRANDS AT THE TOP OF THE GIRDER TO FACILITATE TYING OF THE REINFORCING STEEL. THESE STRANDS SHALL BE PULLED TO A LOAD OF 4500 lbs.


PRESTRESSED CONCRETE GIRDERS SHALL CONTAIN CALCIUM NITRITE CORROSION INHIBITOR.

DEAD LOAD DEFLECTION TABLE FOR GIRDERS																						
0.6" Ø LOW RELAXATION		GIRDERS AG1 & AG5																				
TWENTIETH POINTS		0	.05	.10	.15	.20	.25	.30	.35	.40	.45	.50	.55	.60	.65	.70	.75	.80	.85	.90	.95	1.0
CAMBER (GIRDER ALONE IN PLACE)	↑	0	0.030	0.059	0.087	0.112	0.135	0.154	0.169	0.180	0.187	0.189	0.187	0.180	0.169	0.154	0.135	0.112	0.087	0.059	0.030	0
* DEFLECTION DUE TO SUPERIMPOSED D.L.	↓	0	0.018	0.038	0.057	0.075	0.090	0.104	0.114	0.122	0.127	0.128	0.127	0.114	0.104	0.090	0.075	0.057	0.038	0.018	0	0
FINAL CAMBER	↑	0	1/8"	1/4"	3/8"	7/16"	9/16"	5/8"	11/16"	11/16"	3/4"	3/4"	3/4"	11/16"	11/16"	5/8"	9/16"	7/16"	3/8"	1/4"	1/8"	0
0.6" Ø LOW RELAXATION		GIRDERS AG2, AG3 & AG4																				
TWENTIETH POINTS		0	.05	.10	.15	.20	.25	.30	.35	.40	.45	.50	.55	.60	.65	.70	.75	.80	.85	.90	.95	1.0
CAMBER (GIRDER ALONE IN PLACE)	↑	0	0.030	0.059	0.087	0.112	0.135	0.154	0.169	0.180	0.187	0.189	0.187	0.180	0.169	0.154	0.135	0.112	0.087	0.059	0.030	0
* DEFLECTION DUE TO SUPERIMPOSED D.L.	↓	0	0.020	0.042	0.063	0.083	0.100	0.115	0.127	0.135	0.141	0.142	0.141	0.135	0.127	0.115	0.100	0.083	0.063	0.042	0.020	0
FINAL CAMBER	↑	0	1/8"	3/16"	5/16"	3/8"	7/16"	7/16"	1/2"	9/16"	9/16"	9/16"	9/16"	9/16"	1/2"	7/16"	7/16"	3/8"	5/16"	3/16"	1/8"	0

* INCLUDES FUTURE WEARING SURFACE
ALL VALUES ARE SHOWN IN FEET (DECIMAL FORM), EXCEPT "FINAL CAMBER", WHICH IS GIVEN IN INCHES (FRACTION FORM).

PROJECT NO. B-5652
ONLOW COUNTY
STATION: 20+64.00 -L-RT-


DRAWN BY: T. BANKOVICH DATE: 5-22
CHECKED BY: J.A. BATTS DATE: 5-22
DESIGN ENGINEER OF RECORD: J.A. BATTS DATE: 5-22

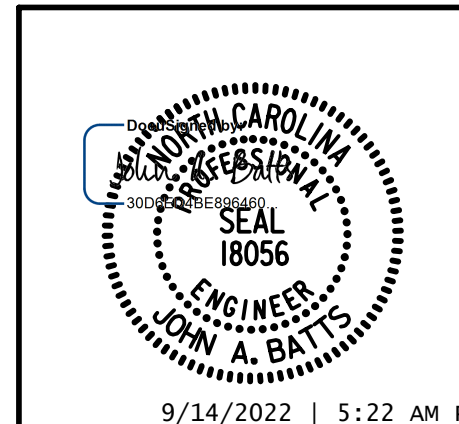


STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH
SUPERSTRUCTURE
PRESTRESSED CONCRETE GIRDER DETAILS

LICENSURE NO. C-4434						DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED						REVISIONS		SHEET NO. S-10
NO.	BY:	DATE:	NO.	BY:	DATE:	NO.	BY:	DATE:	NO.	BY:	DATE:	TOTAL SHEETS	26	
1			3			4								

12/19/2022 8:10:57 AM P:\Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401-B5652-SMU_SS-660033.dgn

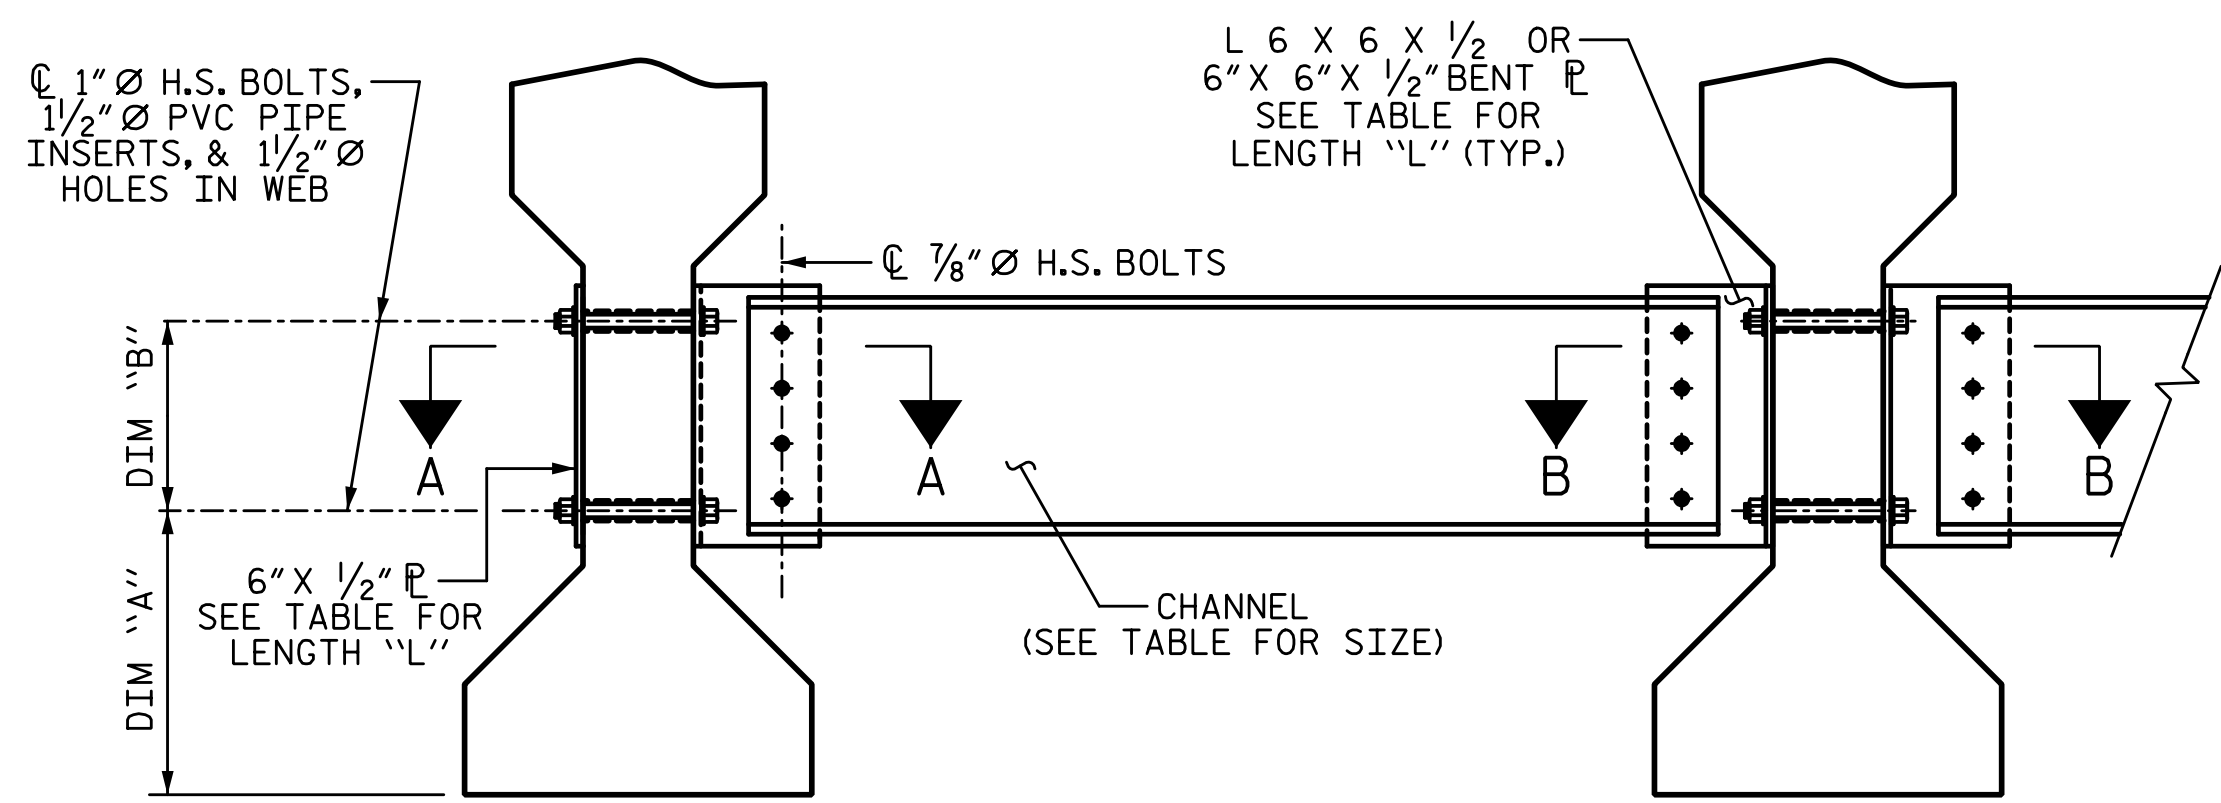

EXTERIOR GIRDER
INTERIOR GIRDER
PART SECTION AT INTERMEDIATE DIAPHRAGM

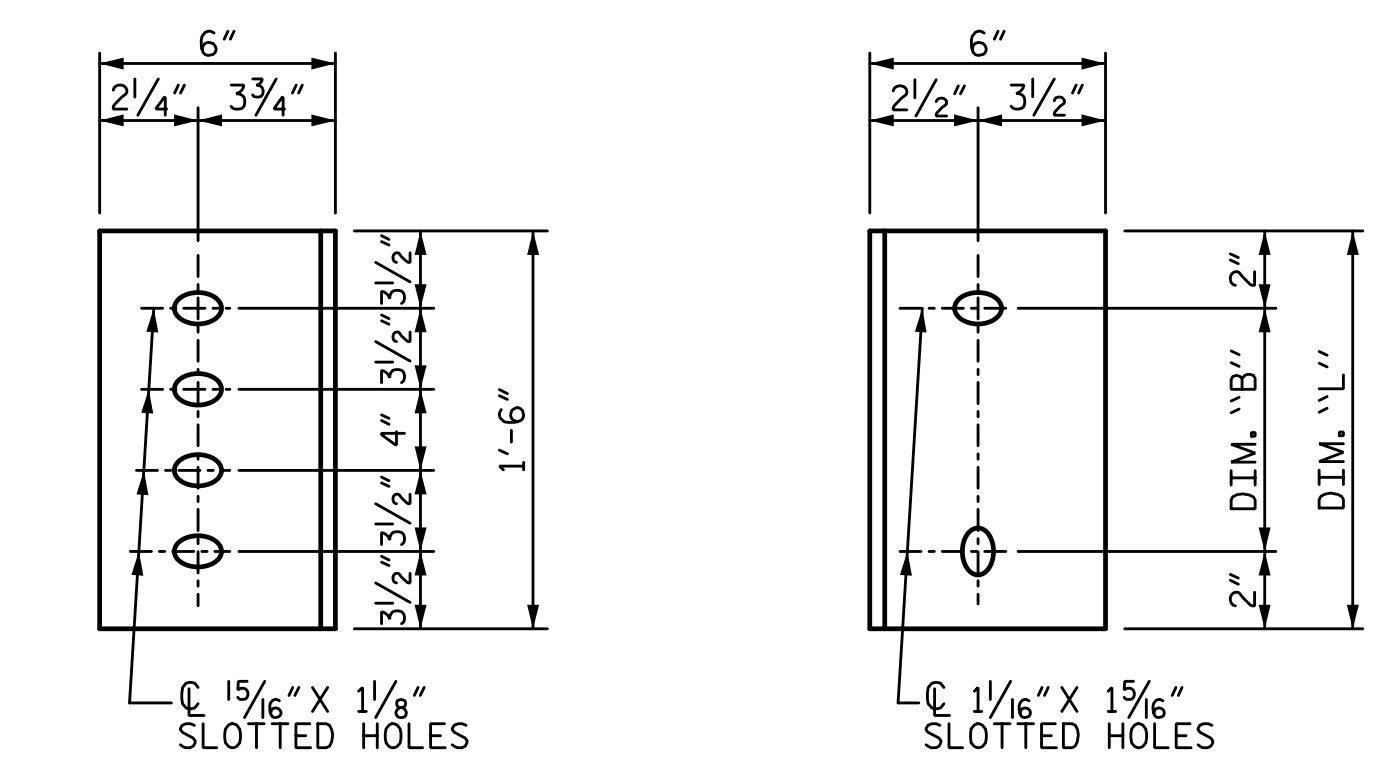

DIAPHRAGM FACE
WEB FACE
CONNECTOR PLATE DETAILS



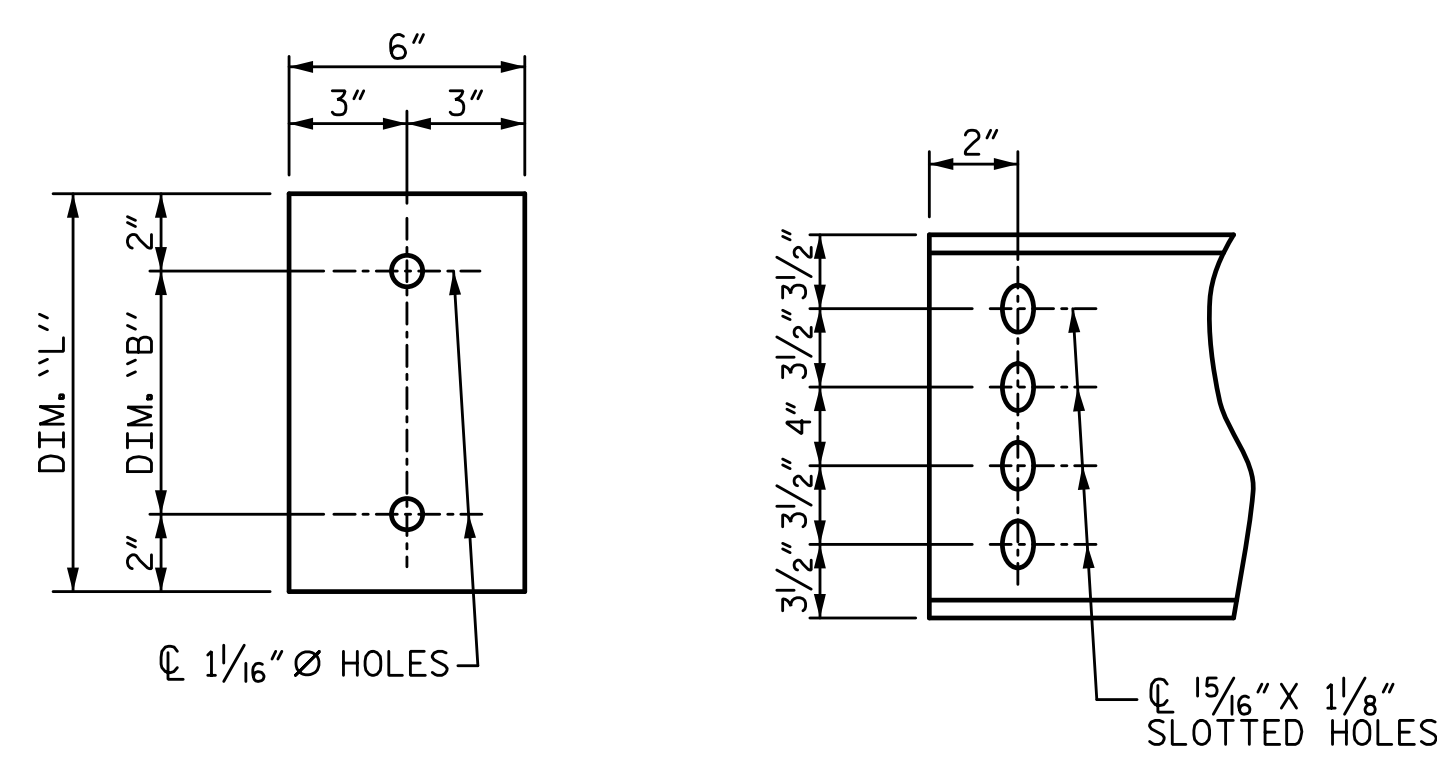


PLATE DETAILS
CHANNEL END

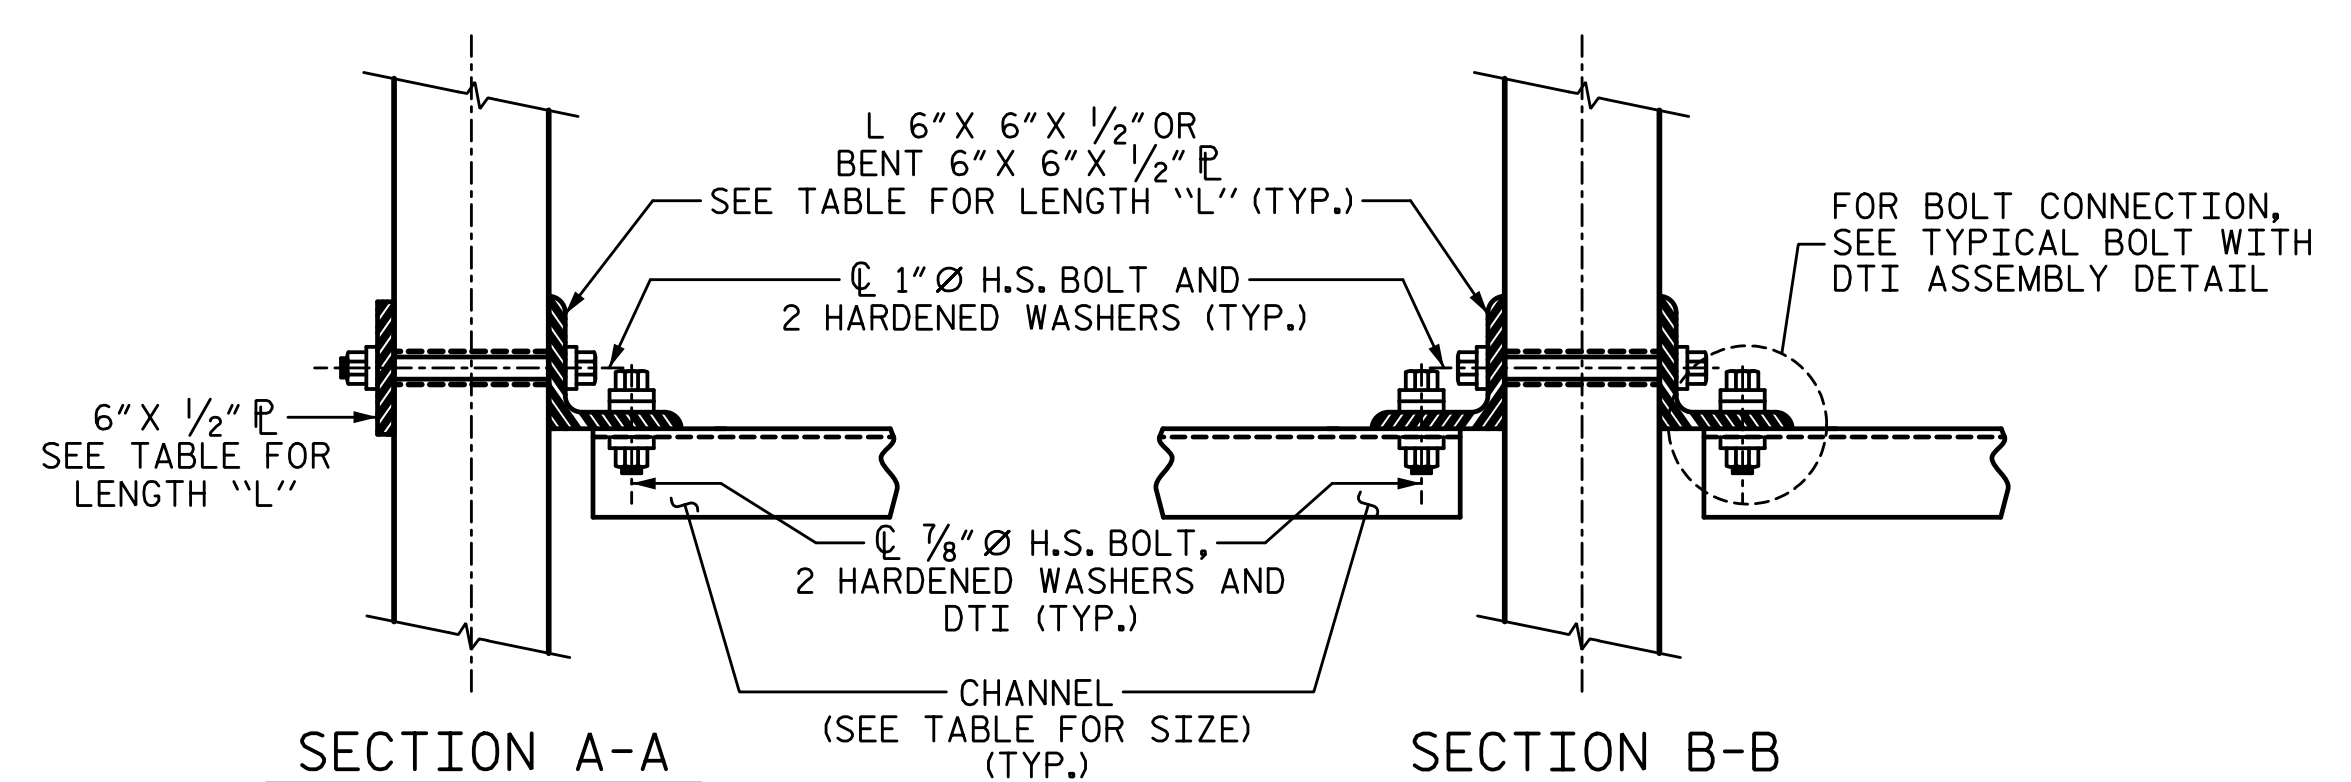

SECTION A-A
SECTION B-B
CONNECTION DETAILS

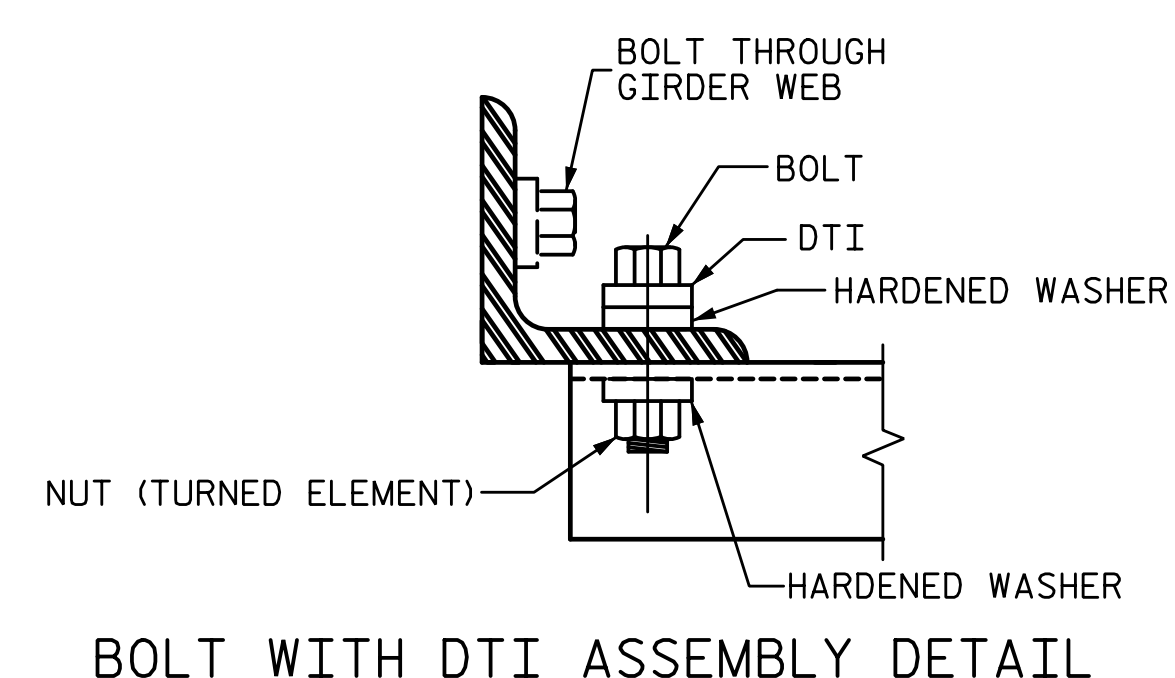

BOLT WITH DTI ASSEMBLY DETAIL

STRUCTURAL STEEL NOTES:

ALL INTERMEDIATE DIAPHRAGM STEEL AND CONNECTOR PLATES SHALL BE AASHTO M270 GRADE 50 OR APPROVED EQUAL.

TENSION ON THE ASTM A325 BOLTS THROUGH THE CHANNEL MEMBER SHALL BE CALIBRATED USING DIRECT TENSION INDICATOR WASHERS IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

TENSION ON THE ASTM A449 BOLTS THROUGH THE GIRDER WEB SHALL BE SNUG TIGHTENED FOLLOWED BY AN ADDITIONAL 1/4 TURN.

THE PLATES, BENT PLATES, CHANNELS, AND ANGLES SHALL BE METALLIZED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS. FOR THERMAL SPRAYED COATINGS (METALLIZATION), SEE SPECIAL PROVISIONS.

FOR METALLIZATION, APPLY A THERMAL SPRAYED COATING WITH A SEAL COAT TO ALL STEEL DIAPHRAGM SURFACES IN ACCORDANCE WITH THE DEPARTMENTS THERMAL SPRAYED COATINGS (METALLIZATION) PROGRAM, THERMAL SPRAYED COATINGS SPECIAL PROVISION AND SECTION 442 OF THE STANDARD SPECIFICATIONS.

METALLIZE THE HIGH STRENGTH BOLTS, NUTS, WASHERS AND DIRECT TENSION INDICATORS IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

USE AN ASTM F436 HARDENED WASHER WITH STANDARD AND SLOTTED HOLES UNDER EACH BOLT HEAD AND NUT.

FOR BOLTS THROUGH THE GIRDER WEB, PROVIDE SUFFICIENT LENGTH OF THREADS ON ALL BOLTS TO ACCOMMODATE WASHERS AND THE THICKNESS OF CONNECTING MEMBER PLUS AT LEAST 1/4" PROJECTION BEYOND THE NUT.

INTERMEDIATE DIAPHRAGM ASSEMBLY SHALL COMPLY WITH SECTION 1072 OF THE STANDARD SPECIFICATIONS.

SUBMIT TWO SETS OF WORKING DRAWINGS FOR THE INTERMEDIATE DIAPHRAGM ASSEMBLY FOR REVIEW, COMMENTS AND ACCEPTANCE. AFTER REVIEW, COMMENTS, AND ACCEPTANCE, SUBMIT SEVEN SETS FOR DISTRIBUTION.

IN THE EXTERIOR BAYS, PLACE TEMPORARY STRUTS BETWEEN PRESTRESSED GIRDERS ADJACENT TO THE STEEL DIAPHRAGMS. STRUTS SHALL REMAIN IN PLACE 3 DAYS AFTER CONCRETE IS PLACED.


THE COST OF THE STEEL DIAPHRAGMS AND ASSEMBLIES SHALL BE INCLUDED IN THE UNIT PRICE BID FOR PRESTRESSED CONCRETE GIRDERS.

TABLE

GIRDER TYPE	CHANNEL SIZE	DIM "A"	DIM "B"	DIM "L"
IV	MC 18 x 42.7	1'-9 1/2"	1'-2"	1'-6"

PROJECT NO. B-5652
ONLOW COUNTY
 STATION: 20+64.00 -L-RT-

DRAWN BY: T. BANKOVICH DATE: 5-22
 CHECKED BY: J.A. BATTS DATE: 5-22
 DESIGN ENGINEER OF RECORD: J.A. BATTS DATE: 5-22

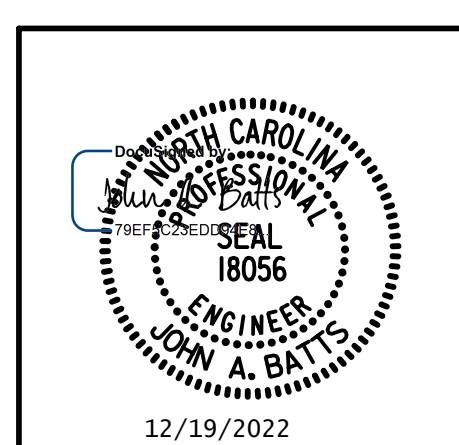





STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH
 SUPERSTRUCTURE
 INTERMEDIATE STEEL
 DIAPHRAGMS FOR
 TYPE IV PREST.
 CONCRETE GIRDERS

REVISIONS				SHEET NO.
NO.	BY:	DATE:	NO.	DATE:
1			3	
2			4	

TOTAL SHEETS: 26

**DOCUMENT NOT CONSIDERED FINAL
 UNLESS ALL SIGNATURES COMPLETED**

9/14/2022 8:05:59 AM P:\Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401_B5652_SMU_BG_660033.dgn

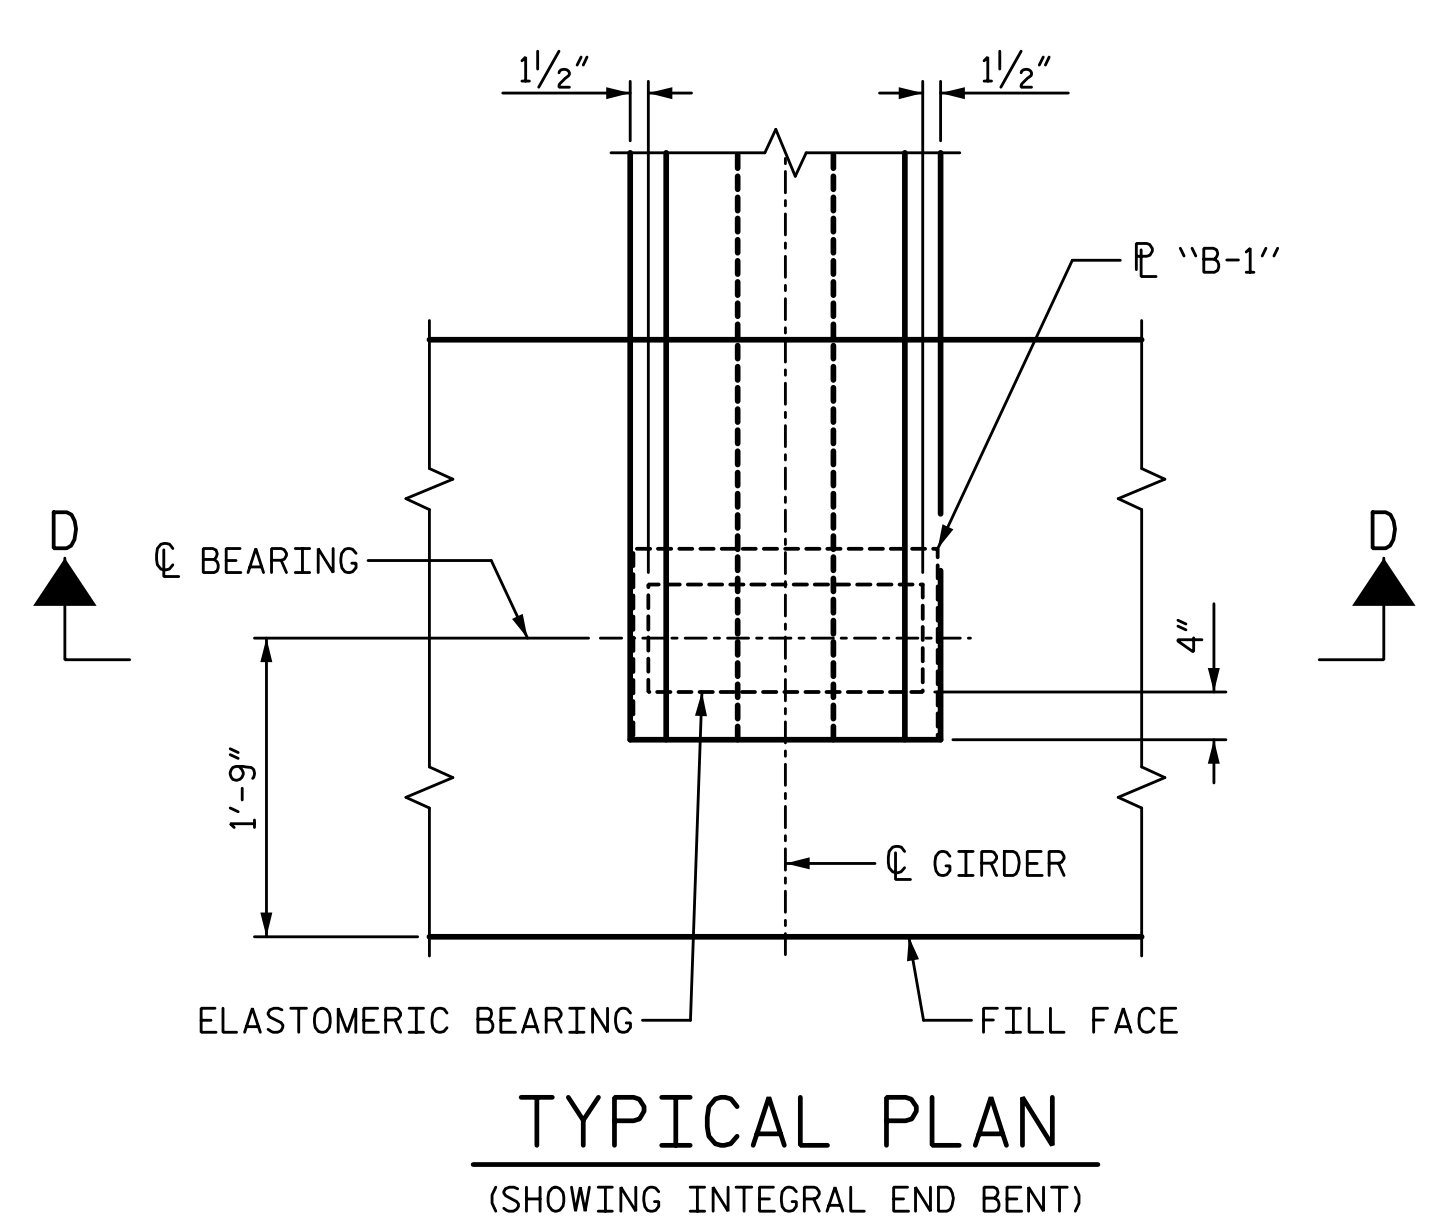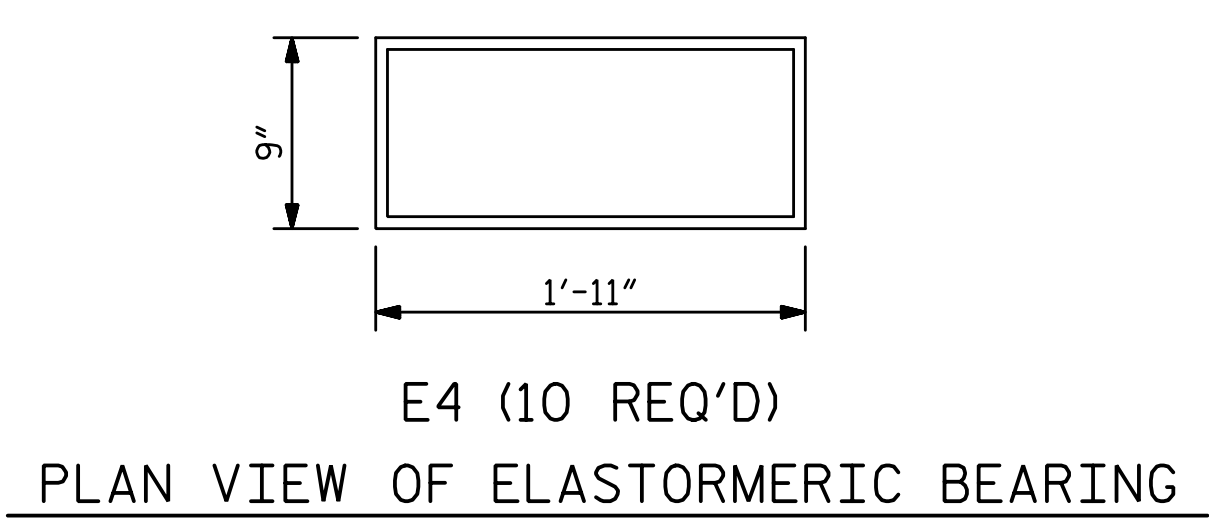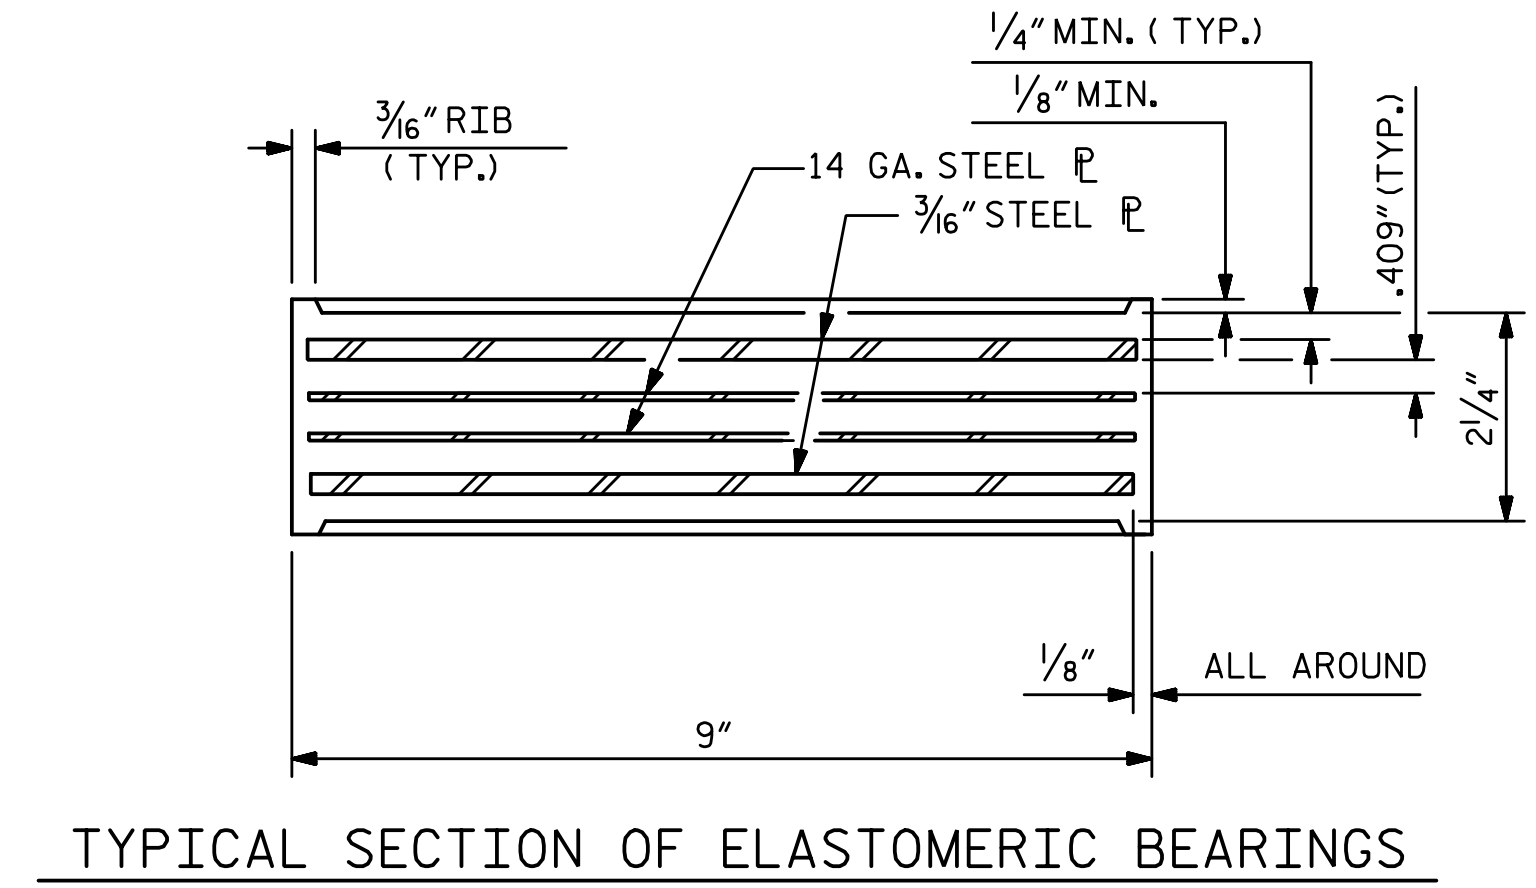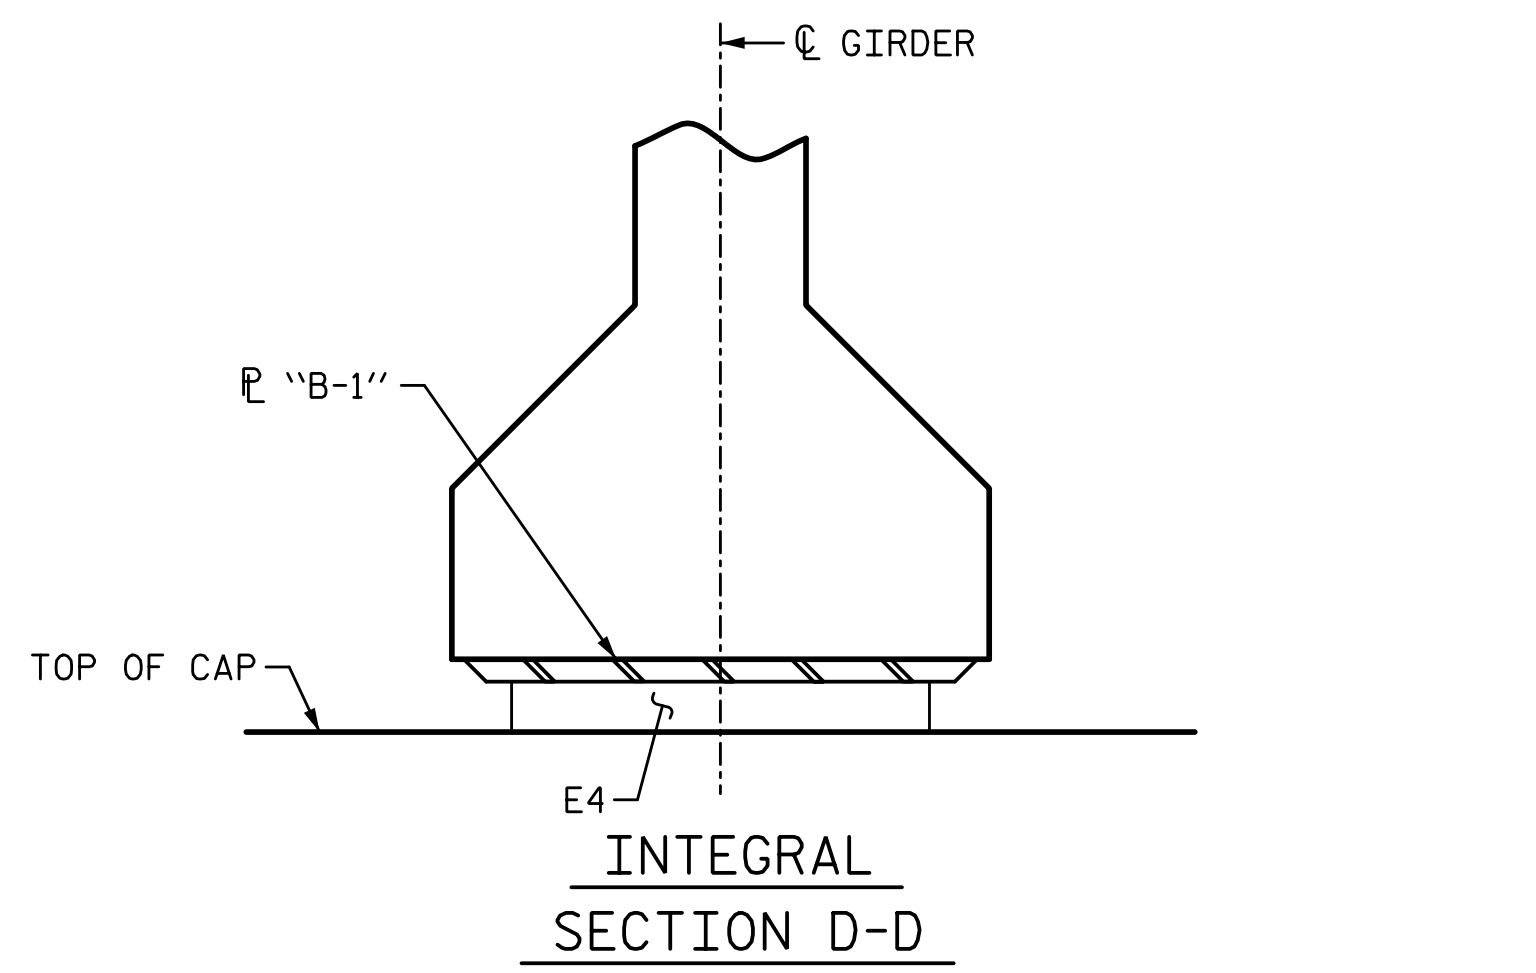

NOTES:

THE ELASTOMER IN THE STEEL REINFORCED BEARINGS SHALL HAVE A SHEAR MODULUS OF 0.160 KSI, IN ACCORDANCE WITH AASHTO M251.


FOR STEEL REINFORCED ELASTOMERIC BEARINGS, SEE SPECIAL PROVISIONS.

ELASTOMER IN ALL BEARINGS SHALL BE 60 DUROMETER HARDNESS.

MAXIMUM ALLOWABLE SERVICE LOADS	
D.L.+L.L. (NO IMPACT)	
TYPE V	365 k

PROJECT NO. B-5652
ONLOW COUNTY
 STATION: 20+64.00 -L-RT-

STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH
 SUPERSTRUCTURE
**ELASTOMERIC BEARING
 DETAILS**

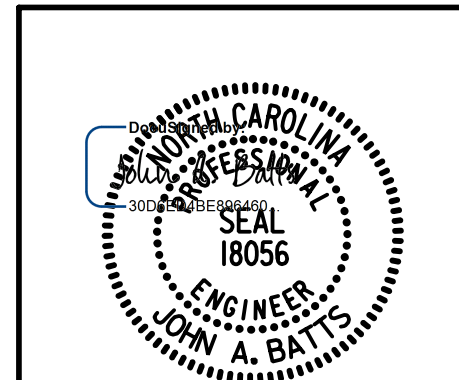


DRAWN BY: <u>T. BANKOVICH</u>	DATE: <u>5-22</u>
CHECKED BY: <u>J.A. BATTS</u>	DATE: <u>5-22</u>
DESIGN ENGINEER OF RECORD: <u>J.A. BATTS</u>	DATE: <u>5-22</u>

REVISIONS						SHEET NO.
NO.	BY:	DATE:	NO.	BY:	DATE:	S-12
1			3			TOTAL SHEETS
2			4			26

LICENSURE NO. C-4434

**DOCUMENT NOT CONSIDERED FINAL
 UNLESS ALL SIGNATURES COMPLETED**

9/14/2022 8:06:00 AM P:\Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401_B5652_SMU_BR_660033.dgn

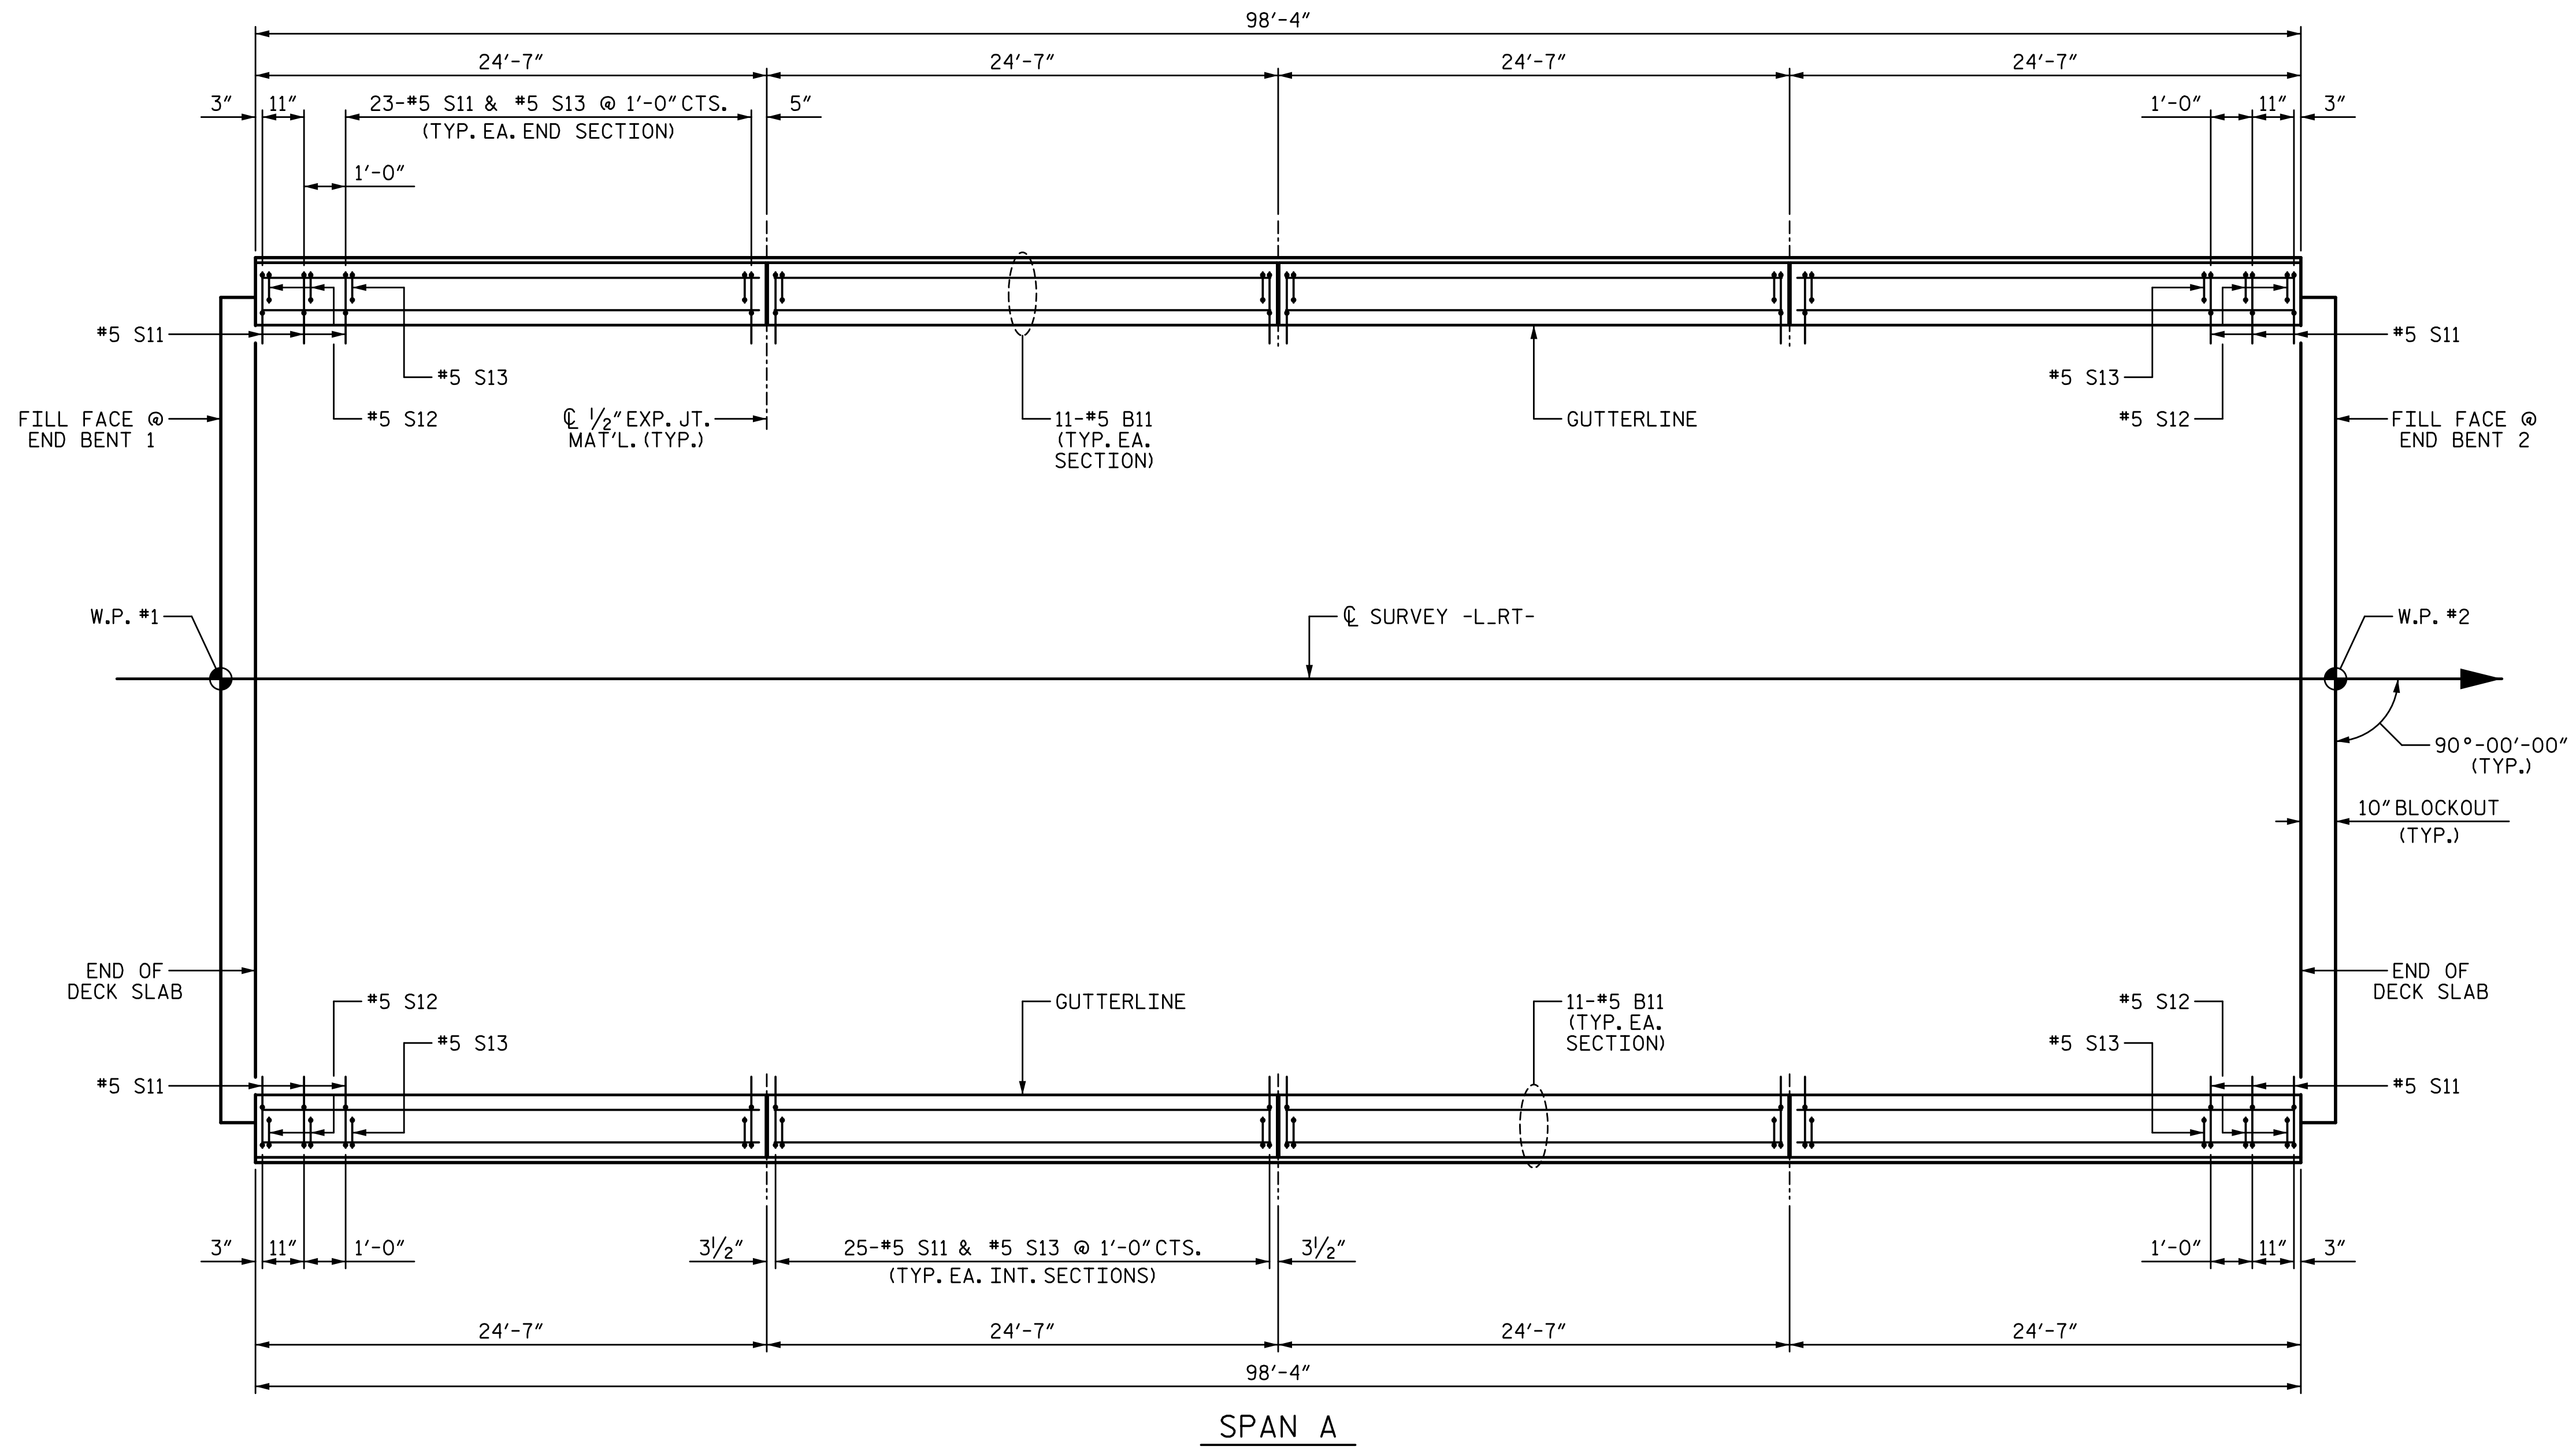


SPAN A
PLAN OF BARRIER RAIL

PROJECT NO. B-5652
ONLOW COUNTY
STATION: 20+64.00 -L-RT-

SHEET 1 OF 2

STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH
SUPERSTRUCTURE

CONCRETE BARRIER
RAIL

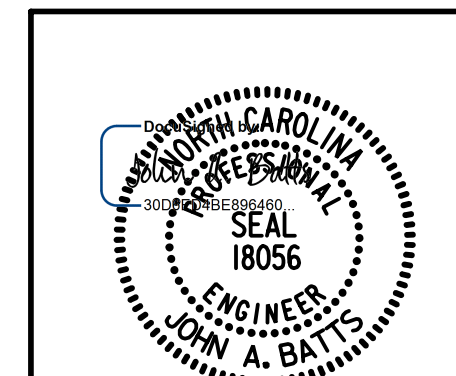

9/14/2022 | 5:22 AM


DRAWN BY:	T. BANKOVICH	DATE:	5-22
CHECKED BY:	J.A. BATTS	DATE:	5-22
DESIGN ENGINEER OF RECORD:	J.A. BATTS	DATE:	5-22

LICENSURE NO. C-4434


DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED

REVISIONS						SHEET NO.
NO.	BY:	DATE:	NO.	BY:	DATE:	S-13
1			3			TOTAL SHEETS
2			4			26

9/14/2022 8:06:00 AM P:\Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401-B5652-SMU_BR_660033.dgn

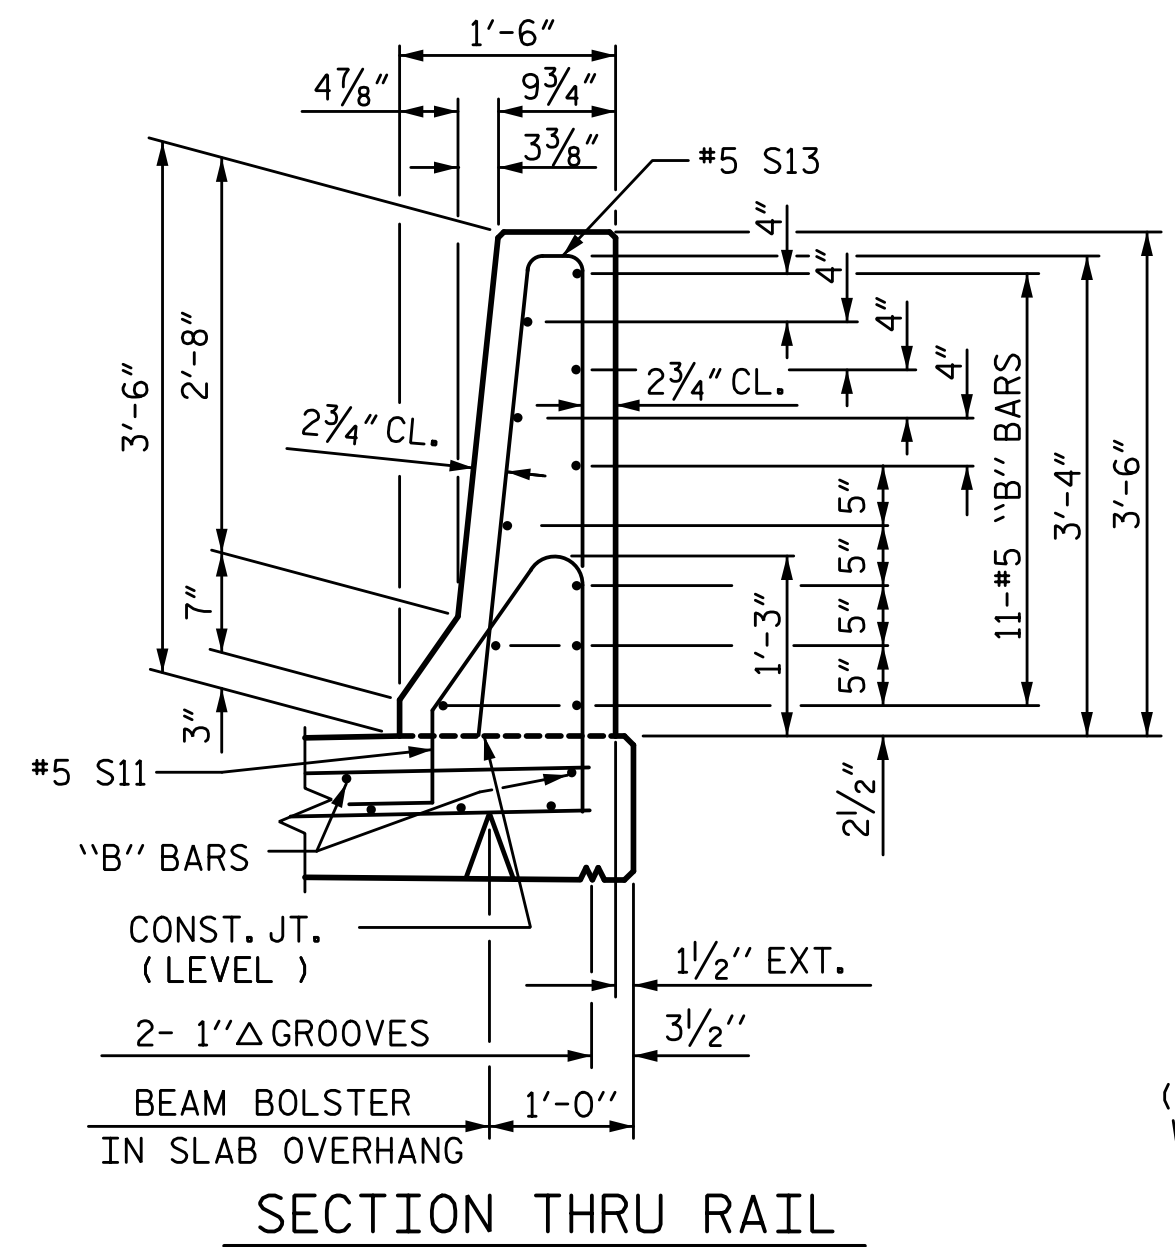


SECTION THRU RAIL

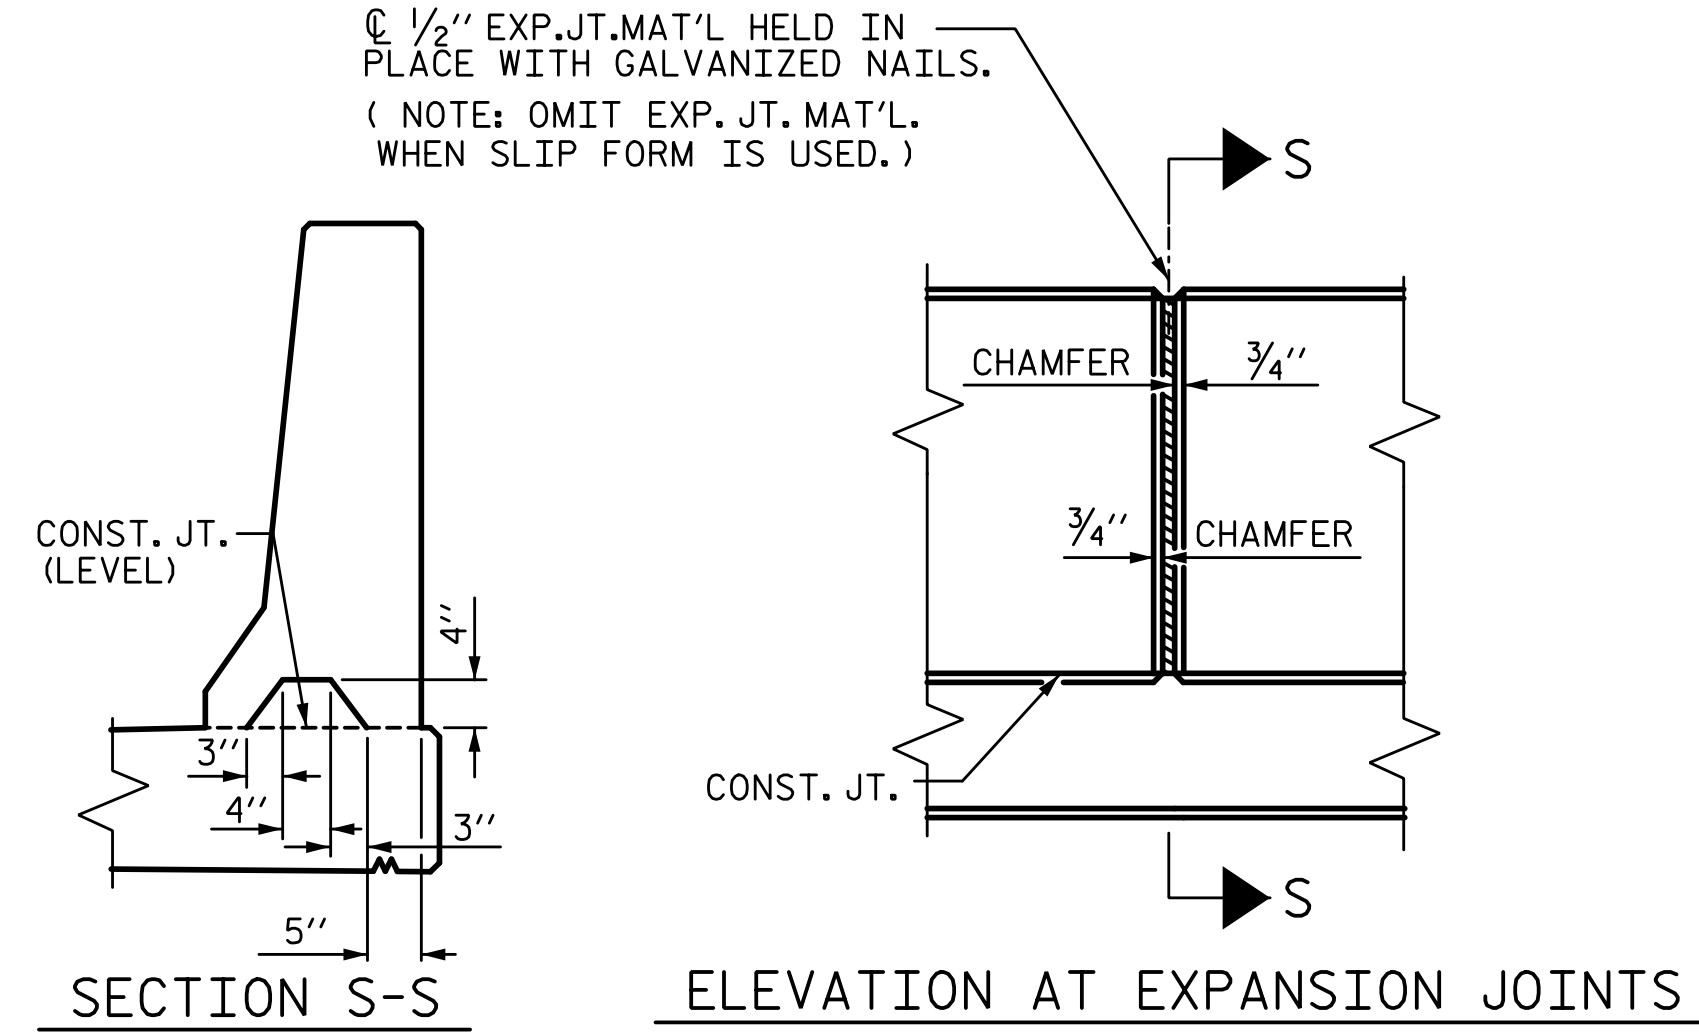


ELEVATION AT EXPANSION JOINTS

BARRIER RAIL DETAILS

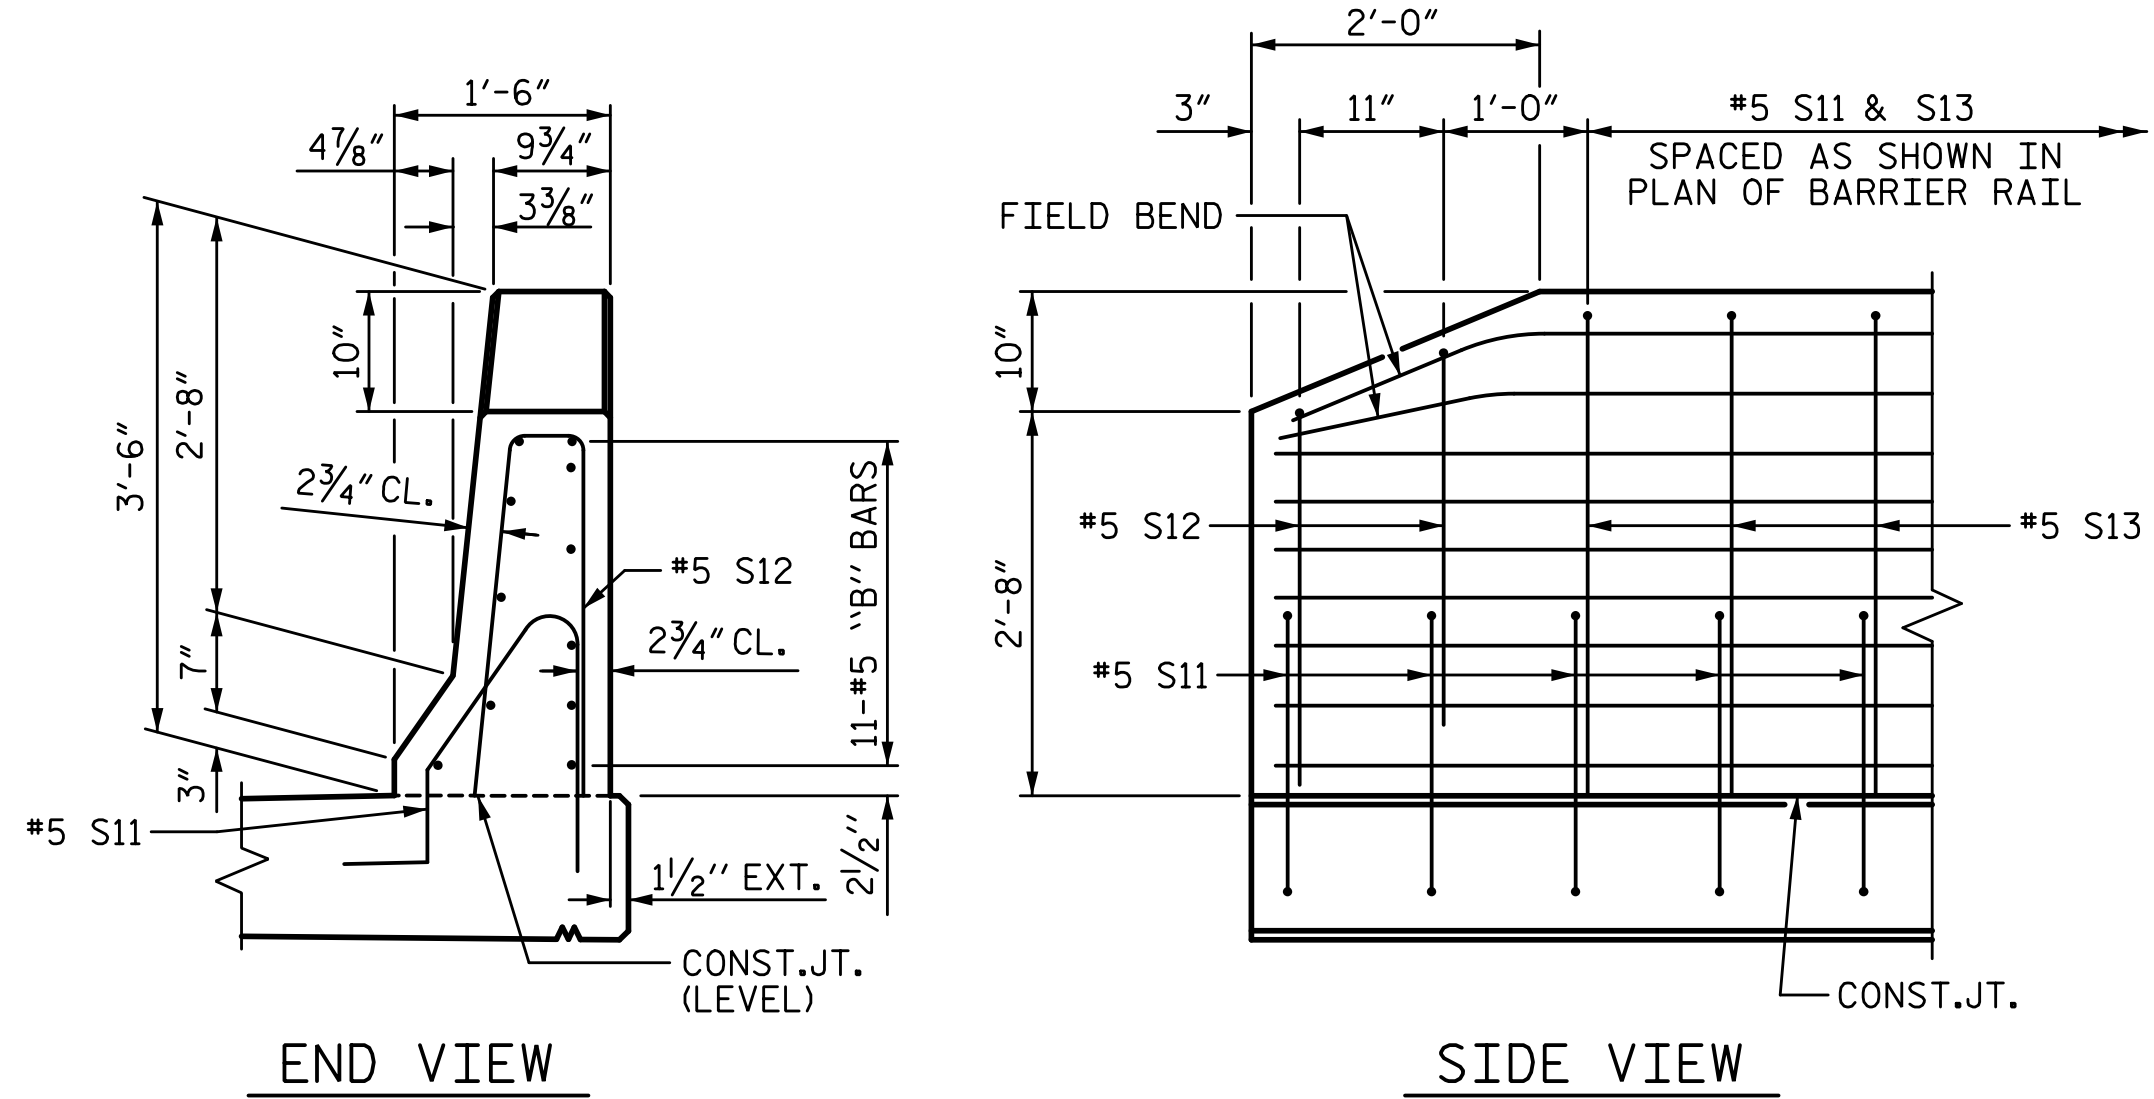

END OF RAIL DETAILS

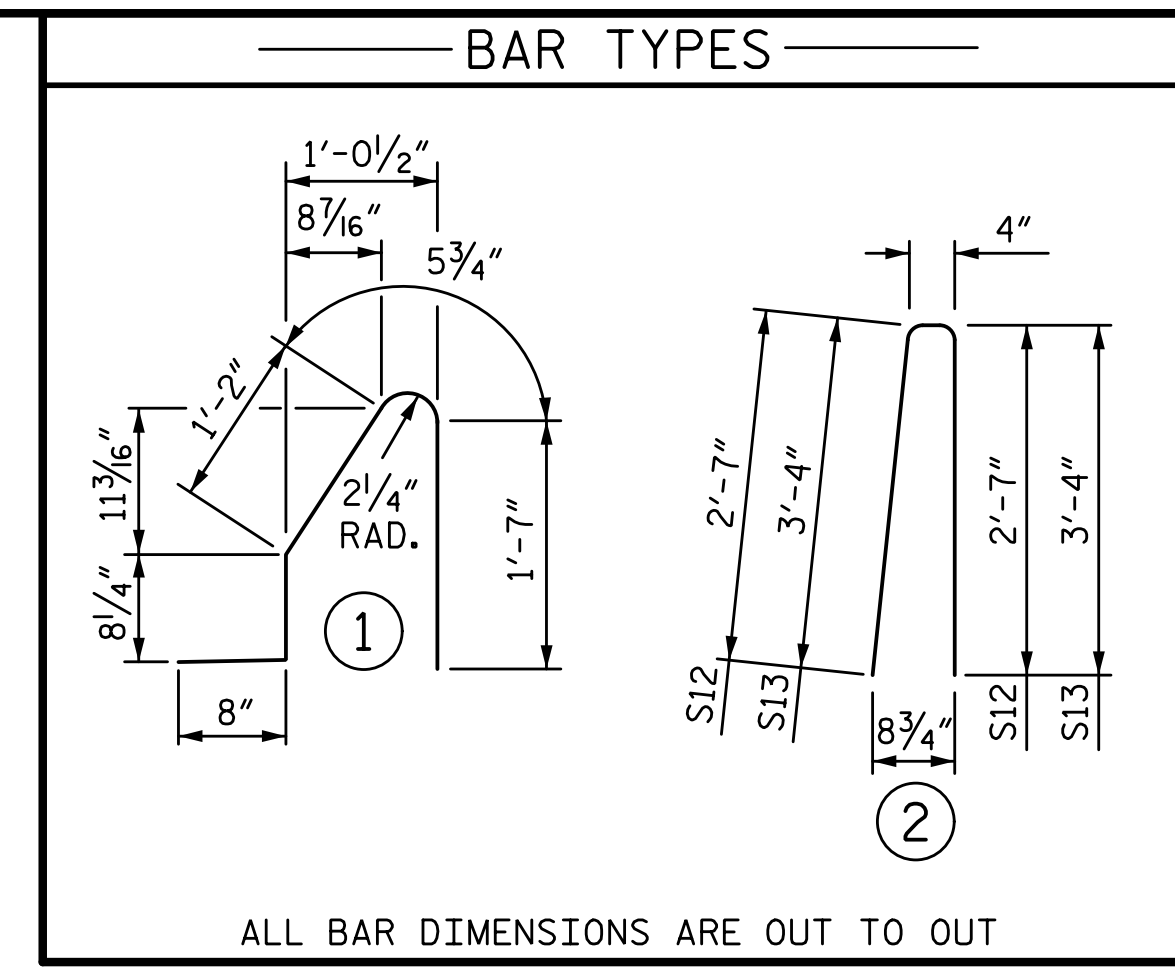

BILL OF MATERIAL						
CONCRETE BARRIER RAIL						
BAR NO.	NO.	SIZE	TYPE	LENGTH	WEIGHT	
*B11	88	#5	STR	24'-2"	2218	
*S11	200	#5	1	4'-7"	956	
*S12	8	#5	2	5'-6"	46	
*S13	192	#5	2	7'-0"	1402	
EPOXY COATED REINFORCING STEEL					4622 LB	
CLASS AA CONCRETE					26.7 CY	
CONCRETE BARRIER RAIL					196.67	
* INDICATES EPOXY COATED REINFORCING STEEL						

NOTES:

THE BARRIER RAIL IN THE SPAN SHALL NOT BE CAST UNTIL ALL SLAB CONCRETE IN THAT SPAN HAS BEEN CAST AND HAS REACHED A MINIMUM COMPRESSIVE STRENGTH OF 3,000 PSI.

ALL REINFORCING STEEL IN BARRIER RAILS SHALL BE EPOXY COATED.

GROOVED CONTRACTION JOINTS, 1/2" IN DEPTH, SHALL BE TOOLED IN ALL EXPOSED FACES OF THE BARRIER RAIL AND IN ACCORDANCE WITH ARTICLE 825-10(B) OF THE STANDARD SPECIFICATIONS. THE CONTRACTION JOINT SHALL BE LOCATED AT EACH THIRD POINT BETWEEN BARRIER RAIL EXPANSION JOINTS. ONLY ONE CONTRACTION JOINT IS REQUIRED AT MIDPOINT OF BARRIER RAIL SEGMENTS LESS THAN 20 FEET IN LENGTH AND NO CONTRACTION JOINTS ARE REQUIRED FOR THOSE SEGMENTS LESS THAN 10 FEET IN LENGTH.


#5 S11 AND #5 S13 BARS MAY BE SHIFTED AS NECESSARY TO MAINTAIN 2" MINIMUM CLEARANCE TO THE 1/2" EXPANSION JOINT MATERIAL.

PROJECT NO. B-5652
ONLOW COUNTY
 STATION: 20+64.00 -L-RT-

SHEET 2 OF 2

STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH
 SUPERSTRUCTURE

CONCRETE BARRIER RAIL




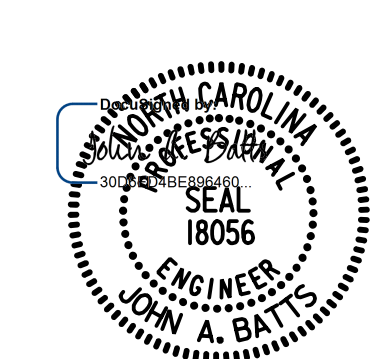


DRAWN BY: T. BANKOVICH	DATE: 5-22
CHECKED BY: J.A. BATTS	DATE: 5-22
DESIGN ENGINEER OF RECORD: J.A. BATTS	DATE: 5-22

REVISIONS						SHEET NO.
NO.	BY:	DATE:	NO.	BY:	DATE:	S-14
1			3			TOTAL SHEETS
2			4			26

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED


9/14/2022 8:06:01 AM P:\Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401_B5652_SMU_CR_660033.dgn

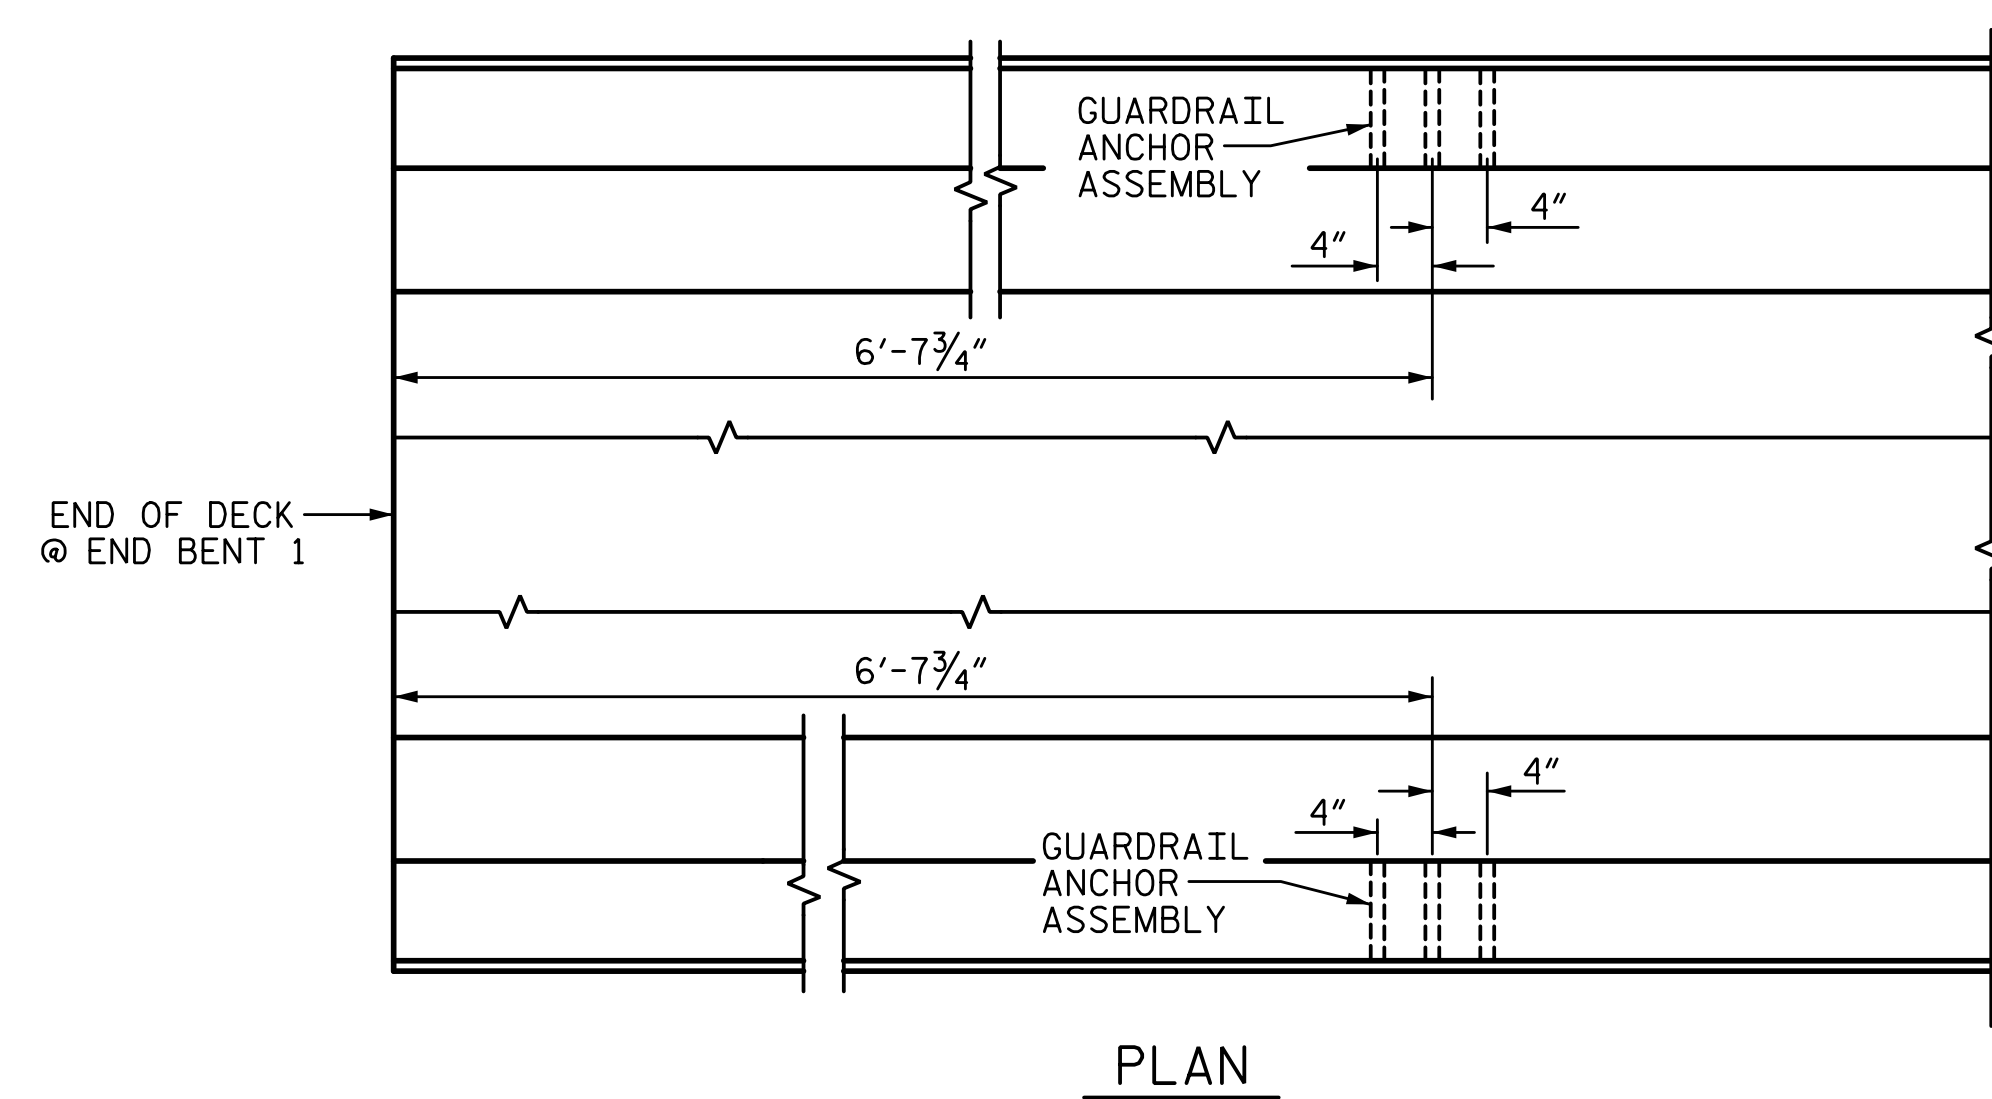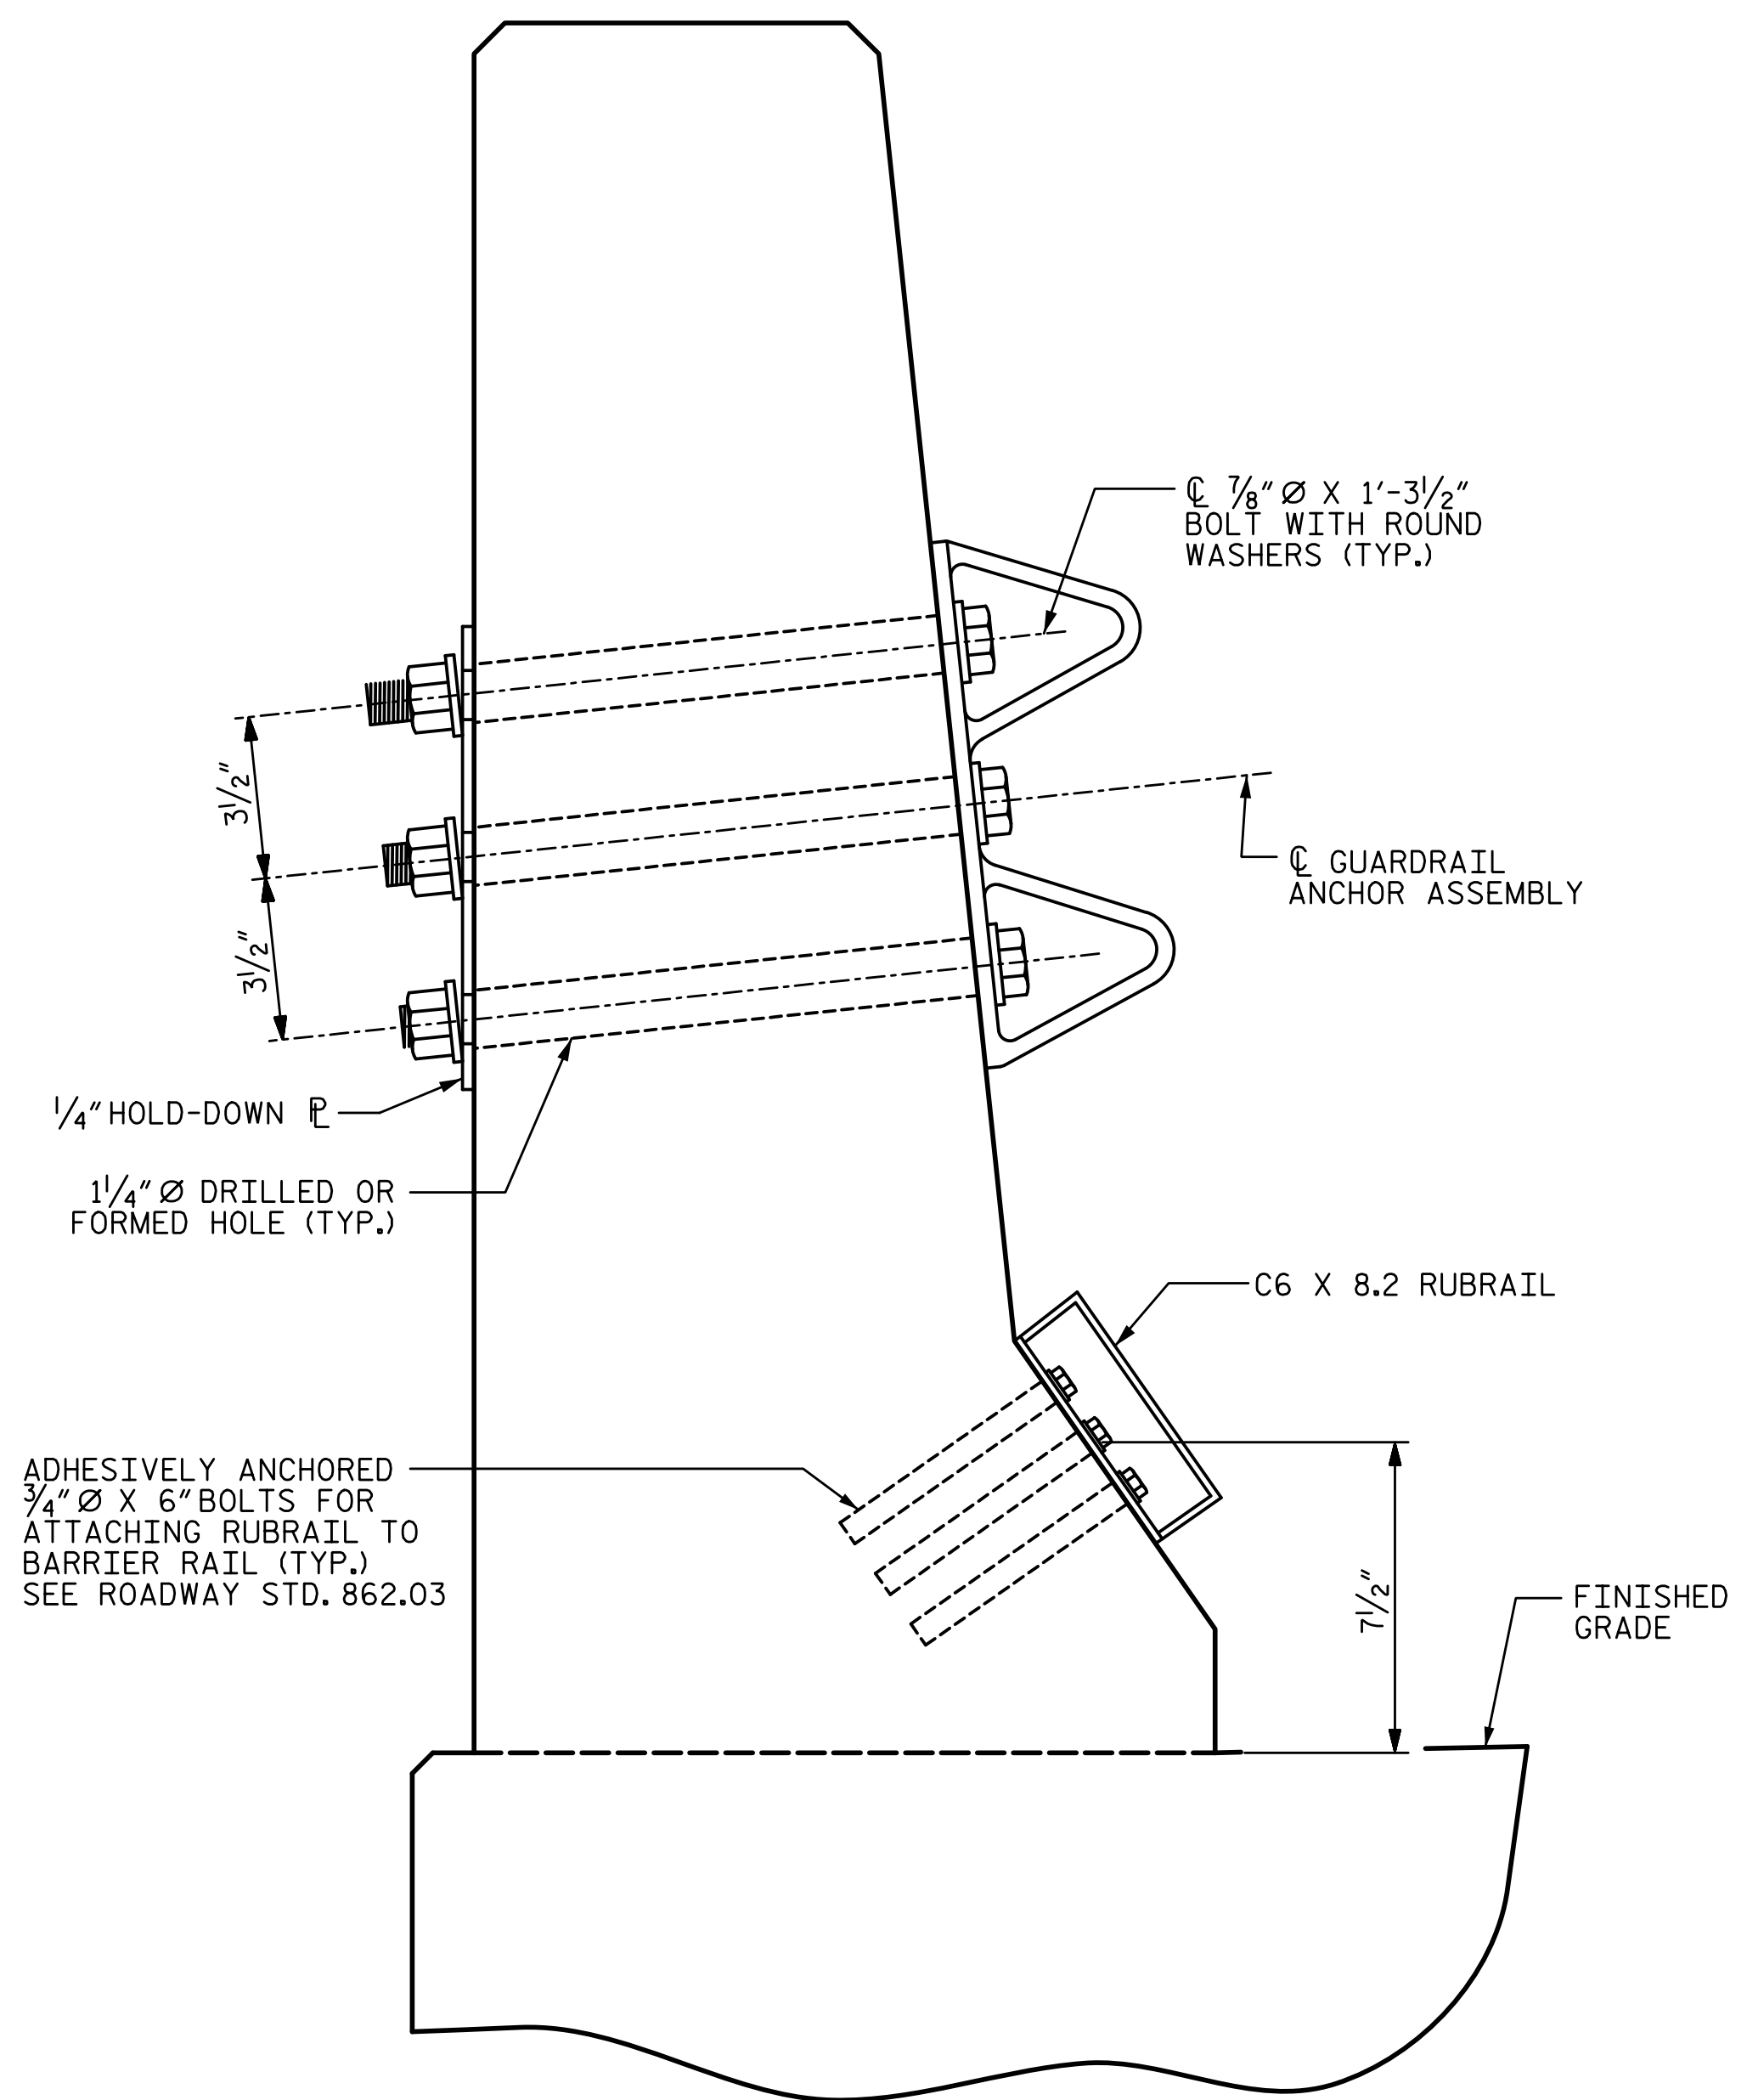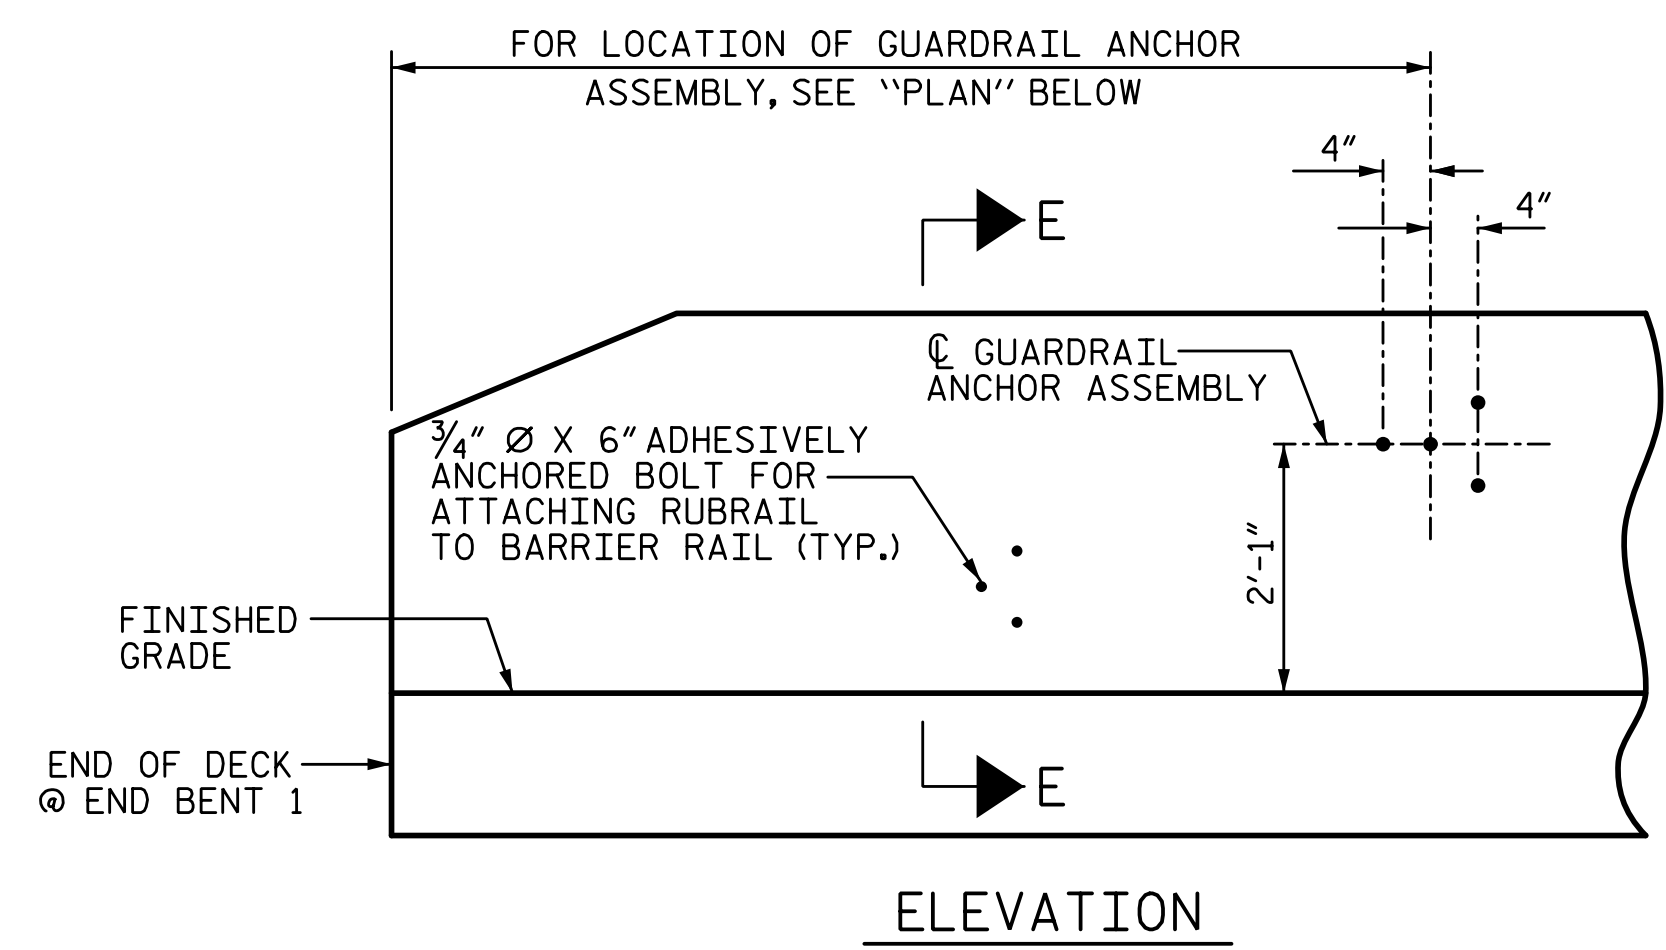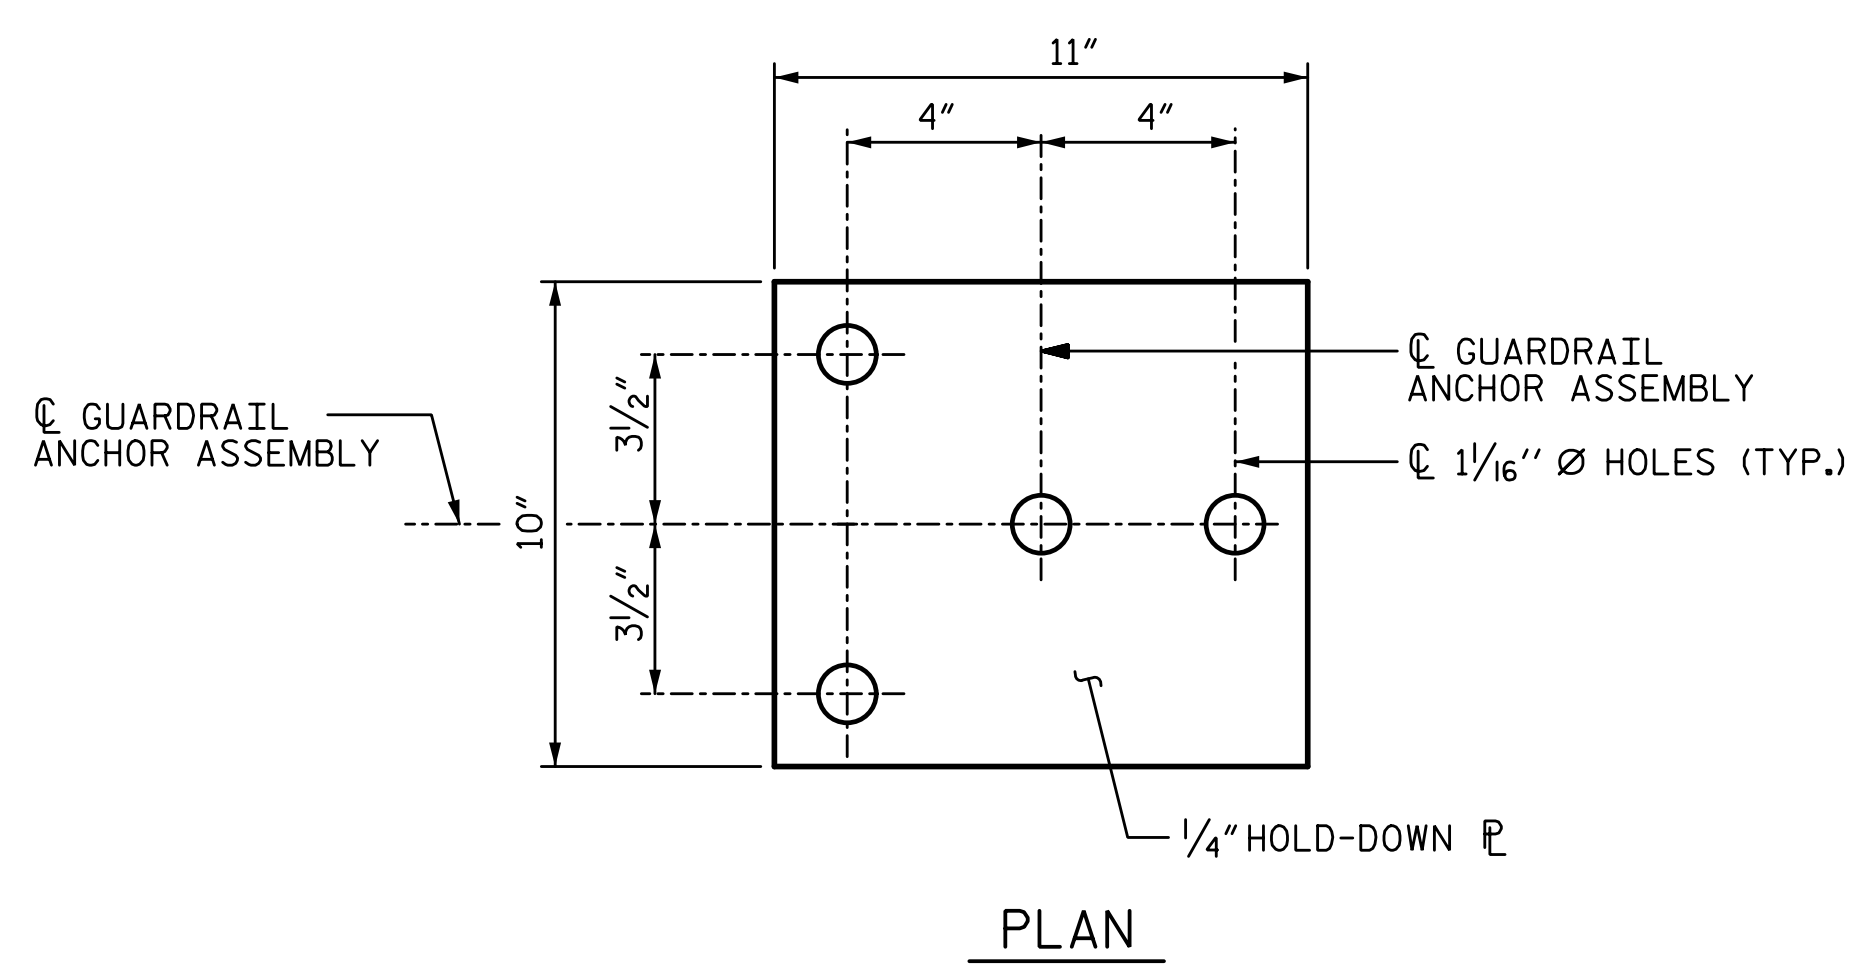

LOCATION OF ANCHORS FOR GUARDRAIL
END BENT 1 SHOWN, END BENT 2 SIMILAR.


NOTES:

- THE GUARDRAIL ANCHOR ASSEMBLY SHALL CONSIST OF A 1/4" HOLD-DOWN PLATE AND 4 - 1/8" Ø BOLTS WITH NUTS AND WASHERS, RUBRAIL, AND ADHESIVELY ANCHORED BOLTS.
- THE HOLD-DOWN PLATE SHALL CONFORM TO AASHTO M270 GRADE 36. AFTER FABRICATION, THE HOLD-DOWN PLATE SHALL BE HOT-DIP GALVANIZED IN ACCORDANCE WITH AASHTO M111.
- BOLTS SHALL CONFORM TO THE REQUIREMENTS OF ASTM A307 AND NUTS SHALL CONFORM TO THE REQUIREMENTS OF AASHTO M291. BOLTS, NUTS AND WASHERS SHALL BE GALVANIZED. (AT THE CONTRACTOR'S OPTION, STAINLESS STEEL BOLTS, NUTS AND WASHERS MAY BE USED AS AN ALTERNATE FOR THE 1/8" Ø GALVANIZED BOLTS, NUTS AND WASHERS. THEY SHALL CONFORM TO OR EXCEED THE MECHANICAL REQUIREMENTS OF ASTM A307. THE USE OF THIS ALTERNATE SHALL BE APPROVED BY THE ENGINEER.)
- THE GUARDRAIL ANCHOR ASSEMBLY IS REQUIRED AT ALL POINTS WHERE APPROACH GUARDRAIL IS TO BE ATTACHED TO THE END OF BARRIER RAIL. FOR POINTS OF ATTACHMENT, SEE SKETCH.
- AFTER INSTALLATION, THE EXPOSED THREAD OF THE BOLT SHALL BE BURRED WITH A SHARP POINTED TOOL.
- THE COST OF THE GUARDRAIL ANCHOR ASSEMBLY SHALL BE INCLUDED IN THE UNIT CONTRACT PRICE BID FOR CONCRETE BARRIER RAIL.
- THE 1 1/4" Ø HOLES SHALL BE FORMED OR DRILLED WITH A CORE BIT. IMPACT TOOLS WILL NOT BE PERMITTED. ANY CONCRETE DAMAGED BY THIS WORK SHALL BE REPAIRED TO THE SATISFACTION OF THE ENGINEER.
- THE C6 X 8.2 RUBRAIL IS TO BE ADHESIVELY ANCHORED TO THE RAIL USING THREE 3/4" Ø X 6" BOLTS WITH WASHERS. LEVEL ONE FIELD TESTING IS REQUIRED, AND THE YIELD LOAD OF THE 3/4" Ø BOLT IS 12 KIPS. FOR ADHESIVELY ANCHORED ANCHOR BOLTS OR DOWELS, SEE STANDARD SPECIFICATIONS. SEE ROADWAY STANDARD 862.03 FOR DETAILS AND LOCATION OF THE RUBRAIL.

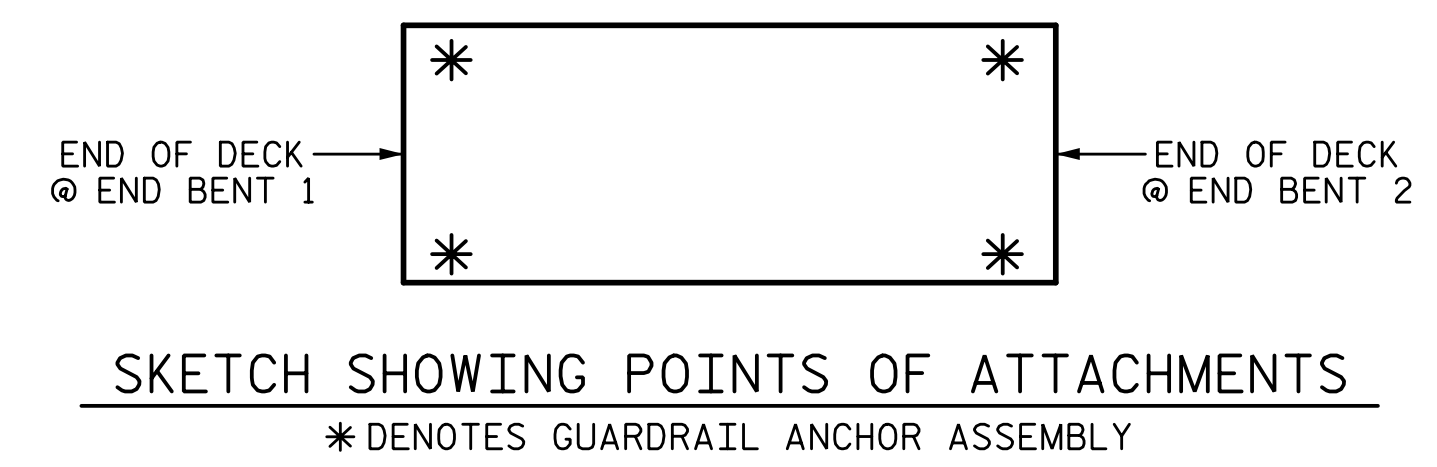

PROJECT NO. B-5652
ONLOW COUNTY
 STATION: 20+64.00 -L-RT-

DRAWN BY: T. BANKOVICH DATE: 5-22
 CHECKED BY: J.A. BATTS DATE: 5-22
 DESIGN ENGINEER OF RECORD: J.A. BATTS DATE: 5-22

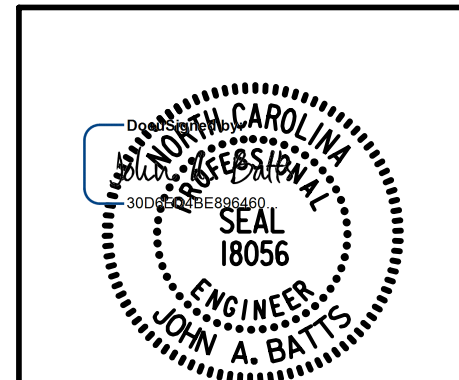

STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH
 SUPERSTRUCTURE
GUARDRAIL ANCHORAGE FOR BARRIER RAIL

REVISIONS						SHEET NO.
NO.	BY:	DATE:	NO.	BY:	DATE:	S-15
1			3			TOTAL SHEETS
2			4			26

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

9/14/2022 1:52:22 AM

LICENSURE NO. C-4434


9/14/2022 8:06:02 AM P:\Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401_B5652_SMU_BM_660033.dgn

SUPERSTRUCTURE REINFORCING STEEL LENGTHS ARE BASED ON THE FOLLOWING MINIMUM SPLICE LENGTHS

BAR SIZE	SUPERSTRUCTURE EXCEPT APPROACH SLABS, PARAPET, AND BARRIER RAIL		APPROACH SLABS		PARAPET AND BARRIER RAIL
	EPOXY COATED	UNCOATED	EPOXY COATED	UNCOATED	
#4	1'-11"	1'-7"	1'-11"	1'-7"	2'-6"
#5	2'-5"	2'-0"	2'-5"	2'-0"	3'-1"
#6	2'-10"	2'-5"	3'-7"	2'-5"	3'-8"
#7	4'-2"	2'-9"			
#8	4'-9"	3'-2"			

GROOVING BRIDGE FLOORS

AREA	AREA (SF)
APPROACH SLABS	1,642 SF
BRIDGE DECK	3,331 SF
TOTAL	4,973 SF

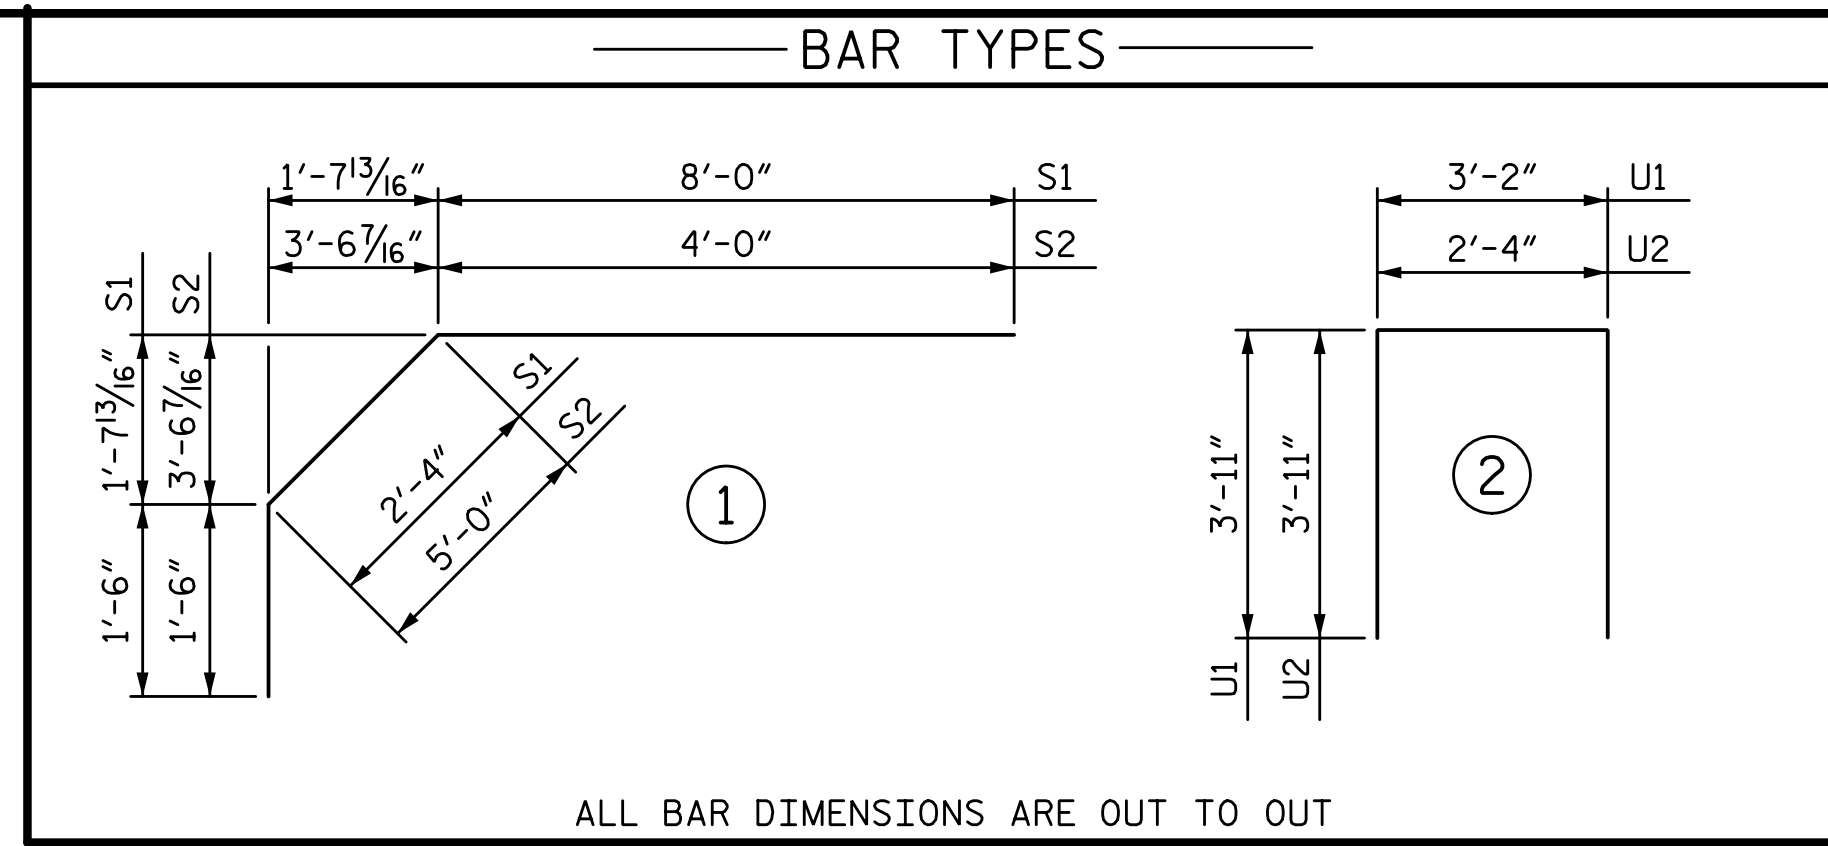

BILL OF MATERIAL



SPAN A

BAR	NO.	SIZE	TYPE	LENGTH	WEIGHT
*A1	181	#5	STR	39'-11"	7536
A2	181	#5	STR	39'-11"	7536
B1	96	#5	STR	50'-1"	5015
*B2	162	#6	STR	20'-0"	4866
*B3	58	#4	STR	32'-10"	1272
K1	10	#4	STR	39'-11"	267
K2	8	#4	STR	6'-0"	32
K3	8	#4	STR	6'-10"	37
K4	16	#4	STR	7'-6"	80
K5	8	#4	STR	6'-6"	35
K6	4	#4	STR	1'-8"	4
K7	4	#4	STR	2'-1"	6
K8	8	#4	STR	2'-5"	13
K9	4	#4	STR	1'-11"	5
*S1	56	#4	1	11'-10"	443
*S2	56	#4	1	10'-6"	393
U1	60	#4	2	11'-0"	441
U2	8	#4	2	10'-2"	54
REINFORCING STEEL					13525 LB
* EPOXY COATED REINFORCING STEEL					14510 LB

—SUPERSTRUCTURE BILL OF MATERIAL—

	CLASS AA CONCRETE	REINFORCING STEEL	EPOXY COATED REINFORCING STEEL
	CY	LB	LB
POUR 1	107.3		
POUR 2	57.6		
TOTALS**	164.9	13,525	14,510

** QUANTITIES FOR CONCRETE BARRIER RAILS ARE NOT INCLUDED

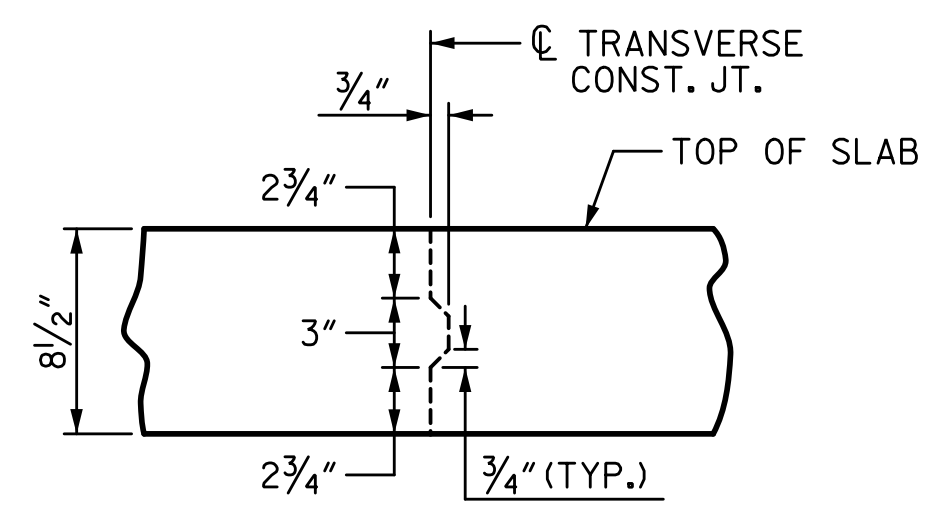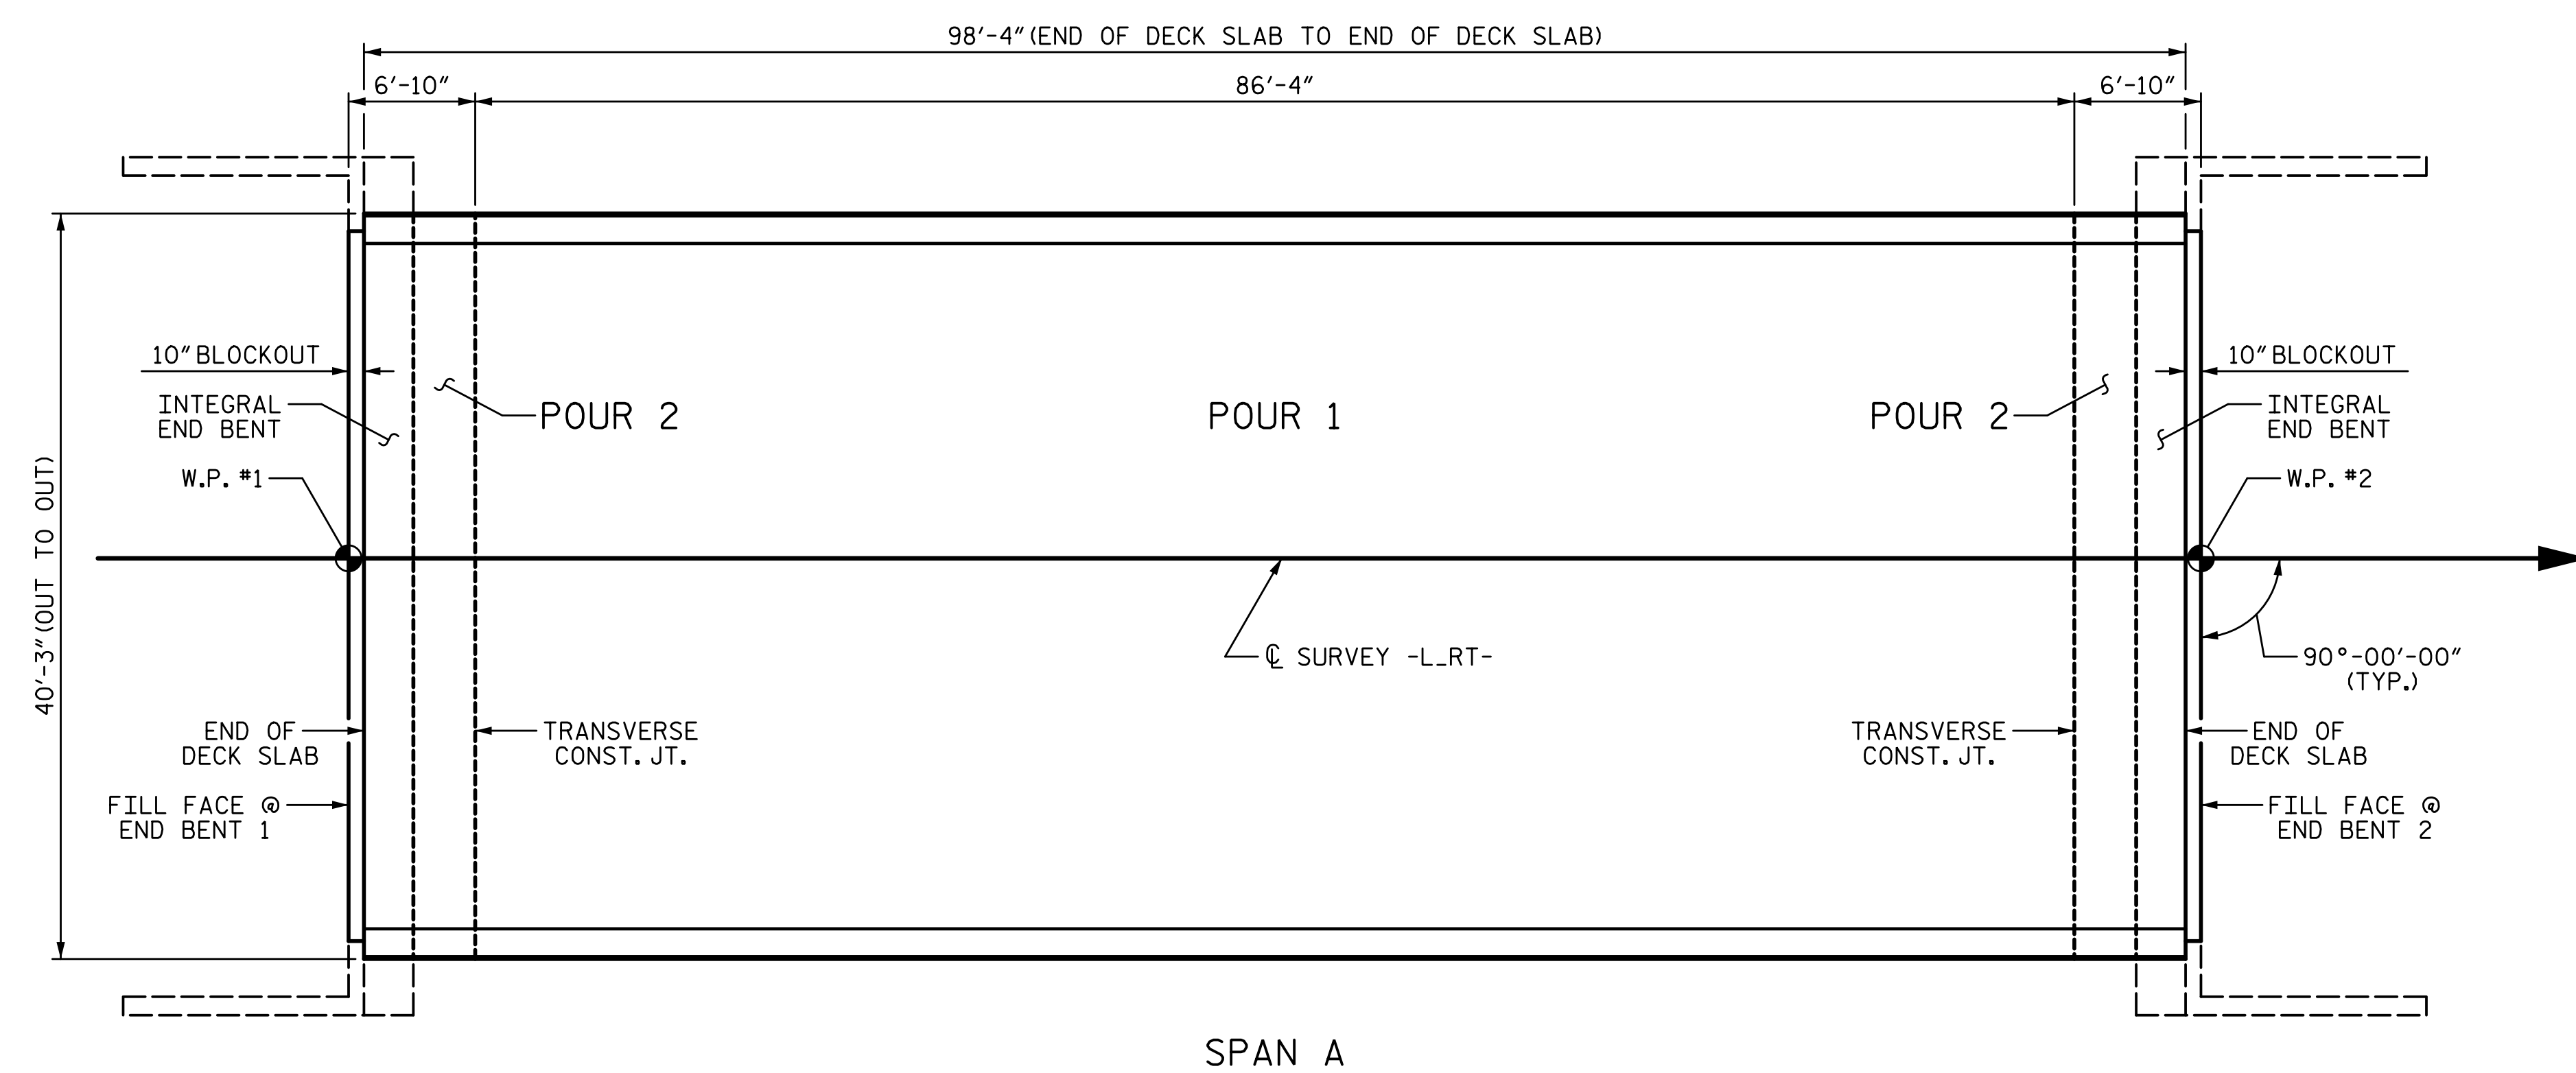


TRANSVERSE CONSTRUCTION JOINT DETAIL

NOTE: REINFORCING STEEL IN SLAB NOT SHOWN. LONGITUDINAL REINFORCING STEEL SHALL BE CONTINUOUS THRU JOINT.

PROJECT NO. B-5652
ONLOW COUNTY
 STATION: 20+64.00 -L-RT-

LAYOUT FOR COMPUTING AREA OF REINFORCED CONCRETE DECK SLAB & POUR SEQUENCE

SQ. FT. = 3,958

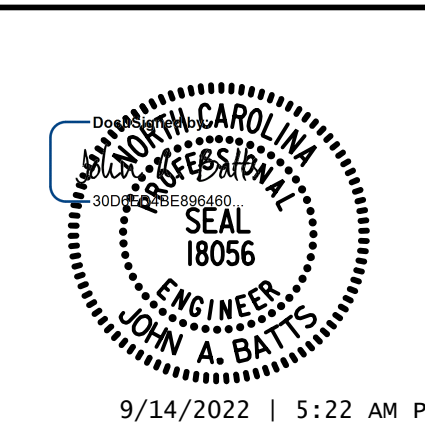


STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH
 SUPERSTRUCTURE
BILL OF MATERIAL

DRAWN BY: <u>T. BANKOVICH</u>	DATE: <u>5-22</u>
CHECKED BY: <u>J.A. BATTS</u>	DATE: <u>5-22</u>
DESIGN ENGINEER OF RECORD: <u>J.A. BATTS</u>	DATE: <u>5-22</u>


REVISIONS				SHEET NO.
NO.	BY:	DATE:	NO.	DATE:
1			3	
2			4	

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED


9/14/2022 8:06:03 AM P:\Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401_B5652_SMU_E1-660033.dgn

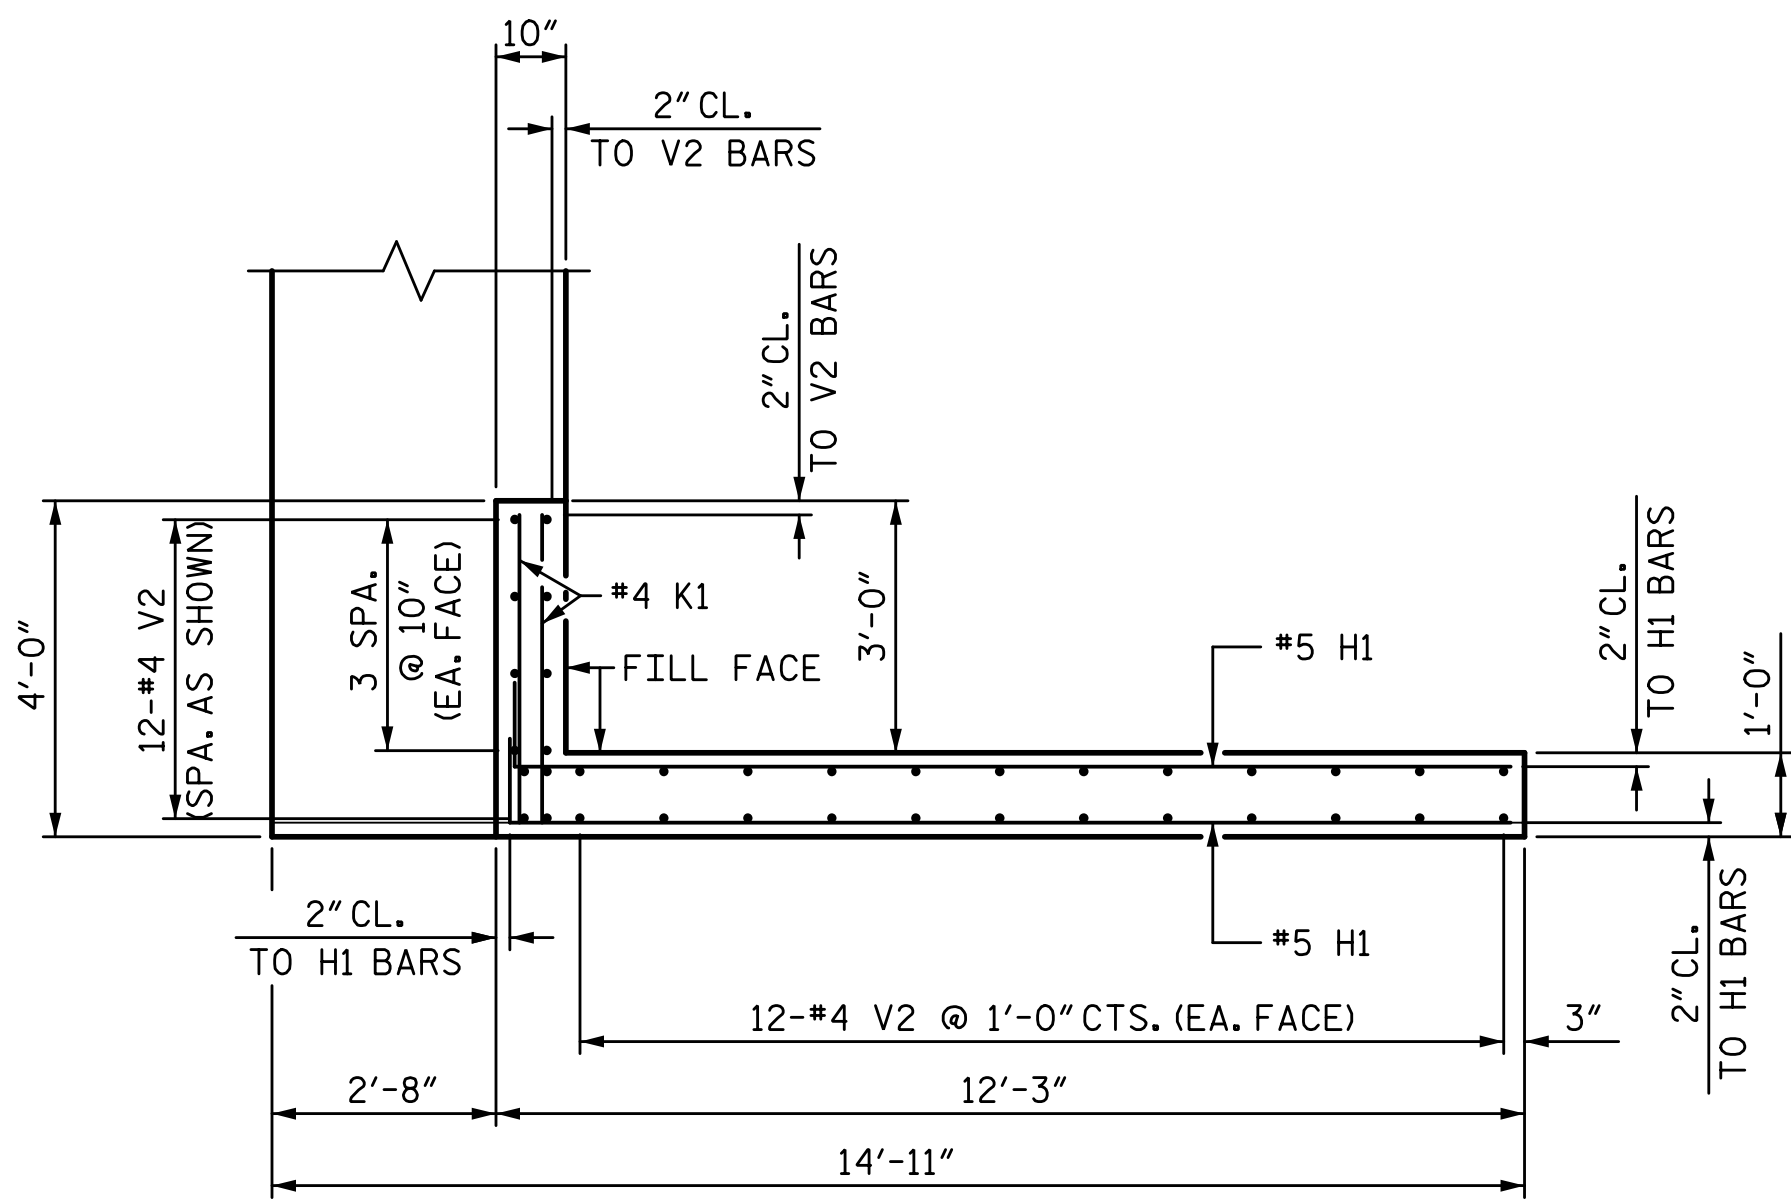


PLAN OF WING (W1)

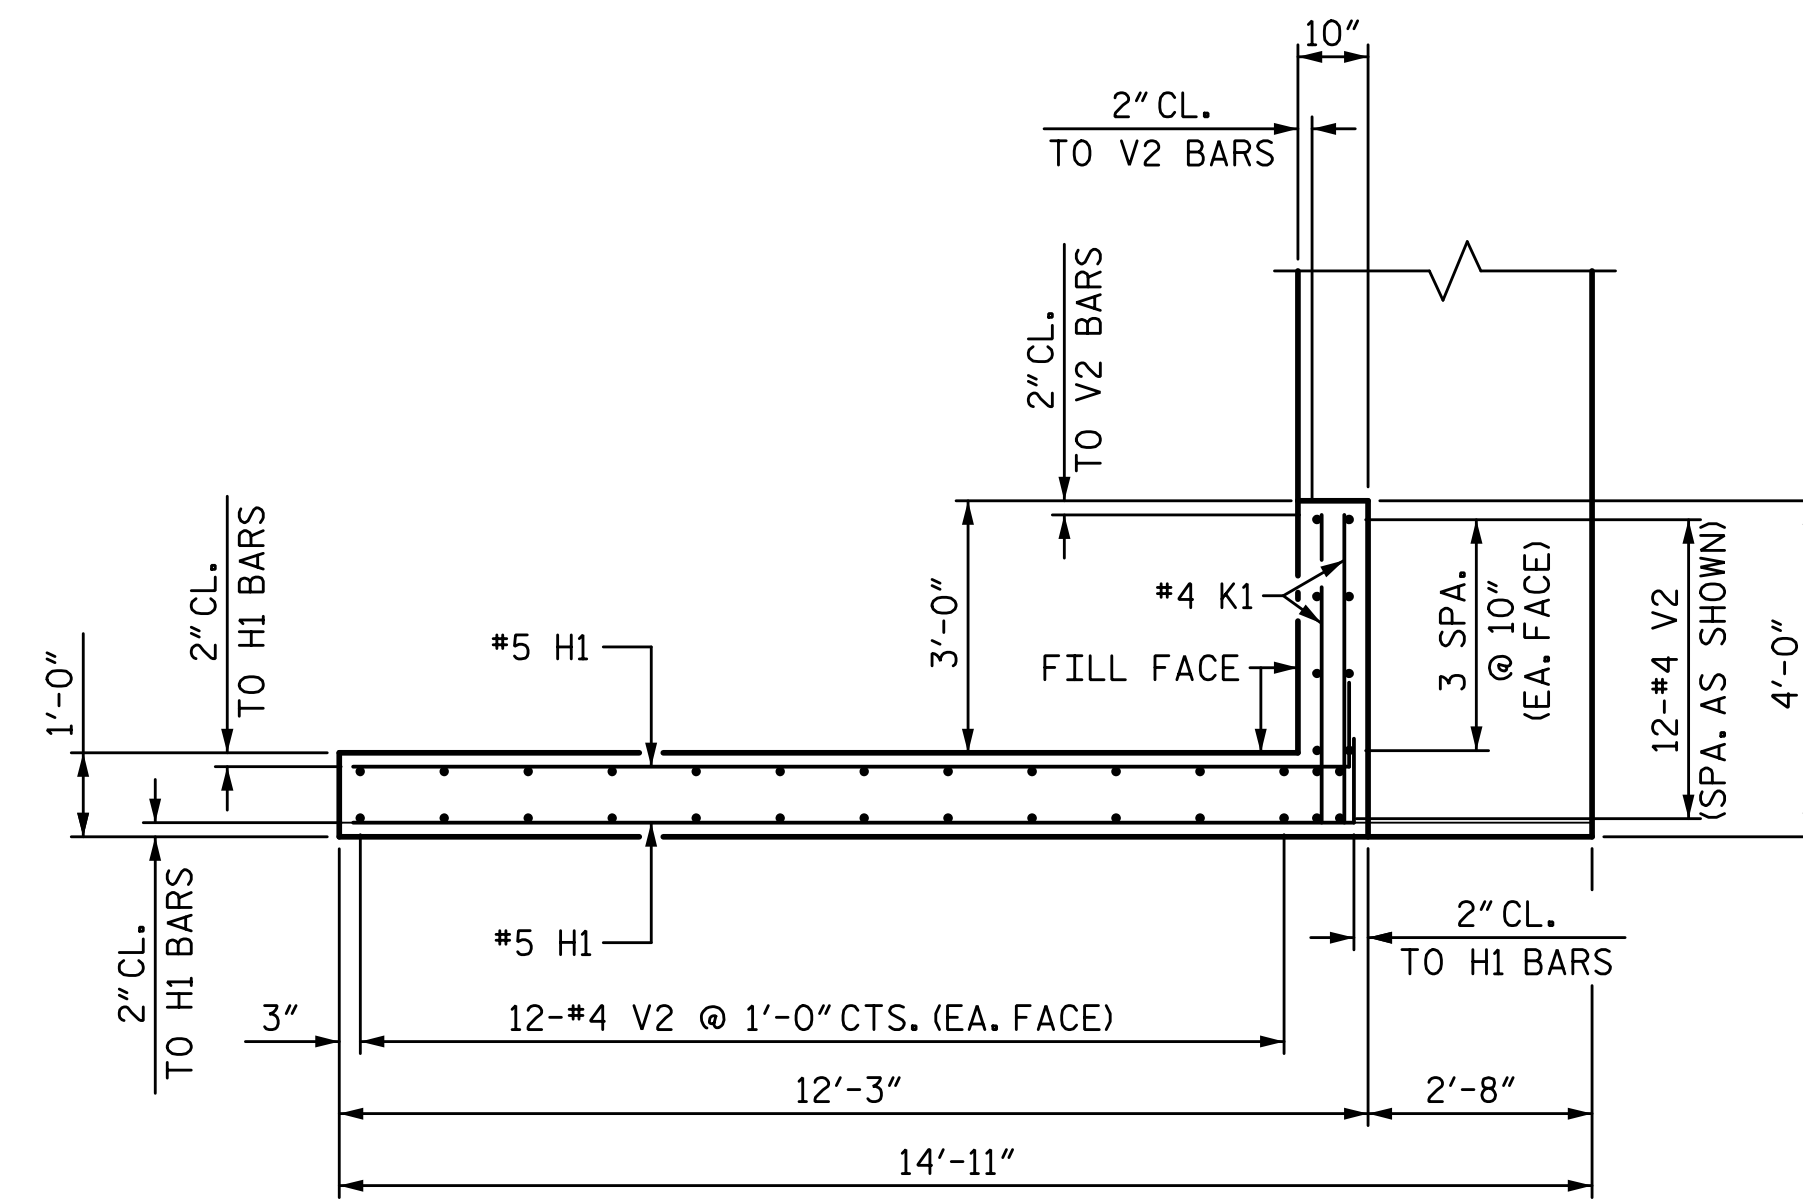


PLAN OF WING (W2)

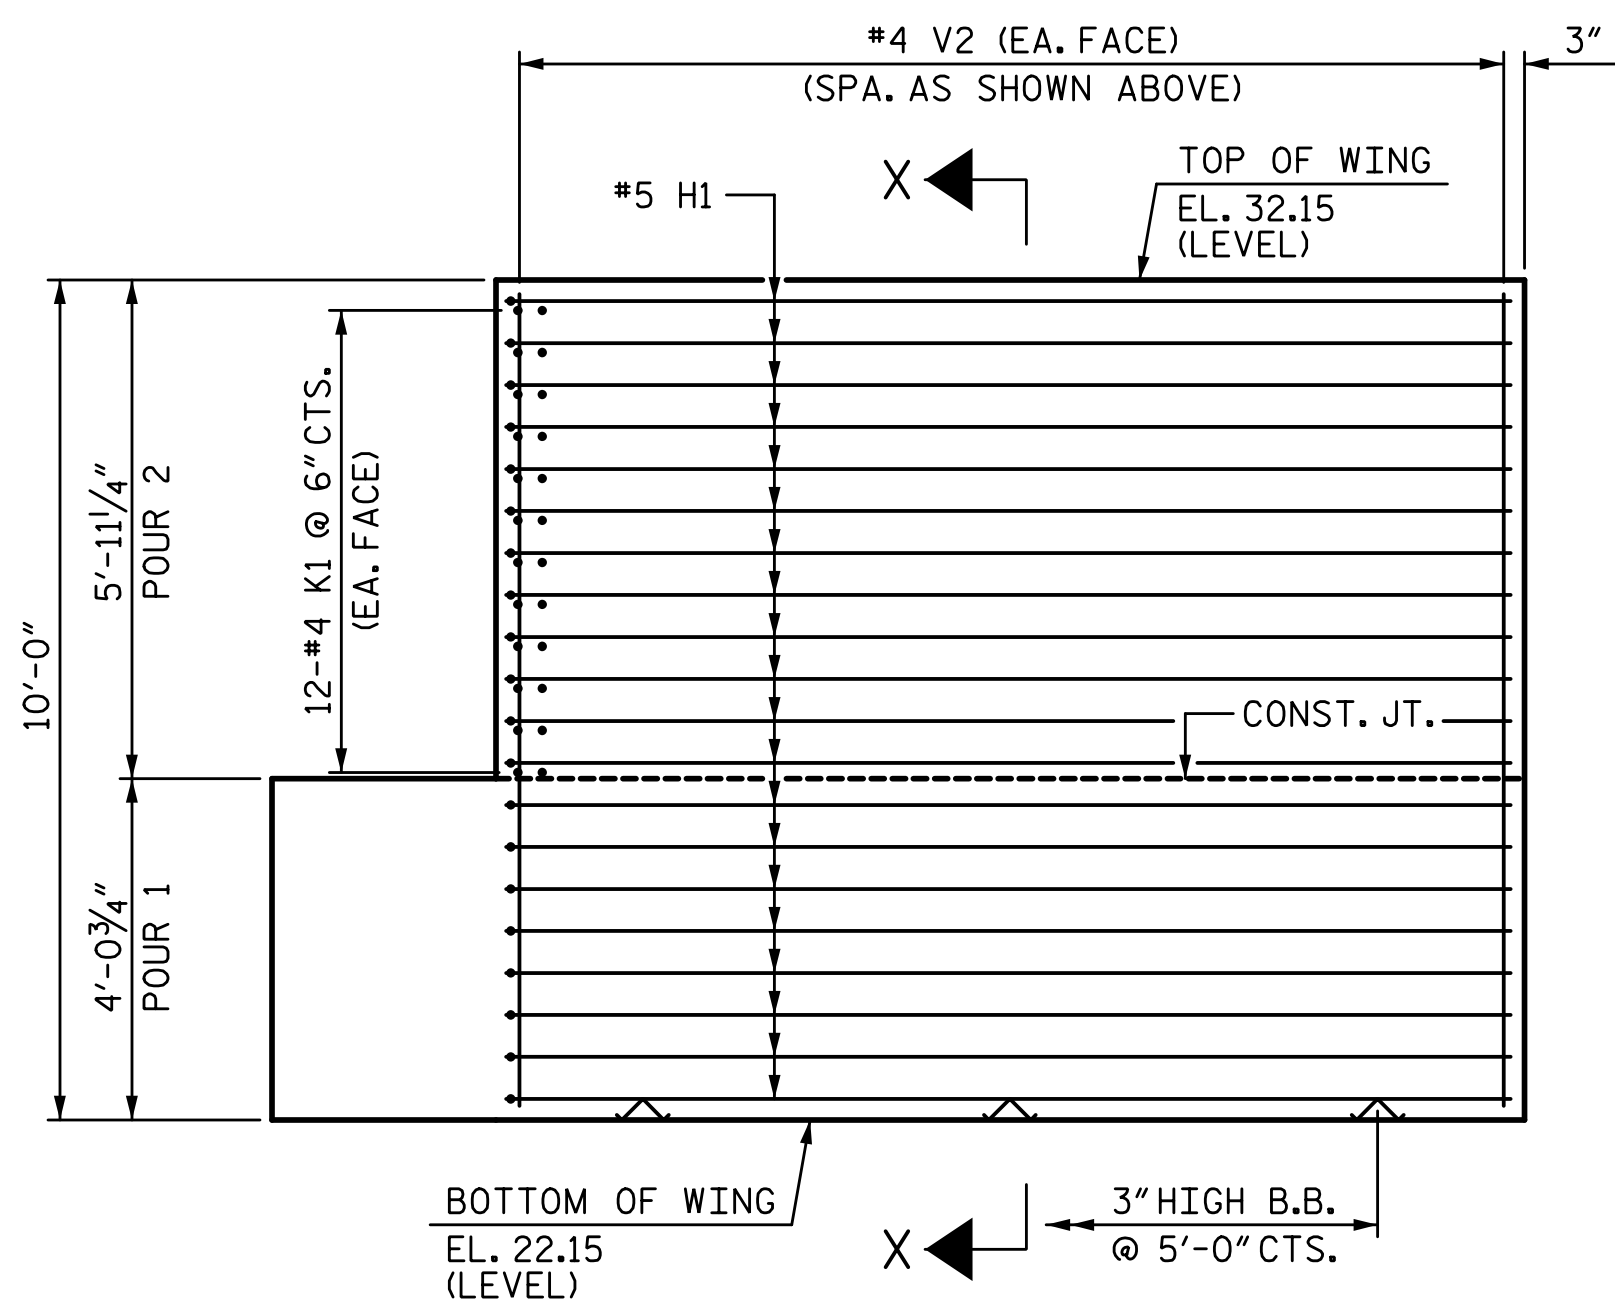


ELEVATION OF WING (W1)

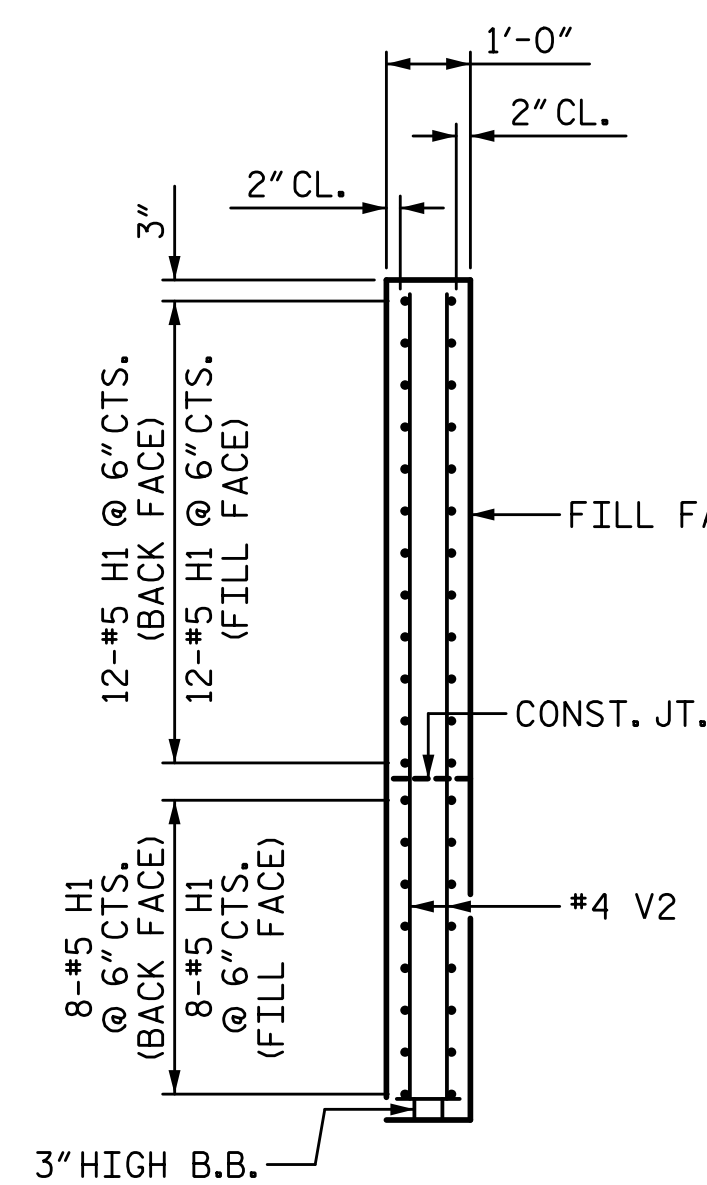

SECTION X-X

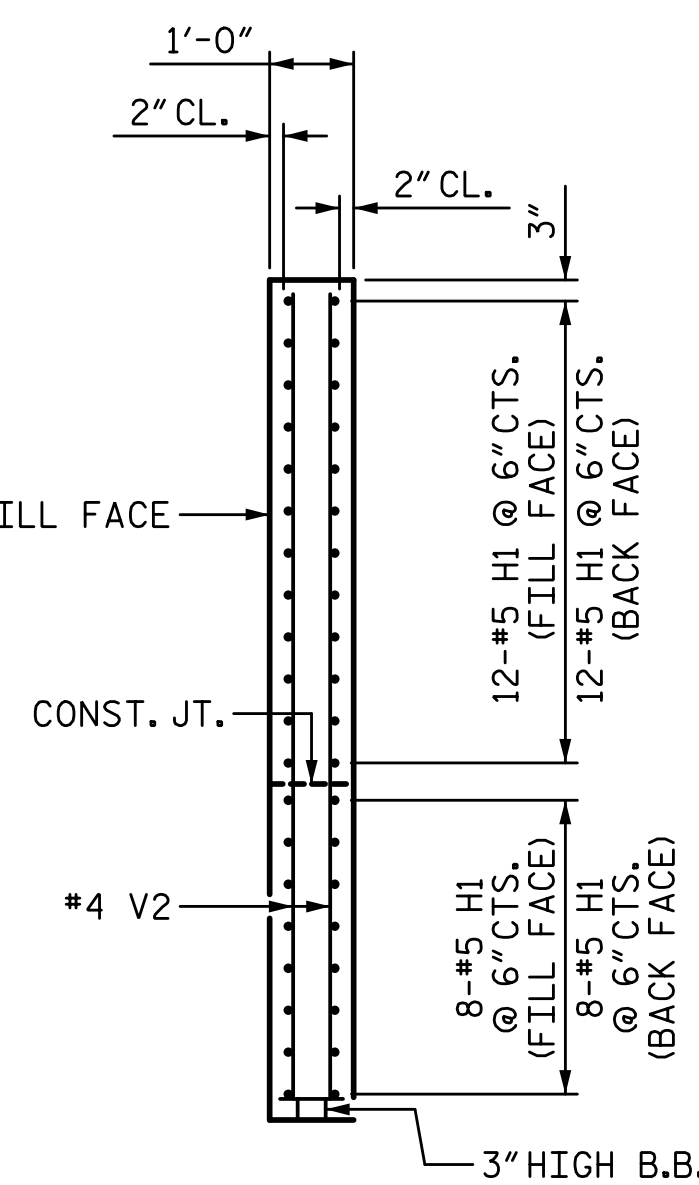

SECTION Y-Y

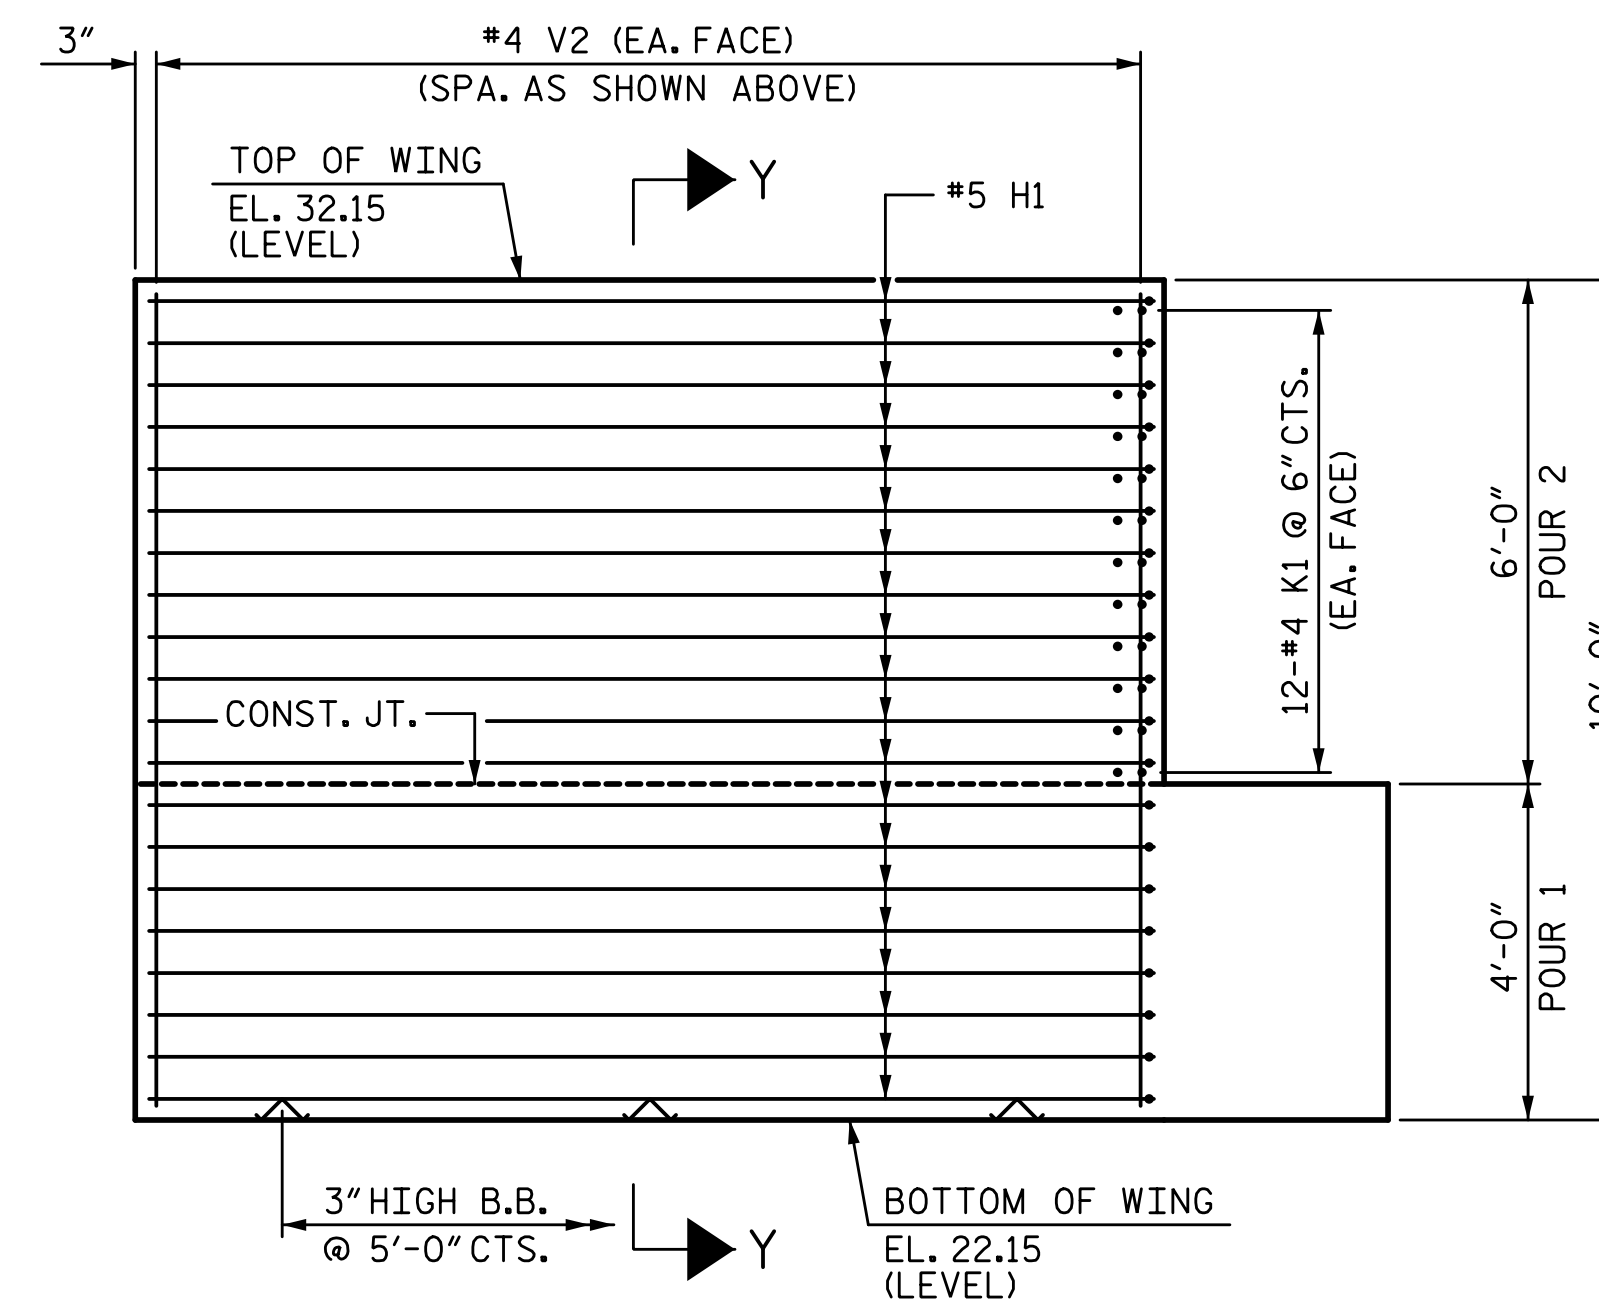


ELEVATION OF WING (W2)

PROJECT NO. B-5652
ONSLow COUNTY
 STATION: 20+64.00 -L-RT-

SHEET 2 OF 3

STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH
 SUBSTRUCTURE

END BENT 1

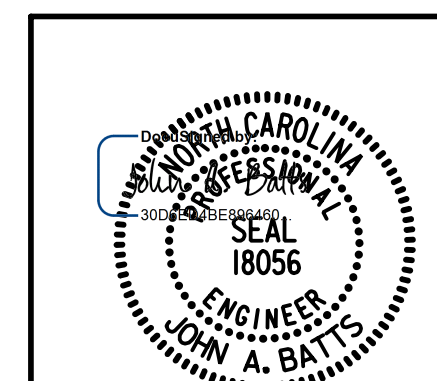


DRAWN BY: S.D. COOPER DATE: 5-22
 CHECKED BY: J.A. BATTS DATE: 5-22
 DESIGN ENGINEER OF RECORD: J.A. BATTS DATE: 5-22

REVISIONS						SHEET NO.
NO.	BY:	DATE:	NO.	BY:	DATE:	S-18
1			3			TOTAL SHEETS
2			4			26

DOCUMENT NOT CONSIDERED FINAL
 UNLESS ALL SIGNATURES COMPLETED

9/14/2022 8:06:04 AM P:\Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401_B5652_SMU_E1_660033.dgn

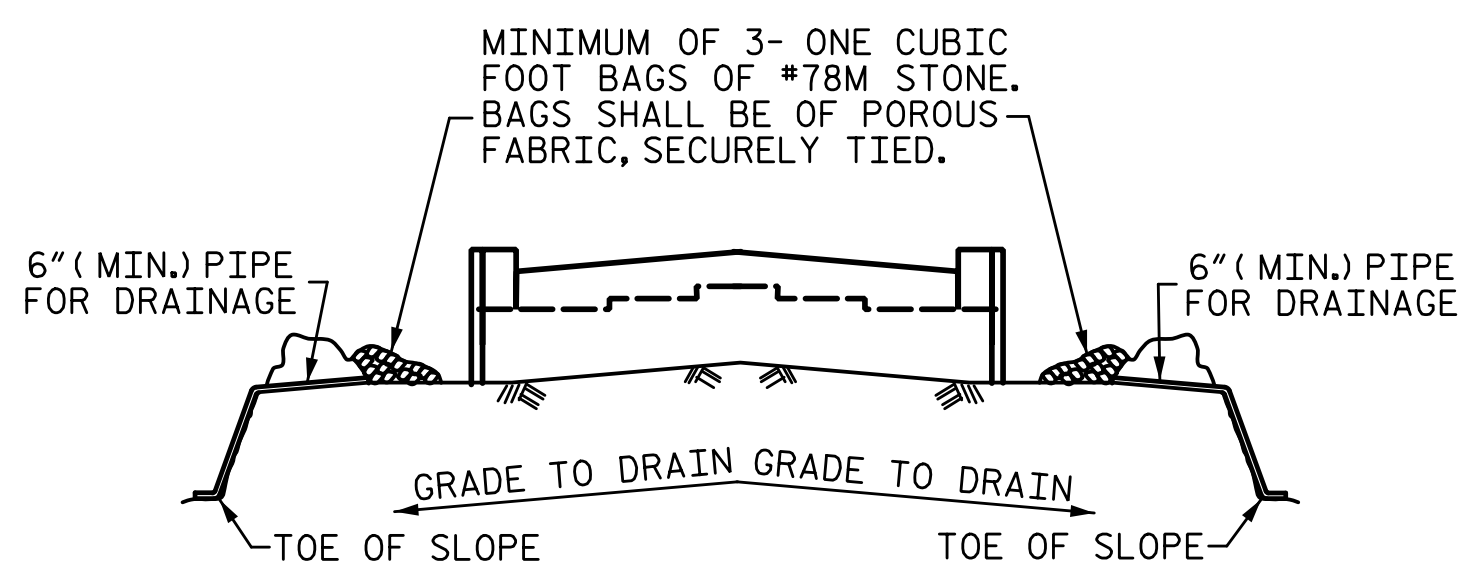


BAGGED STONE AND PIPE SHALL BE PLACED IMMEDIATELY AFTER COMPLETION OF END BENT EXCAVATION. PIPE MAY BE EITHER CONCRETE, CORRUGATED STEEL, CORRUGATED ALUMINUM ALLOY, OR CORRUGATED PLASTIC. PERFORATED PIPE WILL NOT BE ALLOWED.


BAGGED STONE SHALL REMAIN IN PLACE UNTIL THE ENGINEER DIRECTS THAT IT BE REMOVED. THE CONTRACTOR SHALL REMOVE AND DISPOSE OF SILT ACCUMULATIONS AT BAGGED STONE WHEN SO DIRECTED BY THE ENGINEER. BAGS SHALL BE REMOVED AND REPLACED WHENEVER THE ENGINEER DETERMINES THAT THEY HAVE DETERIORATED AND LOST THEIR EFFECTIVENESS.

NO SEPARATE PAYMENT WILL BE MADE FOR THIS WORK AND THE ENTIRE COST OF THIS WORK SHALL BE INCLUDED IN THE UNIT CONTRACT PRICE BID FOR THE SEVERAL PAY ITEMS.

TEMPORARY DRAINAGE AT END BENT

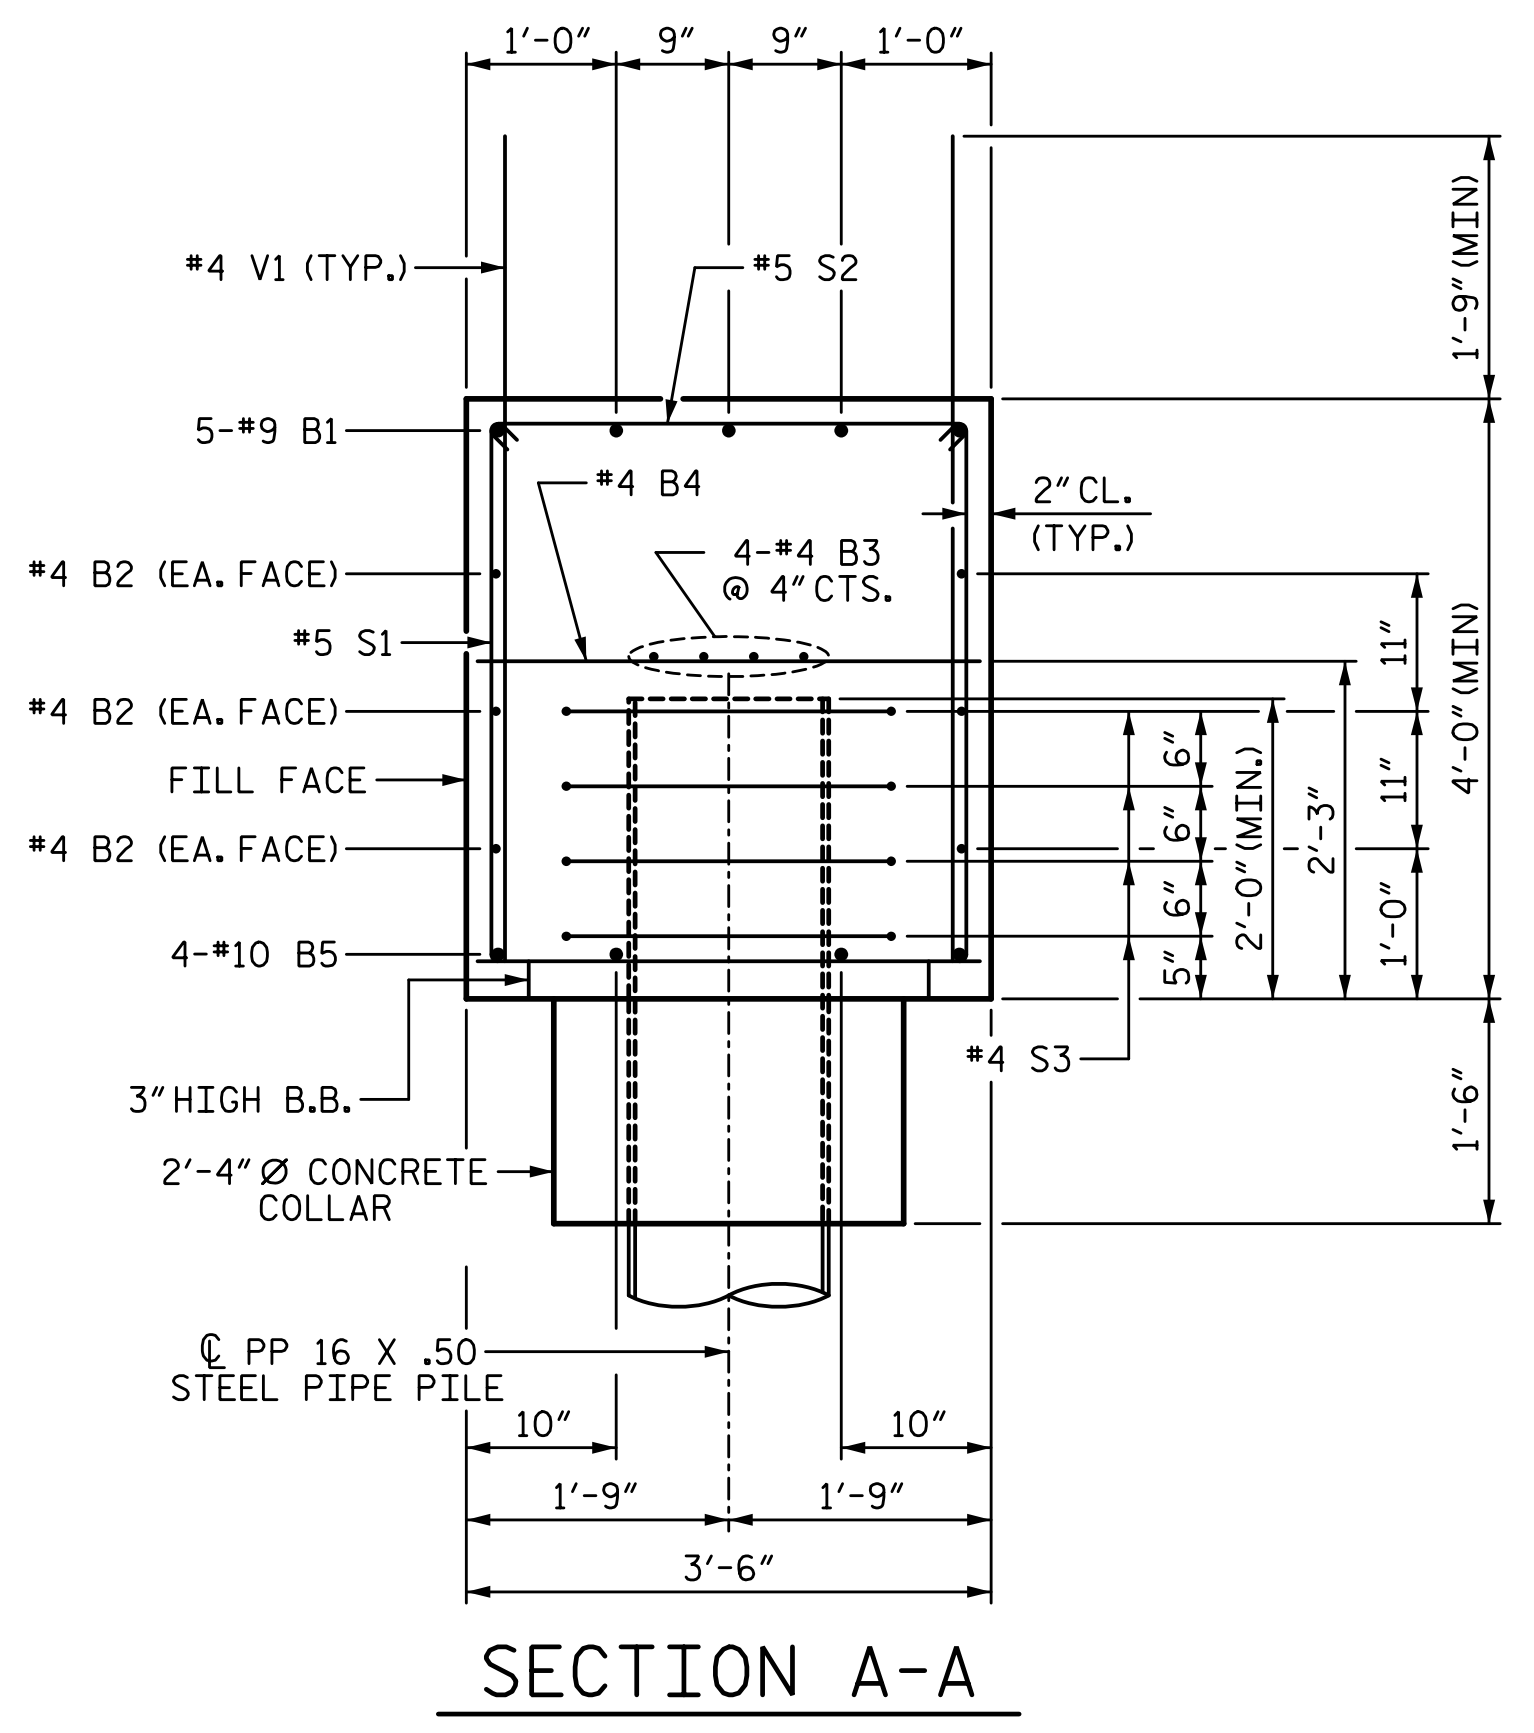

SECTION A-A

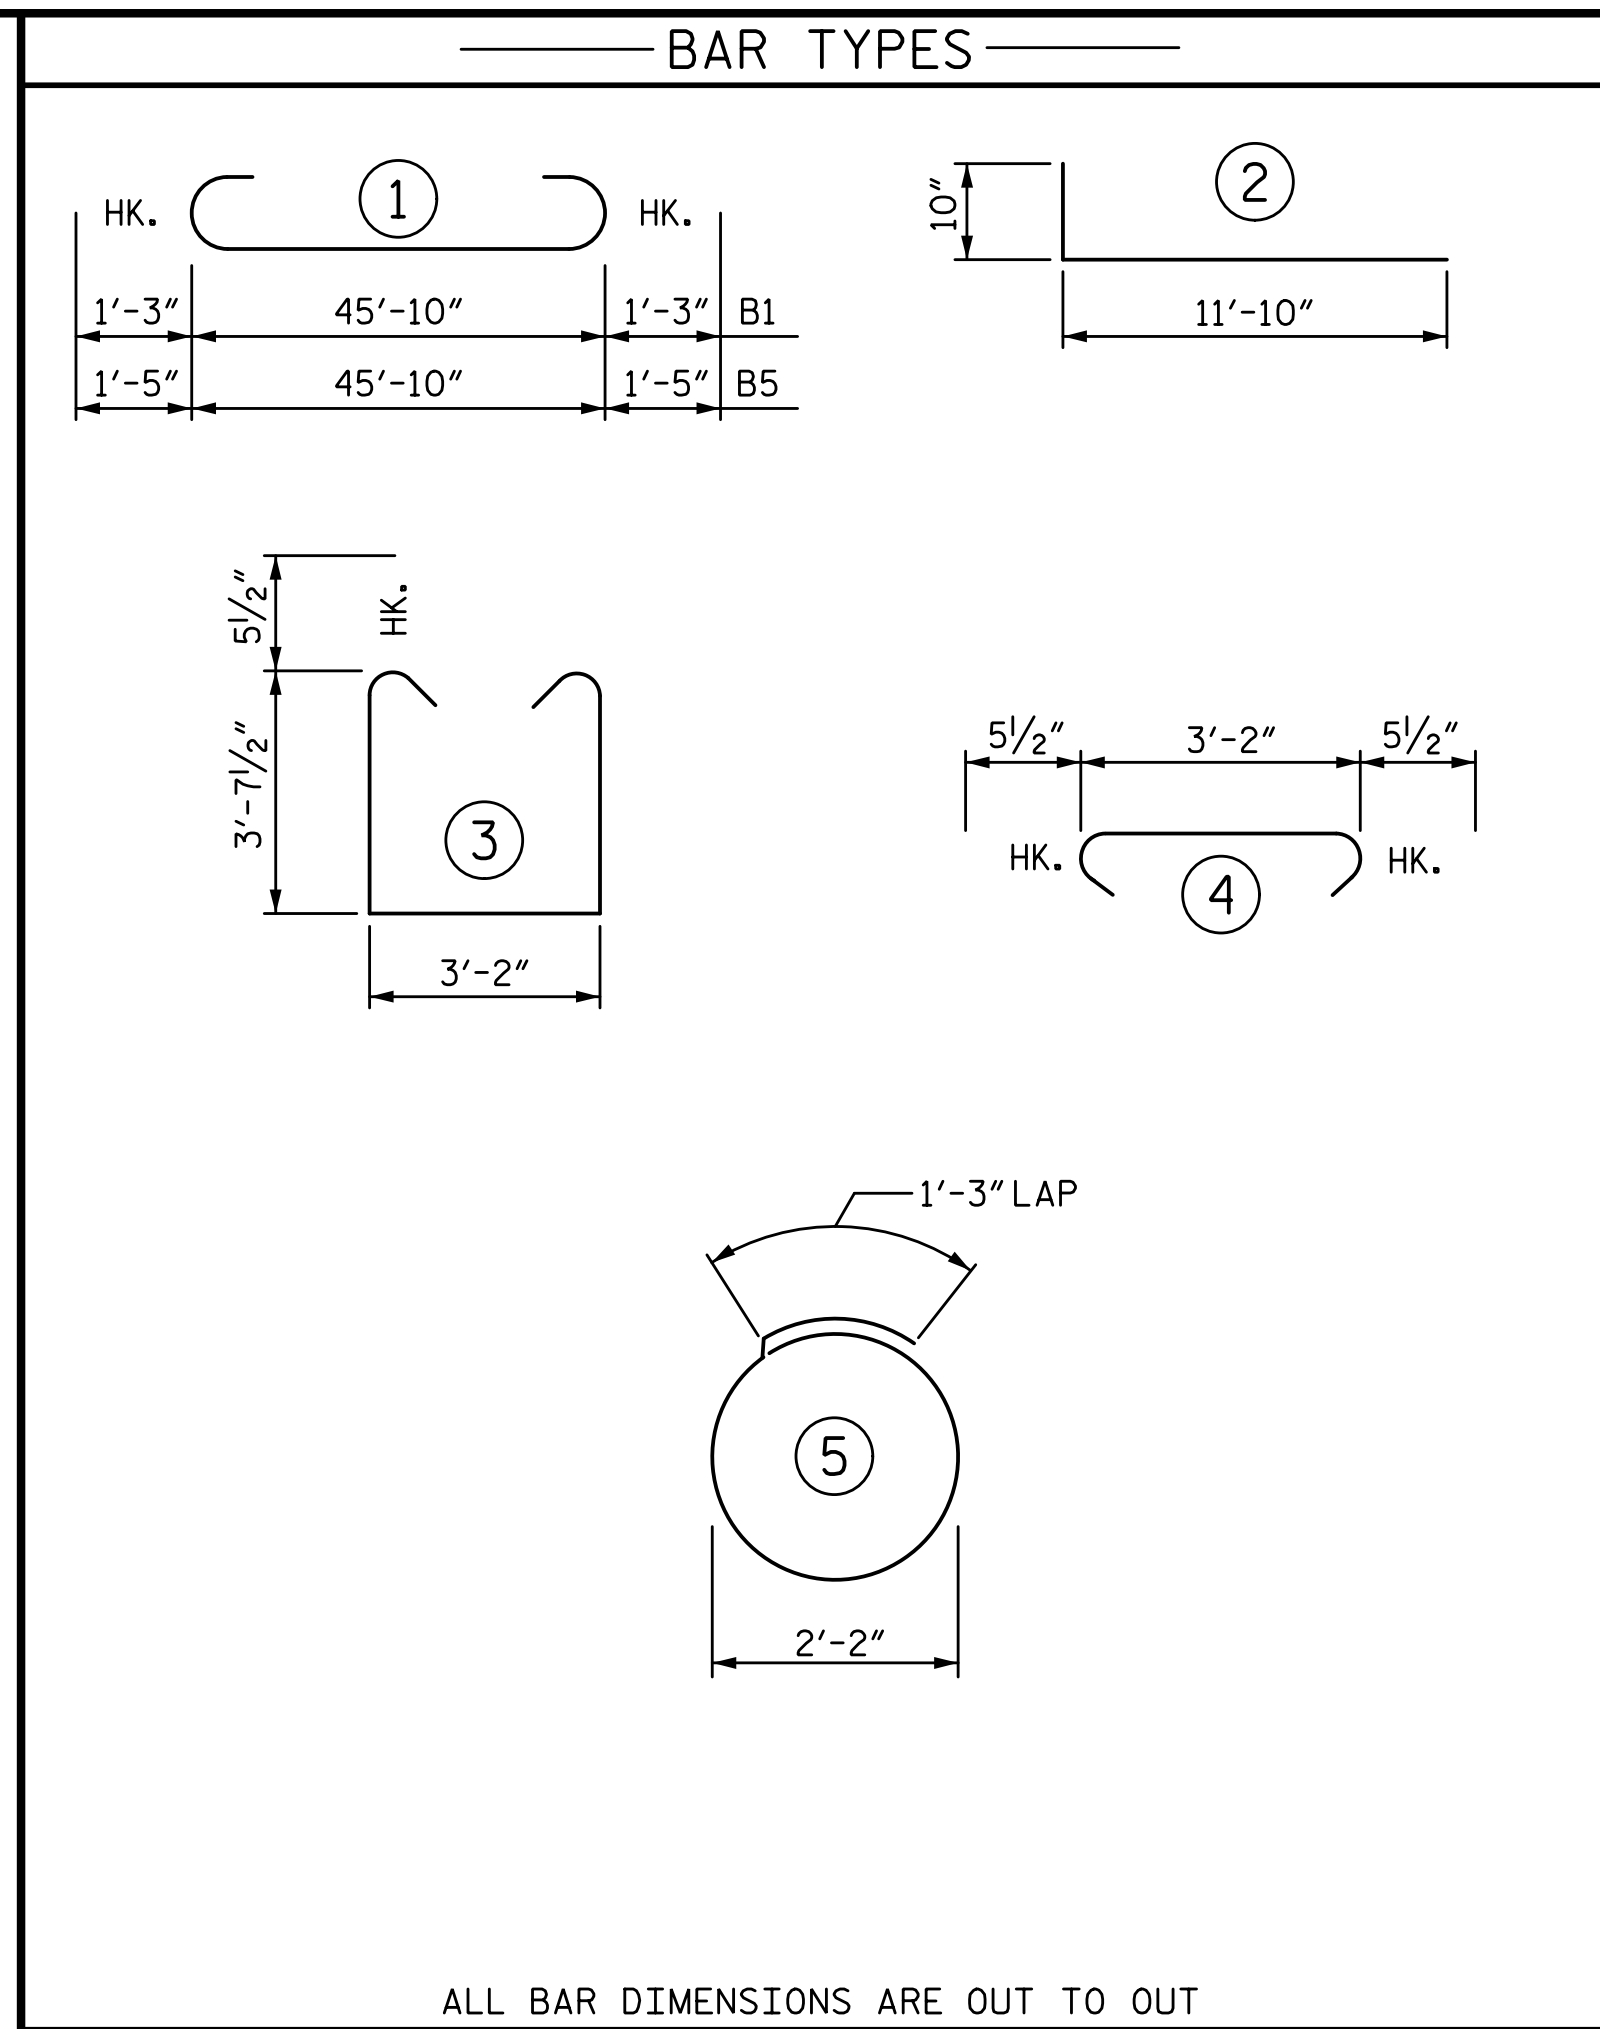

ALL BAR DIMENSIONS ARE OUT TO OUT


BILL OF MATERIAL					
END BENT 1					
BAR	NO.	SIZE	TYPE	LENGTH	WEIGHT
B1	5	#9	1	48'-4"	822
B2	12	#4	STR	24'-4"	195
B3	8	#4	STR	24'-4"	130
B4	12	#4	STR	3'-2"	25
B5	4	#10	1	48'-8"	838
H1	80	#5	2	12'-8"	1057
K1	48	#4	STR	3'-8"	118
S1	60	#5	3	11'-4"	709
S2	60	#5	4	4'-1"	256
S3	32	#4	5	8'-1"	173
V1	68	#4	STR	5'-9"	261
V2	72	#4	STR	9'-8"	465
TOTAL REINFORCING STEEL					5049 LB
CLASS AA CONCRETE					
POUR 1 (CAP, COLLARS, & LOWER WINGS)					
POUR 2 (UPPER WINGS)					6.5 CY
TOTAL CLASS AA CONCRETE					36.7 CY
PILE DRIVING EQUIPMENT SETUP FOR PP 16 X 0.50 GALVANIZED STEEL PILES					
					8 EA
PP 16 X 0.50 GALVANIZED STEEL PILES NO. 8					
					400 LF
PIPE PILE PLATES					8 EA
PILE REDRIVES					4 EA

PROJECT NO. B-5652
ONLOW COUNTY
 STATION: 20+64.00 -L-RT-

SHEET 3 OF 3

STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH
 SUBSTRUCTURE

 END BENT 1

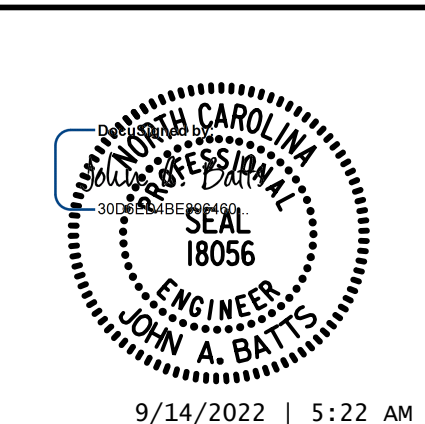


DRAWN BY: S.D. COOPER DATE: 5-22
 CHECKED BY: J.A. BATTS DATE: 5-22
 DESIGN ENGINEER OF RECORD: J.A. BATTS DATE: 5-22

REVISIONS						SHEET NO.
NO.	BY:	DATE:	NO.	BY:	DATE:	S-19
1			3			TOTAL SHEETS
2			4			26



DOCUMENT NOT CONSIDERED FINAL
 UNLESS ALL SIGNATURES COMPLETED

9/14/2022 8:06:05 AM P:\Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401_B5652_SMU_E2_660033.dgn

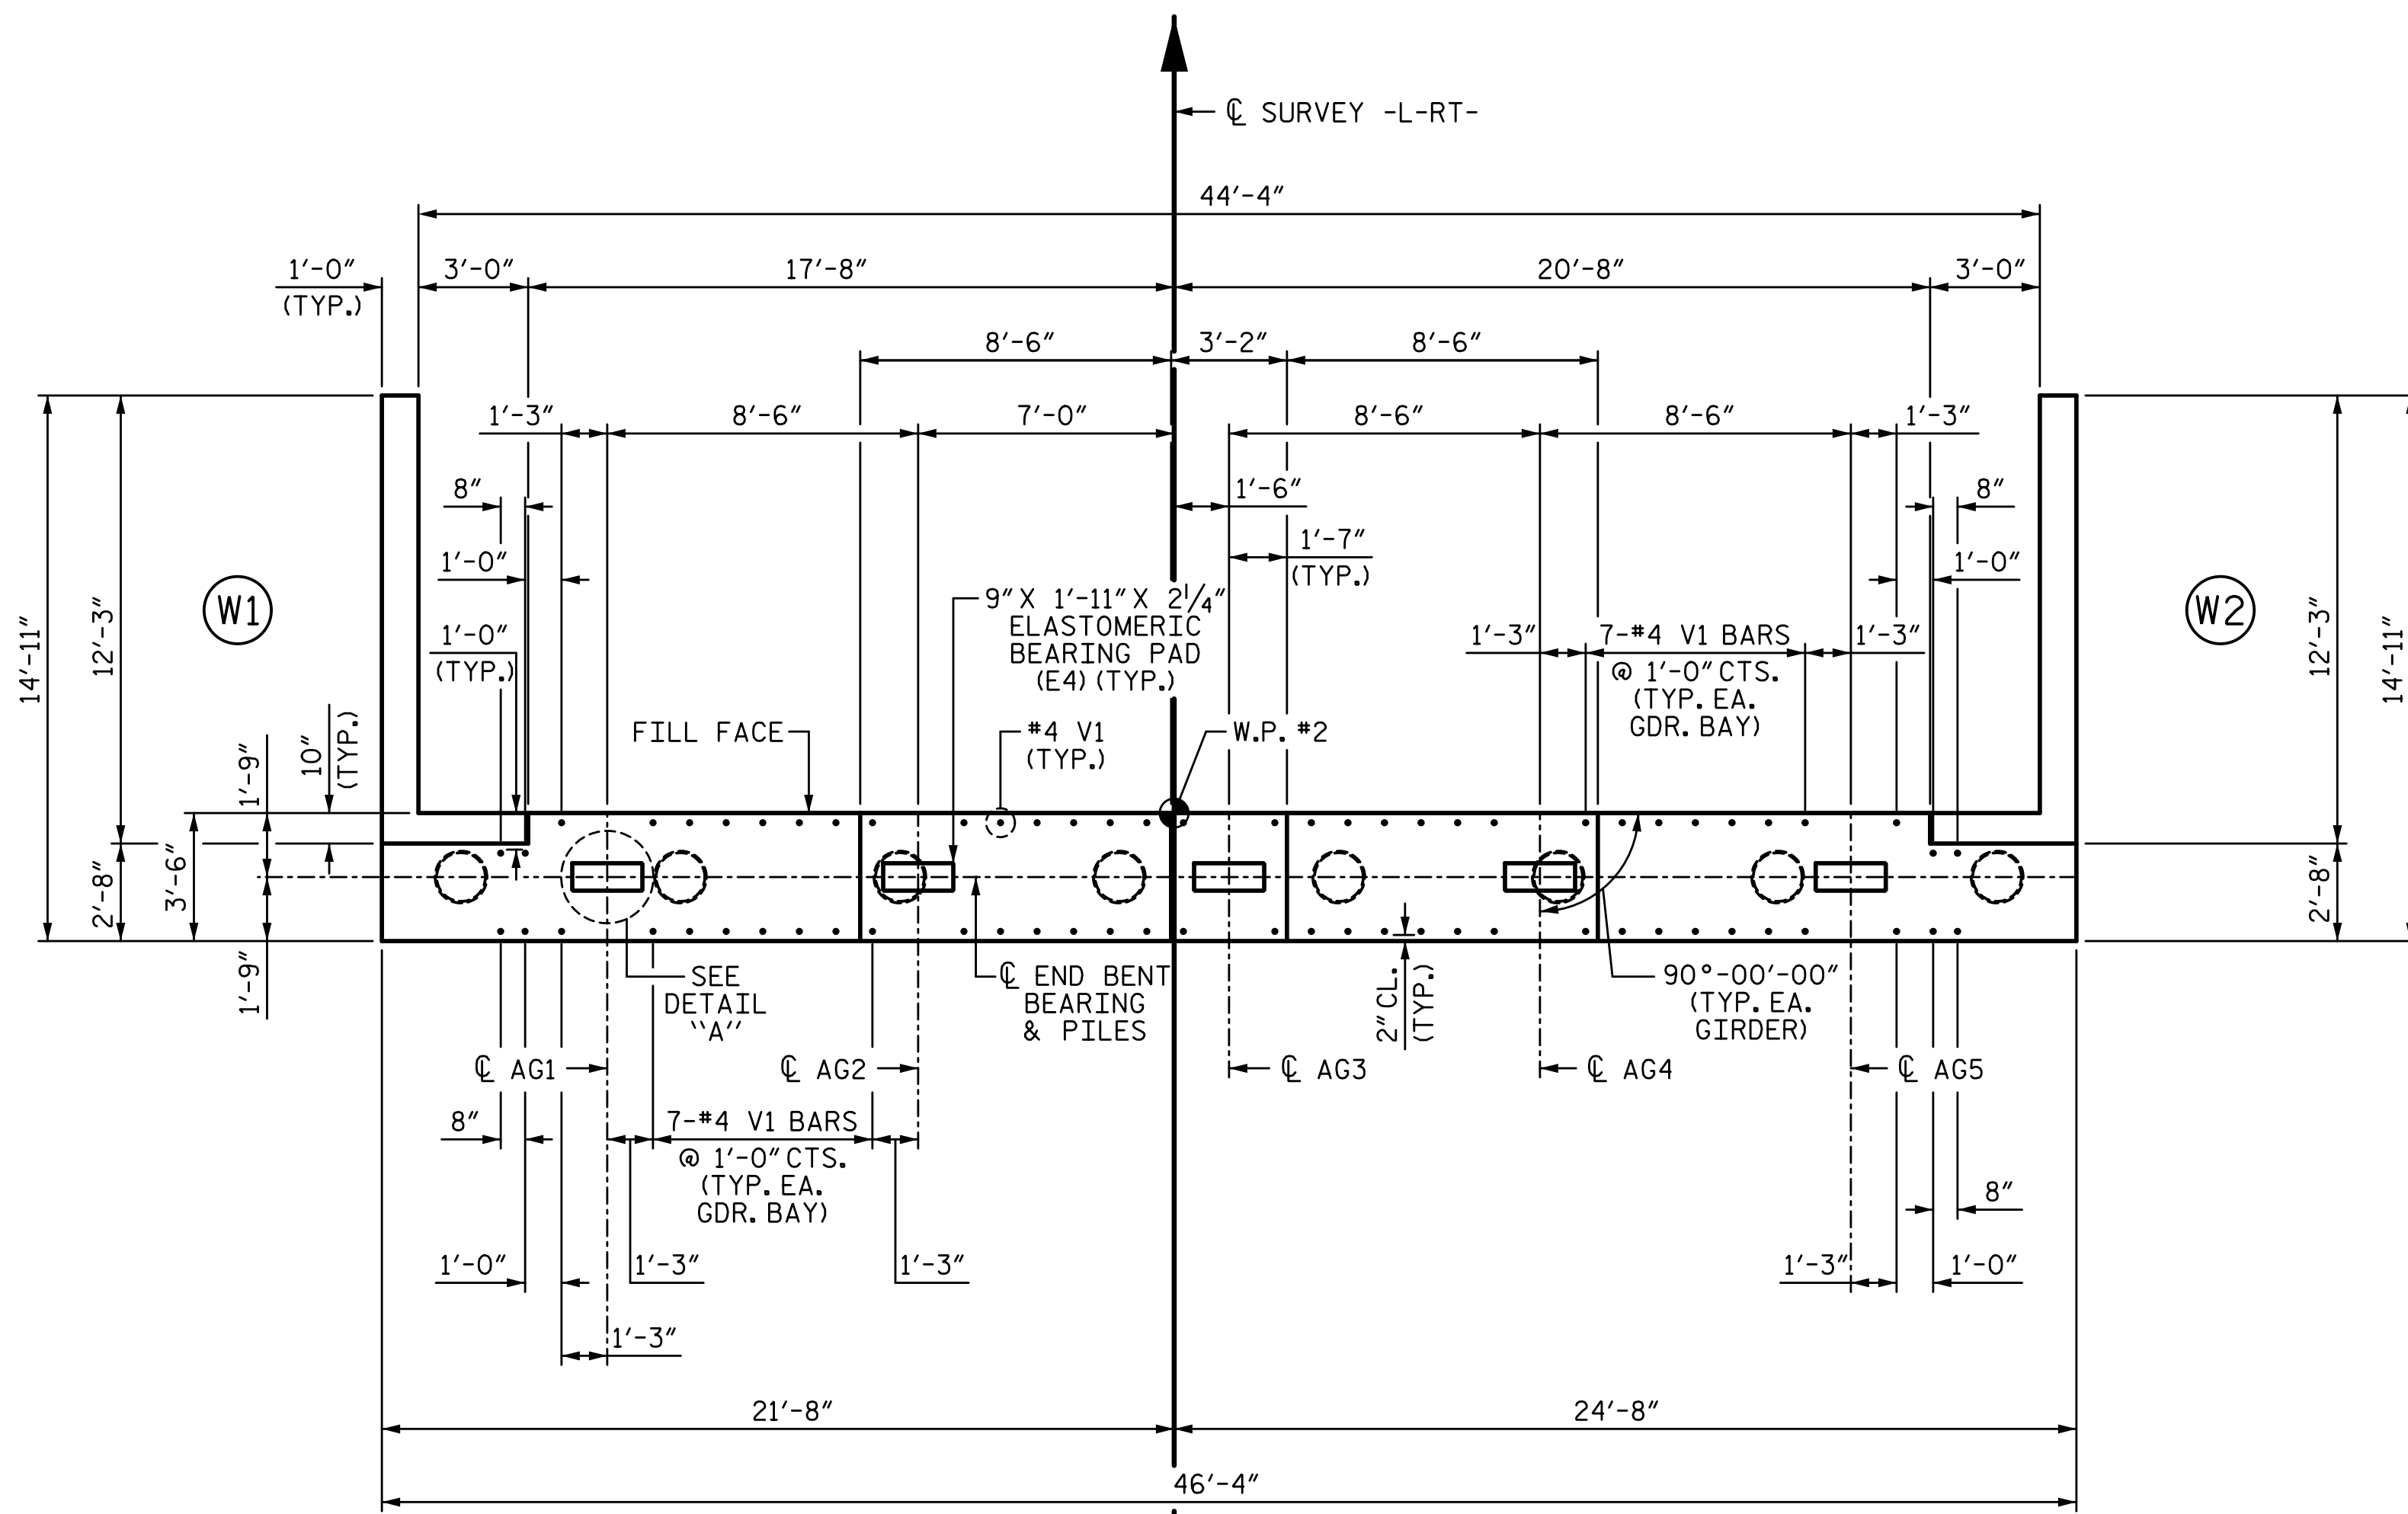

NOTES:

- #4 V1 BARS MAY BE SHIFTED SLIGHTLY TO AVOID STIRRUPS IN CAP.
- FOR SECTION A-A, SEE SHEET 3 OF 3.
- THE TOP SURFACE OF THE END BENT CAP AND WINGS (POUR 1), EXCLUDING THE BEARING AREA, SHALL BE RAKED TO A DEPTH OF 1/4".
- FOR PIPE PILE DETAILS, SEE "16" STEEL PIPE PILE" SHEET.

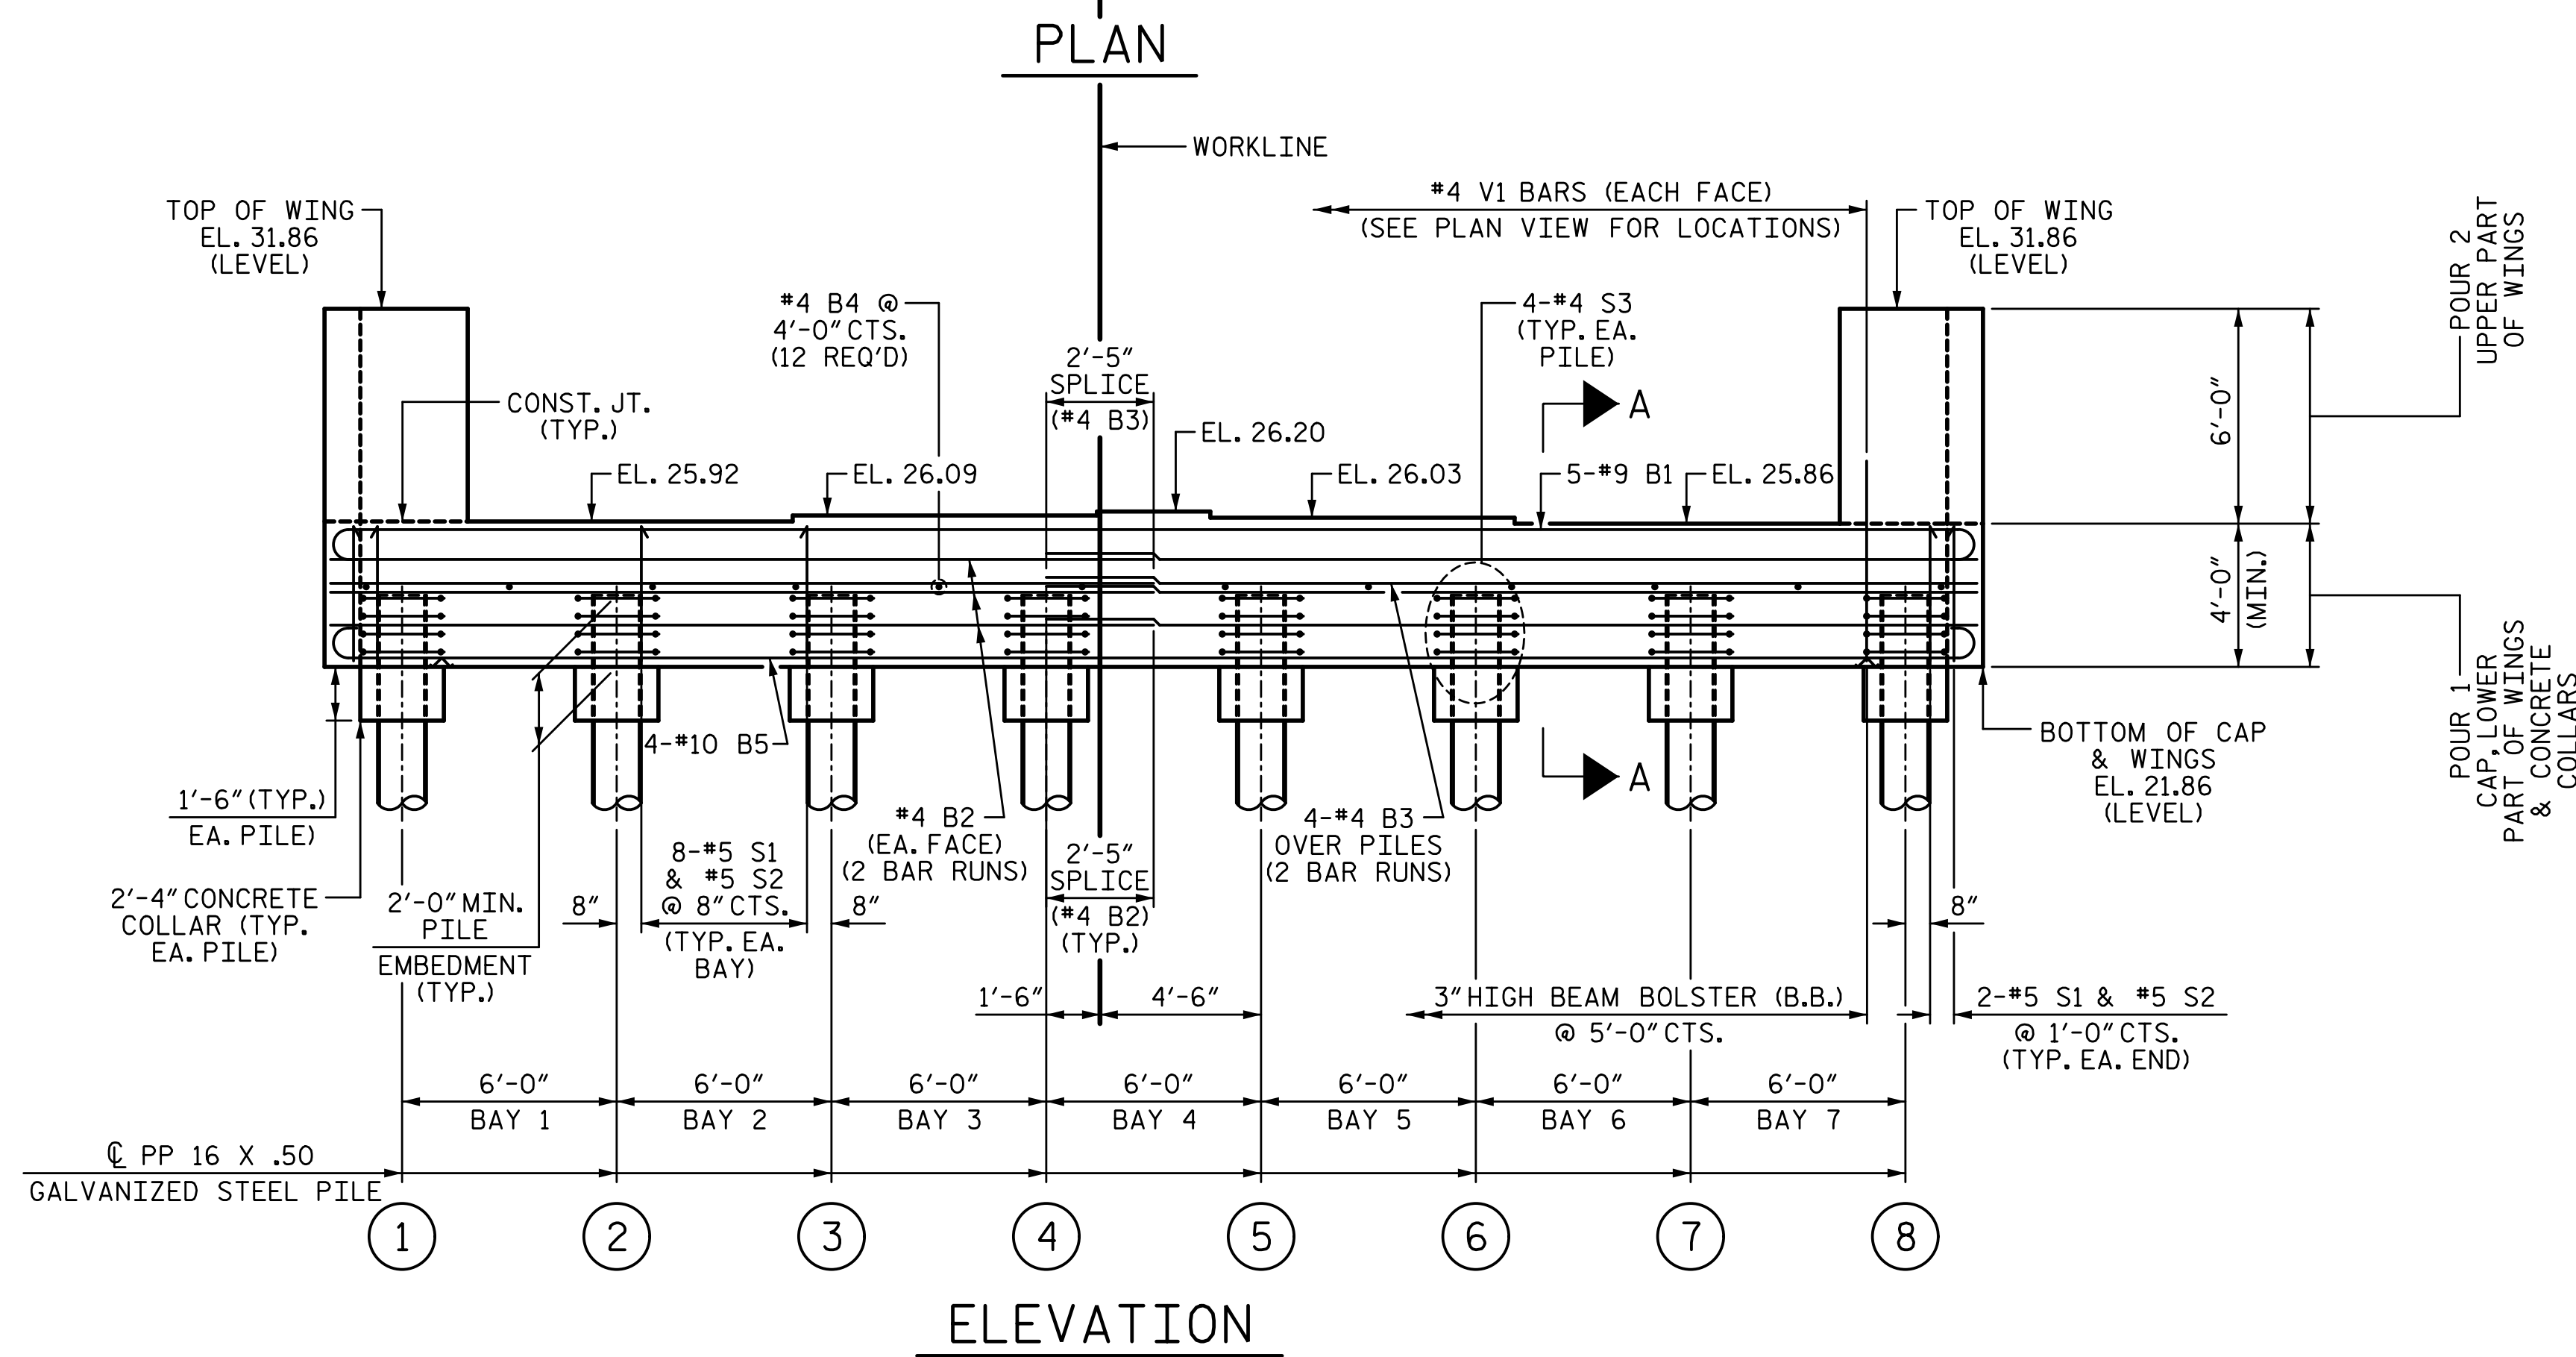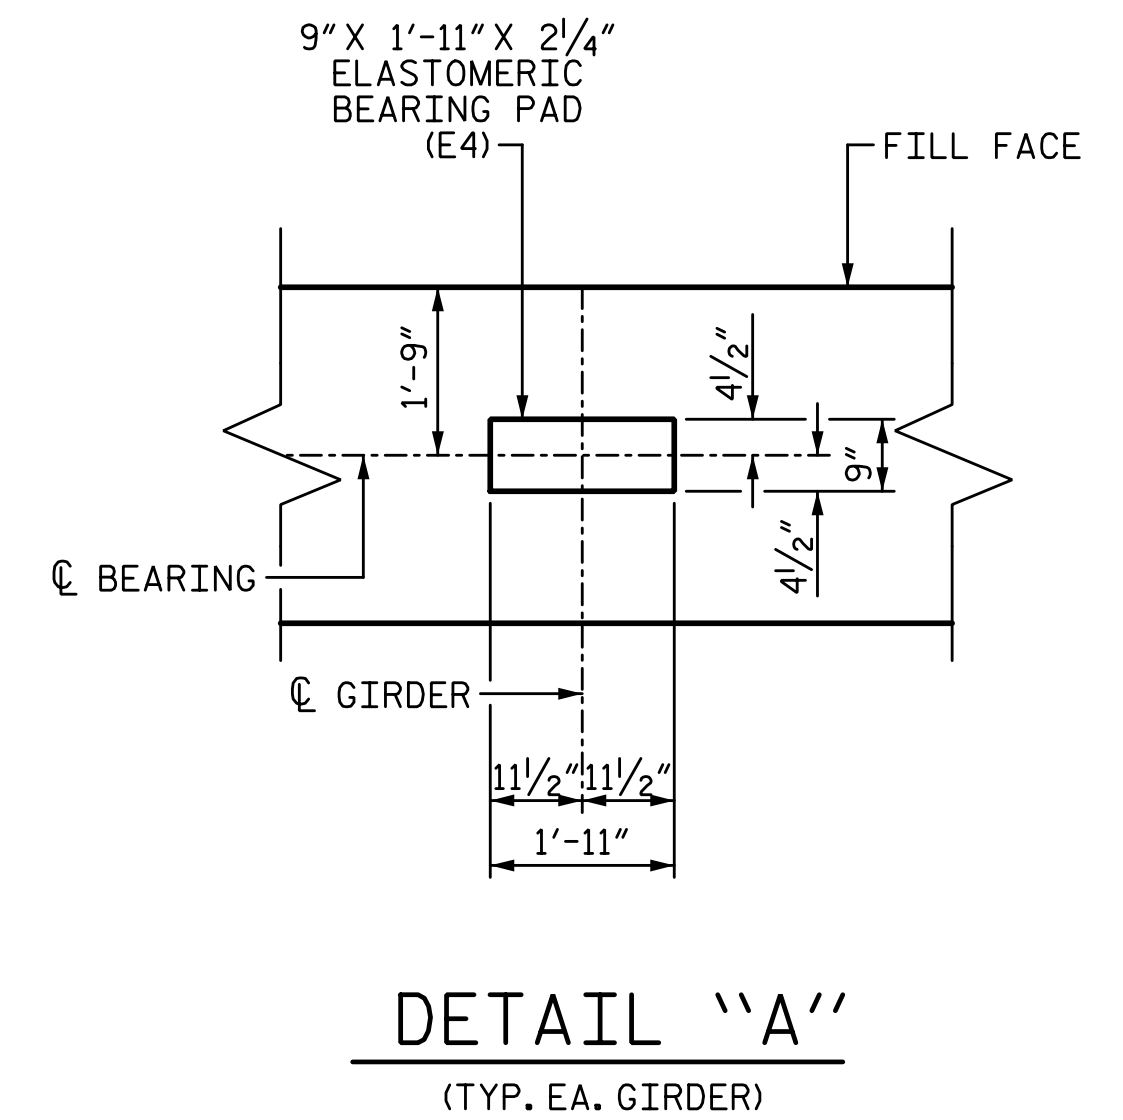

PROJECT NO. B-5652
ONLOW COUNTY
 STATION: 20+64.00 -L-RT-

SHEET 1 OF 3


STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH
 SUBSTRUCTURE

END BENT 2



5640 Dillard Drive, Suite 200
 Cary, NC 27518

LICENSURE NO. C-4434

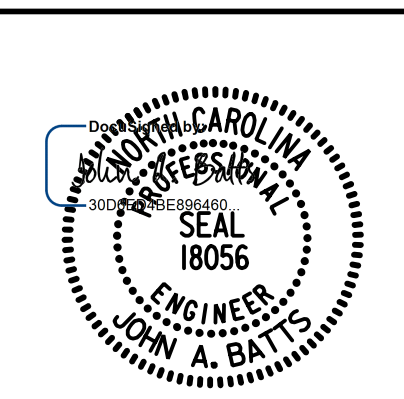


9/14/2022 | 5:22 AM

DRAWN BY: S.D. COOPER DATE: 5-22
 CHECKED BY: J.A. BATTS DATE: 5-22
 DESIGN ENGINEER OF RECORD: J.A. BATTS DATE: 5-22


REVISIONS						SHEET NO.
NO.	BY:	DATE:	NO.	BY:	DATE:	S-20
1			3			TOTAL SHEETS
2			4			26

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED


9/14/2022 8:06:05 AM P:\Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401_B5652_SMU_E2_660033.dgn

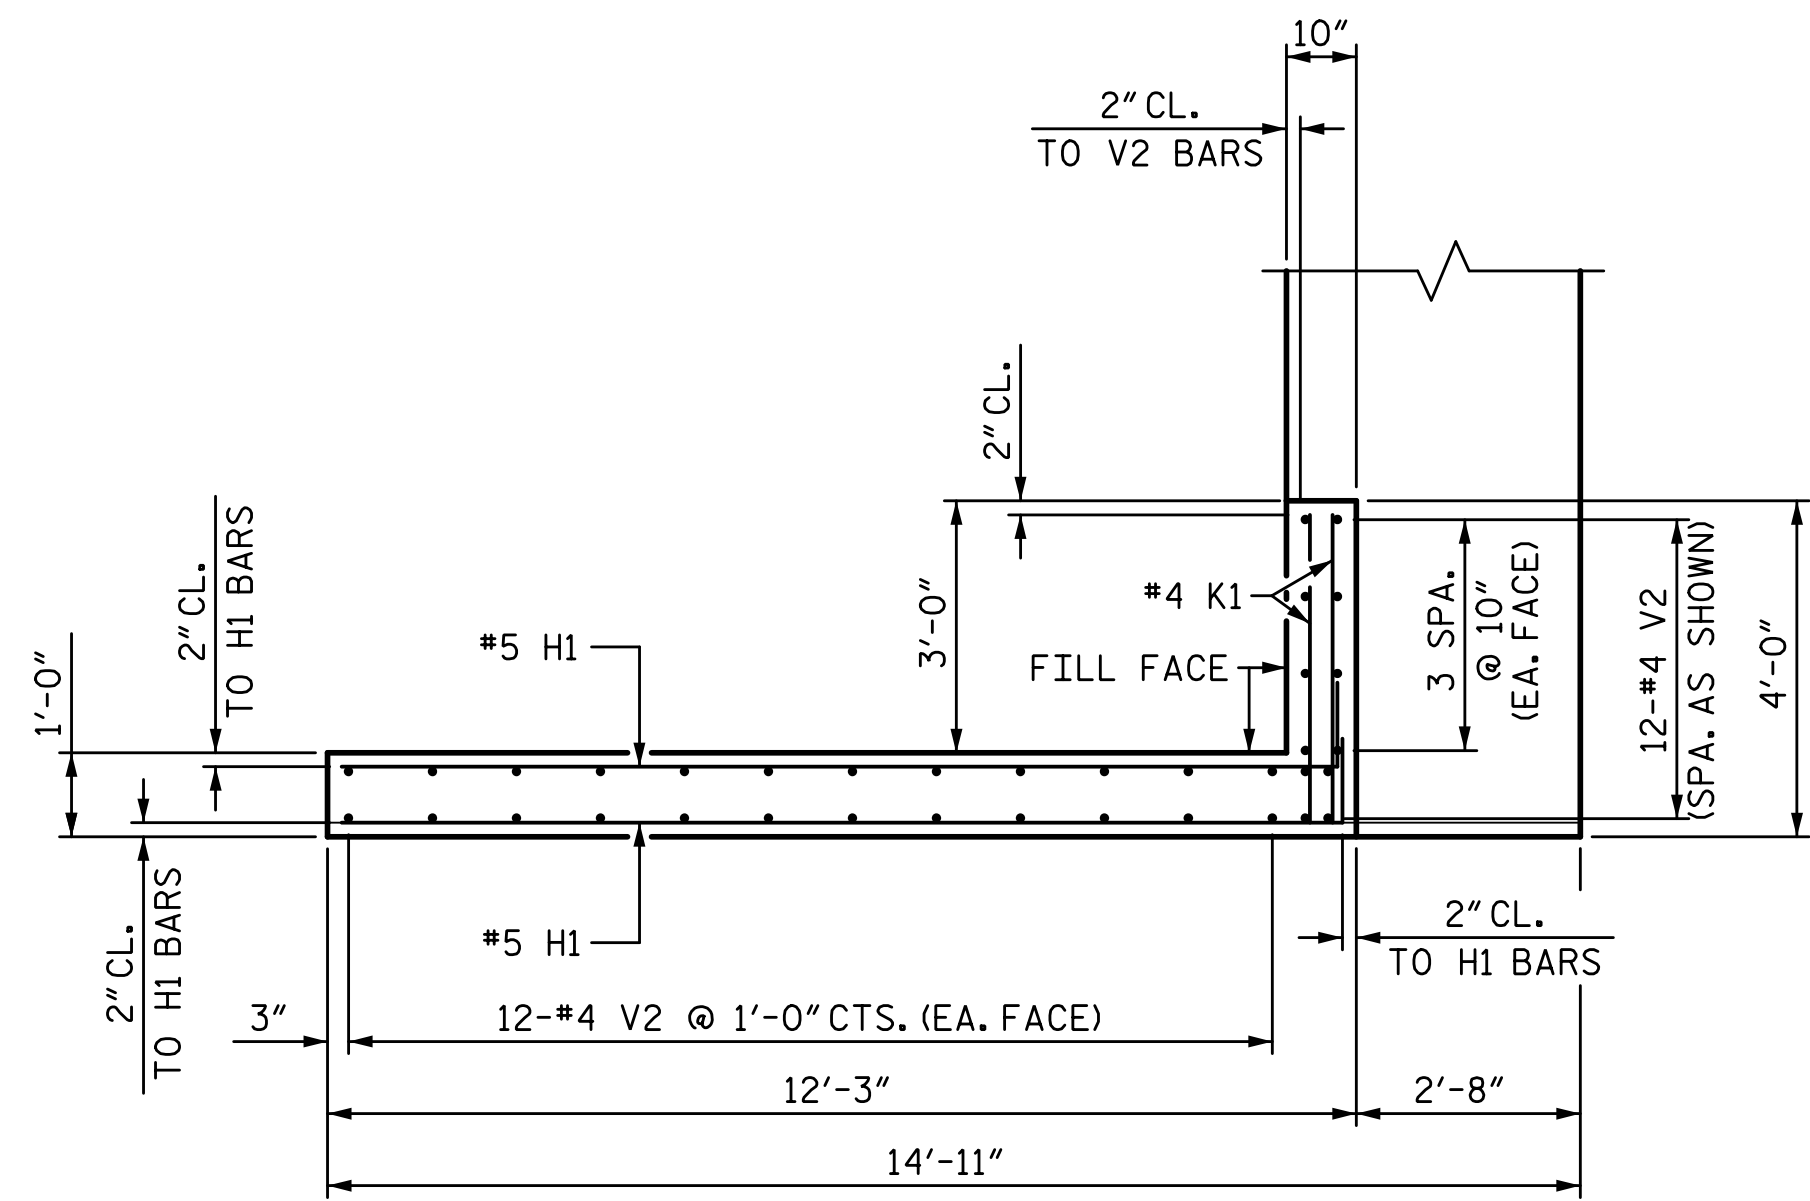


PLAN OF WING (W1)

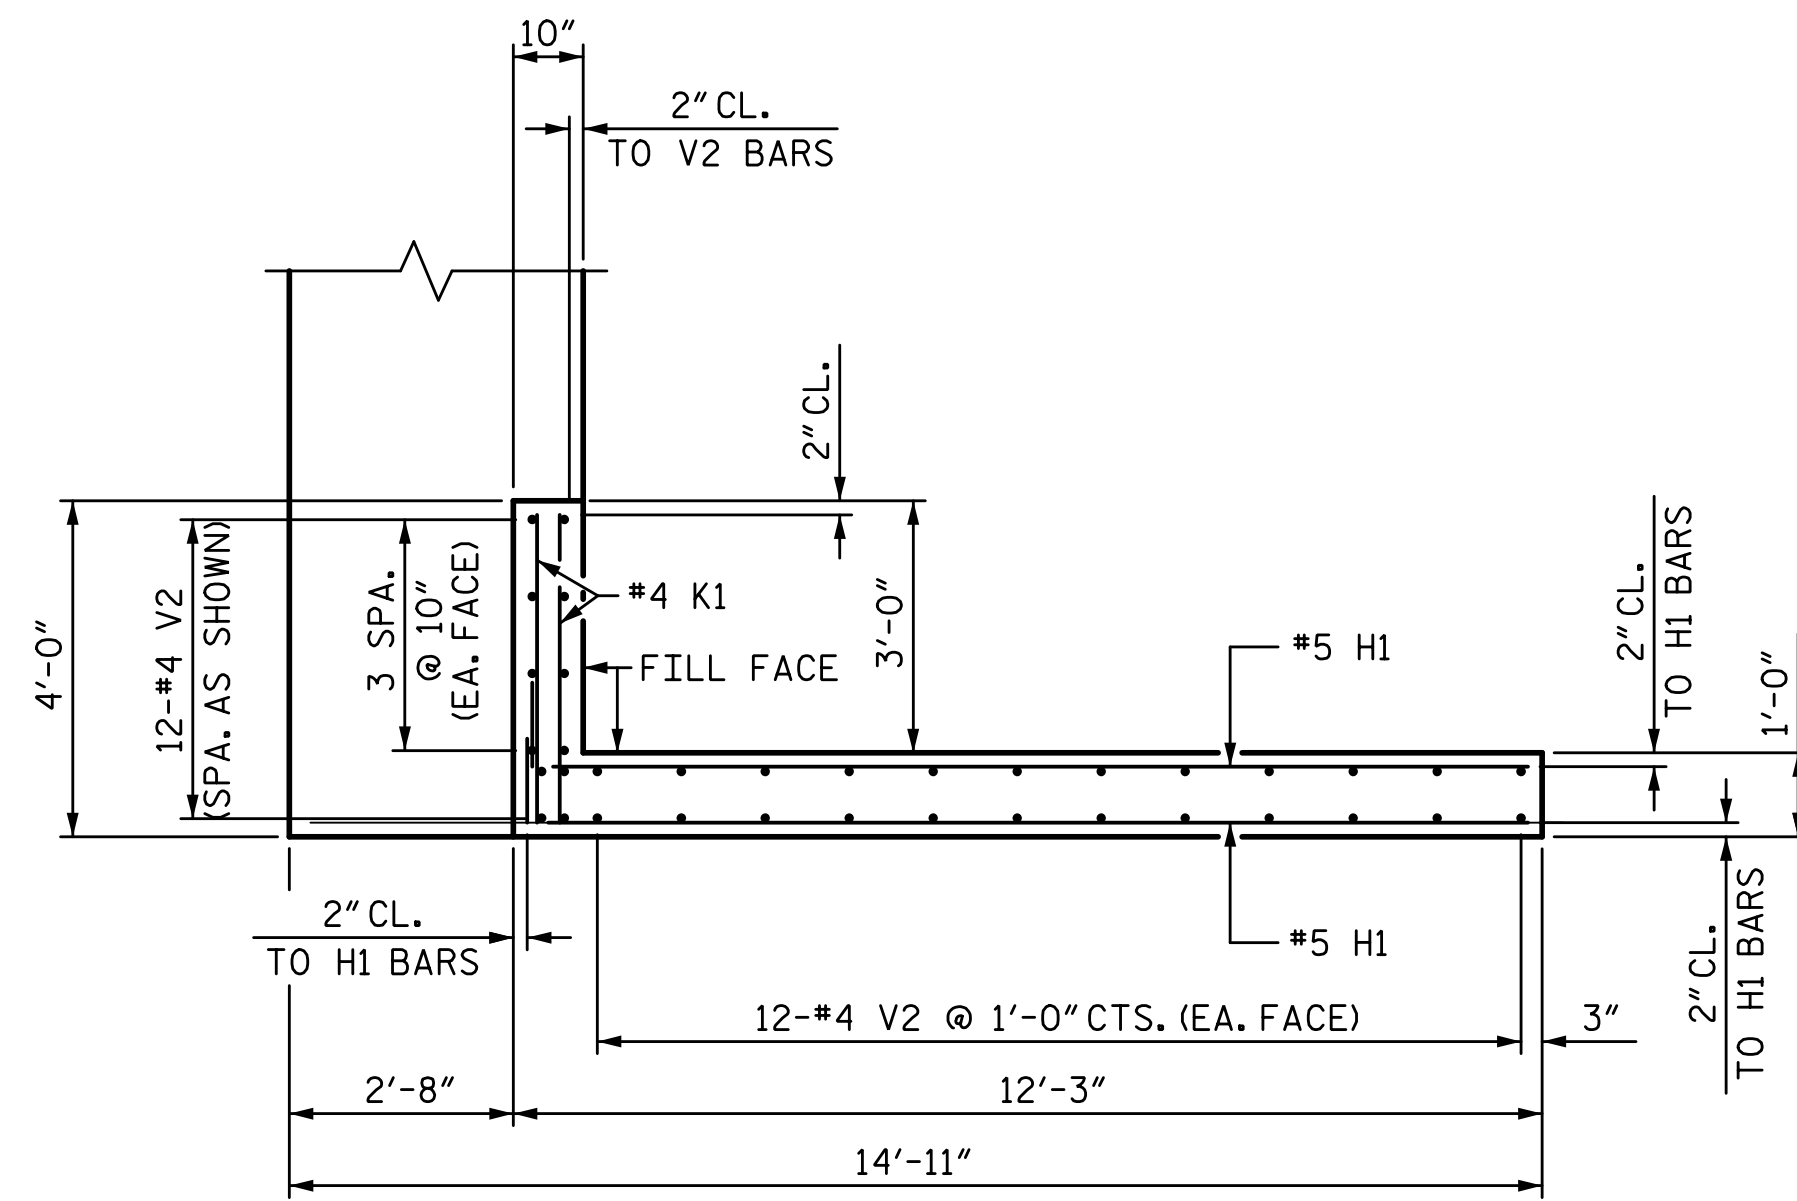


PLAN OF WING (W2)

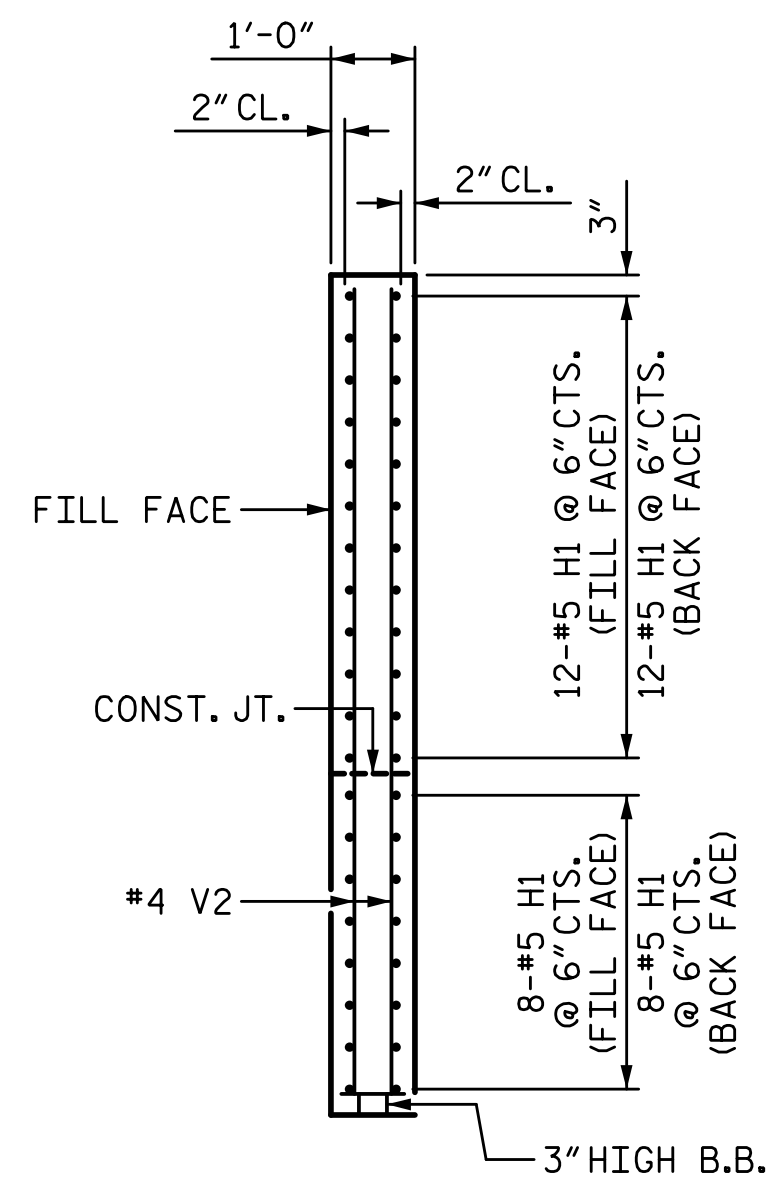


SECTION X-X

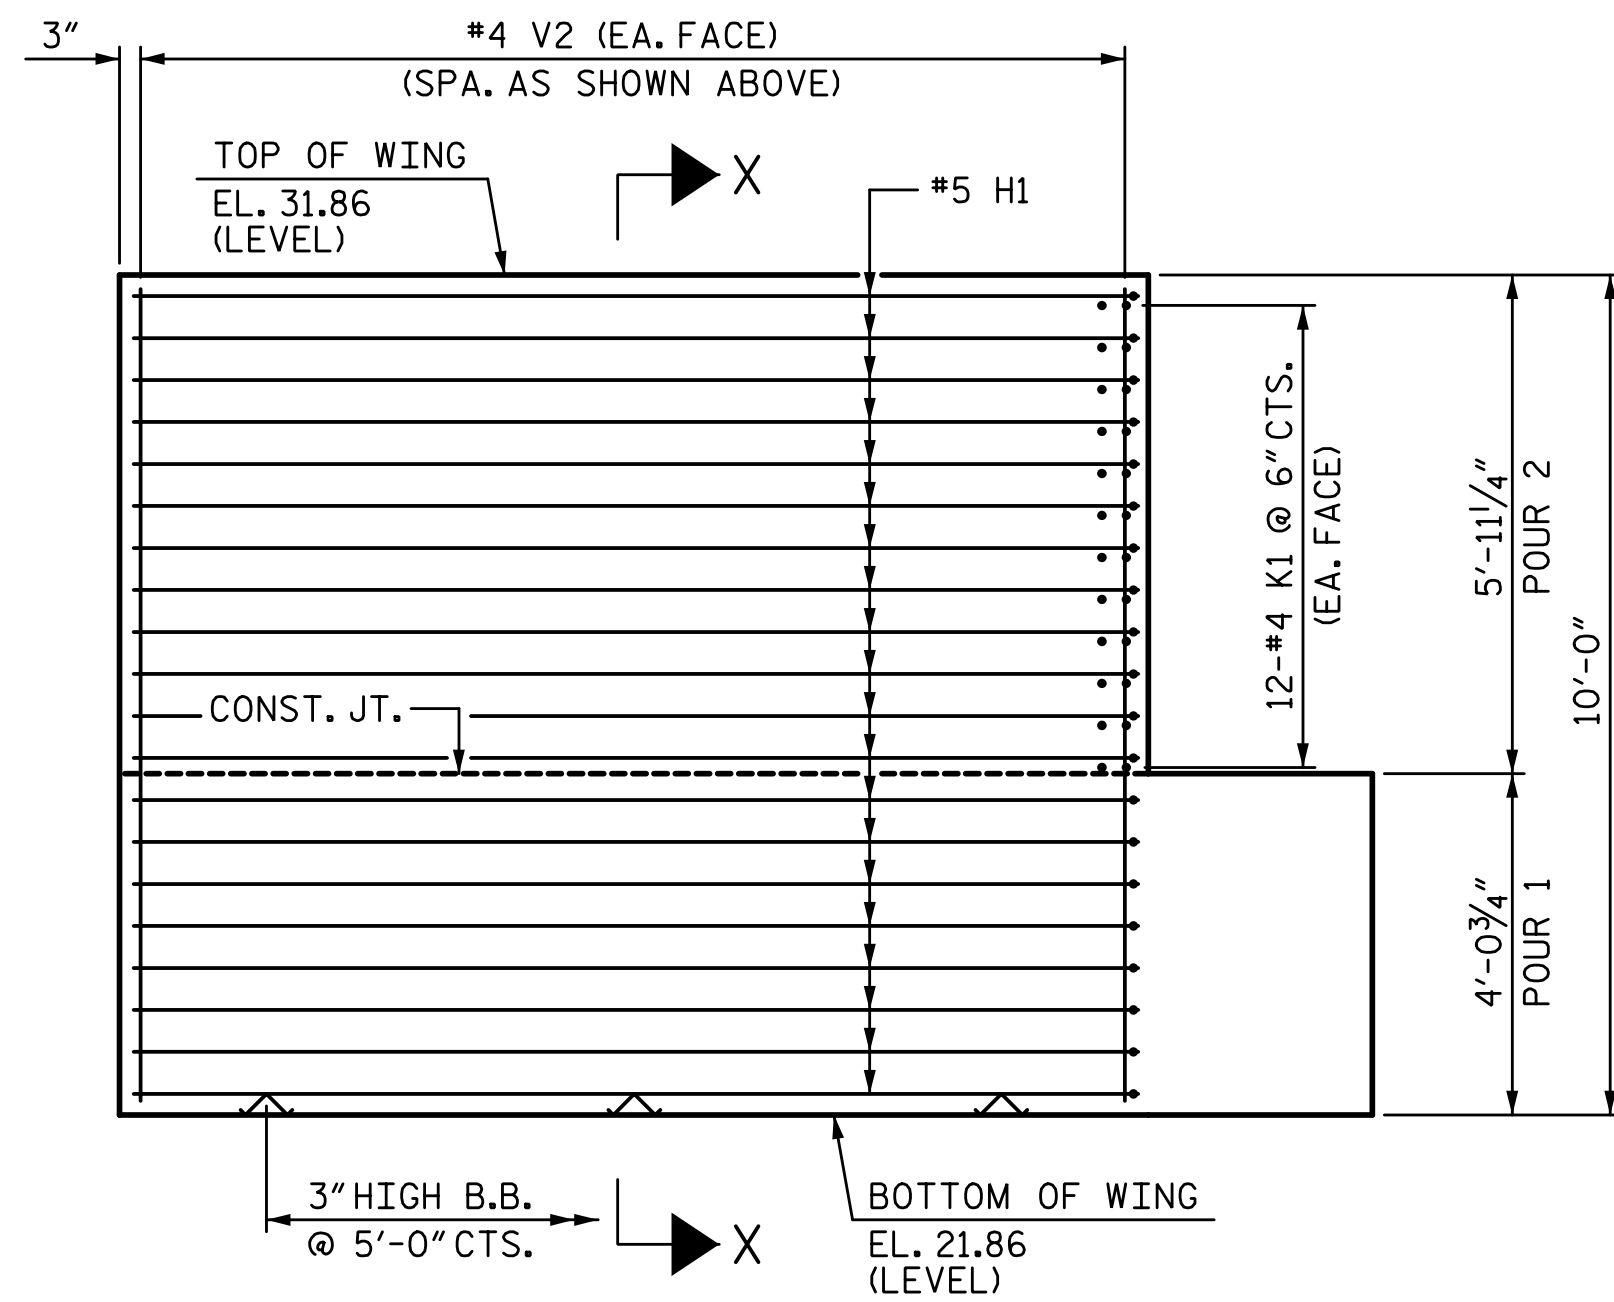

ELEVATION OF WING (W1)

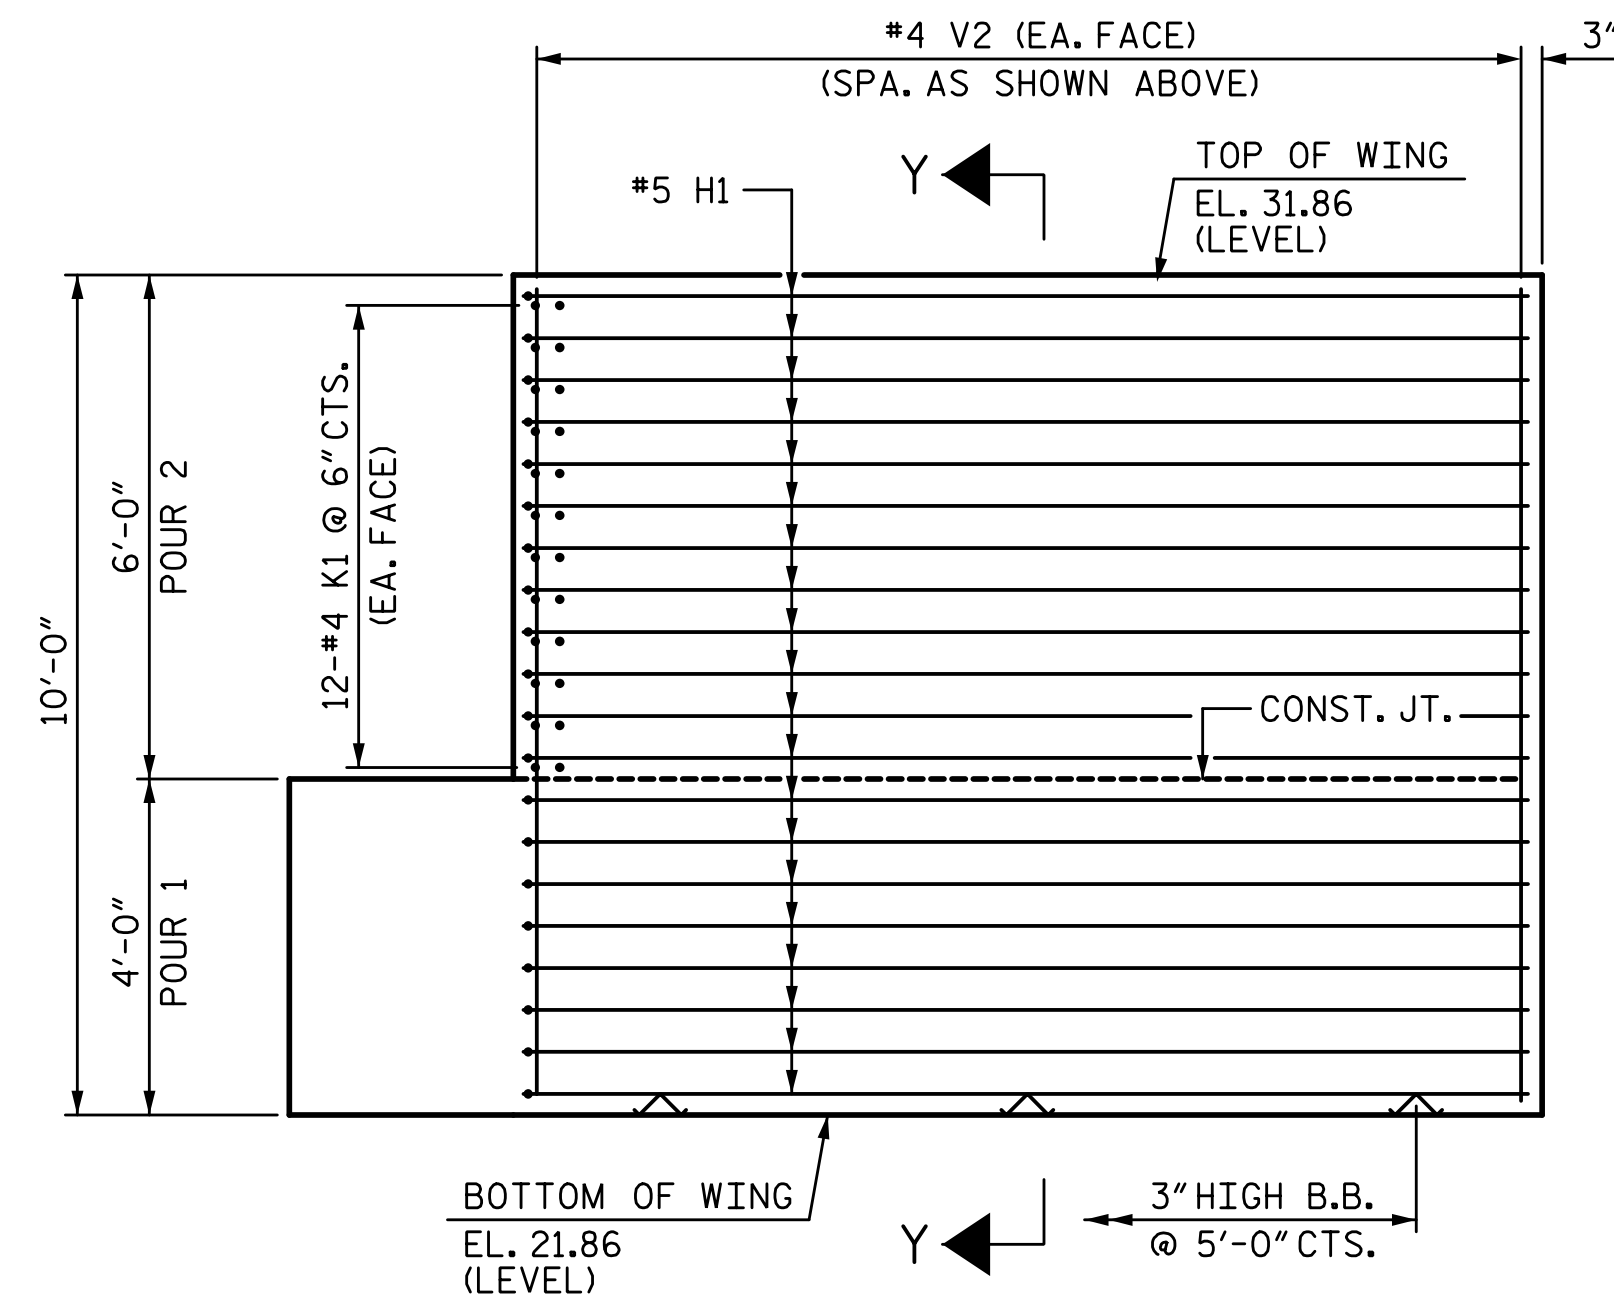

ELEVATION OF WING (W2)

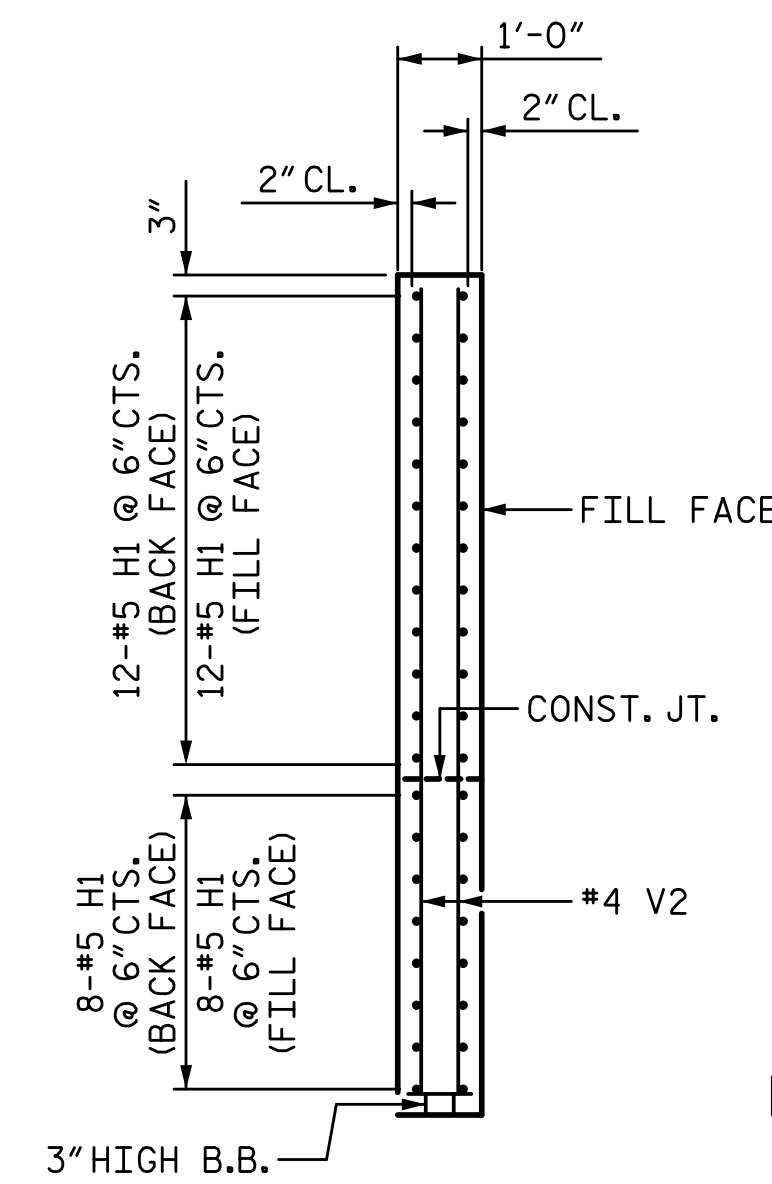


SECTION Y-Y

PROJECT NO. B-5652
ONSLow COUNTY
 STATION: 20+64.00 -L-RT-

SHEET 2 OF 3

STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH
 SUBSTRUCTURE

END BENT 2

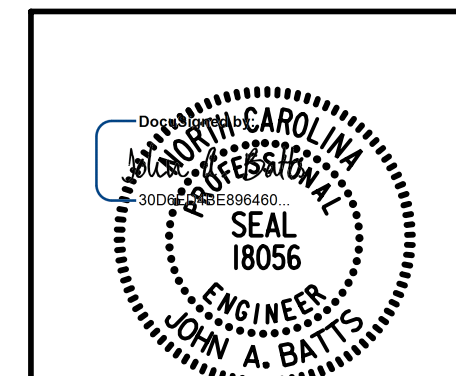

DRAWN BY: S.D. COOPER	DATE: 5-22
CHECKED BY: J.A. BATTS	DATE: 5-22
DESIGN ENGINEER OF RECORD: J.A. BATTS	DATE: 5-22


LICENSURE NO. C-4434

9/14/2022 | 5:22 AM PD

REVISIONS				SHEET NO.	
NO.	BY:	DATE:	NO.	BY:	DATE:
1			3		
2			4		
					TOTAL SHEETS
					26

DOCUMENT NOT CONSIDERED FINAL
 UNLESS ALL SIGNATURES COMPLETED

9/14/2022 8:06:06 AM P:\Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401_B5652_SMU_E2_660033.dgn

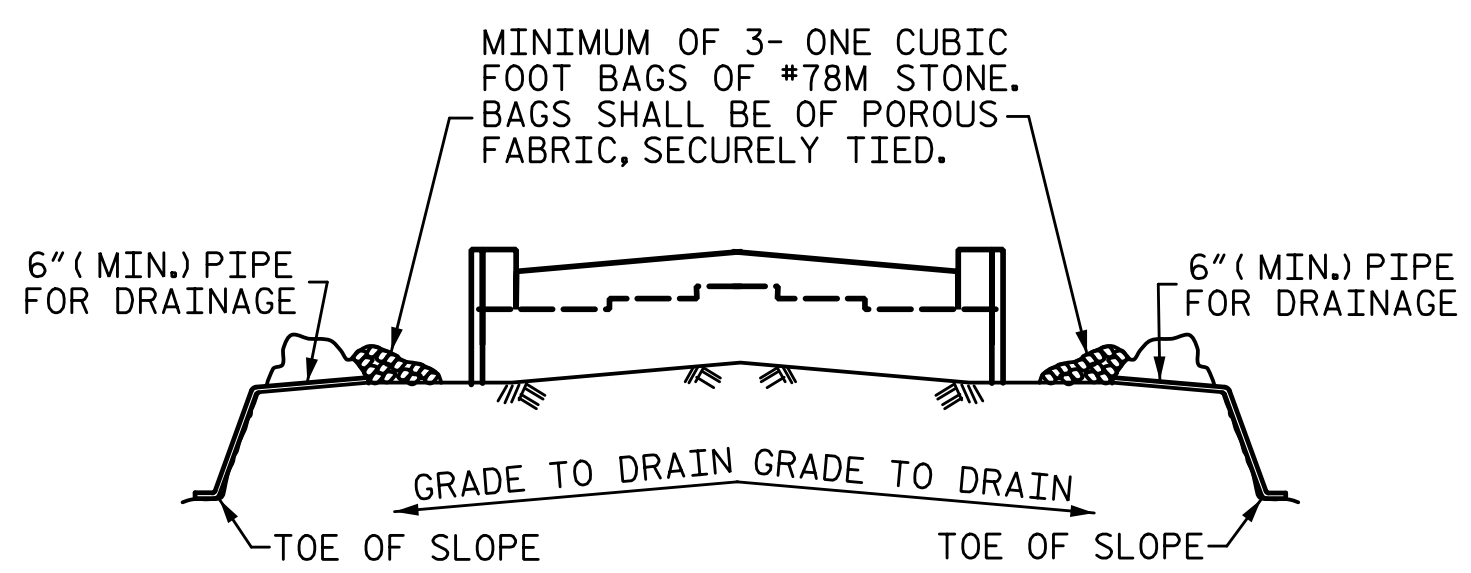


BAGGED STONE AND PIPE SHALL BE PLACED IMMEDIATELY AFTER COMPLETION OF END BENT EXCAVATION. PIPE MAY BE EITHER CONCRETE, CORRUGATED STEEL, CORRUGATED ALUMINUM ALLOY, OR CORRUGATED PLASTIC. PERFORATED PIPE WILL NOT BE ALLOWED.


BAGGED STONE SHALL REMAIN IN PLACE UNTIL THE ENGINEER DIRECTS THAT IT BE REMOVED. THE CONTRACTOR SHALL REMOVE AND DISPOSE OF SILT ACCUMULATIONS AT BAGGED STONE WHEN SO DIRECTED BY THE ENGINEER. BAGS SHALL BE REMOVED AND REPLACED WHENEVER THE ENGINEER DETERMINES THAT THEY HAVE DETERIORATED AND LOST THEIR EFFECTIVENESS.

NO SEPARATE PAYMENT WILL BE MADE FOR THIS WORK AND THE ENTIRE COST OF THIS WORK SHALL BE INCLUDED IN THE UNIT CONTRACT PRICE BID FOR THE SEVERAL PAY ITEMS.

TEMPORARY DRAINAGE AT END BENT

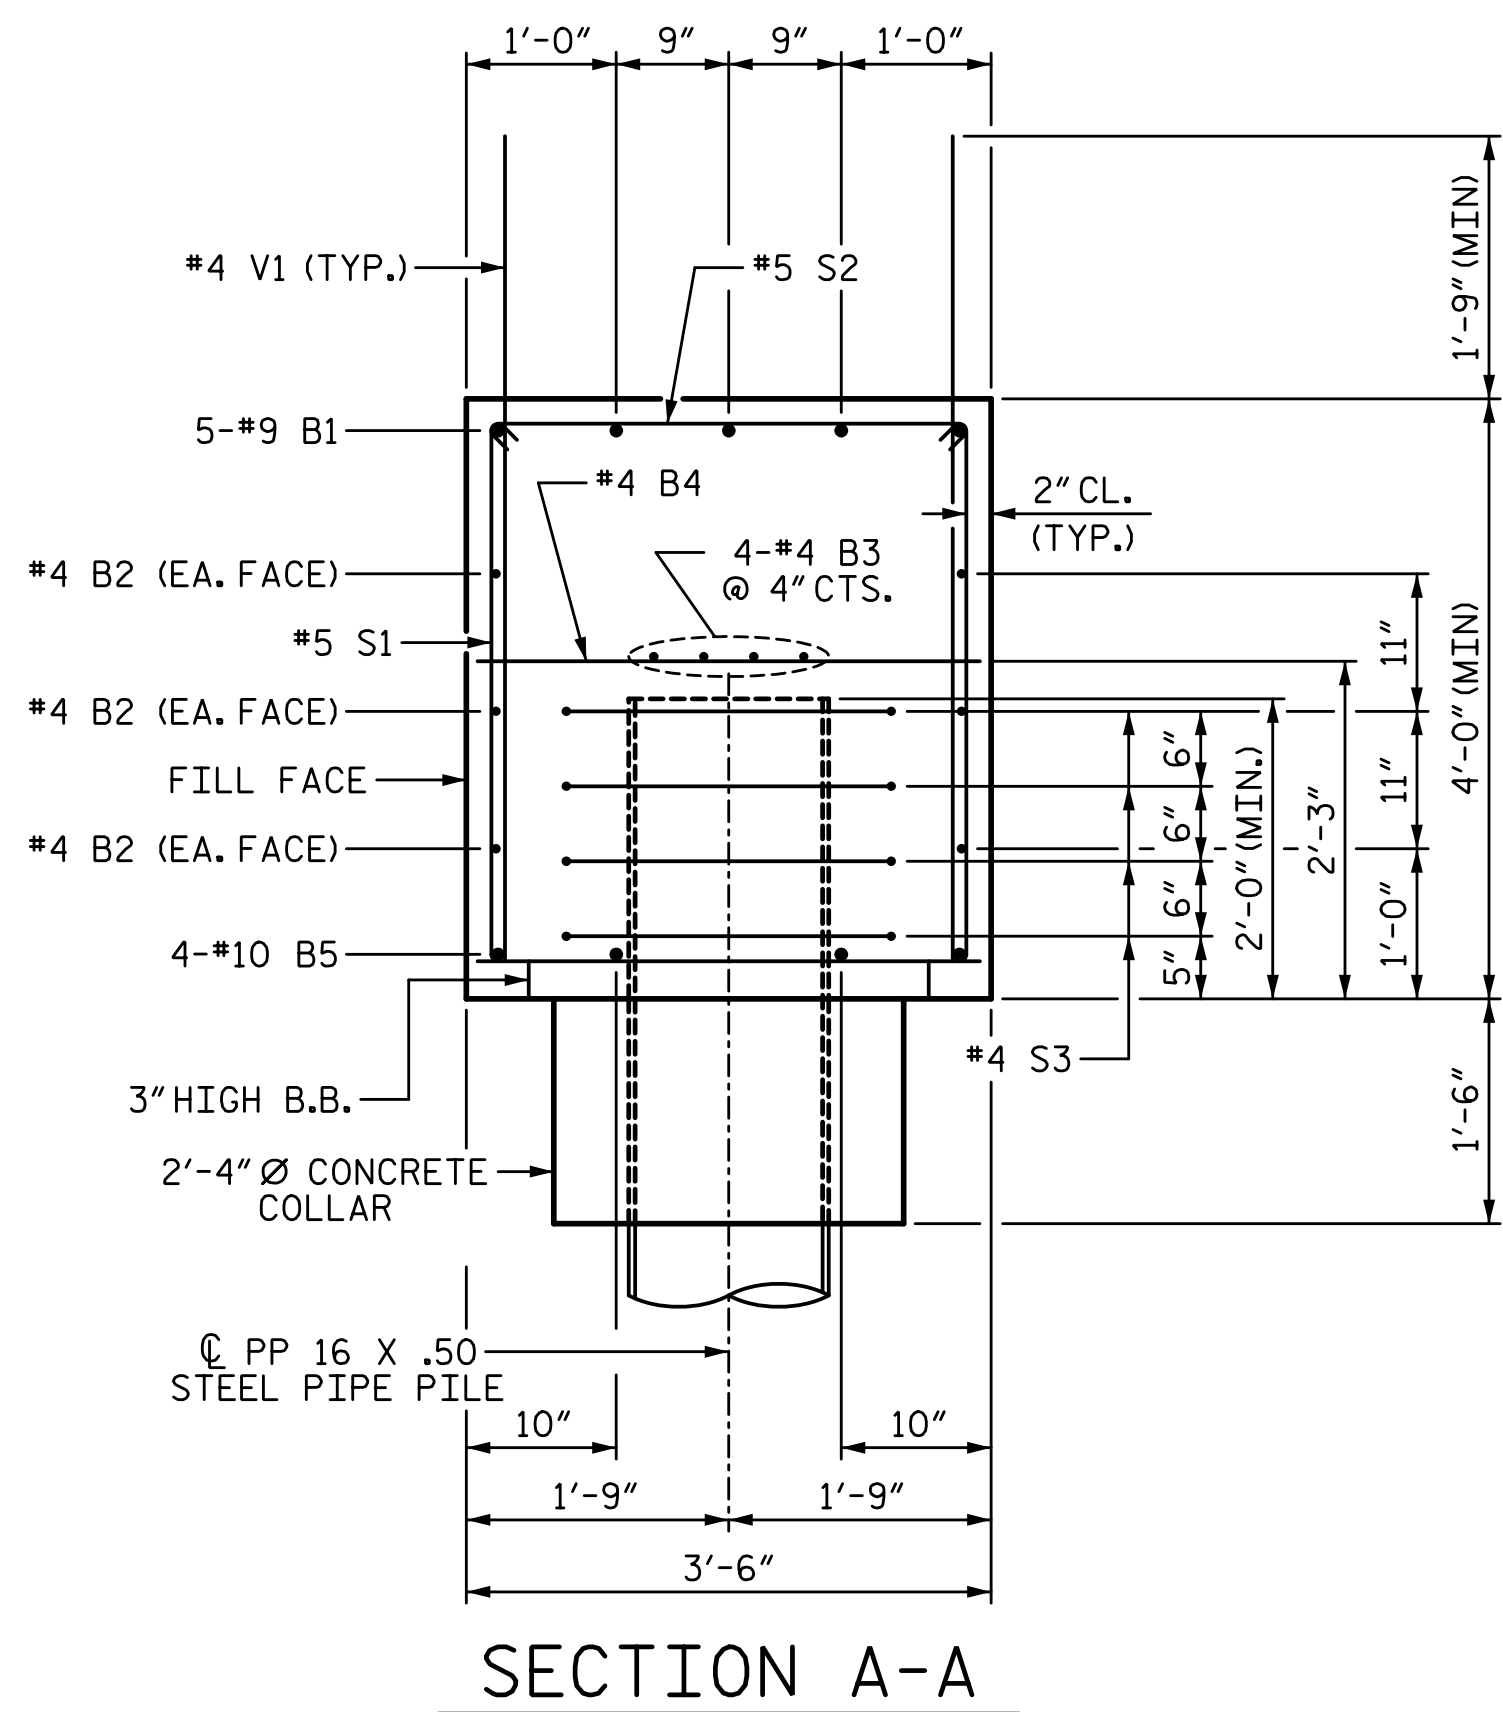

BAR TYPES

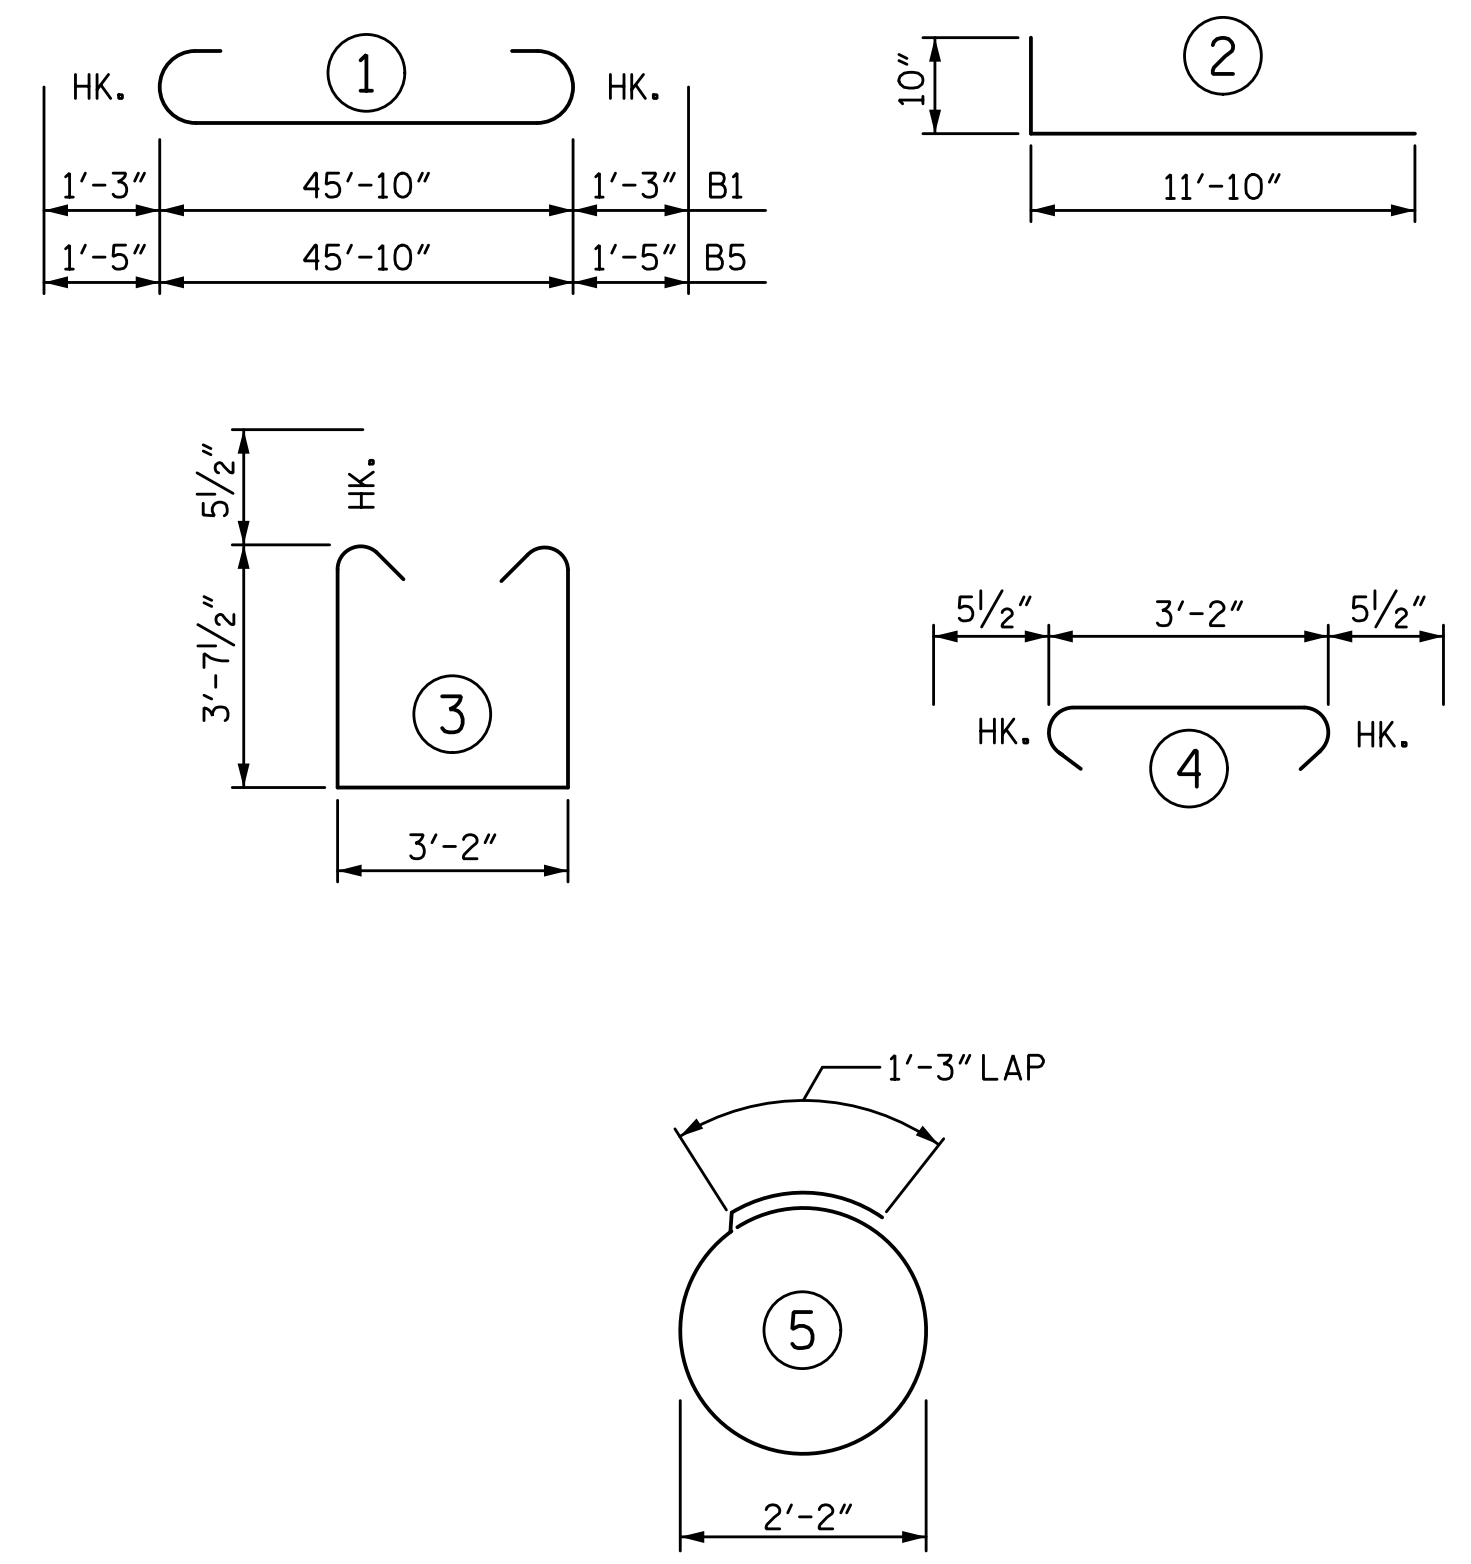

ALL BAR DIMENSIONS ARE OUT TO OUT

BILL OF MATERIAL


END BENT 2					
BAR	NO.	SIZE	TYPE	LENGTH	WEIGHT
B1	5	#9		48'-4"	822
B2	12	#4	STR	24'-4"	195
B3	8	#4	STR	24'-4"	130
B4	12	#4	STR	3'-2"	25
B5	4	#10		48'-8"	838
H1	80	#5		12'-8"	1057
K1	48	#4	STR	3'-8"	118
S1	60	#5		11'-4"	709
S2	60	#5		4'-1"	256
S3	32	#4		8'-1"	173
V1	68	#4	STR	5'-9"	261
V2	72	#4	STR	9'-8"	465
TOTAL REINFORCING STEEL					5049 LB
CLASS AA CONCRETE					
POUR 1 (CAP, COLLARS, & LOWER WINGS) 30.2 CY					
POUR 2 (UPPER WINGS) 6.5 CY					
TOTAL CLASS AA CONCRETE					36.7 CY
PILE DRIVING EQUIPMENT SETUP FOR PP 16 X 0.50 GALVANIZED STEEL PILES 8 EA					
PP 16 X 0.50 GALVANIZED STEEL PILES NO. 8 440 LF					
PIPE PILE PLATES 8 EA					
PILE REDRIVES 4 EA					

PROJECT NO. B-5652
ONLOW COUNTY
 STATION: 20+64.00 -L-RT-

SHEET 3 OF 3

STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH

END BENT 2

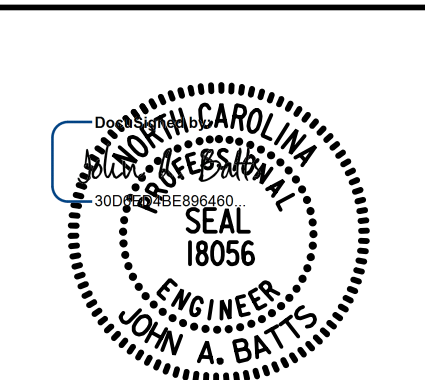

9/14/2022 5:22 AM


DRAWN BY: S.D. COOPER DATE: 5-22
 CHECKED BY: J.A. BATTS DATE: 5-22
 DESIGN ENGINEER OF RECORD: J.A. BATTS DATE: 5-22

LICENSURE NO. C-4434


DOCUMENT NOT CONSIDERED FINAL
 UNLESS ALL SIGNATURES COMPLETED

REVISIONS						SHEET NO.
NO.	BY:	DATE:	NO.	BY:	DATE:	S-22
1			3			TOTAL SHEETS
2			4			26


9/14/2022 8:06:06 AM P:\Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401_B5652_SMU_E1_660033.dgn

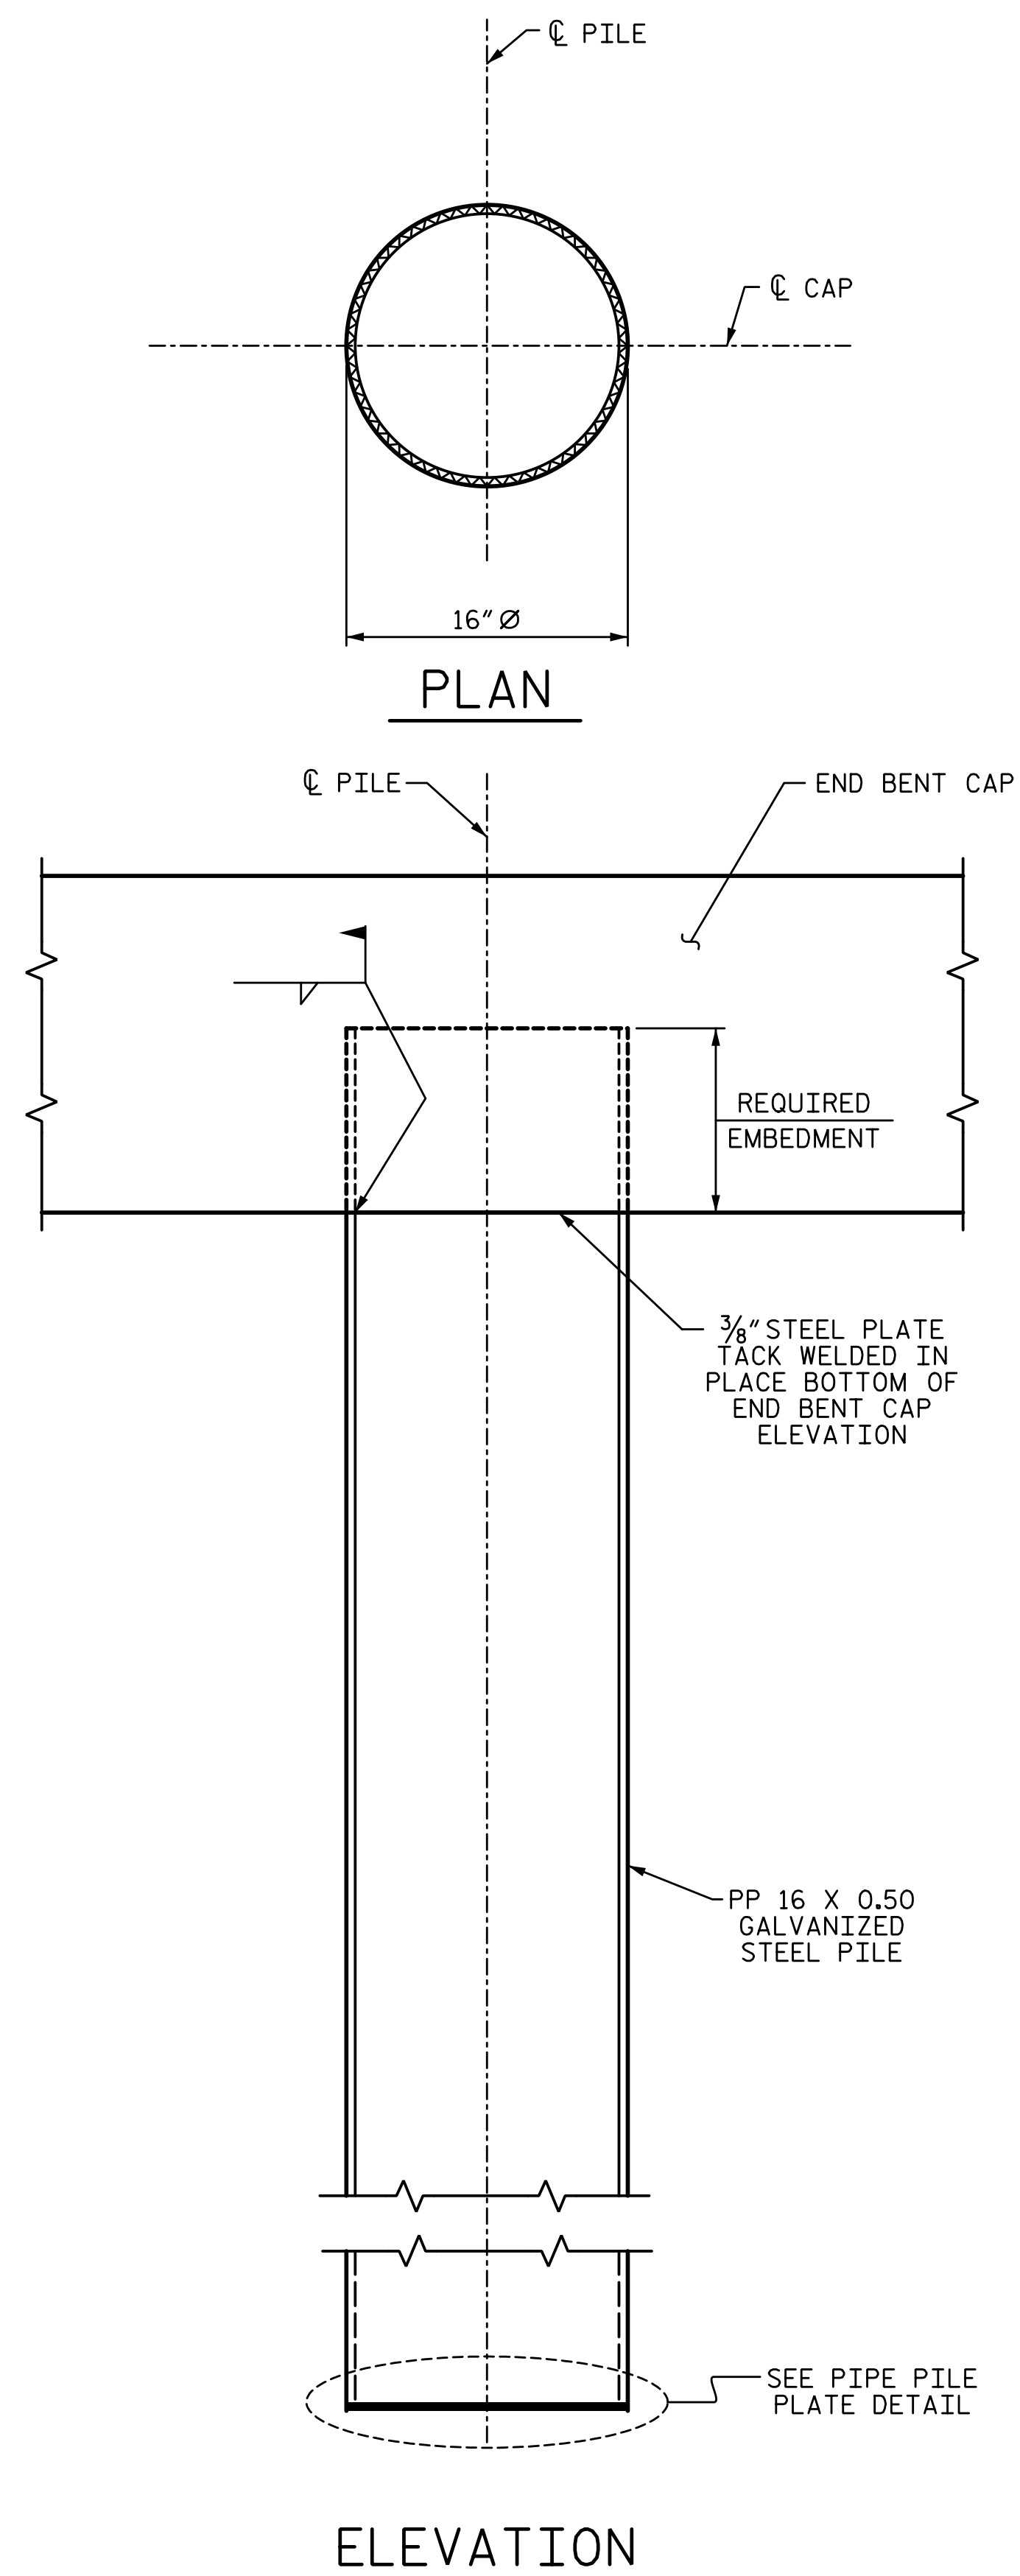

PP 16 X 0.50 GALVANIZED STEEL PILE
(CLOSED END)

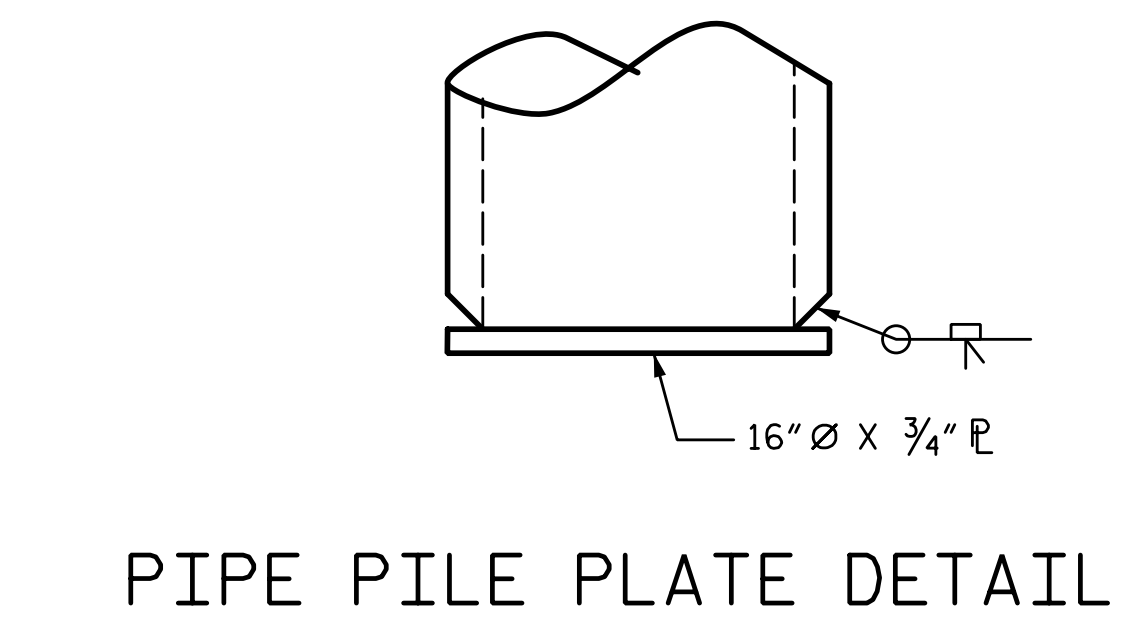

PIPE PILE PLATE DETAIL

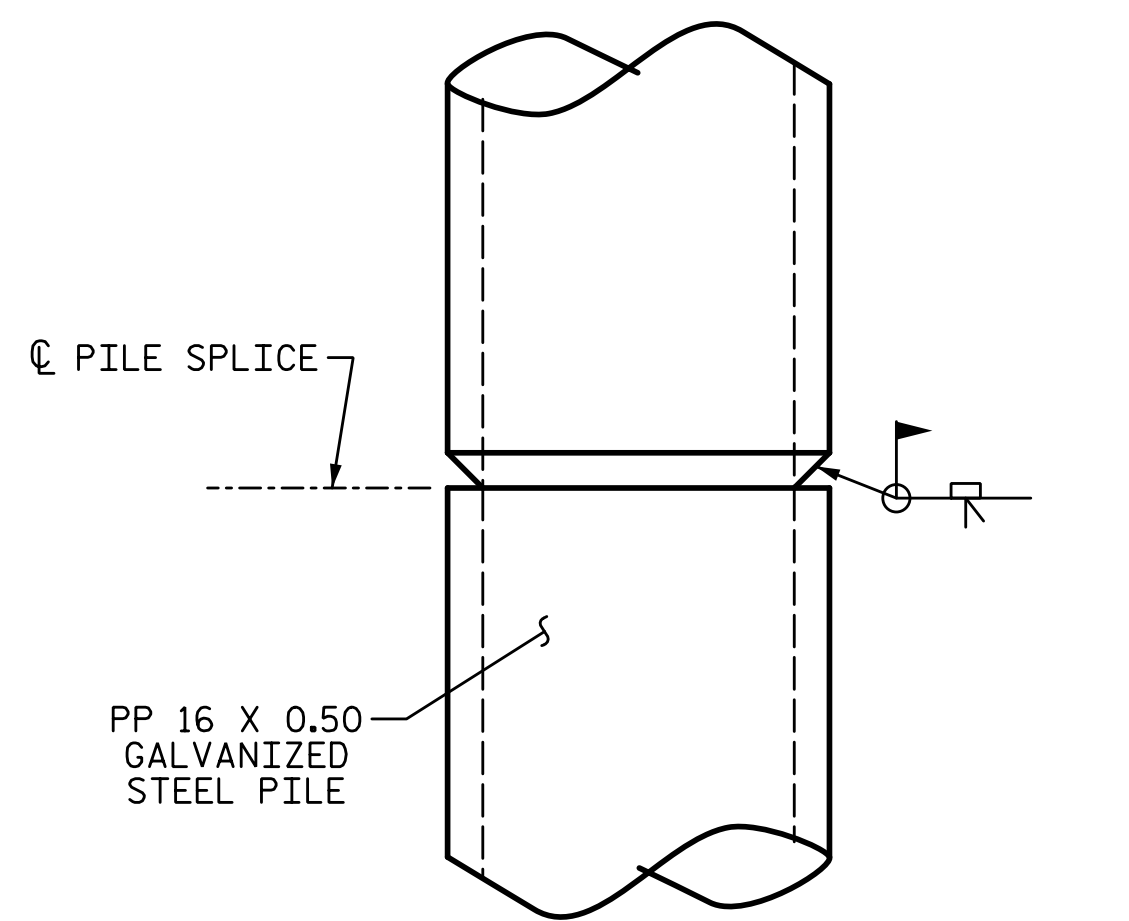

PIPE PILE SPLICE DETAIL


NOTES:

- PIPE PILES SHALL BE IN ACCORDANCE WITH SECTION 1084 OF THE STANDARD SPECIFICATIONS.
- GALVANIZE THE FULL LENGTH OF EACH END BENT PILE IN ACCORDANCE WITH SECTION 1076 OF THE STANDARD SPECIFICATIONS.
- GALVANIZE STEEL PIPE PILES IN ACCORDANCE WITH SECTION 1076 OF THE STANDARD SPECIFICATIONS UNLESS METALLIZING IS REQUIRED. GALVANIZING OR METALLIZING PIPE PILE PLATES IS NOT REQUIRED.
- PIPE PILE PLATES SHALL BE IN ACCORDANCE WITH SECTION 450 OF THE STANDARD SPECIFICATIONS.
- REMOVE AND REPLACE OR REPAIR TO THE SATISFACTION OF THE ENGINEER PILES THAT ARE DAMAGED, DEFORMED OR COLLAPSED DURING INSTALLATION OR DRIVING.
- PILE SPLICES SHALL BE IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS AND AWS D1.1.
- THE GALVANIZING IS CONSIDERED INCIDENTAL TO THE CONTRACT UNIT PRICE BID PER LINEAR FOOT FOR PP 16 X 0.50 GALVANIZED STEEL PILES.
- THE CONTRACTOR MAY PROPOSE AN ALTERNATE METHOD FOR PLUGGING THE STEEL PIPE PILE, SUBJECT TO APPROVAL BY THE ENGINEER.

PROJECT NO. B-5652
ONSLow COUNTY
 STATION: 20+64.00 -L-RT-

STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH
 SUBSTRUCTURE

16" STEEL PIPE PILE

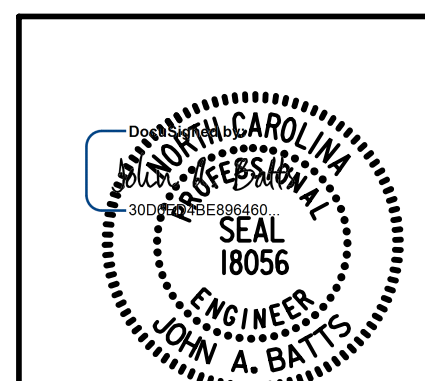


DRAWN BY: <u>S.D. COOPER</u>	DATE: <u>5-22</u>
CHECKED BY: <u>J.A. BATTS</u>	DATE: <u>5-22</u>
DESIGN ENGINEER OF RECORD: <u>J.A. BATTS</u>	DATE: <u>5-22</u>

REVISIONS						SHEET NO. S-23
NO.	BY:	DATE:	NO.	BY:	DATE:	
1			3			TOTAL SHEETS 26
2			4			


**DOCUMENT NOT CONSIDERED FINAL
 UNLESS ALL SIGNATURES COMPLETED**

9/14/2022 8:06:07 AM P:\Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401_B5652_SMU_RR_660033.dgn

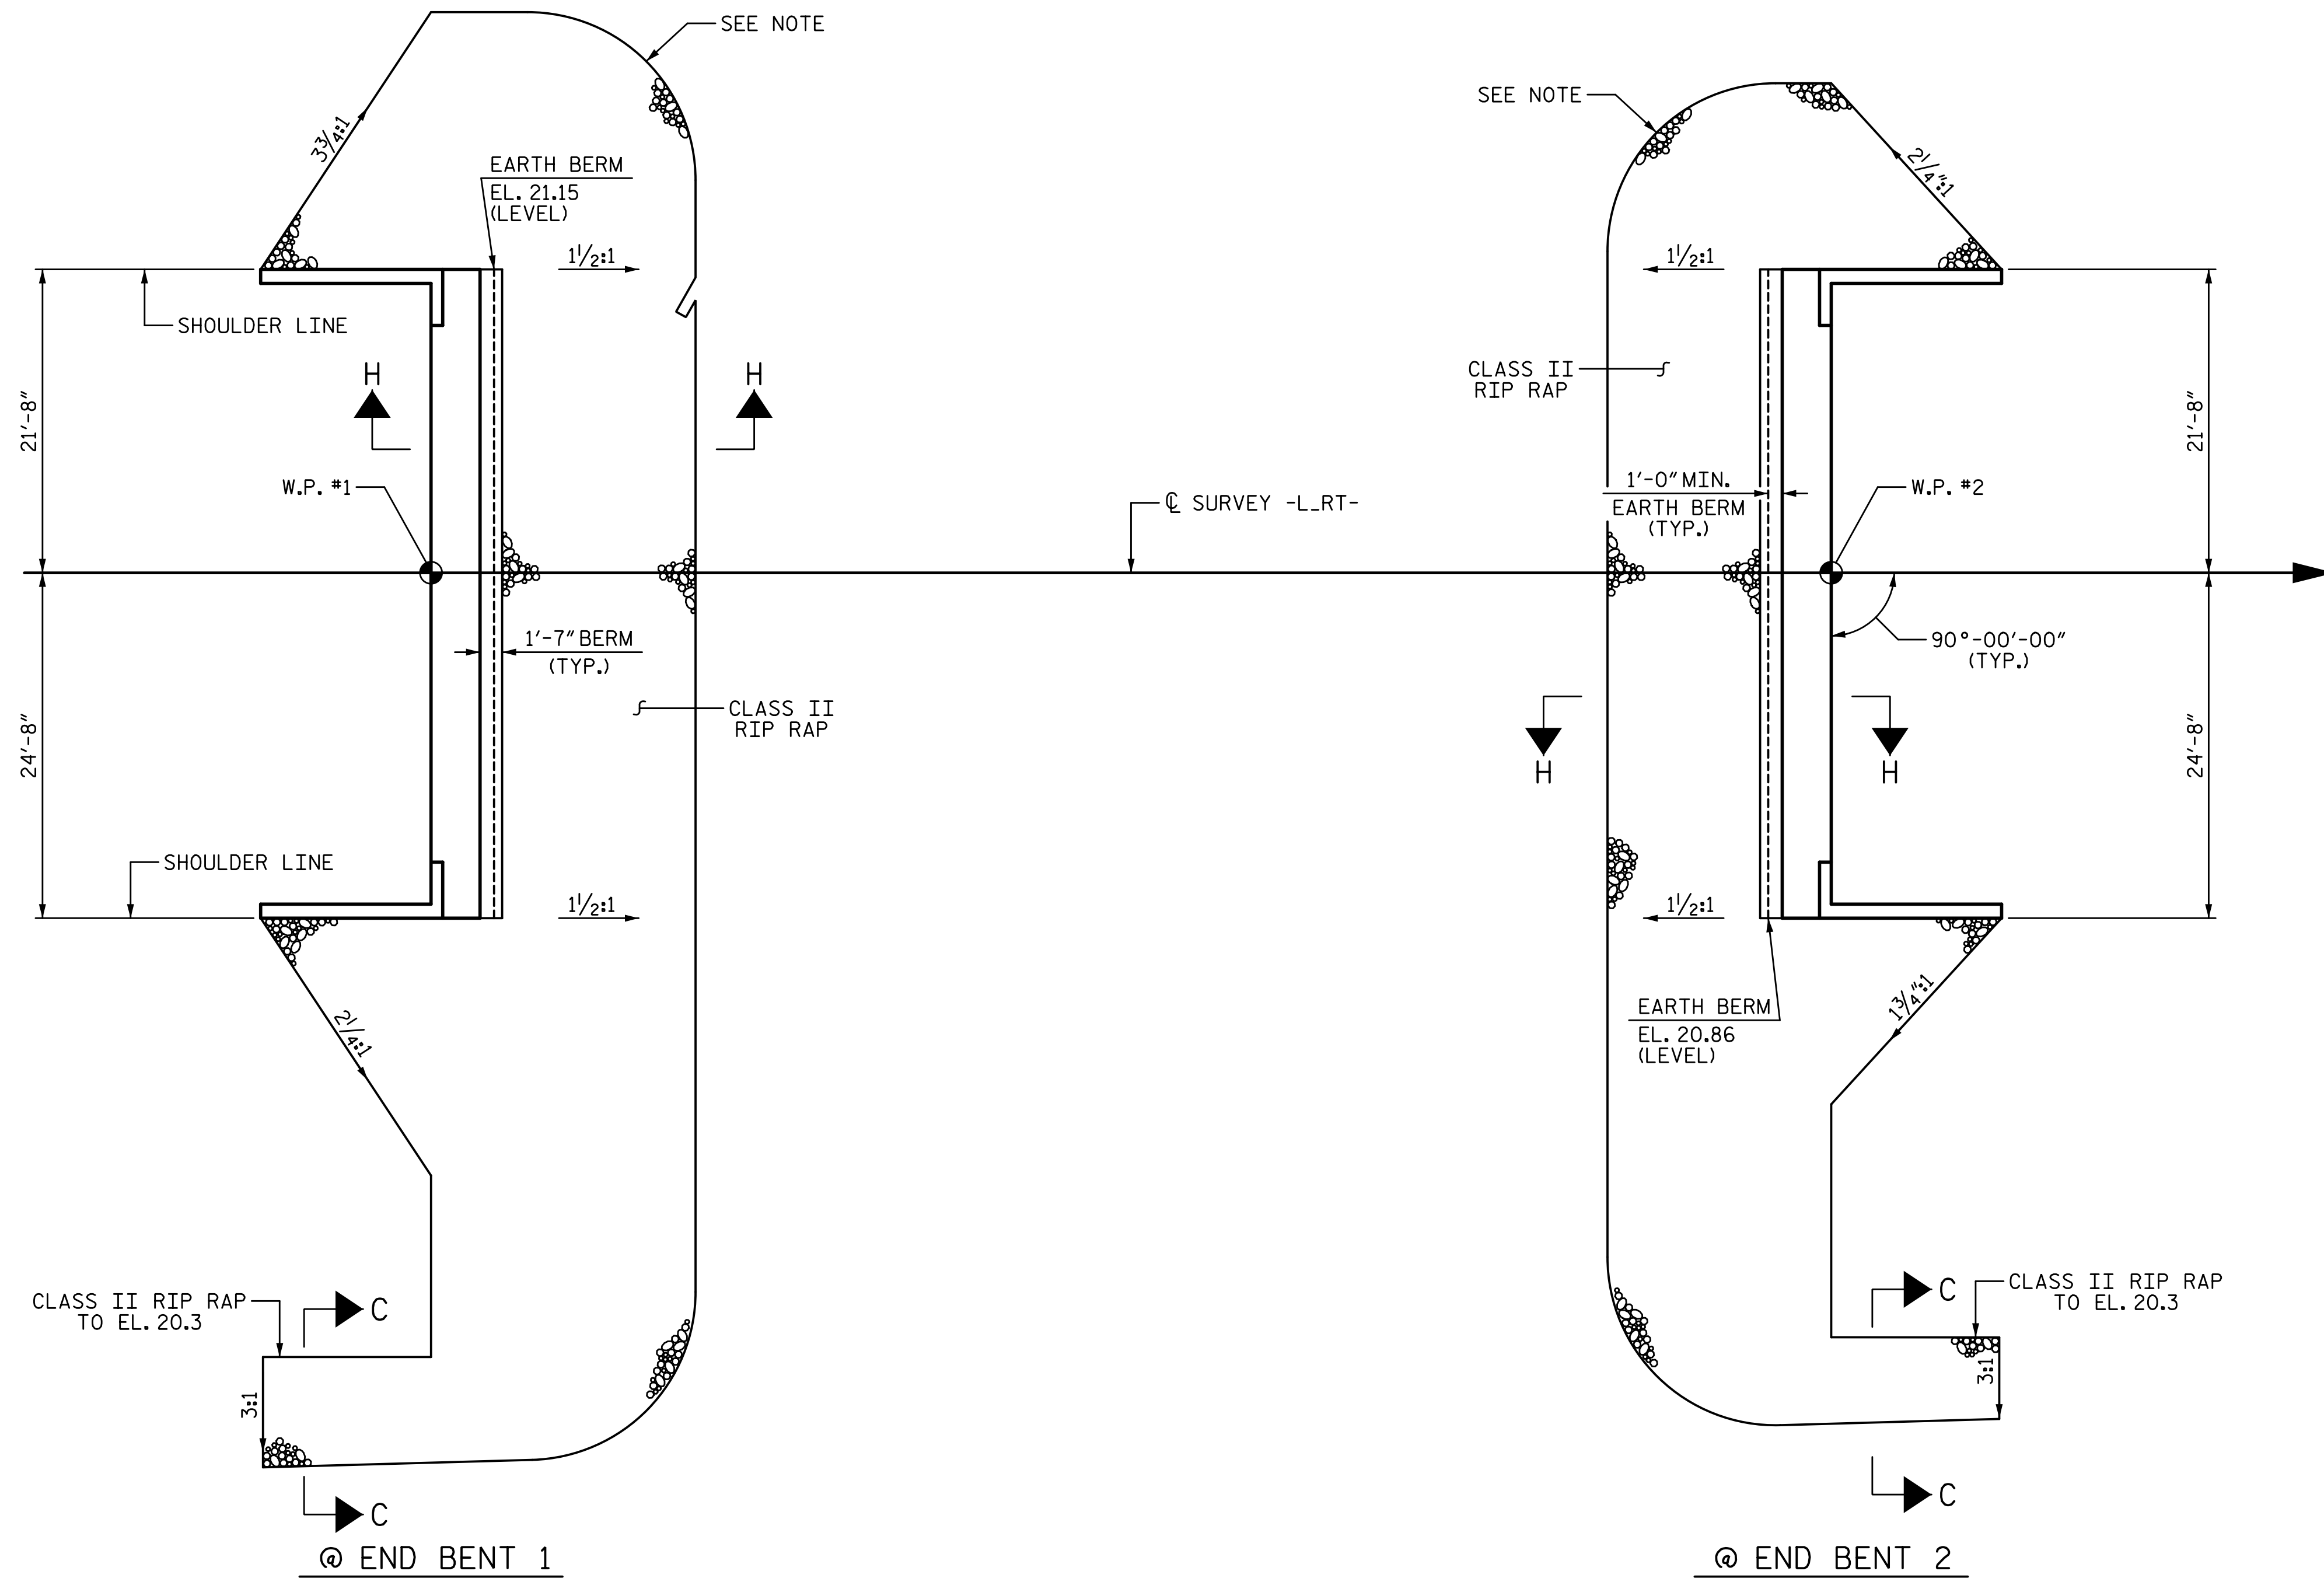


PLAN OF RIP RAP

NOTES:
 LEFT SHOULDER RIP RAP THAT IS IN CONTACT WITH THE EXISTING MEDIAN SLOPE SHALL NOT BE KEYED IN TO THE MEDIAN SLOPE.
 FINAL RIP RAP PLACEMENT IS SHOWN. FINAL RIP RAP IN THE VICINITY OF THE DETOUR BRIDGE SHALL BE PLACED AFTER REMOVAL OF THE DETOUR BRIDGE AND DETOUR BRIDGE APPROACH FILLS AS DIRECTED BY THE ENGINEER. REFER TO ROADWAY CROSS-SECTIONS FOR LIMITS OF DETOUR FILL REMOVAL.

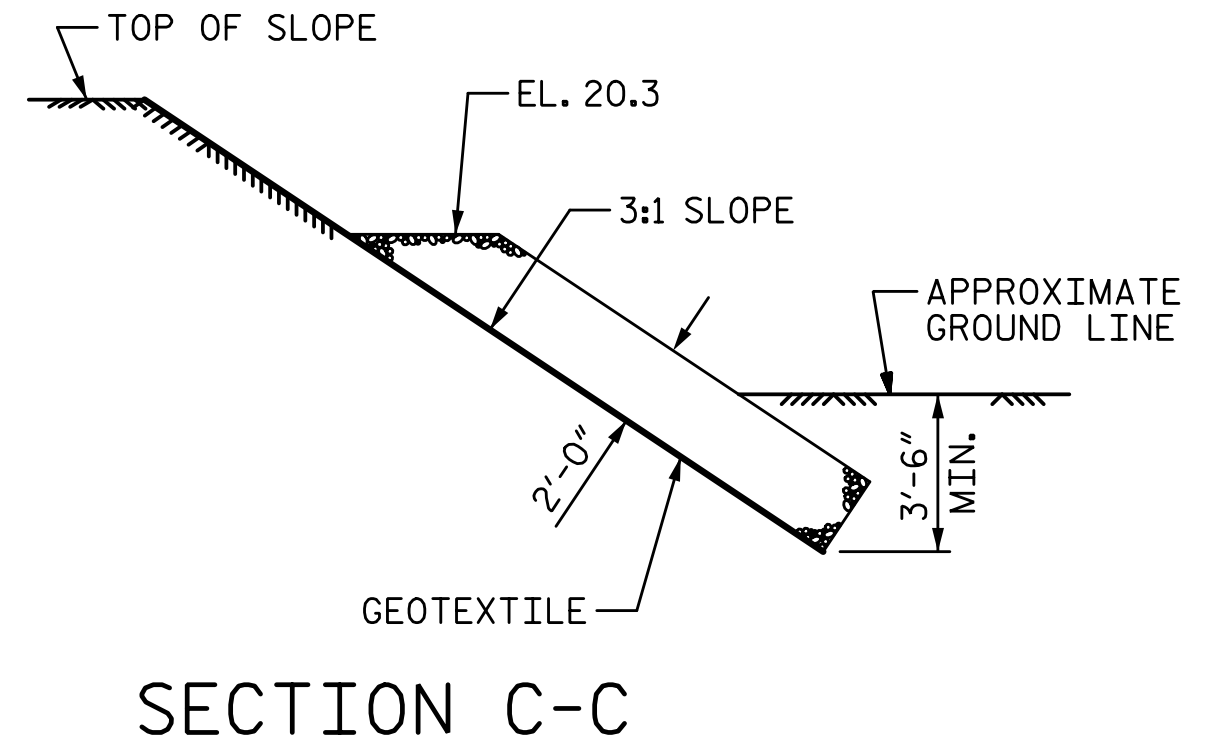


SECTION C-C

ESTIMATED QUANTITIES		
BRIDGE @ STA. 20+64.00 -L-RT-	RIP RAP CLASS II (2'-0" THICK)	GEOTEXTILE FOR DRAINAGE
	TONS	SQUARE YARDS
END BENT 1	210	235
END BENT 2	155	175

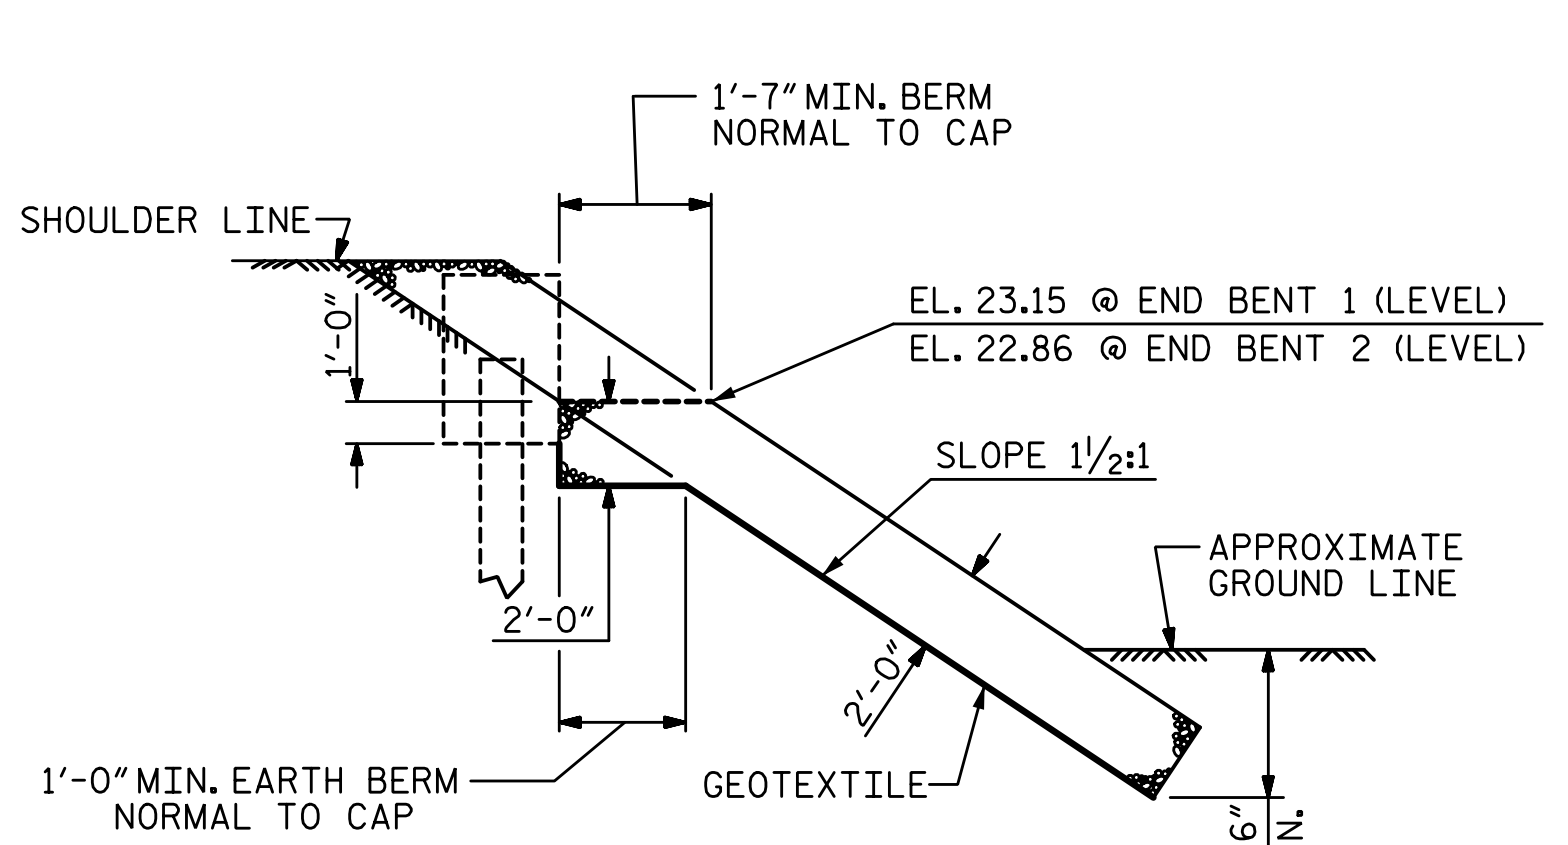

SECTION H-H

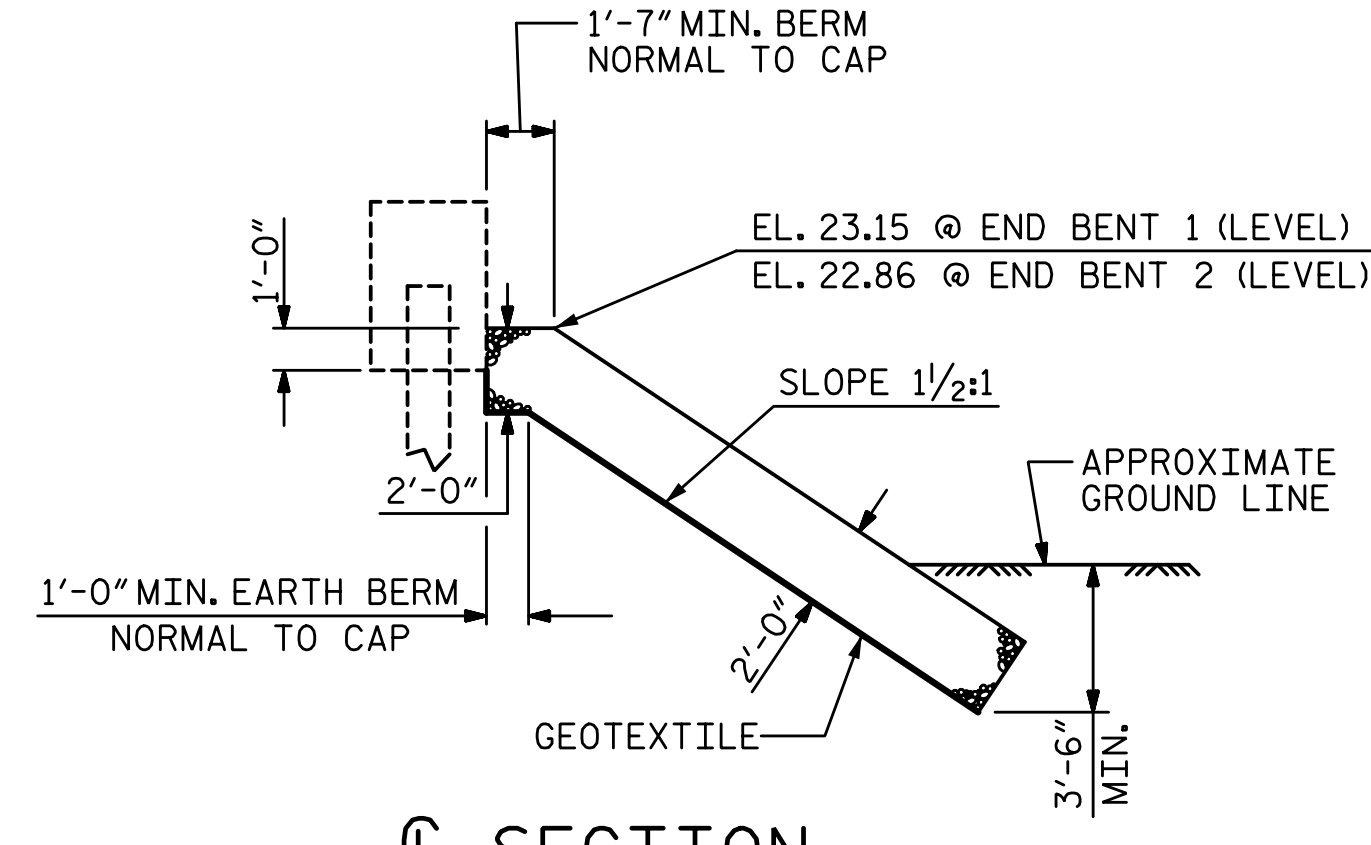


SECTION BERM RIP RAPPED

PROJECT NO. B-5652
ONLOW COUNTY
 STATION: 20+64.00 -L-RT-

STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH

RIP RAP DETAILS


DRAWN BY: T. BANKOVICH DATE: 5-22
 CHECKED BY: J.A. BATTS DATE: 5-22
 DESIGN ENGINEER OF RECORD: J.A. BATTS DATE: 5-22

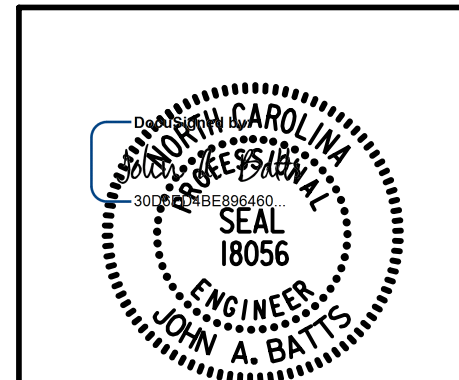

REVISIONS						SHEET NO. S-24
NO.	BY:	DATE:	NO.	BY:	DATE:	
1			3			TOTAL SHEETS 26
2			4			

DOCUMENT NOT CONSIDERED FINAL
 UNLESS ALL SIGNATURES COMPLETED

9/14/2022 8:06:08 AM P:\Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401_B5652_SMU_AS_660033.dgn

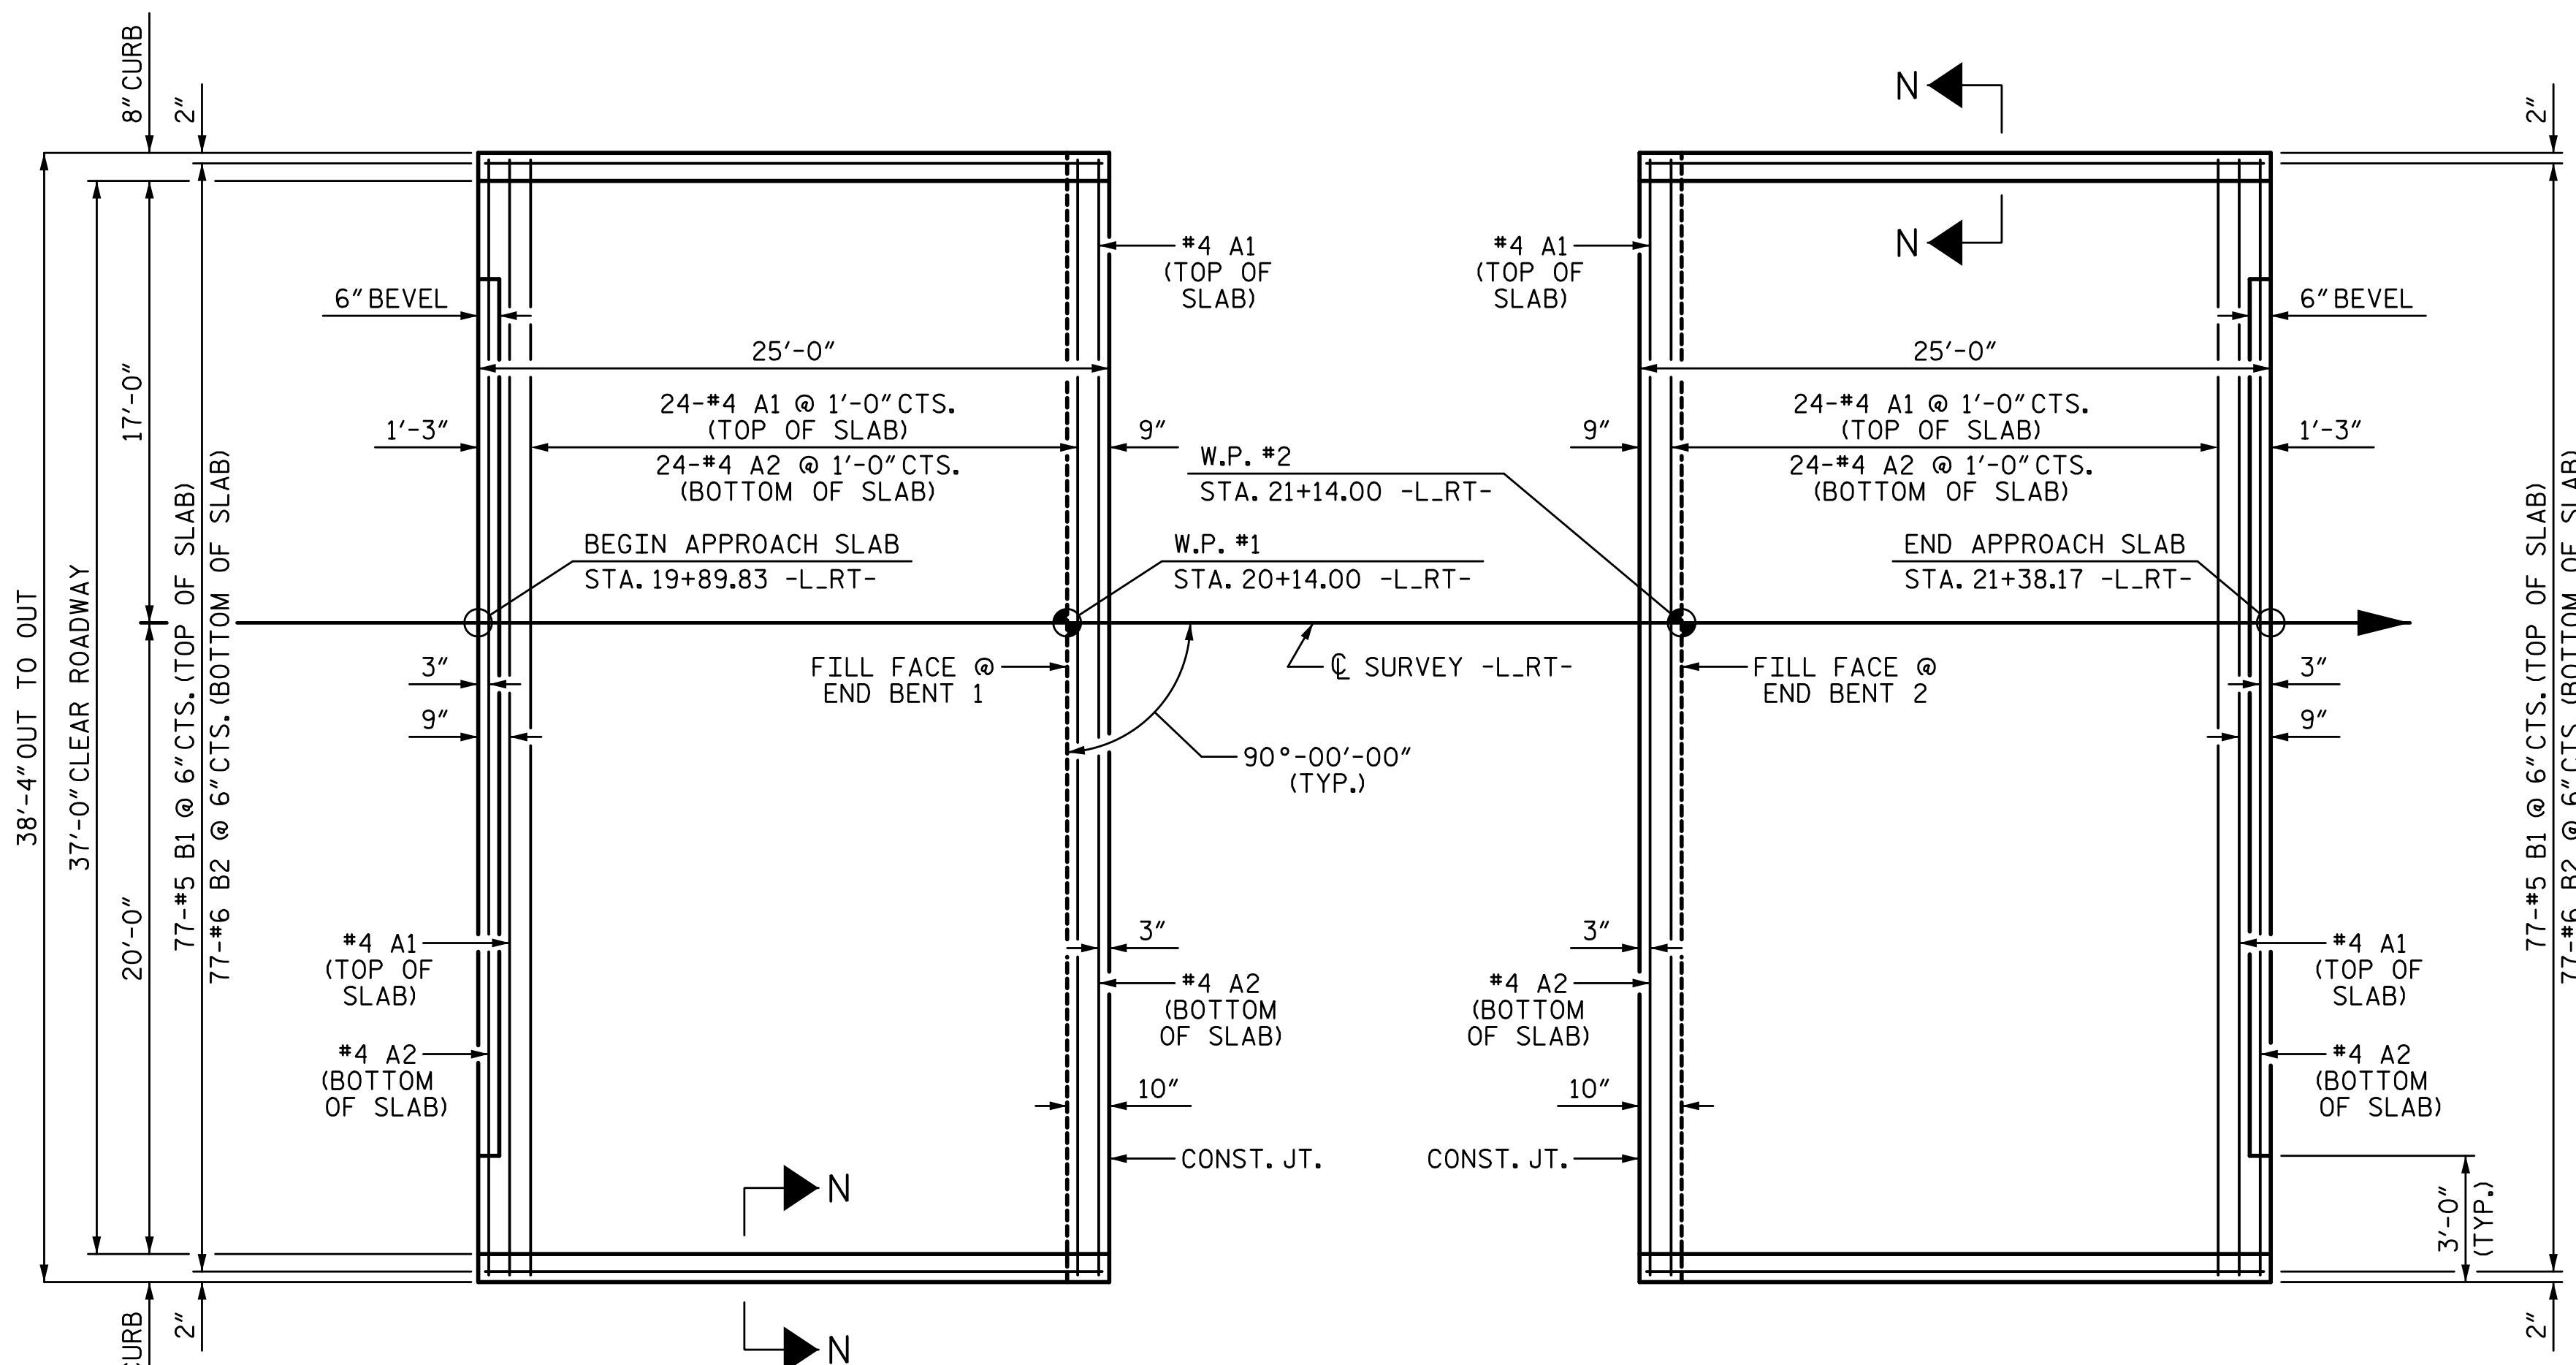

PLAN @ END BENT 1 **PLAN @ END BENT 2**
 DIMENSIONS SHOWN ARE TYPICAL FOR BOTH APPROACH SLABS

NOTES:

APPROACH SLAB SHALL NOT BE CONSTRUCTED PRIOR TO COMPLETION OF THE BRIDGE DECK.

FOR BRIDGE APPROACH FILL INCLUDING GEOTEXTILE, 6" Ø DRAINAGE PIPE, AND SELECT MATERIAL, SEE ROADWAY PLANS.

GEOTEXTILE SHALL BE TYPE 1 IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS SECTION 1056.

SELECT MATERIAL BACKFILL (CLASS V OR CLASS VI) SHALL BE IN ACCORDANCE WITH STANDARD SPECIFICATIONS SECTION 1016.

SELECT MATERIAL BACKFILL IS TO BE CONTINUOUS ALONG FILL FACE OF BACKWALL FROM OUTSIDE EDGE TO OUTSIDE EDGE OF APPROACH SLAB.


FOR THE 6" Ø DRAINAGE PIPE OUTLET(S), SEE ROADWAY STANDARD DRAWINGS.

AREA BETWEEN THE WINGWALL AND APPROACH SLAB SHALL BE GRADED TO DRAIN THE WATER AWAY FROM THE FILL FACE OF THE BRIDGE AND SHALL BE PAVED. SEE ROADWAY PLANS.


THE JOINT OPENING AT THE APPROACH SLAB/DECK INTERFACE SHALL BE SAWED NO MORE THAN 12 HOURS AFTER THE APPROACH SLAB IS CAST. THE JOINT SHALL BE CLEANED OF ALL DEBRIS BEFORE THE SEALANT IS APPLIED. THE JOINT SEALER MATERIAL SHALL CONFORM TO THE REQUIREMENTS OF SECTION 1028-3 OF THE STANDARD SPECIFICATIONS.

AT THE CONTRACTORS OPTION, "TYPE A - ALTERNATE APPROACH FILL" IN LIEU OF "TYPE I - STANDARD APPROACH FILL" MAY BE CONSTRUCTED AT NO ADDITIONAL COST TO THE DEPARTMENT. SEE SHEET 2 OF 2 FOR DETAILS AND NOTES.


BILL OF MATERIAL					
FOR ONE APPROACH SLAB (2 REQUIRED)					
BAR	NO.	SIZE	TYPE	LENGTH	WEIGHT
*A1	26	#4	STR	38'-0"	660
A2	26	#4	STR	38'-0"	660
*B1	77	#5	STR	24'-4"	1954
B2	77	#6	STR	24'-8"	2853
REINFORCING STEEL					3513 LB
*EPOXY COATED REINFORCING STEEL					2614 LB
CLASS AA CONCRETE					41.5 CY

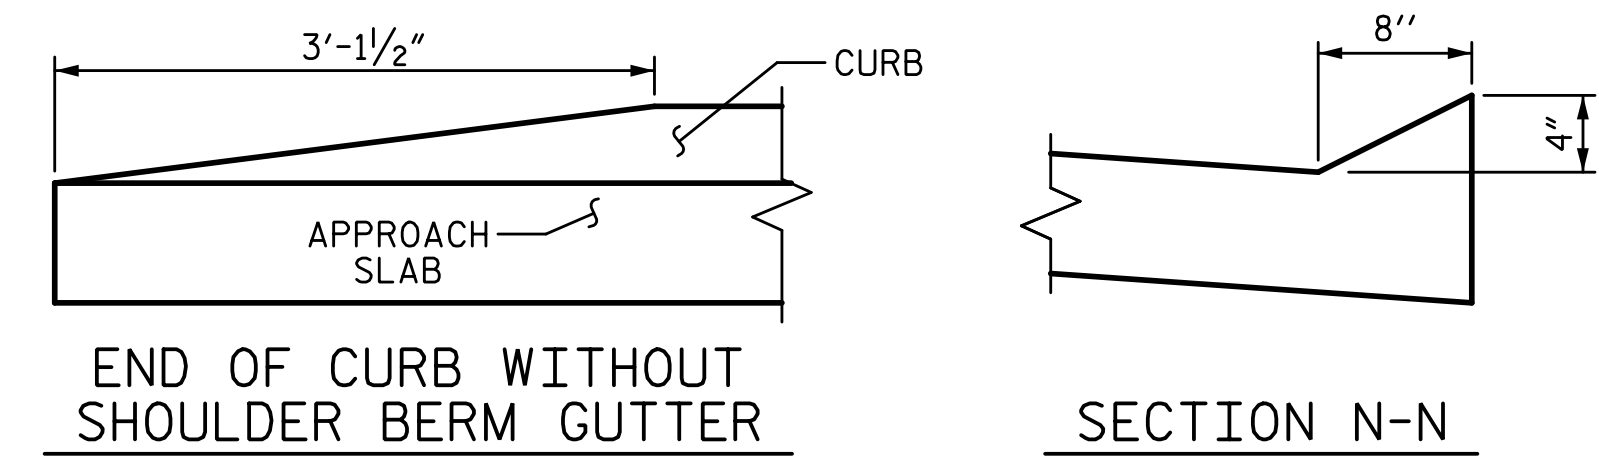

CURB DETAILS

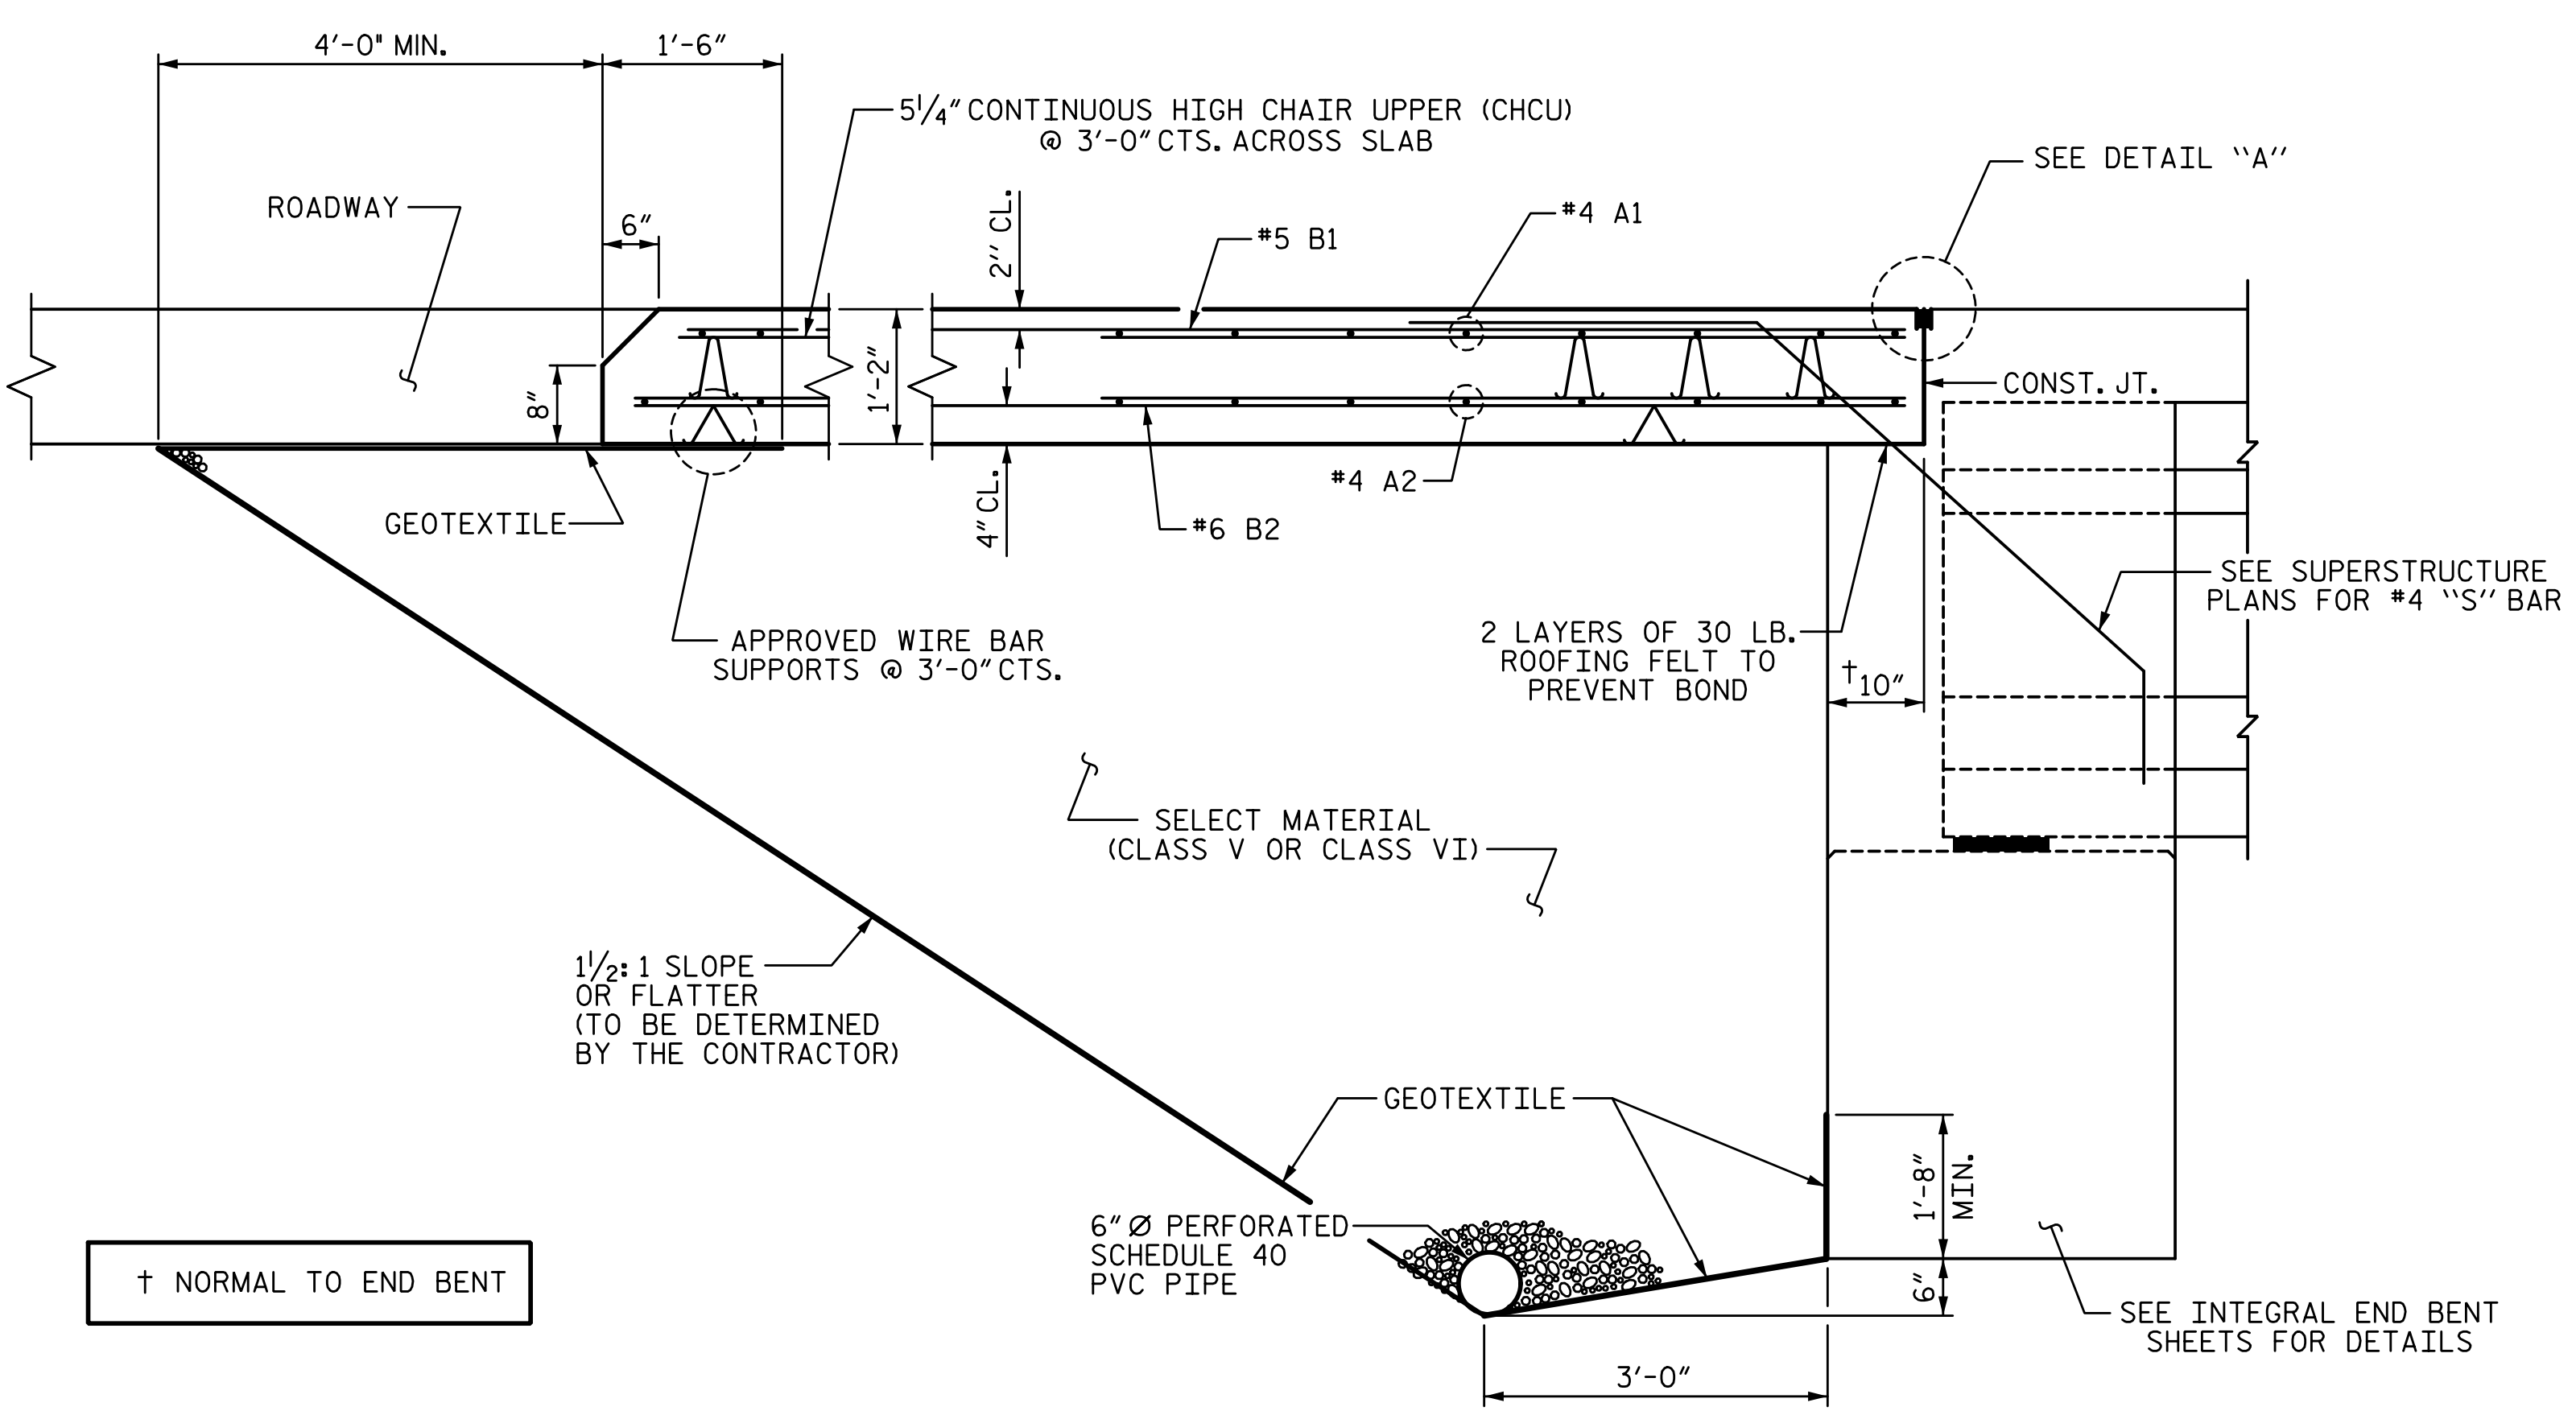

SECTION THRU SLAB
 (TYPE I - STANDARD APPROACH FILL)

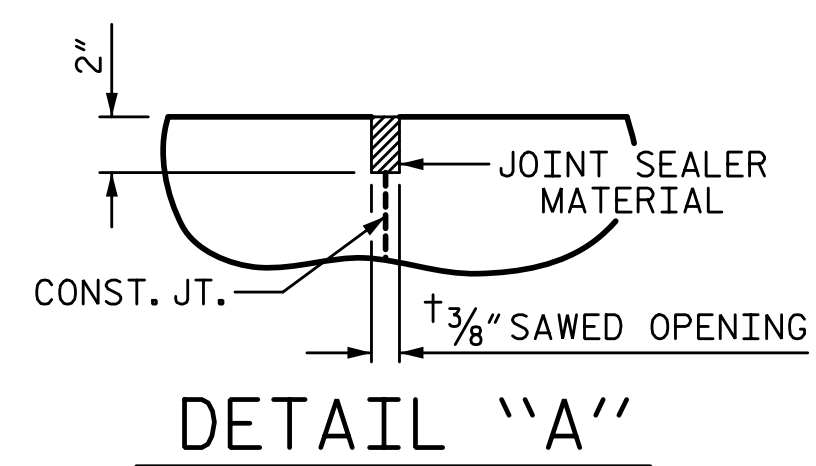


DETAIL "A"

PROJECT NO. B-5652
ONLOW COUNTY
 STATION: 20+64.00 -L-RT-

SHEET 1 OF 2

STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH
BRIDGE APPROACH SLAB FOR INTEGRAL ABUTMENT WITH FLEXIBLE PAVEMENT

DRAWN BY: T. BANKOVICH DATE: 5-22
 CHECKED BY: J.A. BATTS DATE: 5-22
 DESIGN ENGINEER OF RECORD: J.A. BATTS DATE: 5-22

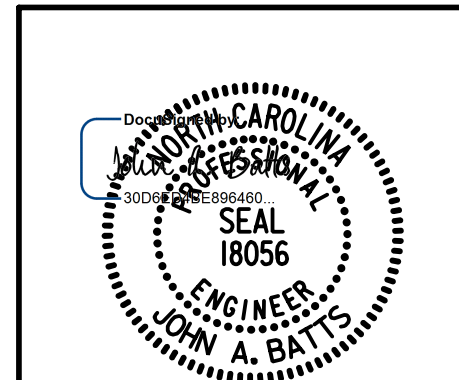


9/14/2022 5:22 AM
DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED


REVISIONS				SHEET NO.	
NO.	BY:	DATE:	NO.	BY:	DATE:
1			3		
2			4		

TOTAL SHEETS: 26

9/14/2022 8:06:08 AM P:\Raleigh\Projects\2018\Division 3 (SEA)\B-5652 (Onslow 33 US17 NBL over Wolf Swamp)\Structures\Drawings\Final\401_B5652_SMU_AS_660033.dgn

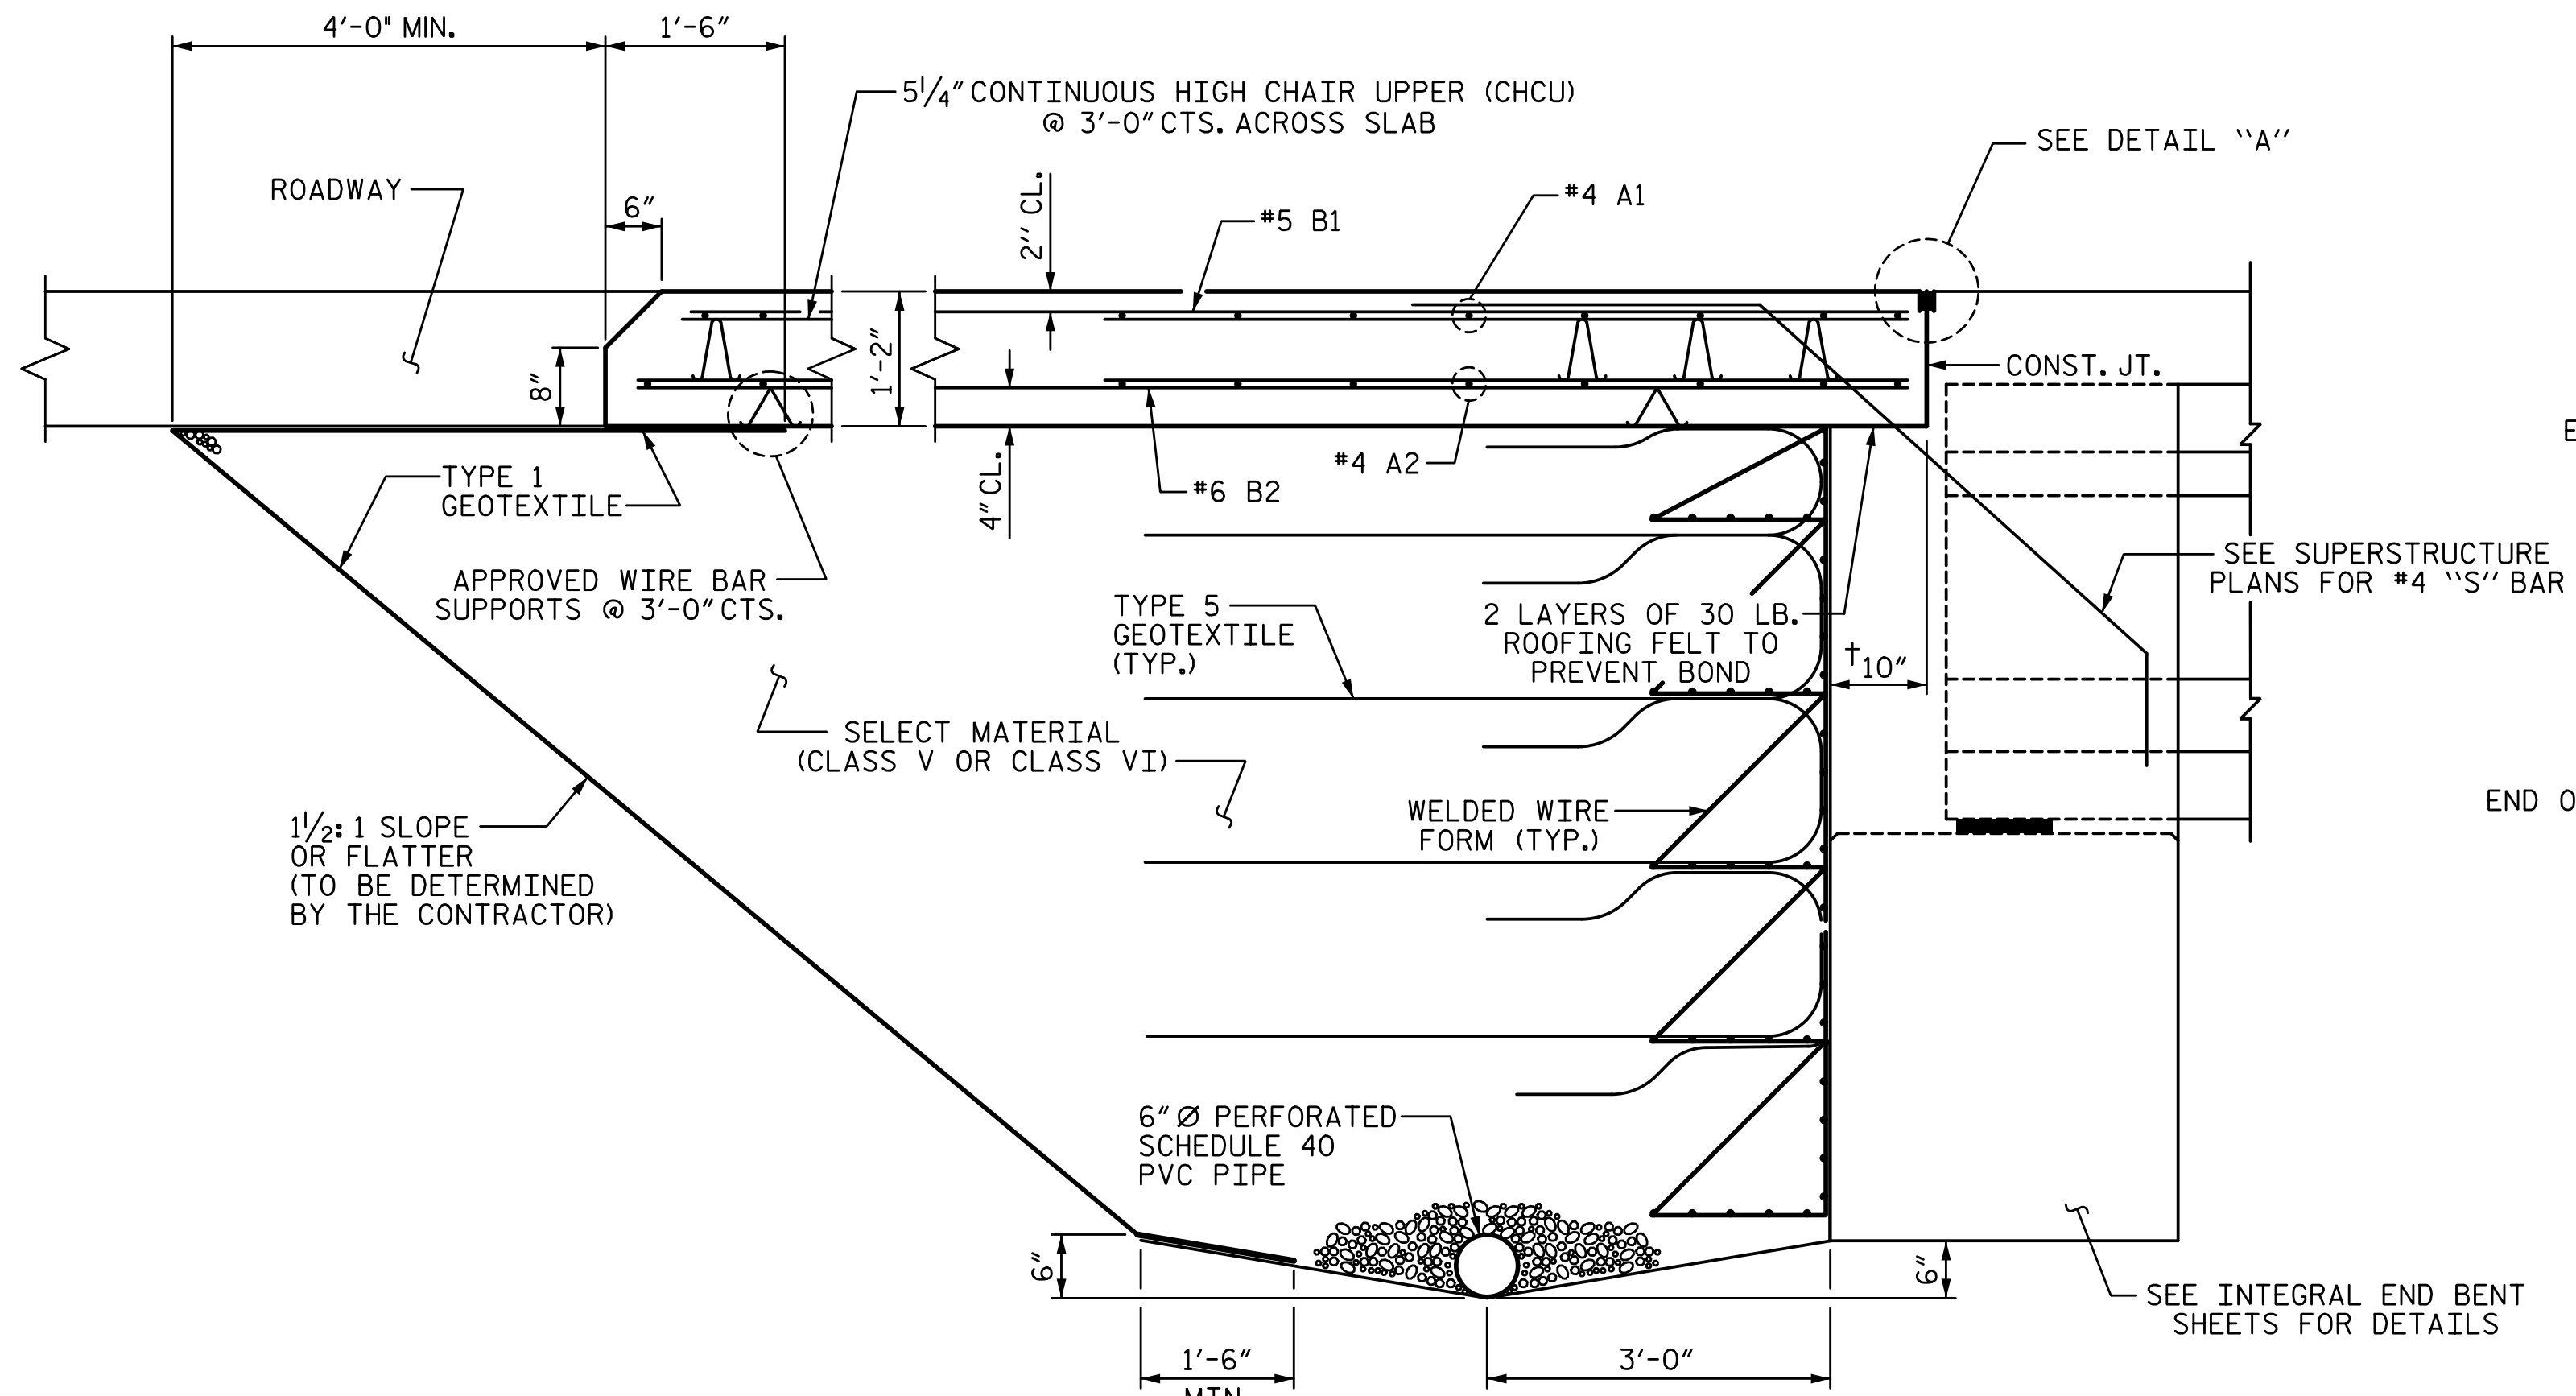


SECTION THRU SLAB
(TYPE A - ALTERNATE APPROACH FILL)

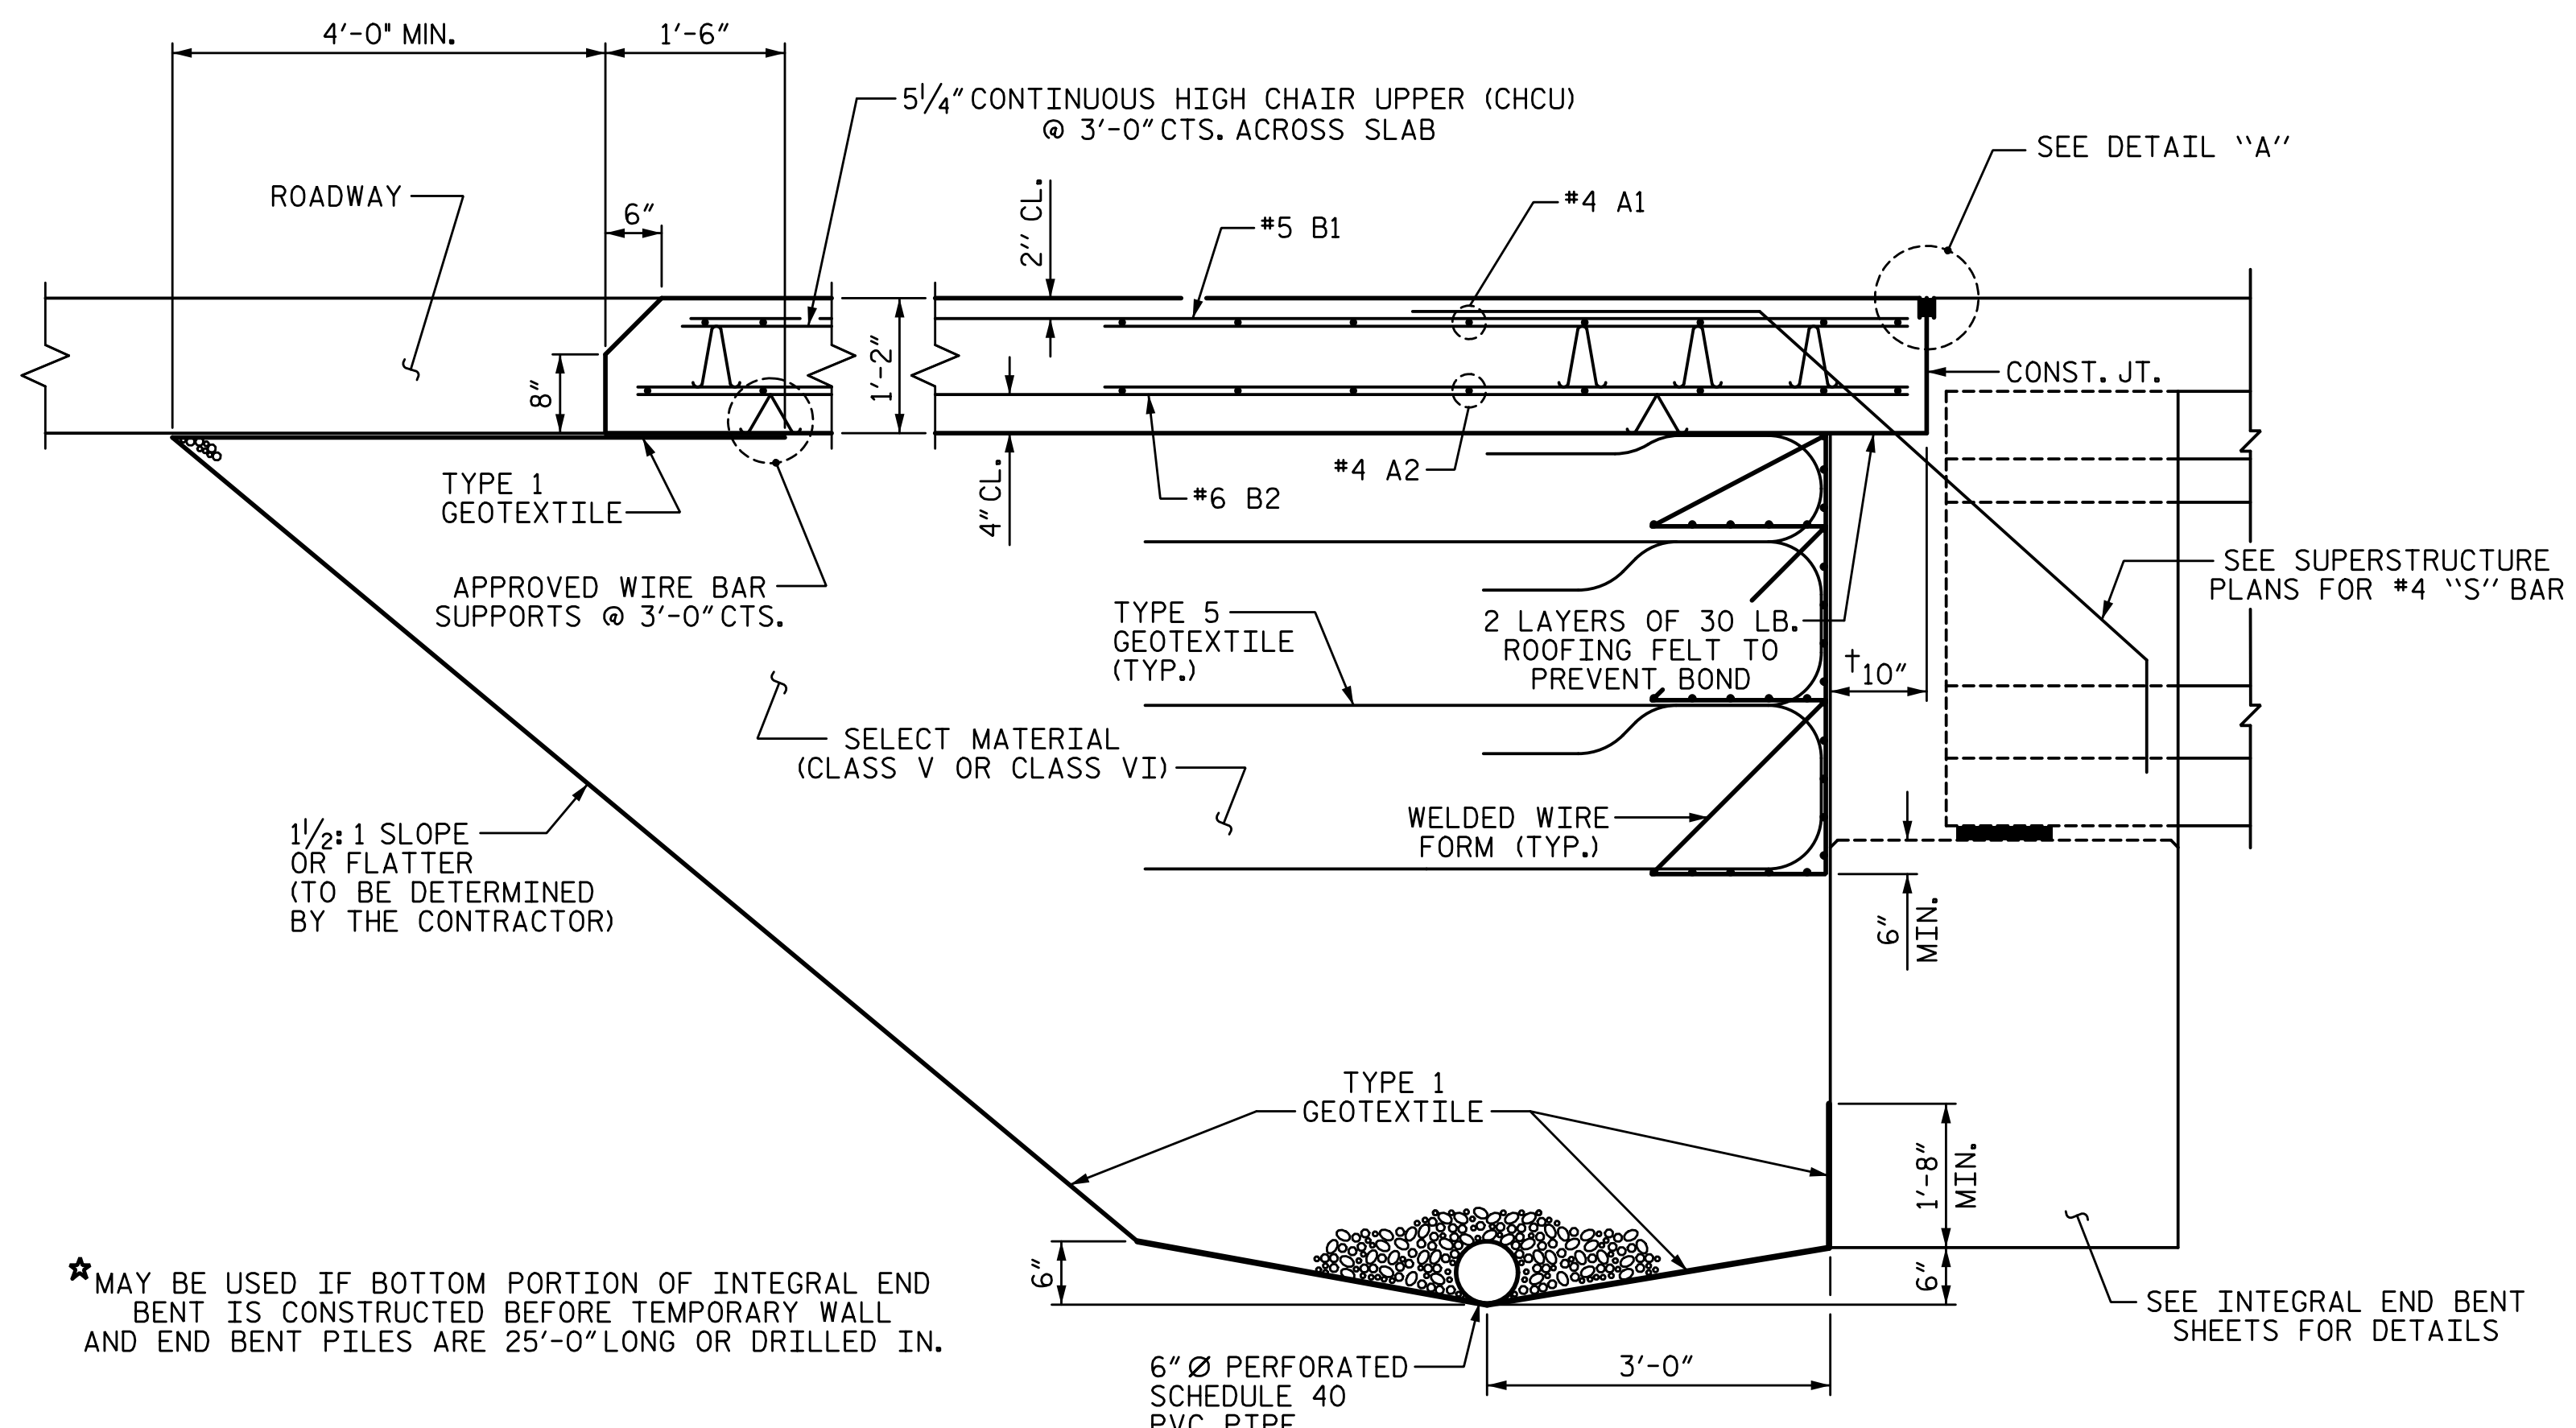

SECTION THRU SLAB
(TYPE A - ALTERNATE APPROACH FILL)

★ MAY BE USED IF BOTTOM PORTION OF INTEGRAL END BENT IS CONSTRUCTED BEFORE TEMPORARY WALL AND END BENT PILES ARE 25'-0" LONG OR DRILLED IN.

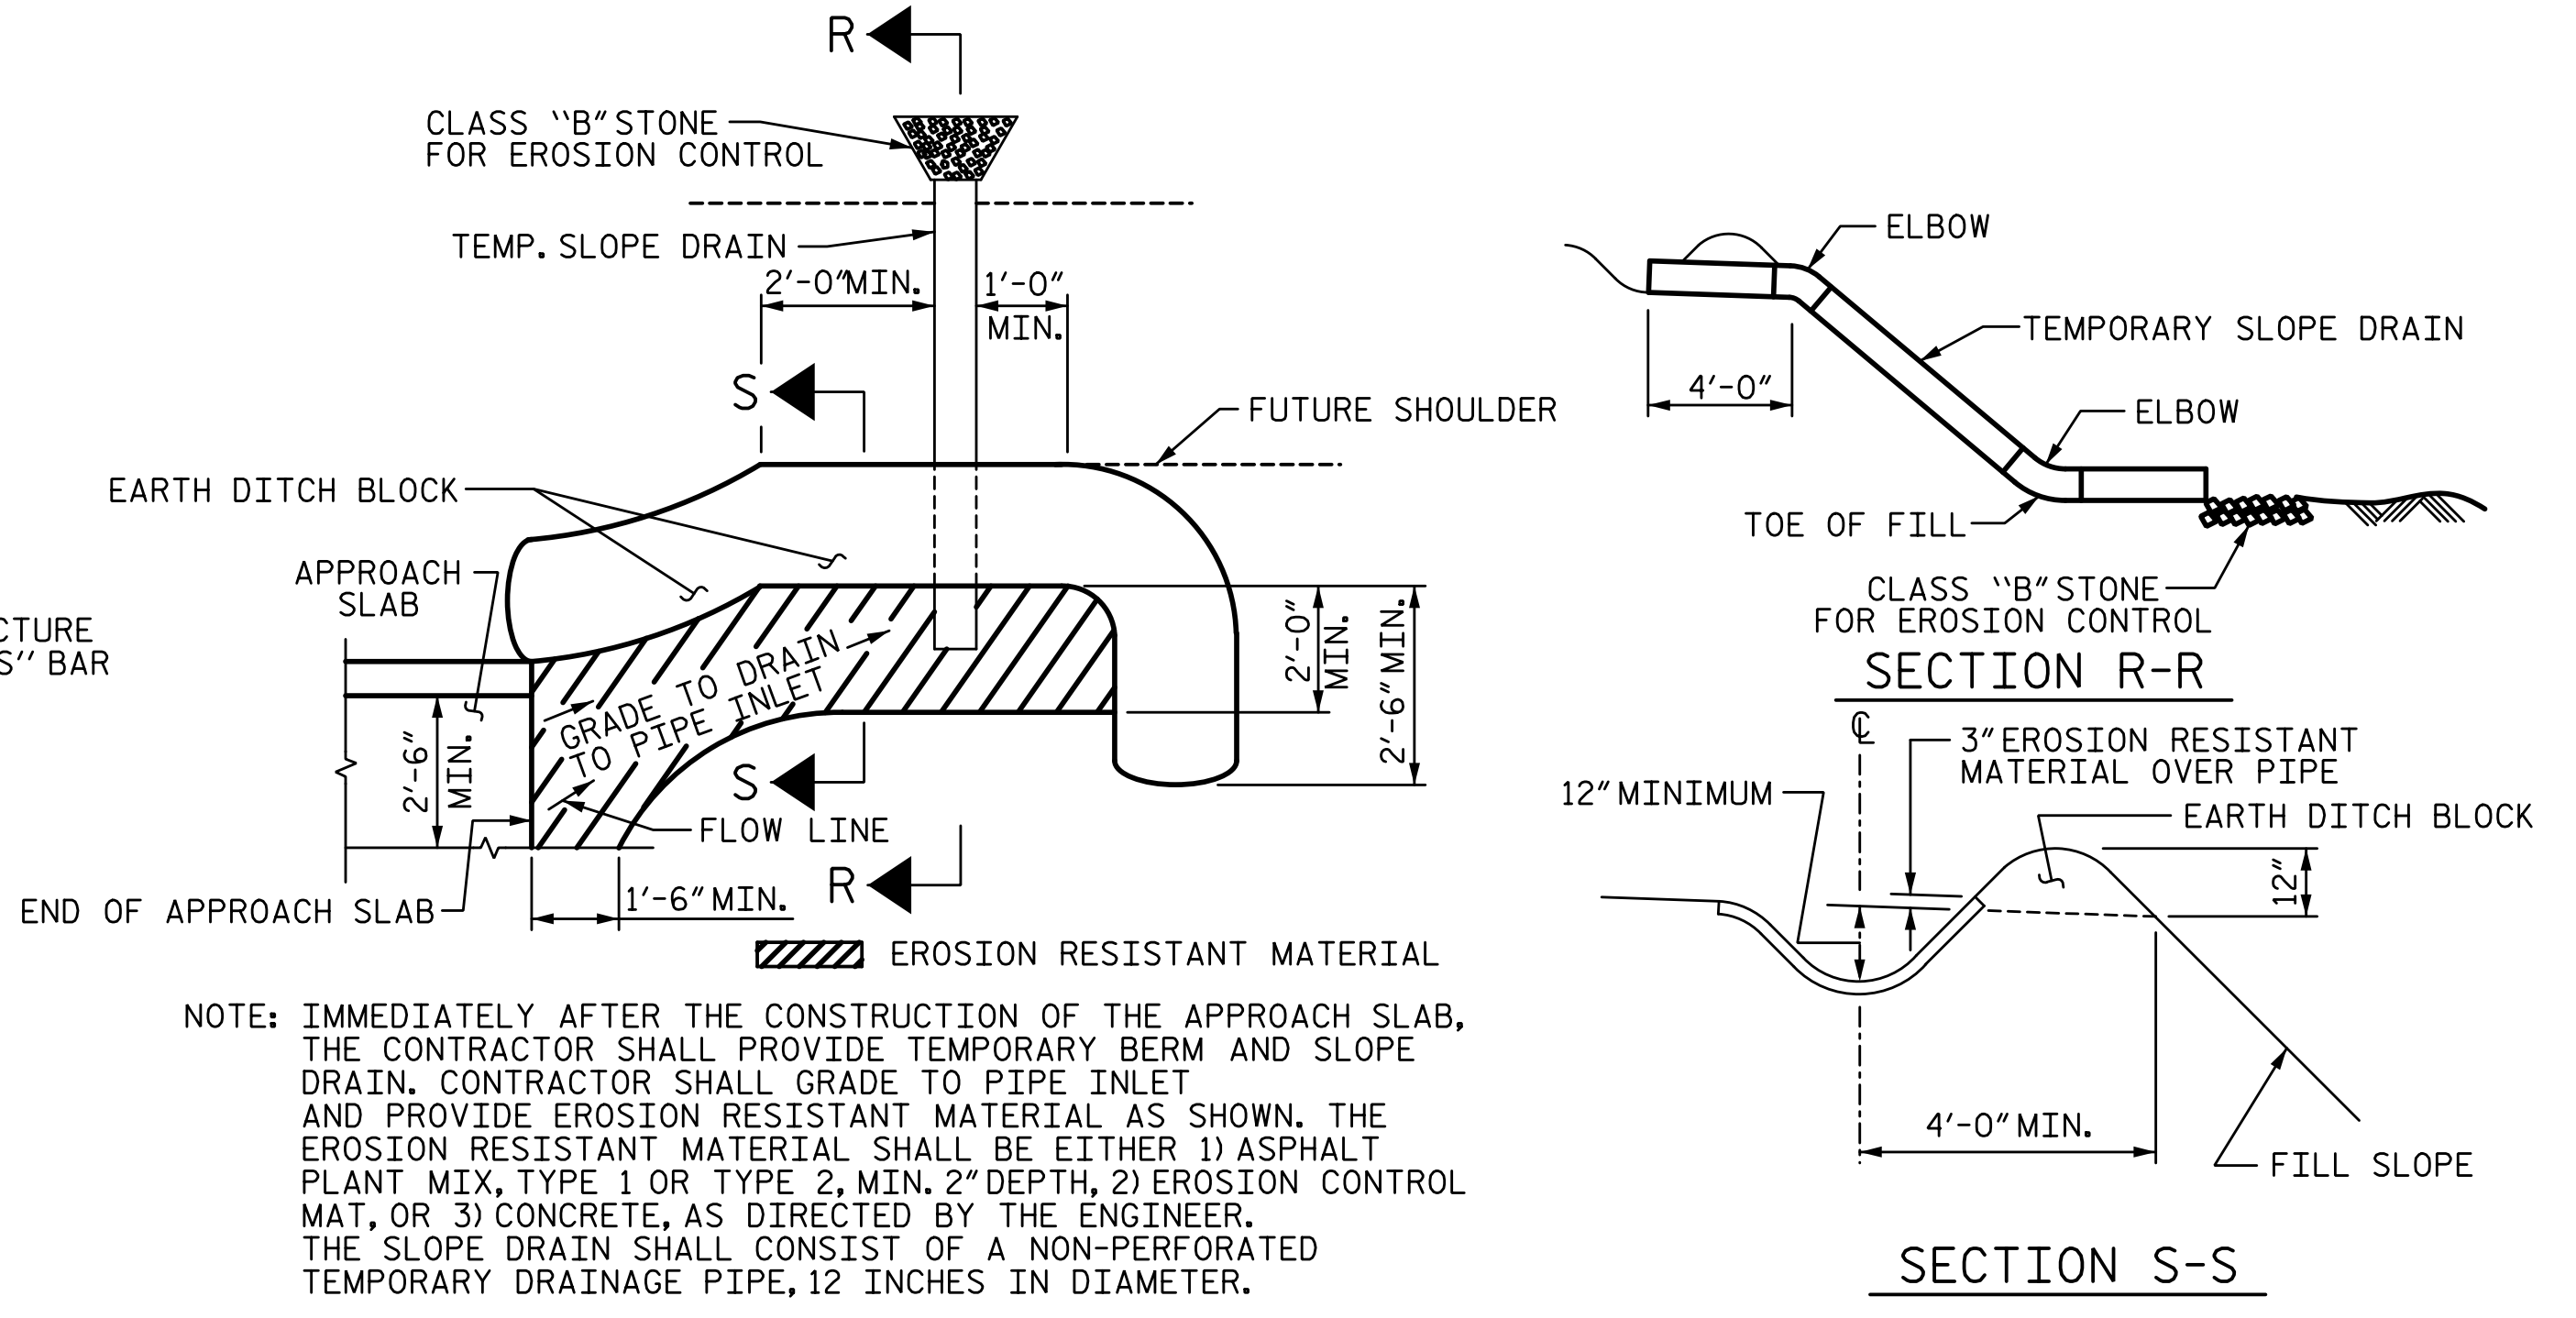

TEMPORARY BERM AND SLOPE DRAIN DETAILS
(TO BE USED WHEN SHOULDER BERM GUTTER IS REQUIRED)

NOTES:

APPROACH SLAB SHALL NOT BE CONSTRUCTED PRIOR TO COMPLETION OF THE BRIDGE DECK.

FOR TEMPORARY GEOTEXTILE WALL INCLUDING GEOTEXTILE, 6" Ø DRAINAGE PIPE, WELDED WIRE FORM, AND SELECT MATERIAL, SEE ROADWAY PLANS.

GEOTEXTILE (TYPE 1 OR TYPE 5) SHALL BE IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS SECTION 1056.


SELECT MATERIAL BACKFILL (CLASS V OR CLASS VI) SHALL BE IN ACCORDANCE WITH STANDARD SPECIFICATIONS SECTION 1016.

SELECT MATERIAL BACKFILL IS TO BE CONTINUOUS ALONG FILL FACE OF BACKWALL FROM OUTSIDE EDGE TO OUTSIDE EDGE OF APPROACH SLAB.

FOR THE 6" Ø DRAINAGE PIPE OUTLET(S), SEE ROADWAY STANDARD DRAWINGS.

AREA BETWEEN THE WINGWALL AND APPROACH SLAB SHALL BE GRADED TO DRAIN THE WATER AWAY FROM THE FILL FACE OF THE BRIDGE AND SHALL BE PAVED. SEE ROADWAY PLANS.

THE JOINT OPENING AT THE APPROACH SLAB/DECK INTERFACE SHALL BE SAWED NO MORE THAN 12 HOURS AFTER THE APPROACH SLAB IS CAST. THE JOINT SHALL BE CLEANED OF ALL DEBRIS BEFORE THE SEALANT IS APPLIED. THE JOINT SEALER MATERIAL SHALL CONFORM TO THE REQUIREMENTS OF SECTION 1028-3 OF THE STANDARD SPECIFICATIONS.

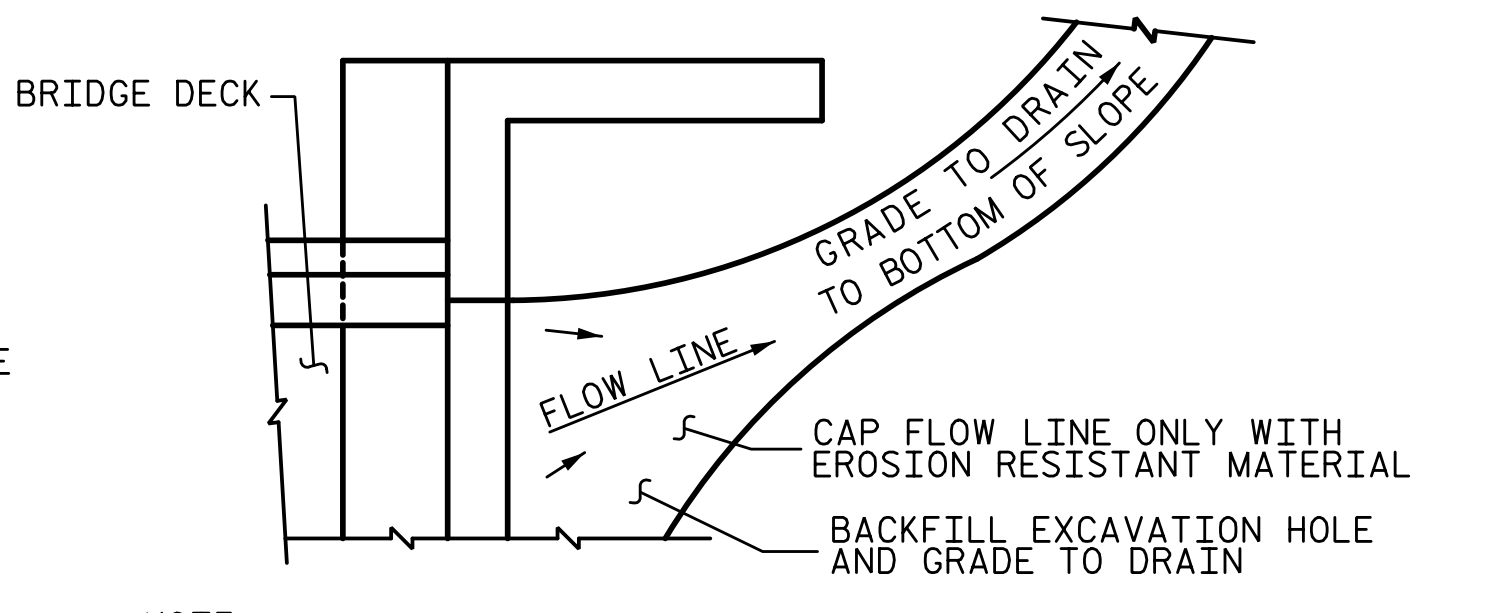

NOTE: IF THE APPROACH SLAB IS NOT CONSTRUCTED IMMEDIATELY AFTER THE BACKFILLING OF THE END BENT EXCAVATION, GRADE TO DRAIN TO THE BOTTOM OF THE SLOPE AND PROVIDE EROSION RESISTANT MATERIAL, SUCH AS FIBERGLASS ROVING OR AS DIRECTED BY THE ENGINEER TO PREVENT SOIL EROSION AND TO PROTECT THE AREA ADJACENT TO THE STRUCTURE. THE CONTRACTOR WILL BE REQUIRED TO REMOVE THESE MATERIALS PRIOR TO CONSTRUCTION OF THE APPROACH SLAB.

TEMPORARY DRAINAGE DETAIL


PROJECT NO. B-5652
ONLOW COUNTY
 STATION: 20+64.00 -L-RT-

SHEET 2 OF 2

STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH

BRIDGE APPROACH SLAB DETAILS

DRAWN BY: T. BANKOVICH DATE: 5-22
 CHECKED BY: J.A. BATTS DATE: 5-22
 DESIGN ENGINEER OF RECORD: J.A. BATTS DATE: 5-22

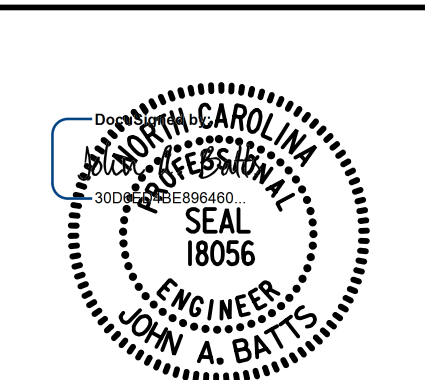

REVISIONS						SHEET NO.
NO.	BY:	DATE:	NO.	BY:	DATE:	S-26
1			3			TOTAL SHEETS
2			4			26

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

