



PLAN

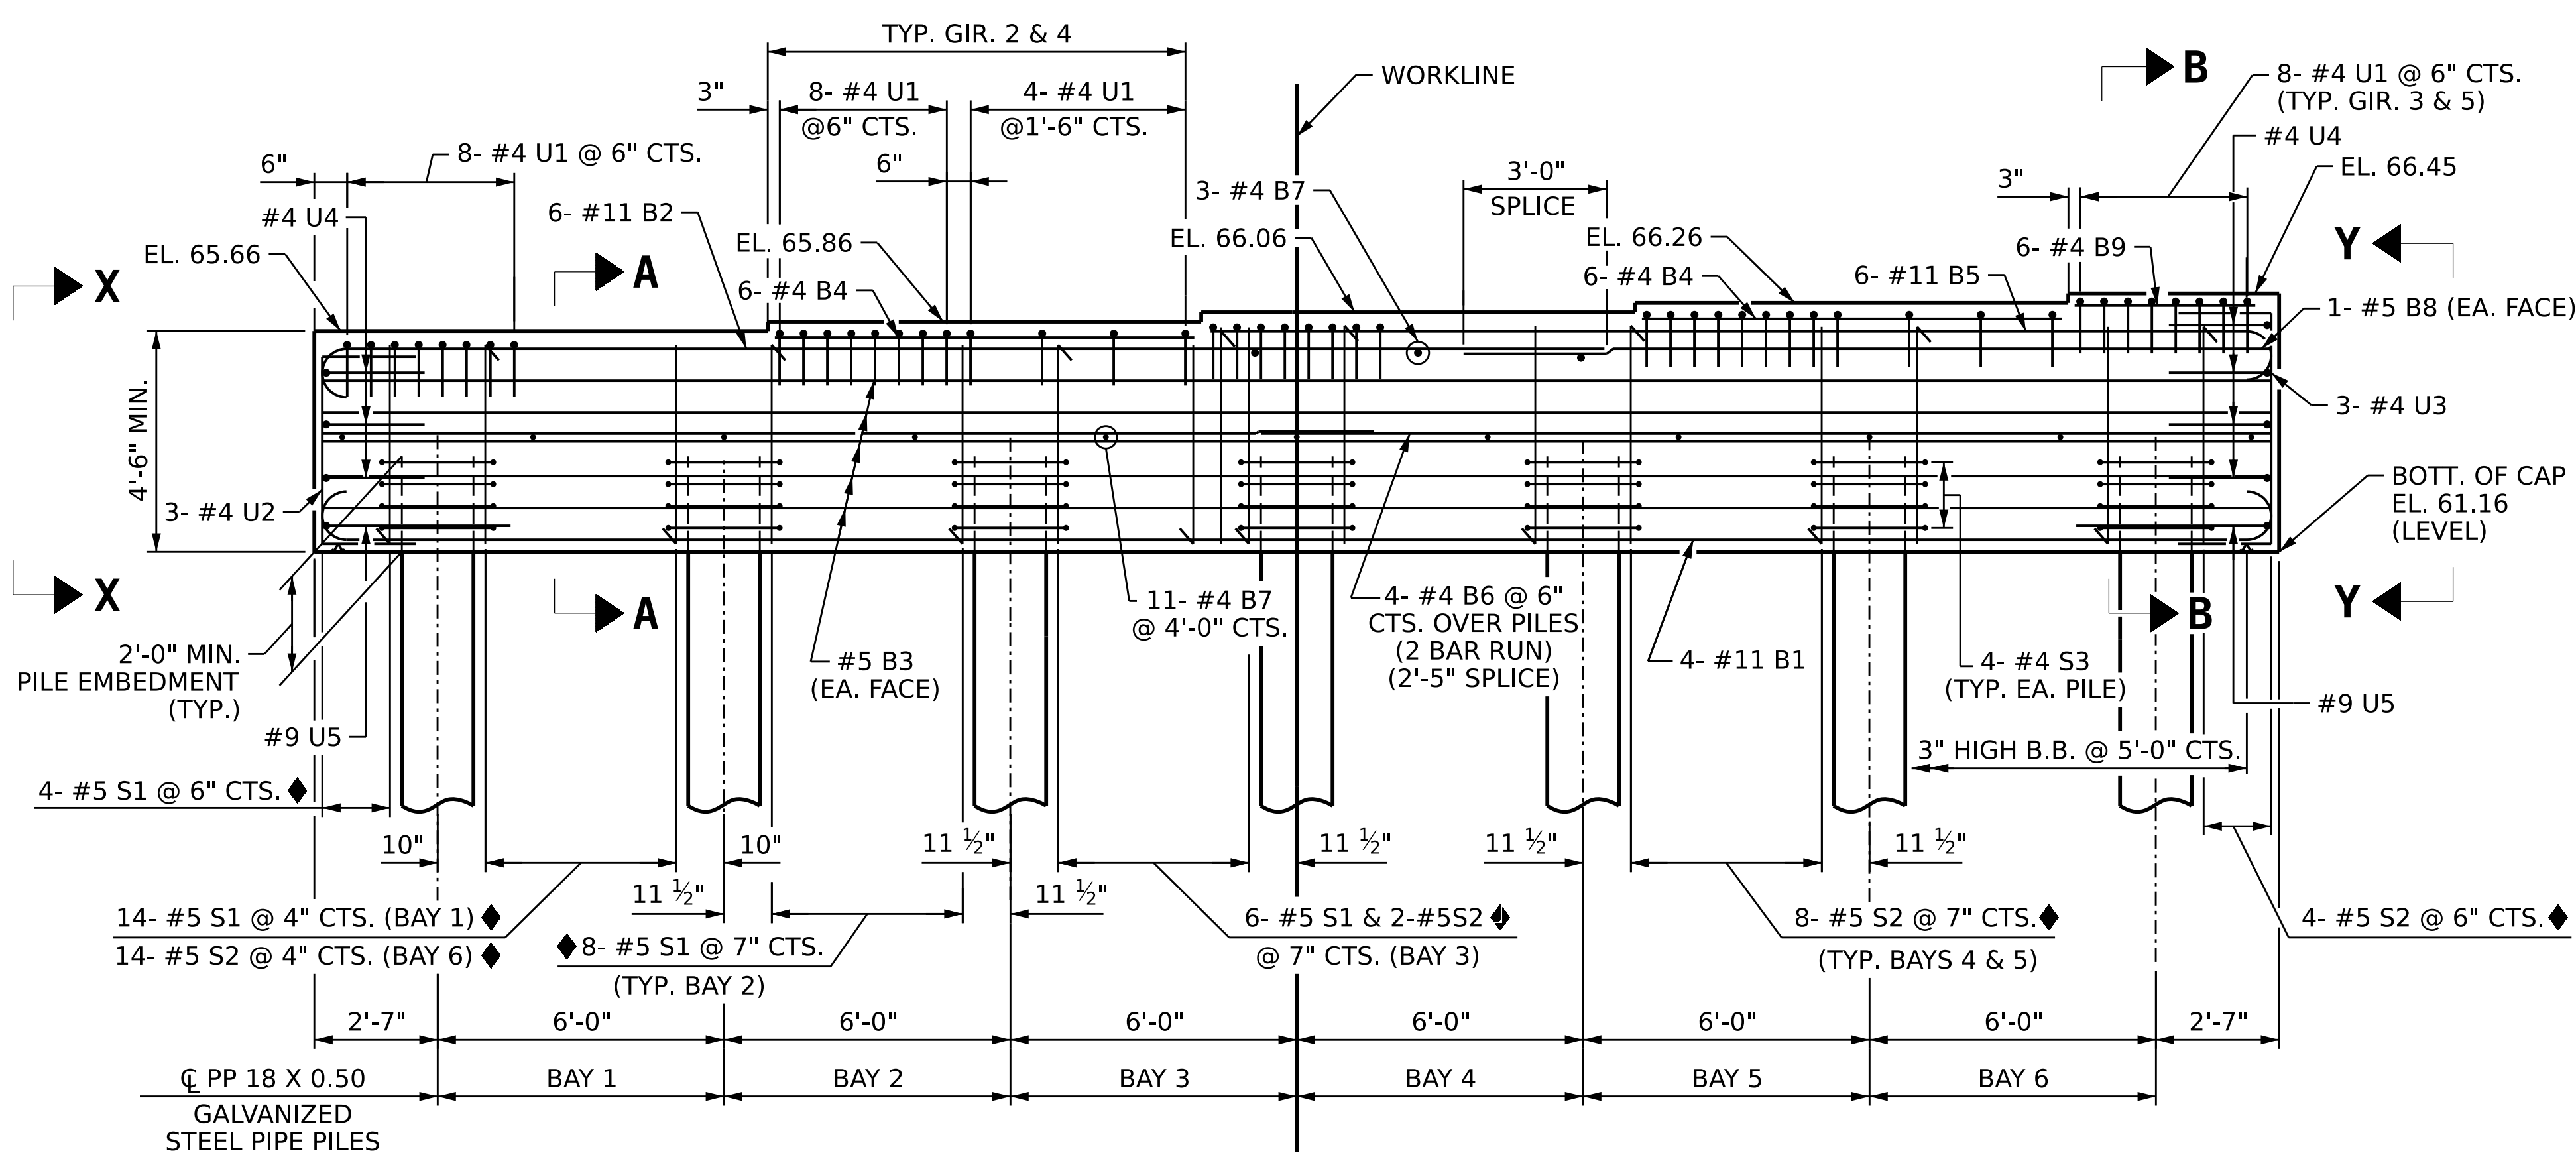

ELEVATION

NOTES:

- STIRRUPS IN CAP MAY BE SHIFTED AS NECESSARY TO CLEAR ANCHOR BOLTS.
- FOR SECTIONS A-A AND B-B AND VIEWS X-X AND Y-Y, SEE SHEET 2 OF 2.
- GALVANIZE THE TOP OF EACH INTERIOR BENT PILE A MINIMUM OF 26 FEET. GALVANIZE IN ACCORDANCE WITH SECTION 1076 OF THE STANDARD SPECIFICATIONS.
- FOR PP 18 X 0.50 GALVANIZED STEEL PIPE PILE DETAILS, SEE "18" STEEL PIPE PILE" SHEET.
- ◆ INVERT ALTERNATE STIRRUPS AS SHOWN.

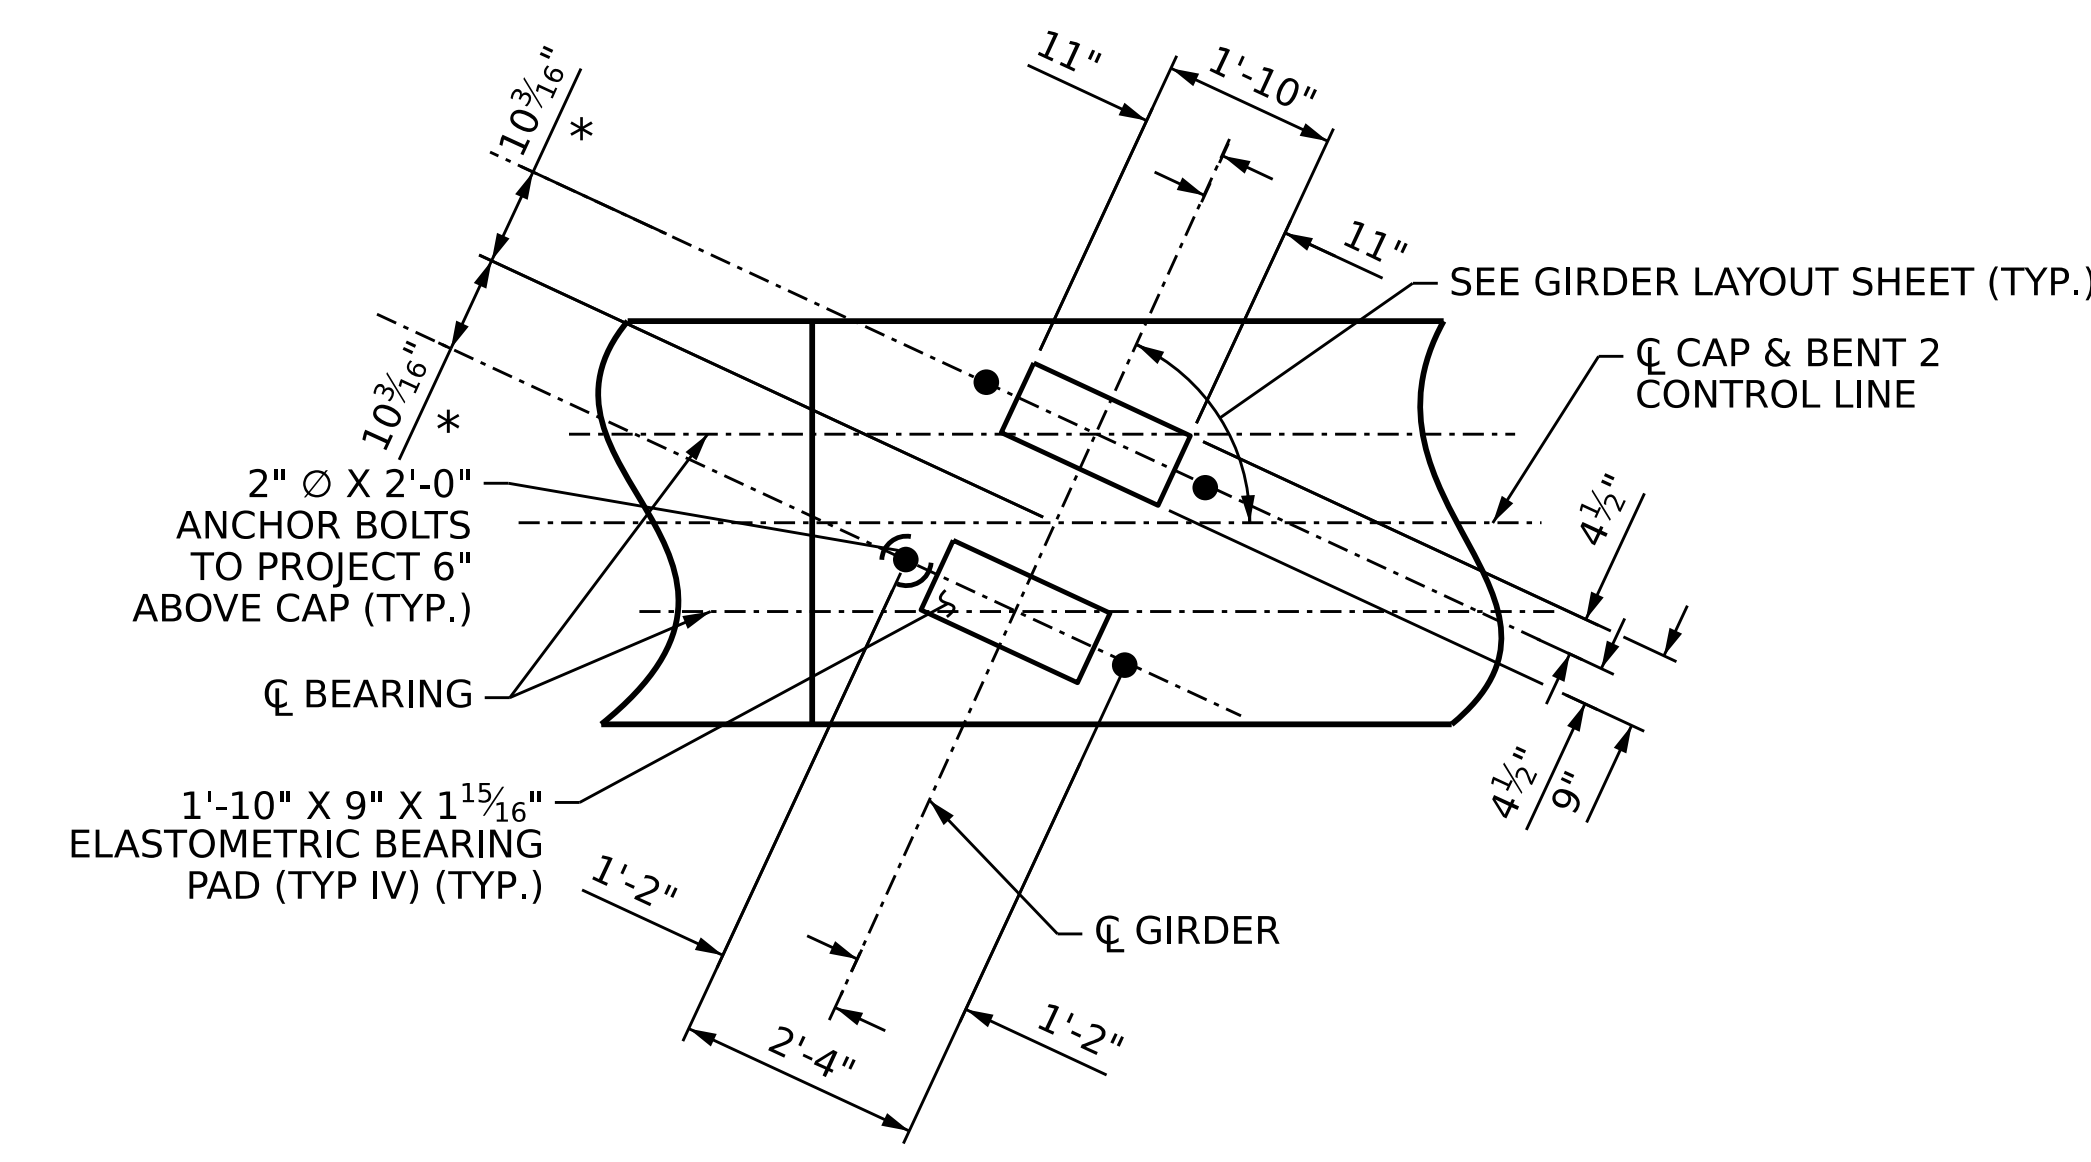

DETAIL "A"

DIMENSIONS ARE TYPICAL UNLESS OTHERWISE NOTED. * MEASURED ALONG Q GIRDER

PROJECT NO. **BR-0073**
COLUMBUS COUNTY
 STATION: **18+24.50 -L-**
 SHEET 1 OF 2



STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH

SUBSTRUCTURE
BENT 2

VOLKERT
 5430 Wade Park Blvd., Suite 410
 Raleigh, NC 27607
 Tel. 919-854-0344 Fax. 919-854-0355
 NC License No. F-0765

REVISIONS				SHEET NO.
NO.	BY:	DATE:	NO.	S-30
1			3	TOTAL SHEETS
2			4	38

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

DRAWN BY: **A. Y. WU** DATE: **10/22**
 CHECKED BY: **B. H. BARNHILL** DATE: **11/22**
 DESIGN ENGINEER OF RECORD: **P. N. HOLDER** DATE: **11/22**