


Prepared in the Office of:



AECOM TECHNICAL SERVICES OF NORTH CAROLINA, INC.
5438 WADE PARK BLVD, SUITE 200, RALEIGH, NC 27607
919-461-1100
F-0342


DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED

PROJECT REFERENCE NO.	SHEET NO.
BR-0041	UC-4
DESIGNED BY:	1/24/2023
DRAWN BY:	
CHECKED BY:	
APPROVED BY:	
REVISED:	
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151	

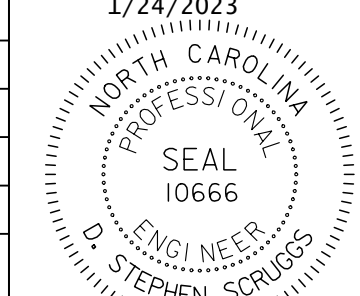

UTILITY CONSTRUCTION

0401 TOP=802.5 INV=801.3	0404 TOP=806.9 INV=803.9	0407 INV=800.2	0410 TOP=811.5 INV=808.5
0402 TOP=803.8 INV=800.8	0405 TOP=804.1 INV=801.1	0408 TOP=808.0 INV=805.3	0411 TOP=809.1 INV=804.6
0403 INV=799.0	0406 TOP=802.8 INV=800.3	0409 TOP=809.1 INV=804.9	0412 TOP=806.7 INV=802.3

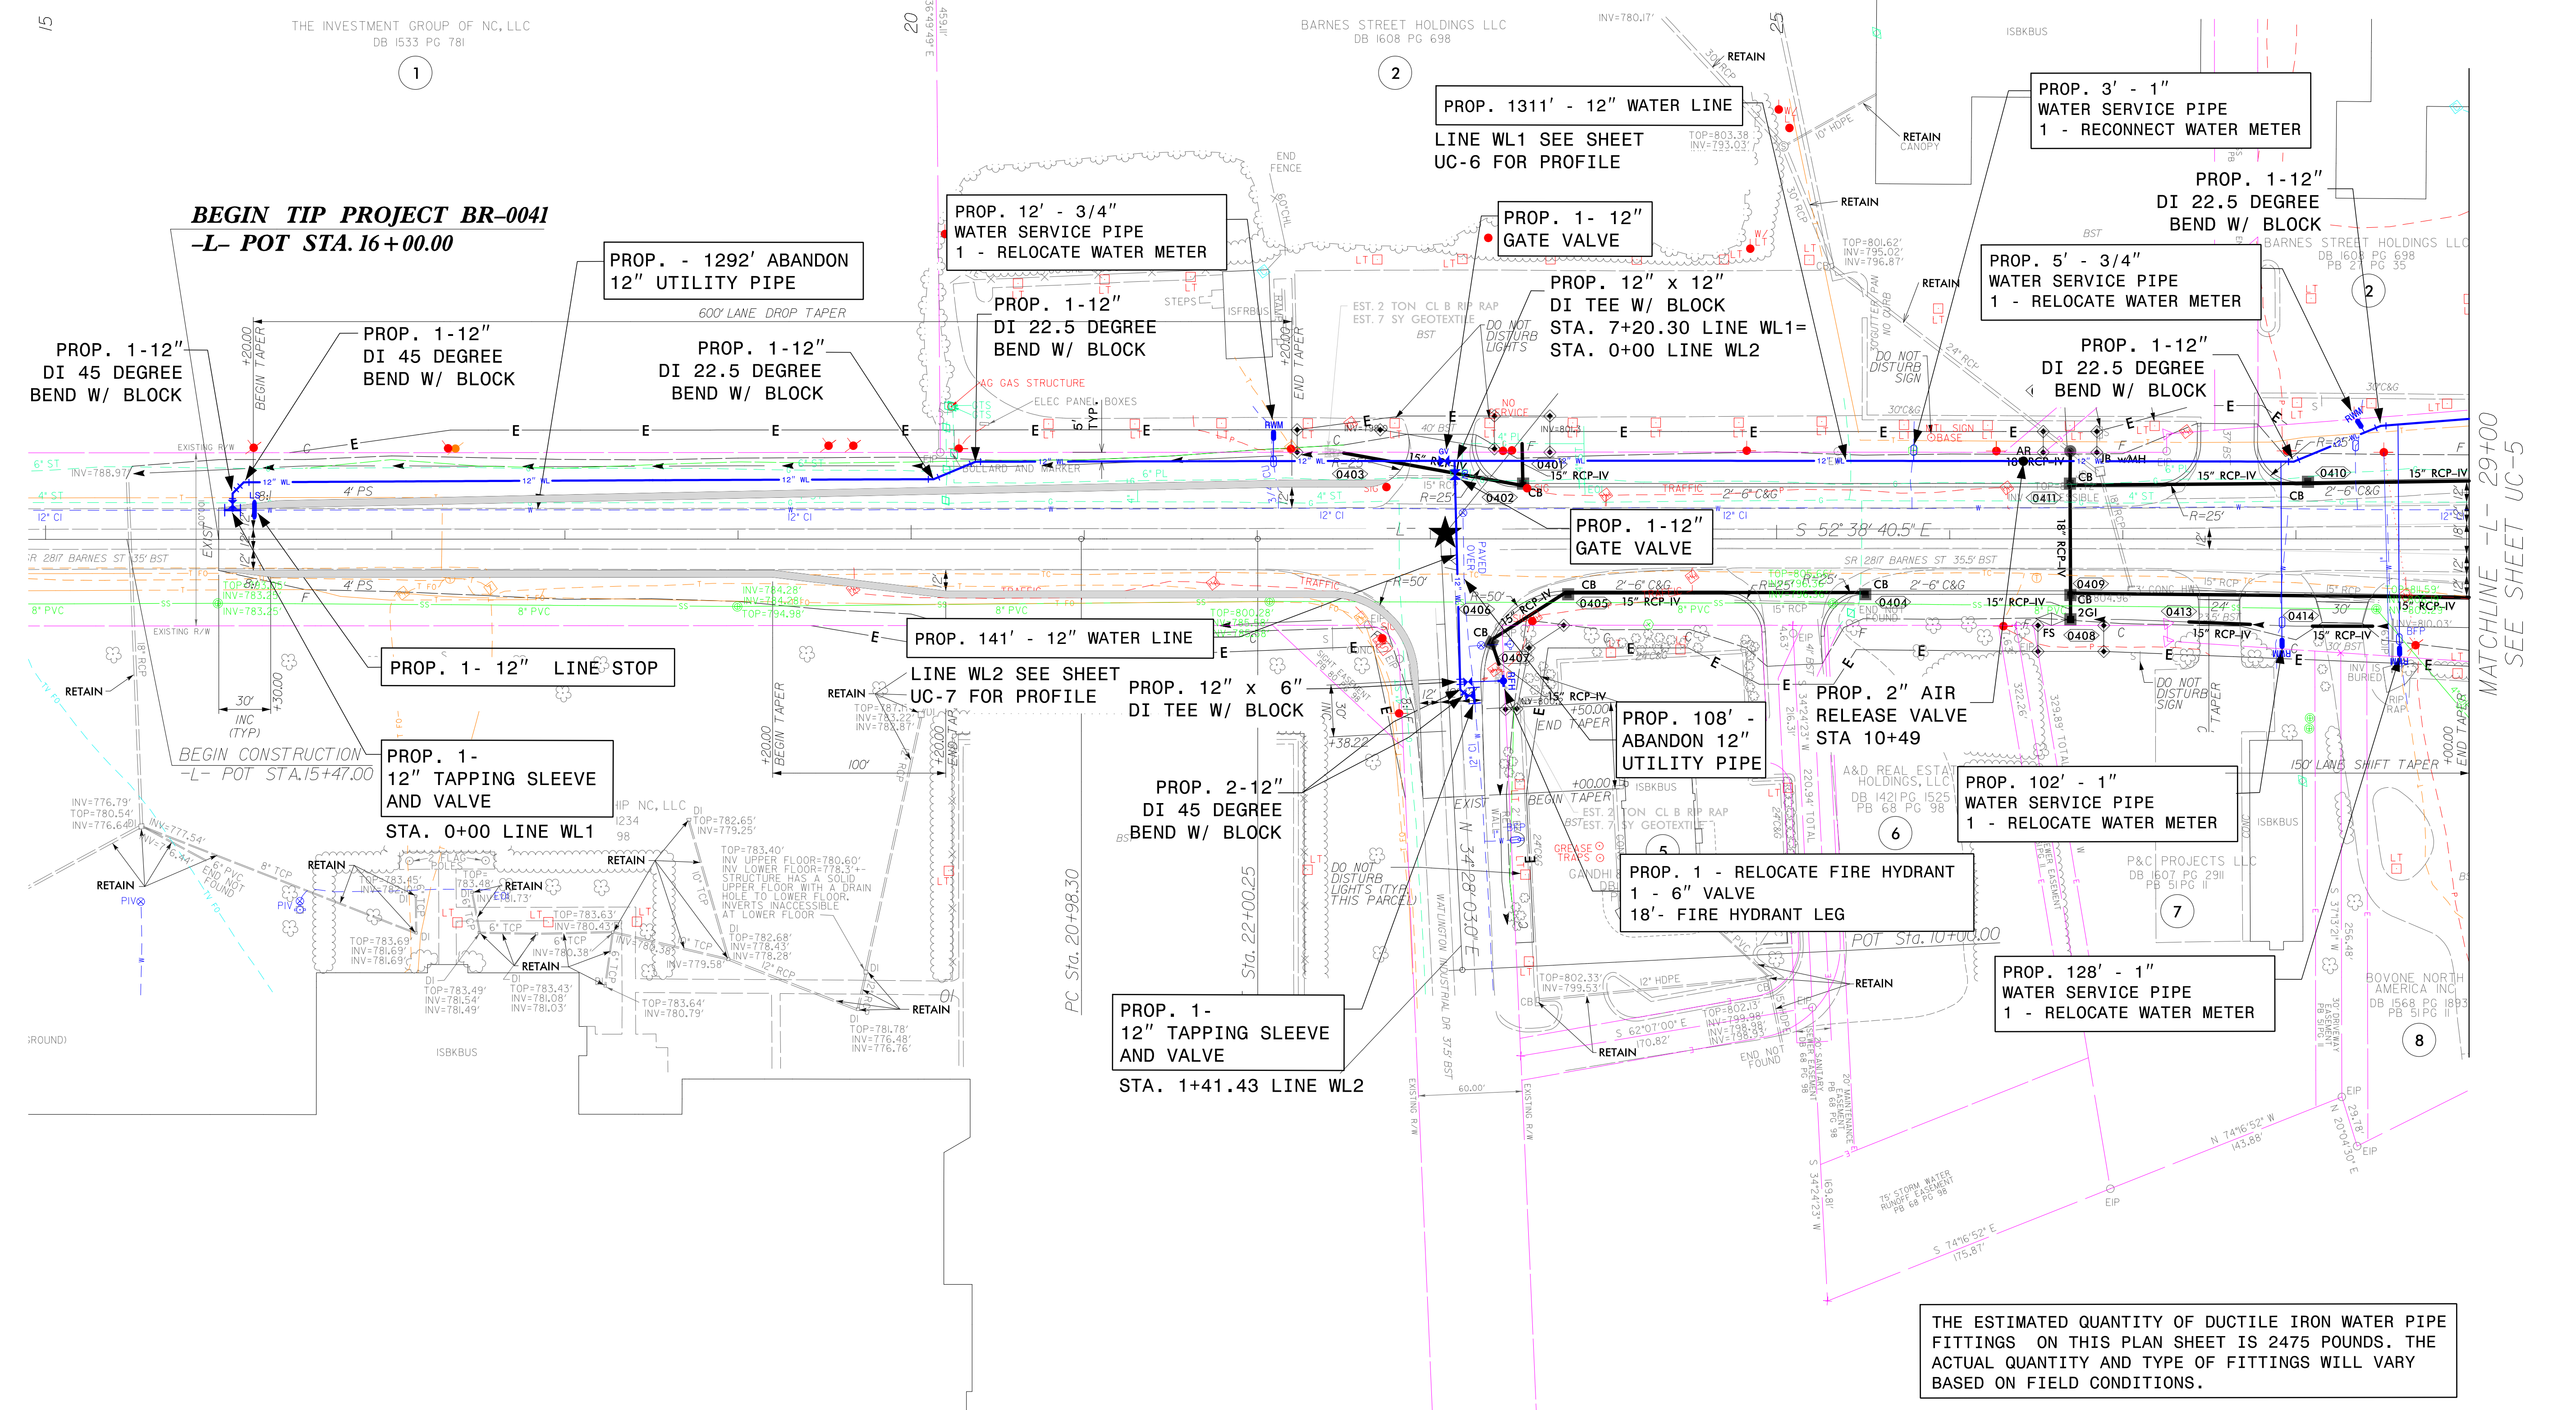

THE ESTIMATED QUANTITY OF DUCTILE IRON WATER PIPE FITTINGS ON THIS PLAN SHEET IS 2475 POUNDS. THE ACTUAL QUANTITY AND TYPE OF FITTINGS WILL VARY BASED ON FIELD CONDITIONS.

DATE: 8/04/23
TIME: 8:11 AM
DGN: 8/04/23