NOTES:

FOR MECHANICALLY STABILIZED EARTH (MSE) RETAINING WALLS, SEE MECHANICALLY STABILIZED EARTH RETAINING WALLS PROVISION.

FOR TYPE III REINFORCED BRIDGE APPROACH FILL, SEE BRIDGE APPROACH FILLS PROVISION AND ROADWAY DETAIL DRAWING NO. 422D10.

FOR STEEL BEAM GUARDRAIL, SEE ROADWAY PLANS AND SECTION 862 OF THE STANDARD SPECIFICATIONS.

FOR SINGLE FACED PRECAST CONCRETE BARRIER, SEE ROADWAY PLANS AND SECTION 857 OF THE STANDARD SPECIFICATIONS.

AT THE CONTRACTOR'S OPTION, USE FINE AGGREGATE IN THE REINFORCED ZONE OF RETAINING WALL NO. 2.

A SEPARATION GEOTEXTILE IS REQUIRED AT THE BACK OF THE REINFORCED ZONE FOR RETAINING WALL NO. 2.

A DRAIN IS REQUIRED FOR RETAINING WALL NO. 2.

BEFORE BEGINNING MSE WALL DESIGN FOR RETAINING WALL NO.2, SURVEY WALL LOCATION AND SUBMIT A REVISED WALL PROFILE VIEW (WALL ENVELOPE) FOR REVIEW. DO NOT START WALL DESIGN OR CONSTRUCTION UNTIL THE REVISED WALL ENVELOPE IS ACCEPTED.

DESIGN RETAINING WALL NO. 2 FOR THE FOLLOWING:

1) DESIGN HEIGHT (H) = WALL HEIGHT + WALL EMBEDMENT

2) DESIGN LIFE = 100 YEARS

3) MAXIMUM FACTORED VERTICAL PRESSURE = 4.1 KSF 4) MINIMUM REINFORCEMENT LENGTH (L) = 0.7H OR 6 FT, WHICHEVER IS LONGER

5) MINIMUM EMBEDMENT DEPTH, SEE MECHANICALLY STABILIZED EARTH RETAINING WALLS PROVISION 6) REINFORCED ZONE AGGREGATE PARAMETERS:

AGGREGATE TYPE*	UNIT WEIGHT (γ) PCF	FRICTION ANGLE (φ) DEGREES	COHESION (c) PSF	
COARSE	110	38	0	
FINE	115	34	0	
* SEE MSE RETAINING WALLS PROVISION FOR COARSE AND FINE AGGREGATE MATERIAL REQUIREMENTS.				

7) IN-SITU ASSUMED MATERIAL PARAMETERS:

MATERIAL TYPE	UNIT WEIGHT (γ) PCF	FRICTION ANGLE (φ) DEGREES	COHESION (c) PSF
BACKFILL	115	30	0
FOUNDATION	120	30	0

DESIGN RETAINING WALL NO. 2 FOR A LIVE LOAD (TRAFFIC) SURCHARGE.

DESIGN REINFORCEMENT CONNECTED TO END BENT CAPS FOR FACTORED LOAD AND LENGTH OF REINFORCEMENT IN ACTIVE ZONE (La) SHOWN. CAST REINFORCEMENT OR CONNECTORS INTO CAP BACKWALL FOR END BENT NO. 2 LOCATED AT STATION 35+62.50 -L-.

FOUNDATIONS FOR SIGNS, LIGHTING OF SIGNALS MAY BE LOCATED BEHIND RETAINING WALL NO.2 AND MAY INTERFERE WITH REINFORCEMENT. BEFORE BEGINNING MSE WALL CONSTRUCTION, SUBMIT PROPOSED CONSTRUCTION METHODS FOR THESE FOUNDATIONS FOR APPROVAL.

EXISTING OR FUTURE OBSTRUCTIONS SUCH AS FOUNDATIONS, GUARDRAIL, FENCE OR HANDRAIL POSTS, PAVEMENTS, PIPES, INLETS OR UTILITIES MAY INTERFERE WITH REINFORCEMENT FOR RETAINING WALL NO. 2.


FOUNDATIONS FOR END BENT NO. 2 LOCATED AT STATION 35+62.50 WILL INTERFERE WITH REINFORCEMENT FOR RETAINING WALL NO. 2. SEE "FOUNDATION LAYOUT" SHEET FOR FOUNDATION LOCATIONS.


DO NOT PLACE LEVELING PAD CONCRETE, AGGREGATE OR REINFORCEMENT FOR RETAINING WALL NO.2 UNTIL EXCAVATION DIMENSIONS AND FOUNDATION MATERIAL ARE APPROVED.

"TEMPORARY SHORING" MAY BE REQUIRED FOR RETAINING WALL NO.2 IN ACCORDANCE WITH THE TEMPORARY SHORING PROVISION. SEE ROADWAY, STRUCTURE OF TRAFFIC CONTROL PLANS.

AT THE CONTRACTOR'S OPTION, "TEMPORARY SHORING FOR WALL CONSTRUCTION" MAY BE USED TO CONSTRUCT RETAINING WALL NO.2. SEE MSE RETAINING WALLS PROVISION FOR TEMPORARY SHORING FOR WALL CONSTRUCTION.

FROM APPROXIMATE -W2- STATION 0+00 TO 1+75 SOFT COHESIVE SOILS AND OVERLYING EXISTING ROADWAY EMBANKMENT FILL SHALL BE UNDERCUT FROM THE FRONT OF THE WALL TOWARDS END BENT 2 A, WIDTH OF APPROXIMATELY 5 FEET AND A DEPTH OF APPROXIMATELY 3 FEET.GEOTEXTILE SHALL BE PLACED AT THE BASE OF THE UNDERCUT.BACKFILL TO FINISHED GRADE WITH COMPACTED FILL.

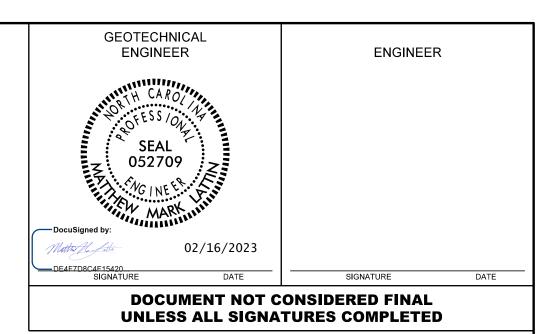

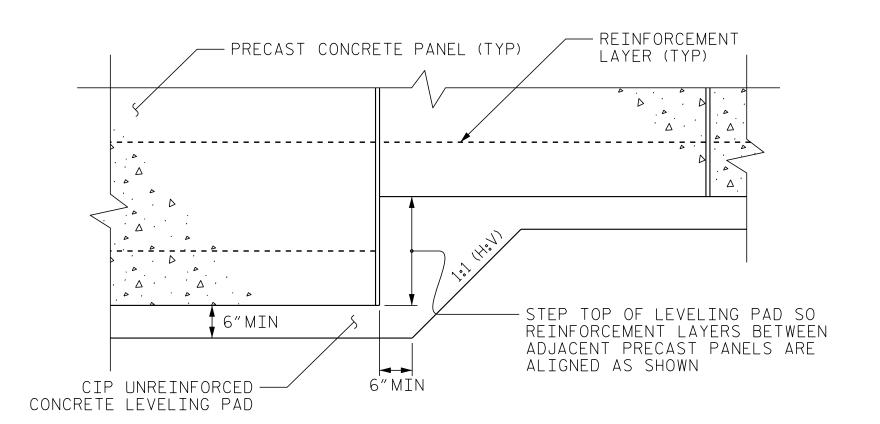

PRECAST PANELS LEVELING PAD STEP DETAIL

PROJECT NO.: BR-0041

ROCKINGHAM COUNTY

STATION: -Y- STA. 20+26.72 TO 18+17.73

SHEET 3 OF 3

RETAINING WALL NO. 2 NOTES & LEVELING PAD STEP DETAILS

REVISIONS DATE NO. DATE NO.

ESP ASSOCIATES, INC. 7011 ALBERT PICK RD GREENSBORO, NC 27409 FIRM # C-0587 WWW.ESPASSOCIATES.COM



DIVISION OF HIGHWAYS GEOTECHNICAL ENGINEERING UNIT

NORTH CAROLINA

DEPARTMENT OF TRANSPORTATION

DATE: 02/2023 PREPARED BY: C.R. PASTRANA REVIEWED BY: M.M. LATTIN DATE: 02/2023