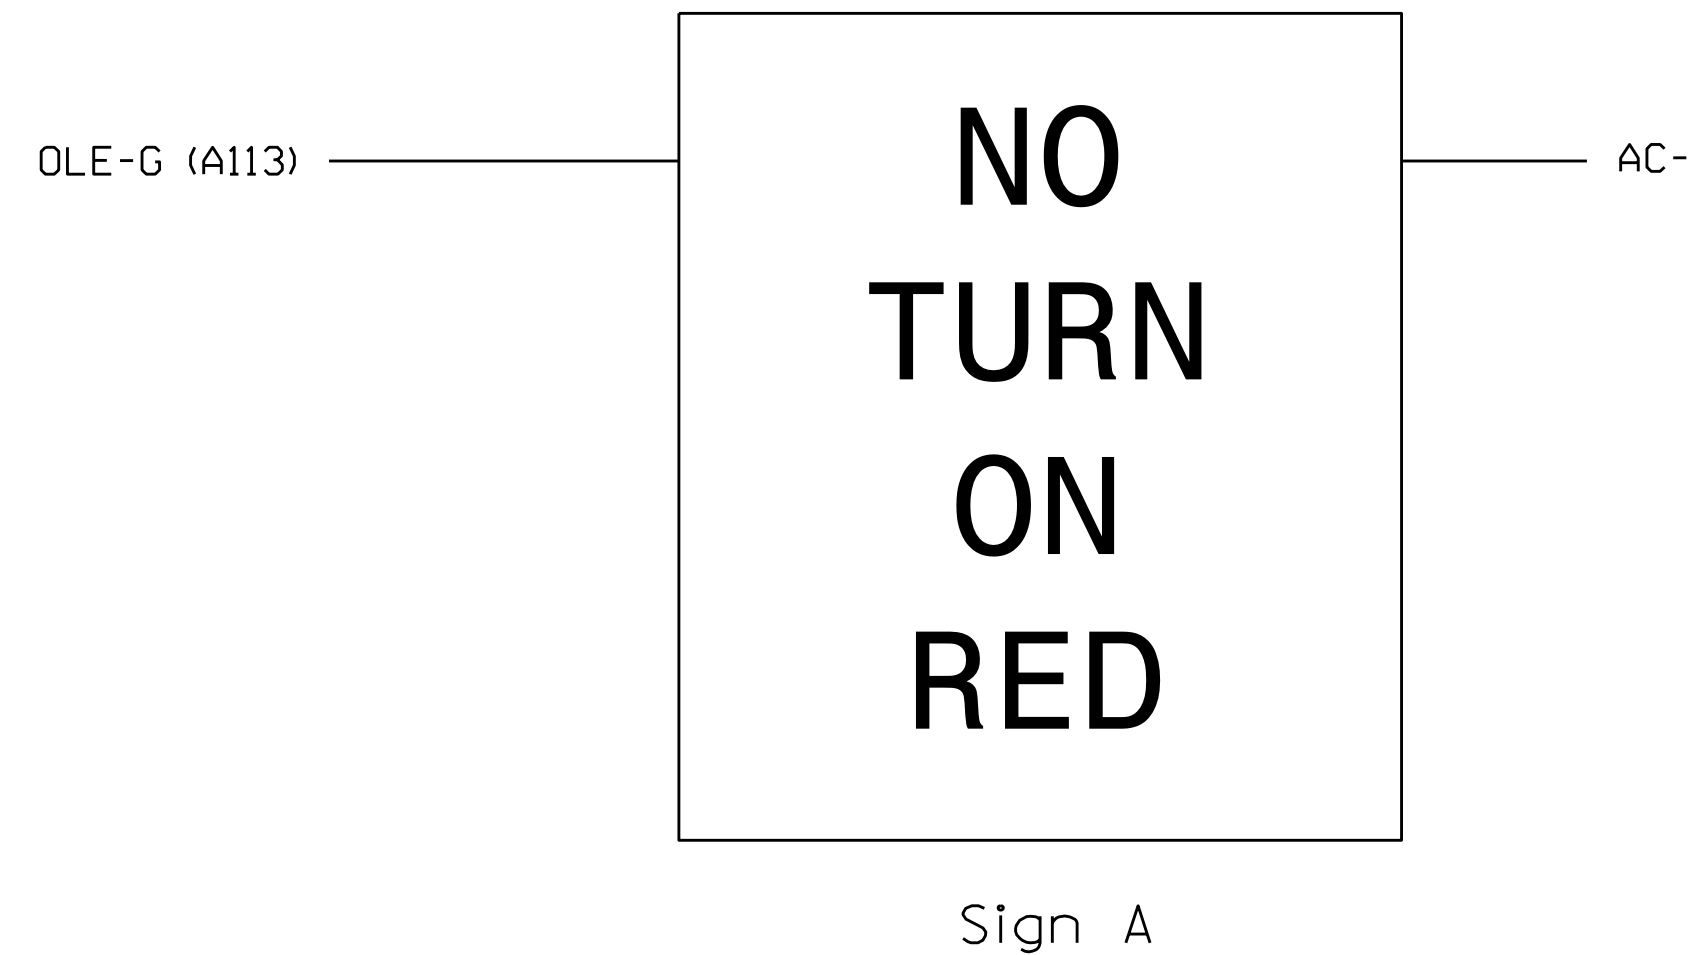


BLANKOUT SIGN WIRING DETAIL


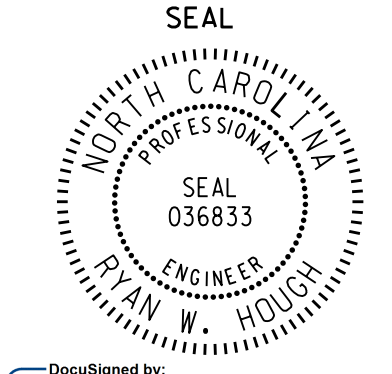



Sign A

BLANKOUT SIGN 'A' INDICATION						
Phase	I+5	I+6	2+5	2+6	3	4
Default Phasing	OFF	OFF	OFF	OFF	OFF	OFF
Alternate Phasing	ON	OFF	ON	OFF	ON	ON

IMPORTANT! Remove, tape and label conflict monitor wires from OLE-G (A113) and OLE-Y (A112).

THIS ELECTRICAL DETAIL IS FOR
THE SIGNAL DESIGN: 05-2036T2
DESIGNED: February 2022
SEALED: 2/22/2022
REVISED: N/A

Electrical Detail - Temp 2 (TMP Phase II) - Sheet 4 of 4		DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED									
<small>ELECTRICAL AND PROGRAMMING DETAILS FOR:</small> <small>Prepared In the Offices of:</small>  <small>750 N. Greenfield Pkwy, Garner, NC 27529</small>	SR 2000 (Falls of Neuse Rd.) at I-540 WB Ramps and Falls Valley Drive Division 5 Wake County Raleigh PLAN DATE: February 2022 REVIEWED BY: PREPARED BY: S. Armstrong REVIEWED BY:	SEAL  SEAL 036833 ENGINEER RYAN W. HOUGH									
<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>REVISIONS</th> <th>INIT.</th> <th>DATE</th> </tr> </thead> <tbody> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> </tbody> </table>		REVISIONS	INIT.	DATE							Documented by:  03/07/2022 DATE SIG. INVENTORY NO. 05-2036T2
REVISIONS	INIT.	DATE									

07-1485-2022_01:15
W:\2036\2022\erl\erl-wk.dgn
S:\MS\T.DG