

PROVIDE WIRING ROUTING AND STAPLING SO


ELECTRODE RESISTANCE BY CLAMP ON TESTER

REMOVED AND GROUNDING WIRES CAN BE
PULLED MIN 1.5" OFF POLE & SPACED MAX
0.75" APART TO ENABLE TESTING OF GROUNDING

TR S

ᆸ

THAT STAPLES MAY BE TEMPORARILY

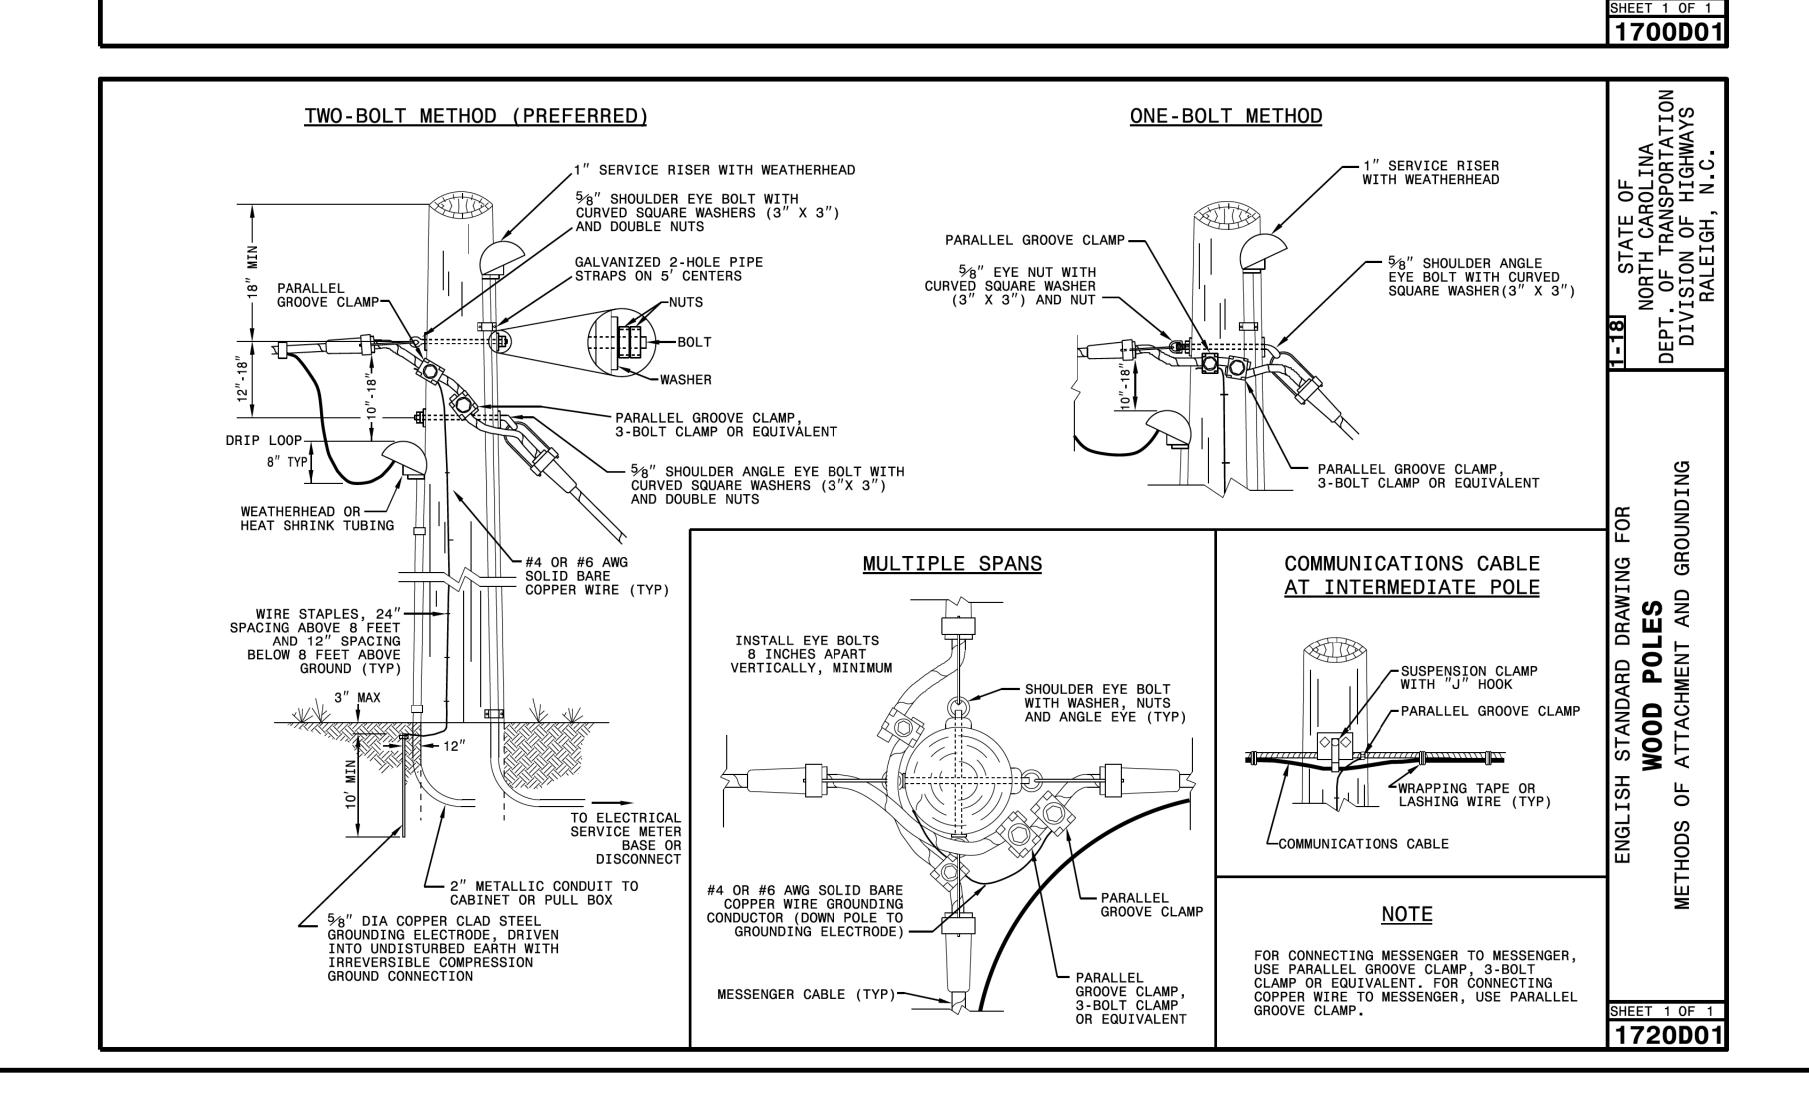

── ELECTRICAL SERVICE

TO CABINET


5/8" DIA COPPER CLAD STEEL


GROUNDING ELECTRODES, WITH IRREVERSIBLE COMPRESSION

GROUND CONNECTOR

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

See Plate for Title

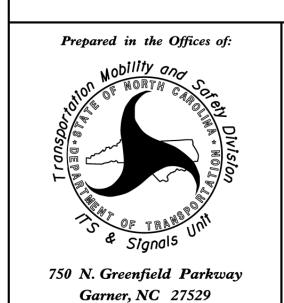

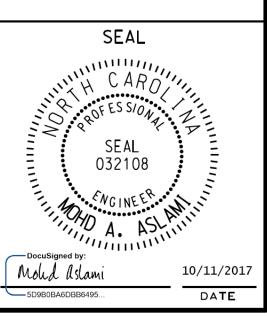

SHEET NO

Sig. 1.1