

PROJECT REFERENCE NO. R-5799	SHEET NO. UC-8
DESIGNED BY: MRD	
DRAWN BY: SRW	
CHECKED BY: JDN	
APPROVED BY: JDN	NORTH CAROLINA DEPARTMENT OF TRANSPORTATION UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151



UTILITY CONSTRUCTION

DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED


DO NOT DISTURB SIGN
ABANDON 30 LF
6" UTILITY PIPE

NOTE: CONTRACTOR
TO ADJUST WATER LINE
PER FIELD CONDITIONS



ABANDON 50 LF
10" UTILITY PIPE

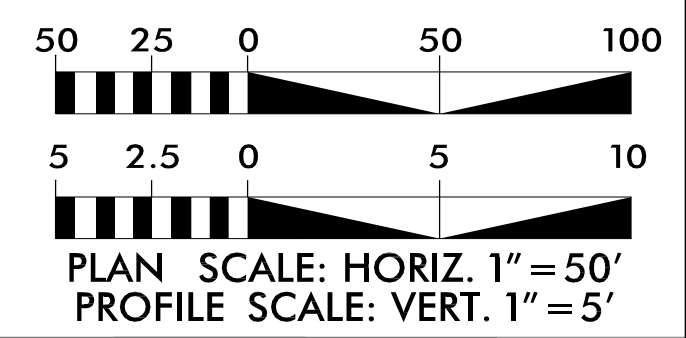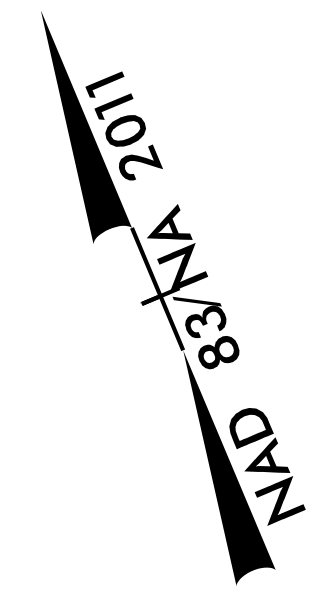

THE ESTIMATED QUANTITY OF DUCTILE IRON WATER PIPE FITTINGS ON THIS PLAN SHEET IS 1,335 POUNDS. THE ACTUAL QUANTITY AND TYPE OF FITTINGS WILL VARY BASED ON FIELD CONDITIONS.

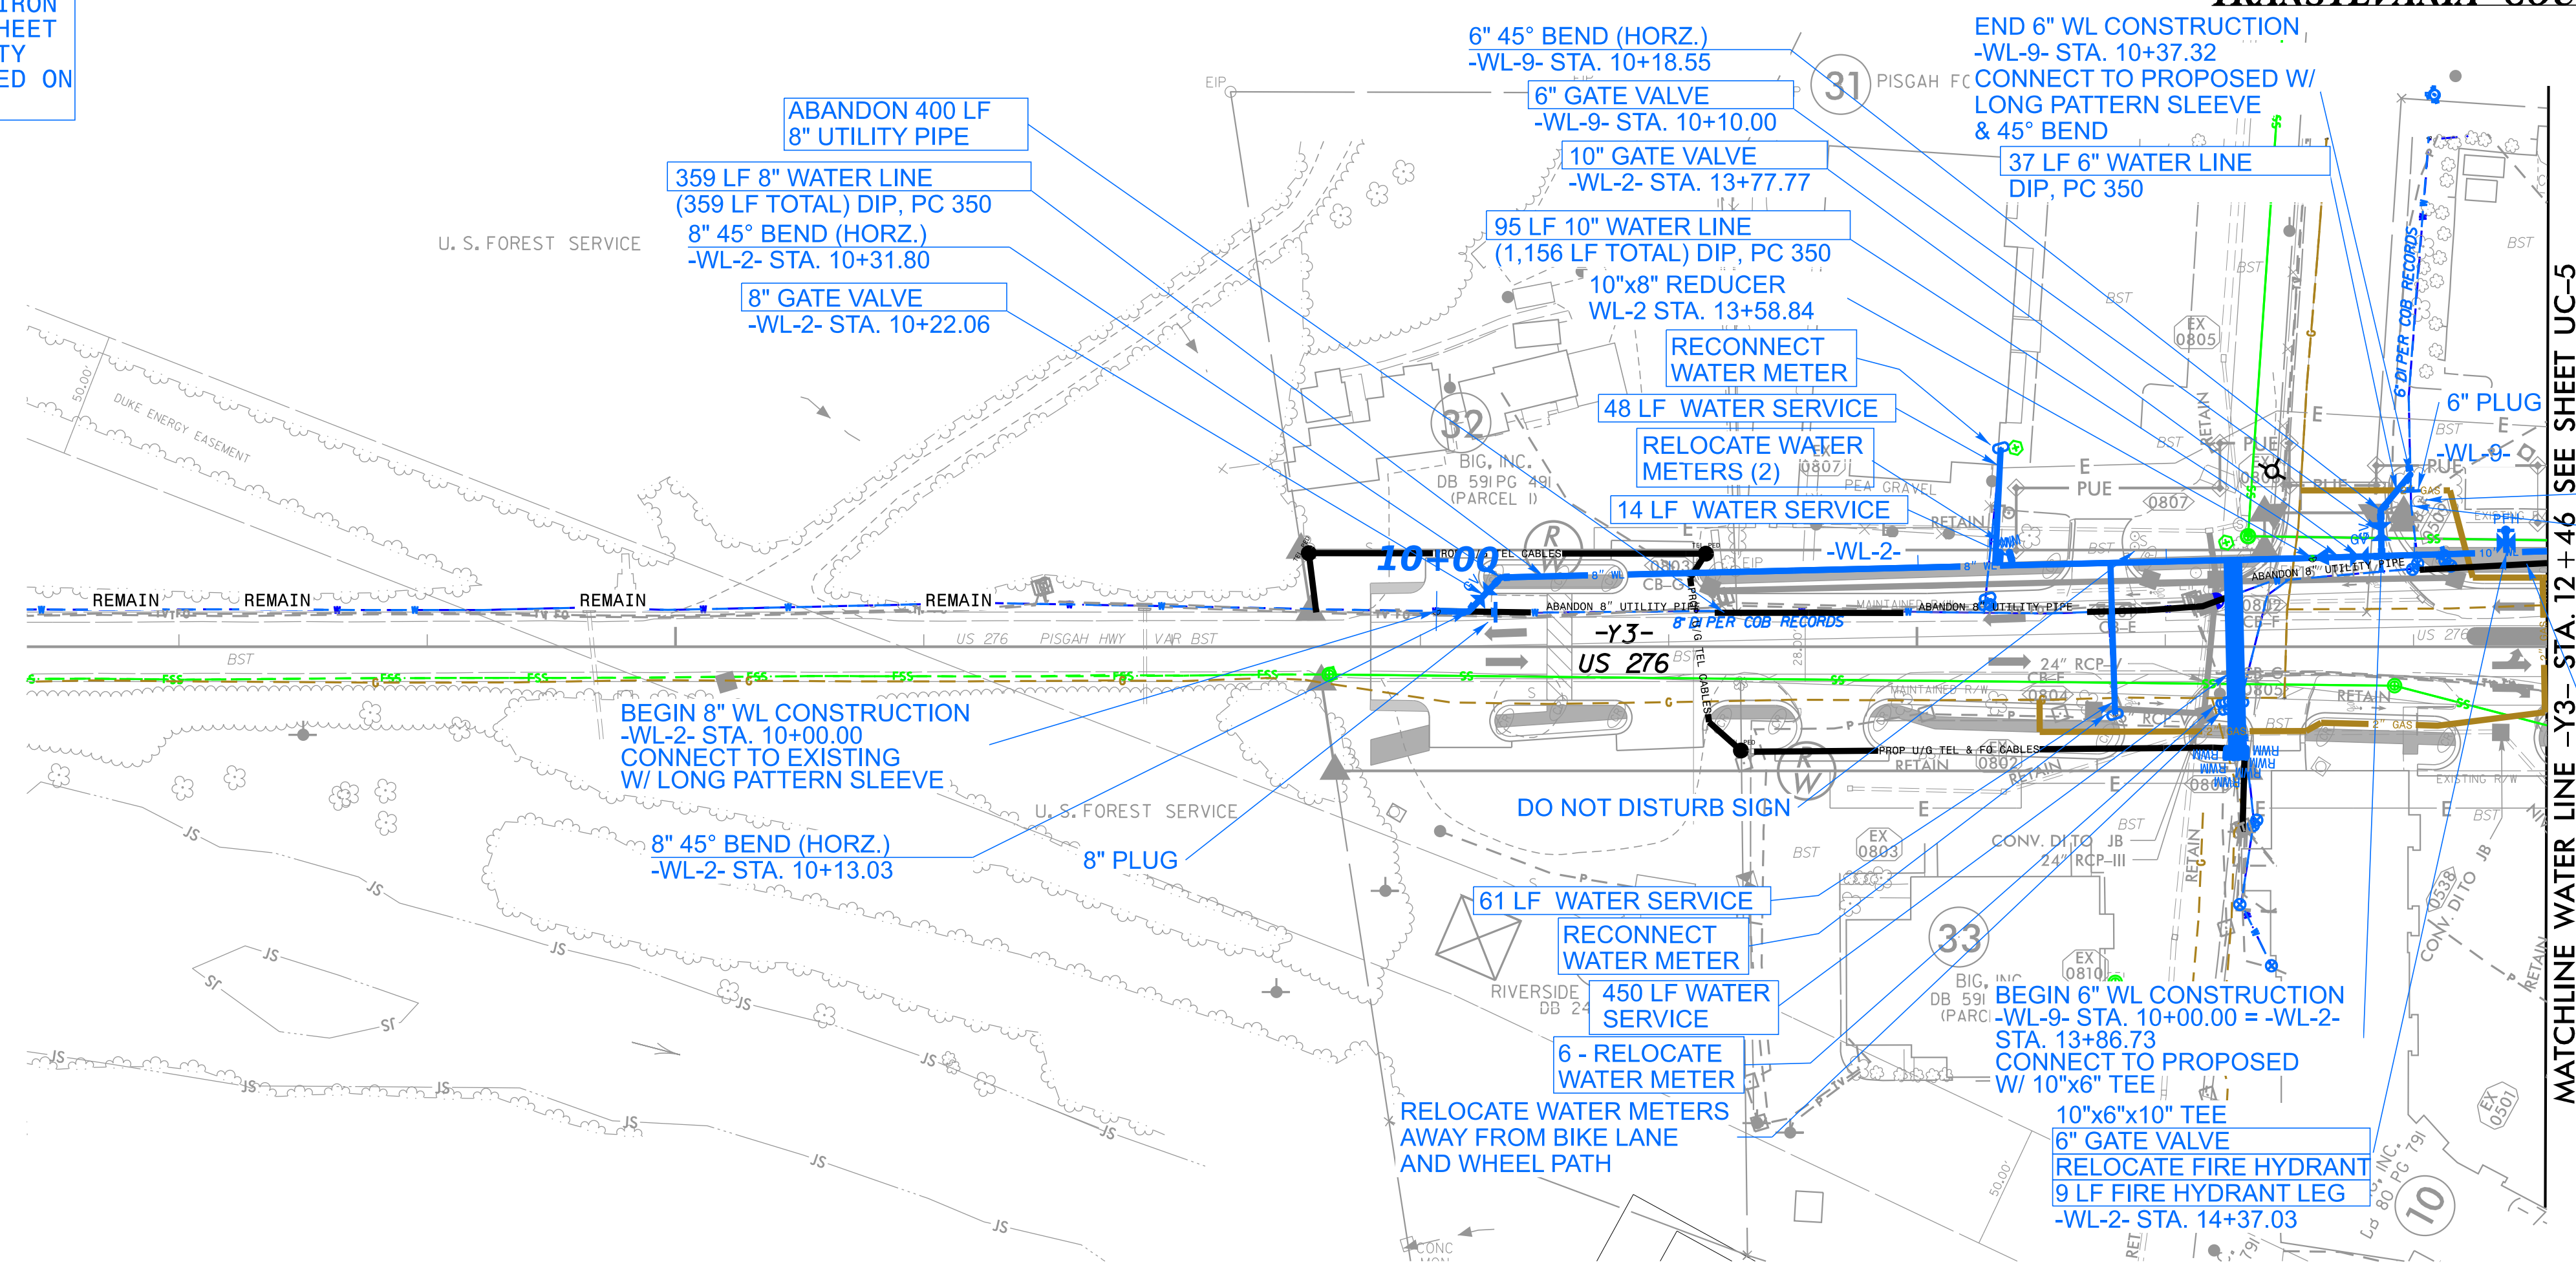

REVISIONS

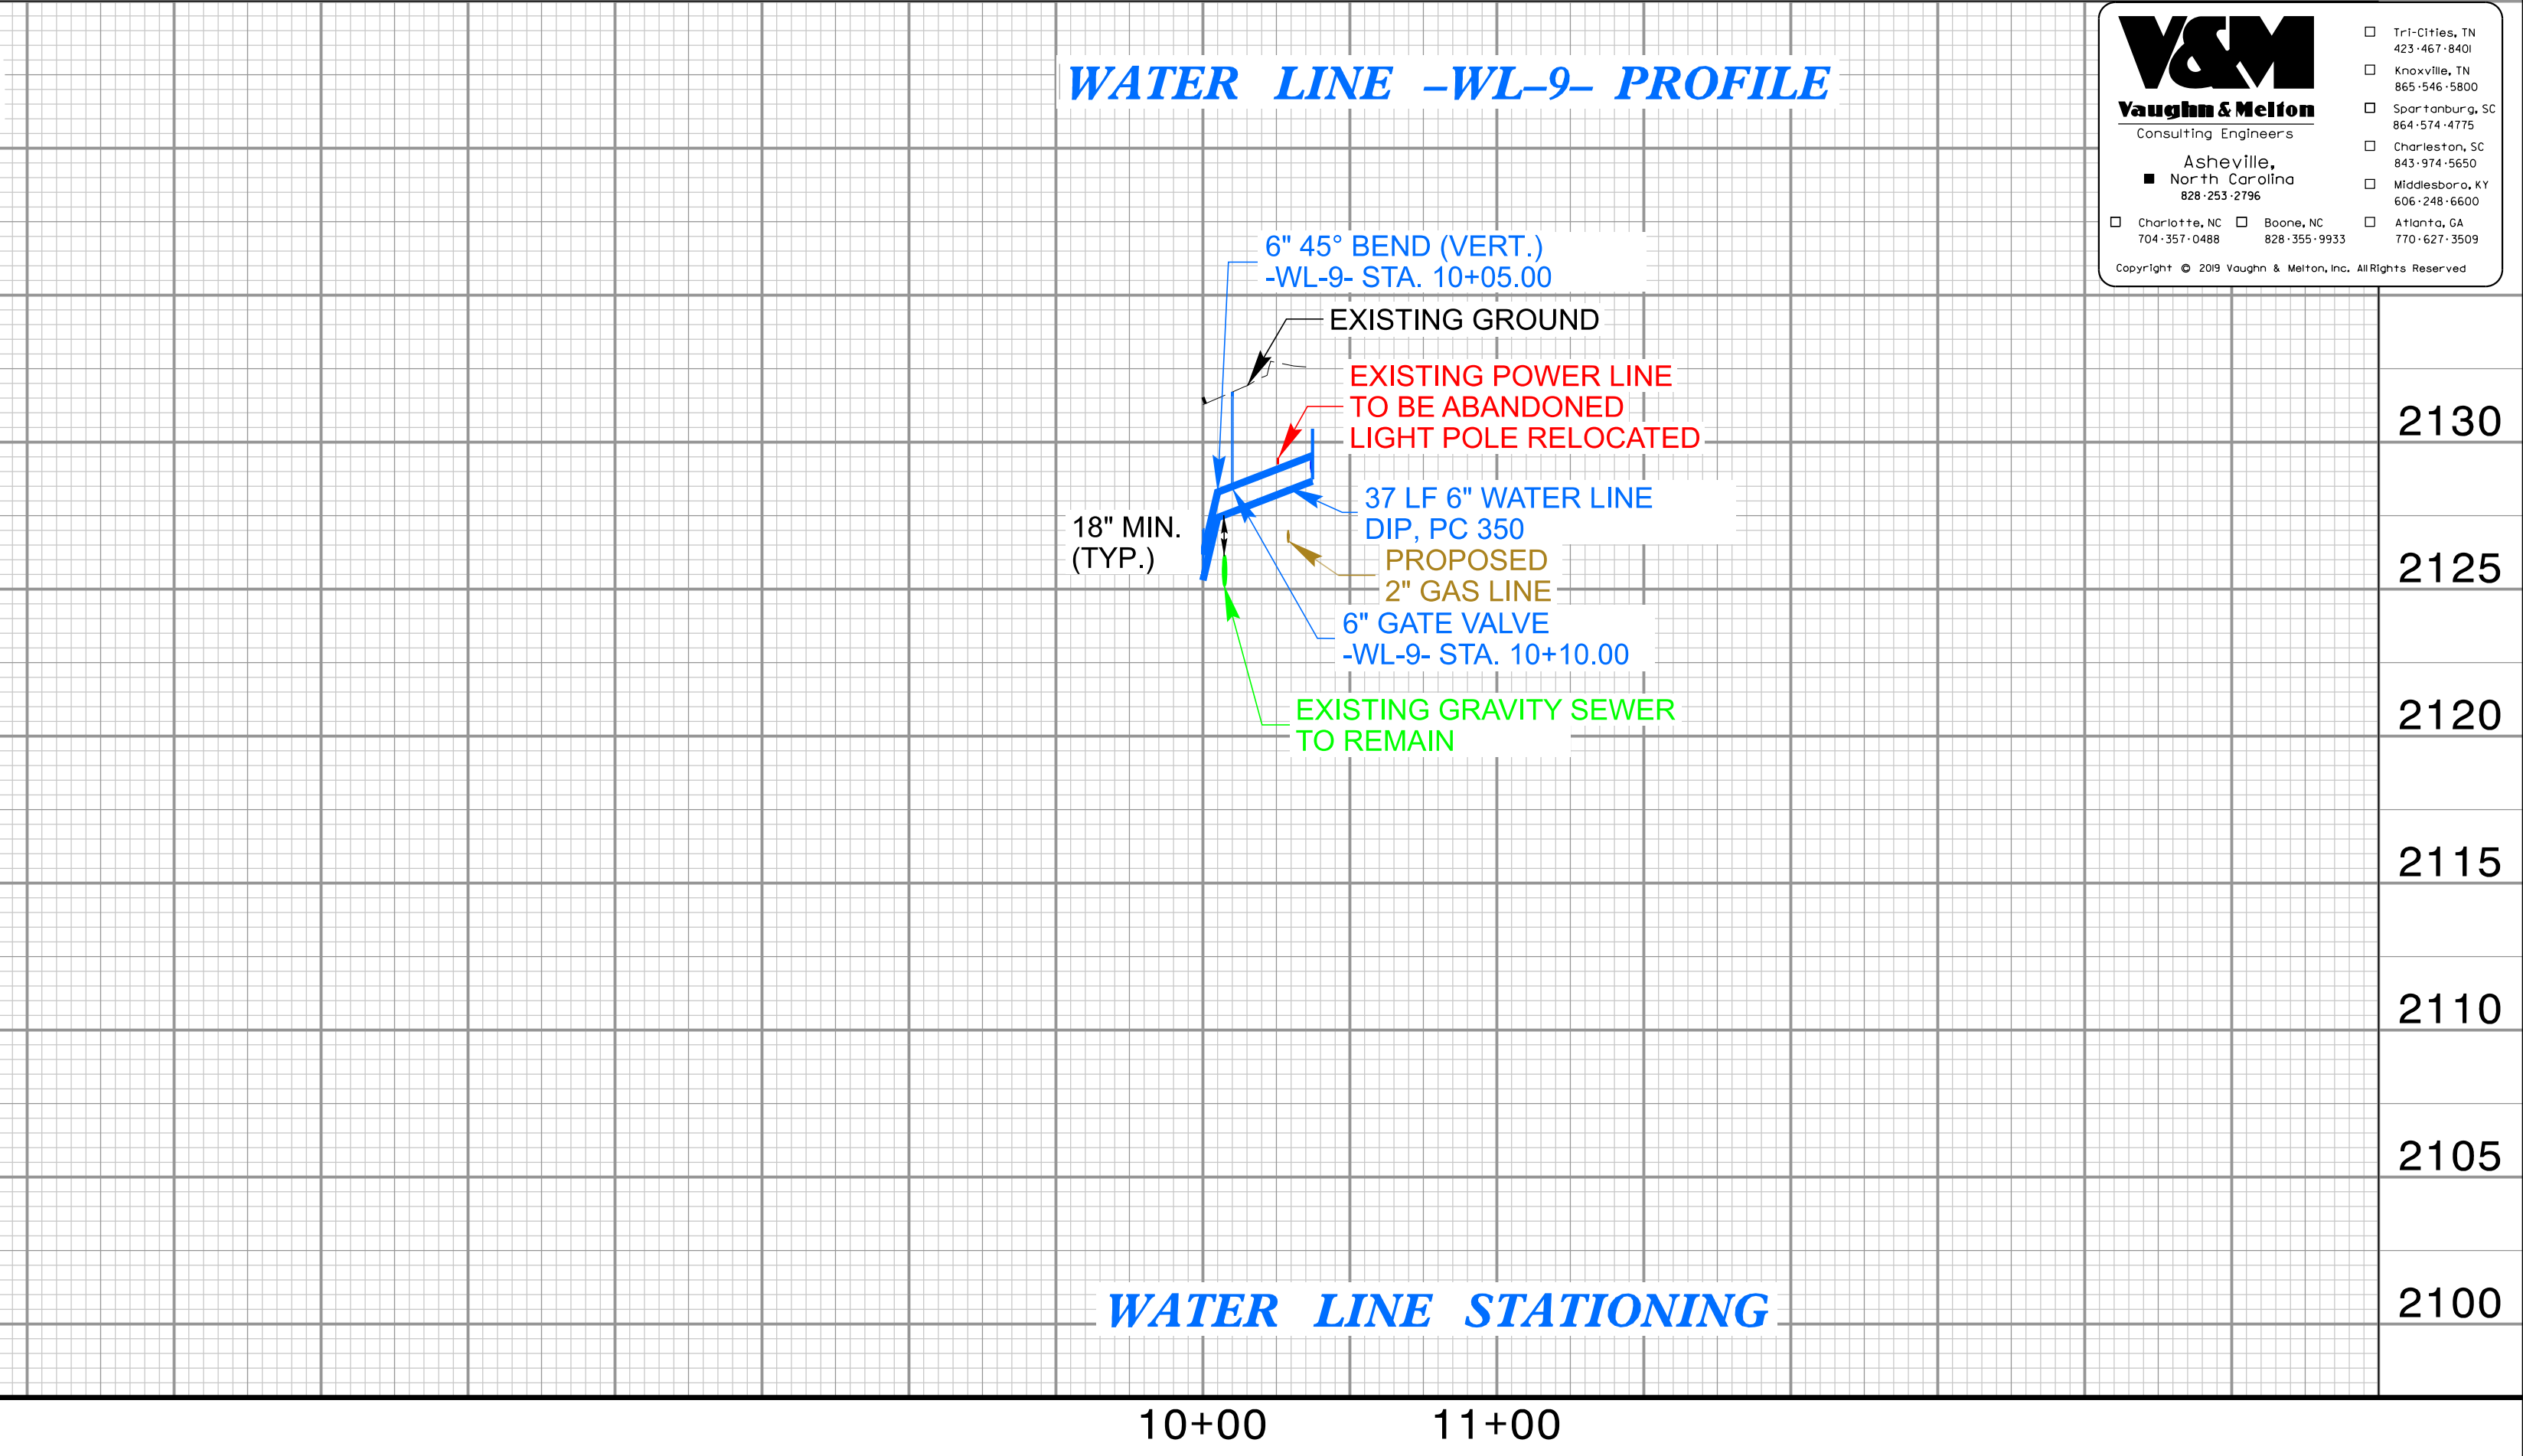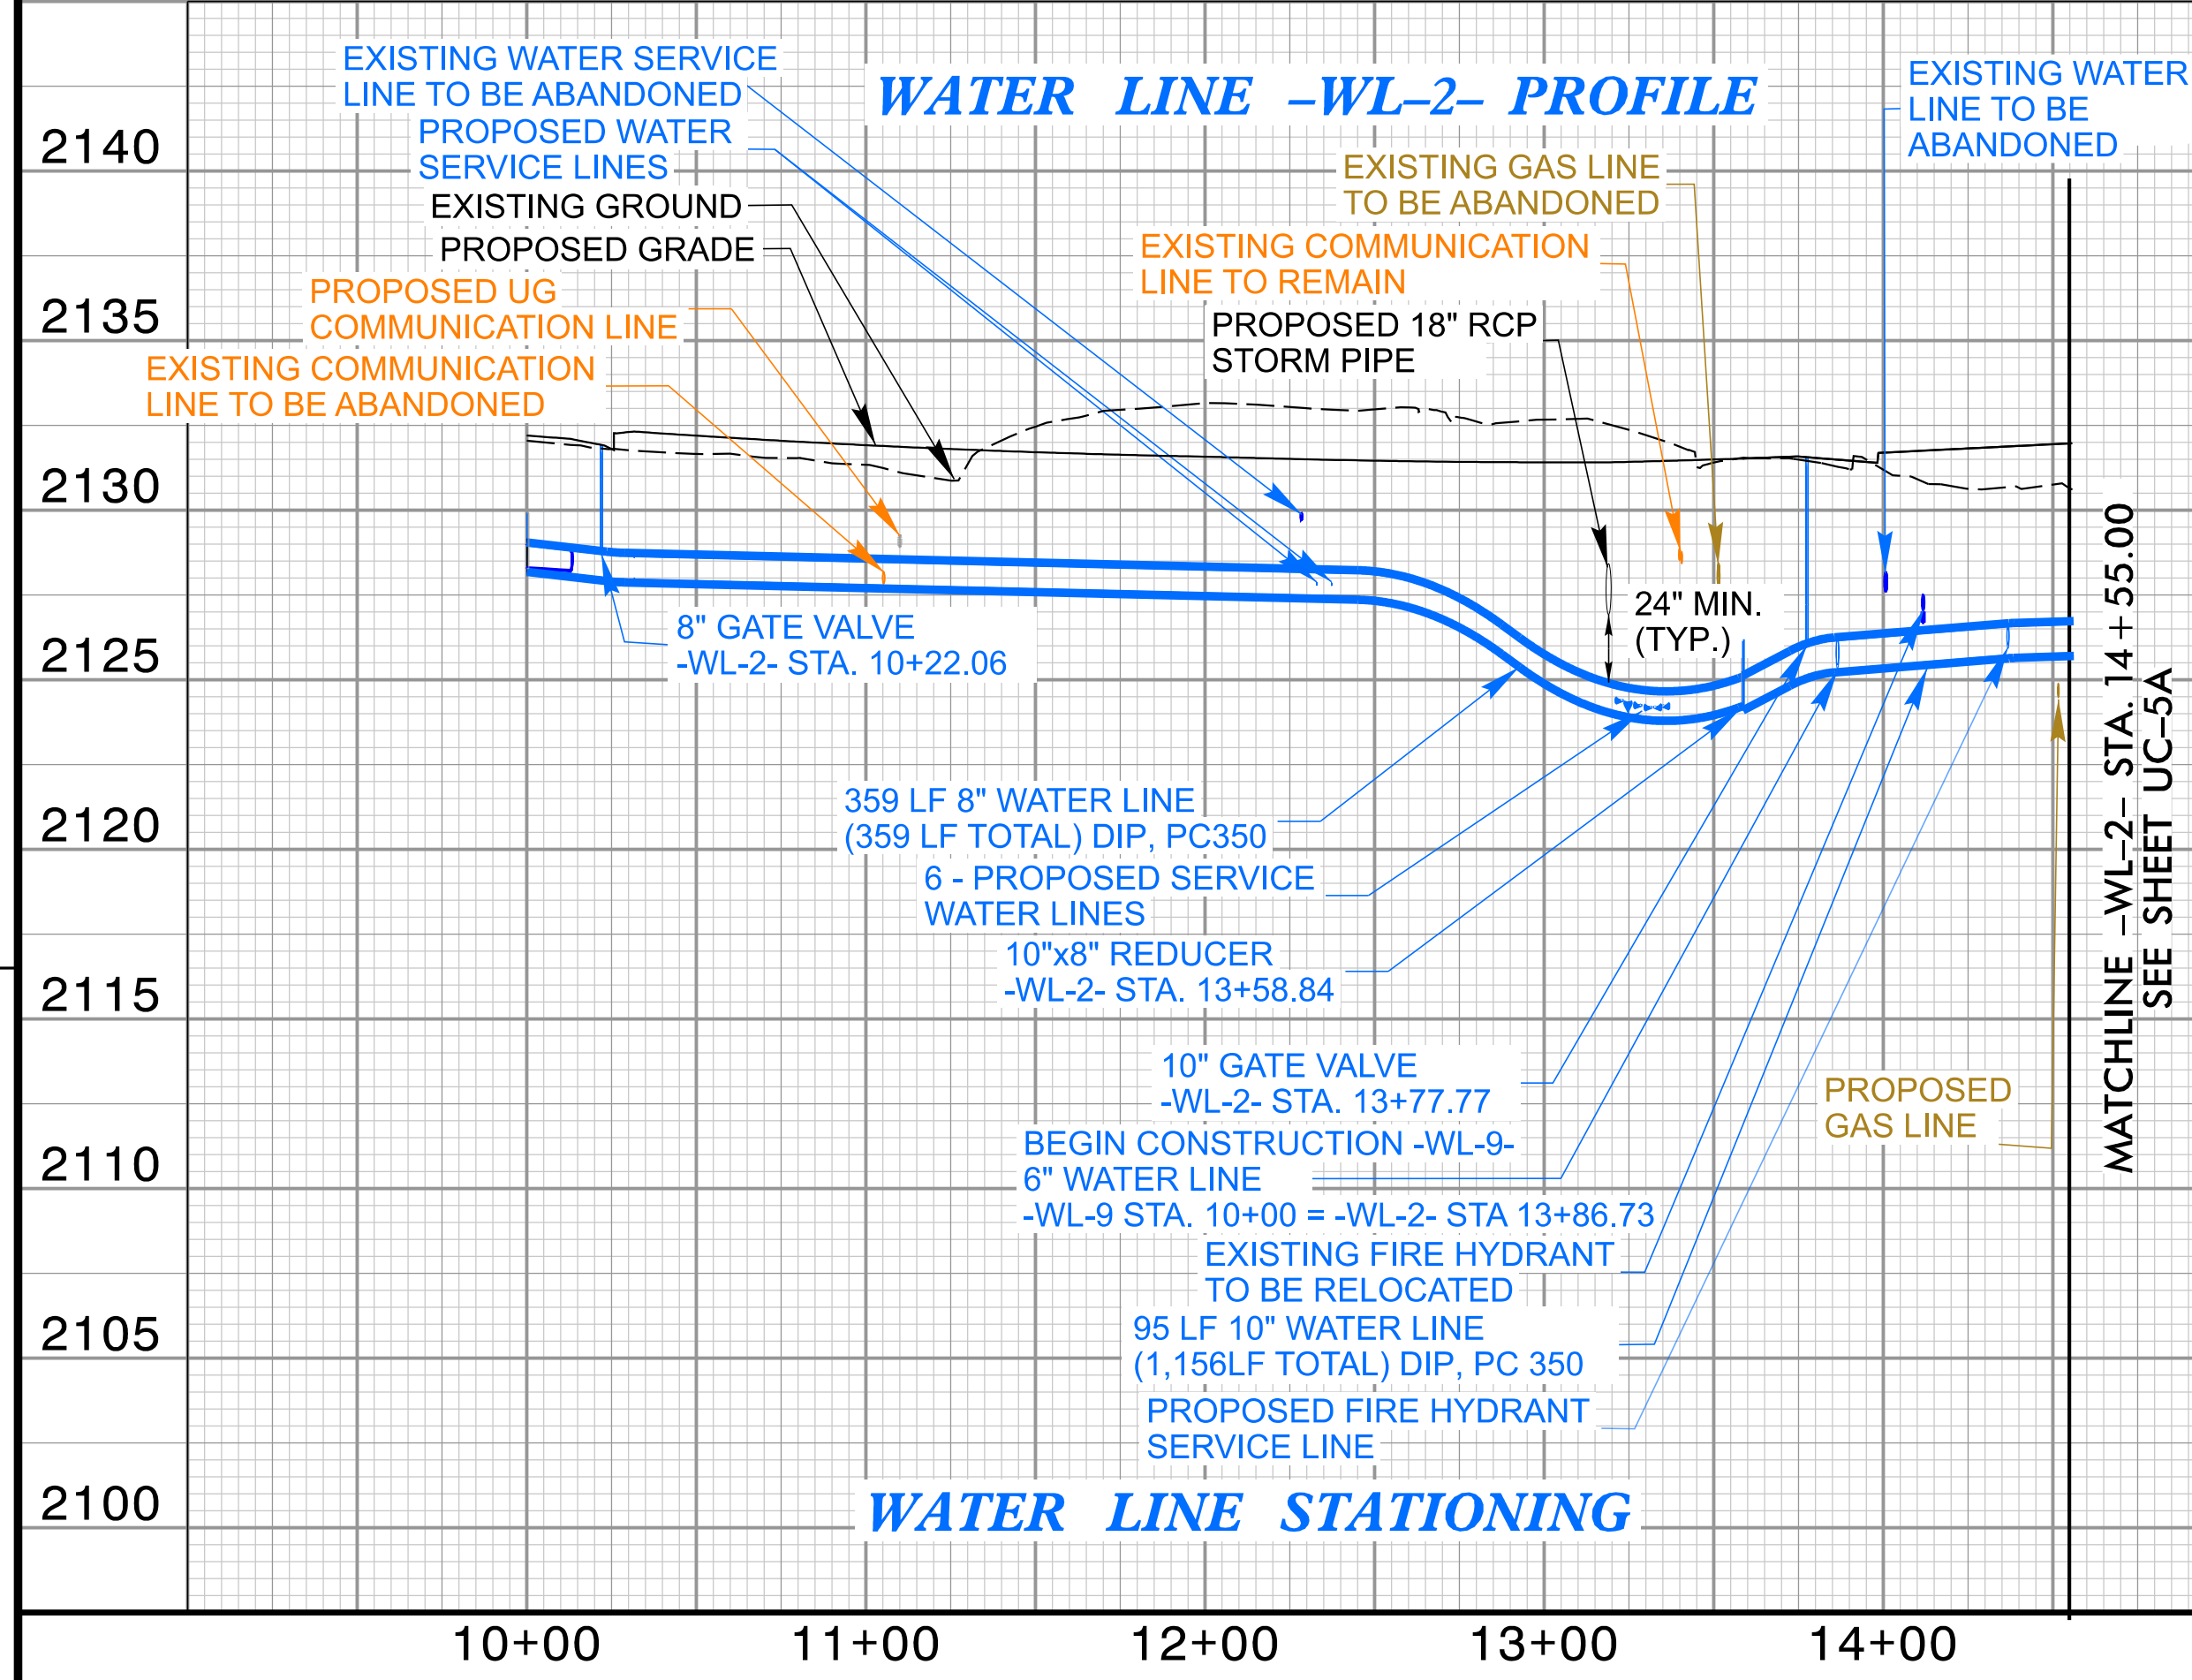

V&M
Vaughn & Melton
Consulting Engineers
Asheville, NC
North Carolina
828-255-2796

Tri-Cities, TN 423-467-9400
 Knoxville, TN 865-546-5800
 Spartanburg, SC 864-574-4775
 Charleston, SC 843-974-5650
 Middleboro, KY 606-248-6600
 Atlanta, GA 770-627-3509
 Charlotte, NC 828-355-9933
 Boone, NC 828-355-9933

Copyright © 2019 Vaughn & Melton, Inc. All Rights Reserved