


NOTES:

1. THE CONTRACTOR SHALL VERIFY EXISTING PIPE SIZE AND MATERIAL AND PROVIDE APPROPRIATE SIZED SLEEVE TO MAKE PROPER CONNECTIONS TO EXISTING PIPE LINES.
2. WHEN CROSSING PIPE LINES UNDER PROPOSED AND/OR EXISTING DITCHES INSURE THAT PIPE LINE WILL HAVE A MINIMUM OF 4' COVER FROM FINISHED GRADE.
3. IF AN ITEM IS NOT CALLED OUT IN A BOX, IT IS INCIDENTAL TO AND INCLUDED IN THE UNIT COST OF THE PIPE LINE.
4. PIPE LINE ABANDONMENT SHALL BE AFTER NEW PIPE LINE HAS BEEN TESTED AND ACCEPTED. PIPE LINE ABANDONMENT SHALL BE IN ACCORDANCE WITH SECTION 1530 OF THE NCDOT STANDARD SPECIFICATIONS FOR ROADS AND STRUCTURES.

- PROP 4' DIA UTILITY MANHOLE
PROP MH SSG-1
LAT 880437.93
LONG 1356119.64
- PROP 4' DIA UTILITY MANHOLE
PROP MH SSG-2
LAT 880453.71
LONG 1355980.41
- PROP 4' DIA UTILITY MANHOLE
PROP MH SSG-3 / SEG 1-2
LAT 880650.21
LONG 1355991.33
- PROP 4' DIA UTILITY MANHOLE
PROP MH SEG1-1
LAT 880650.34
LONG 1355991.49

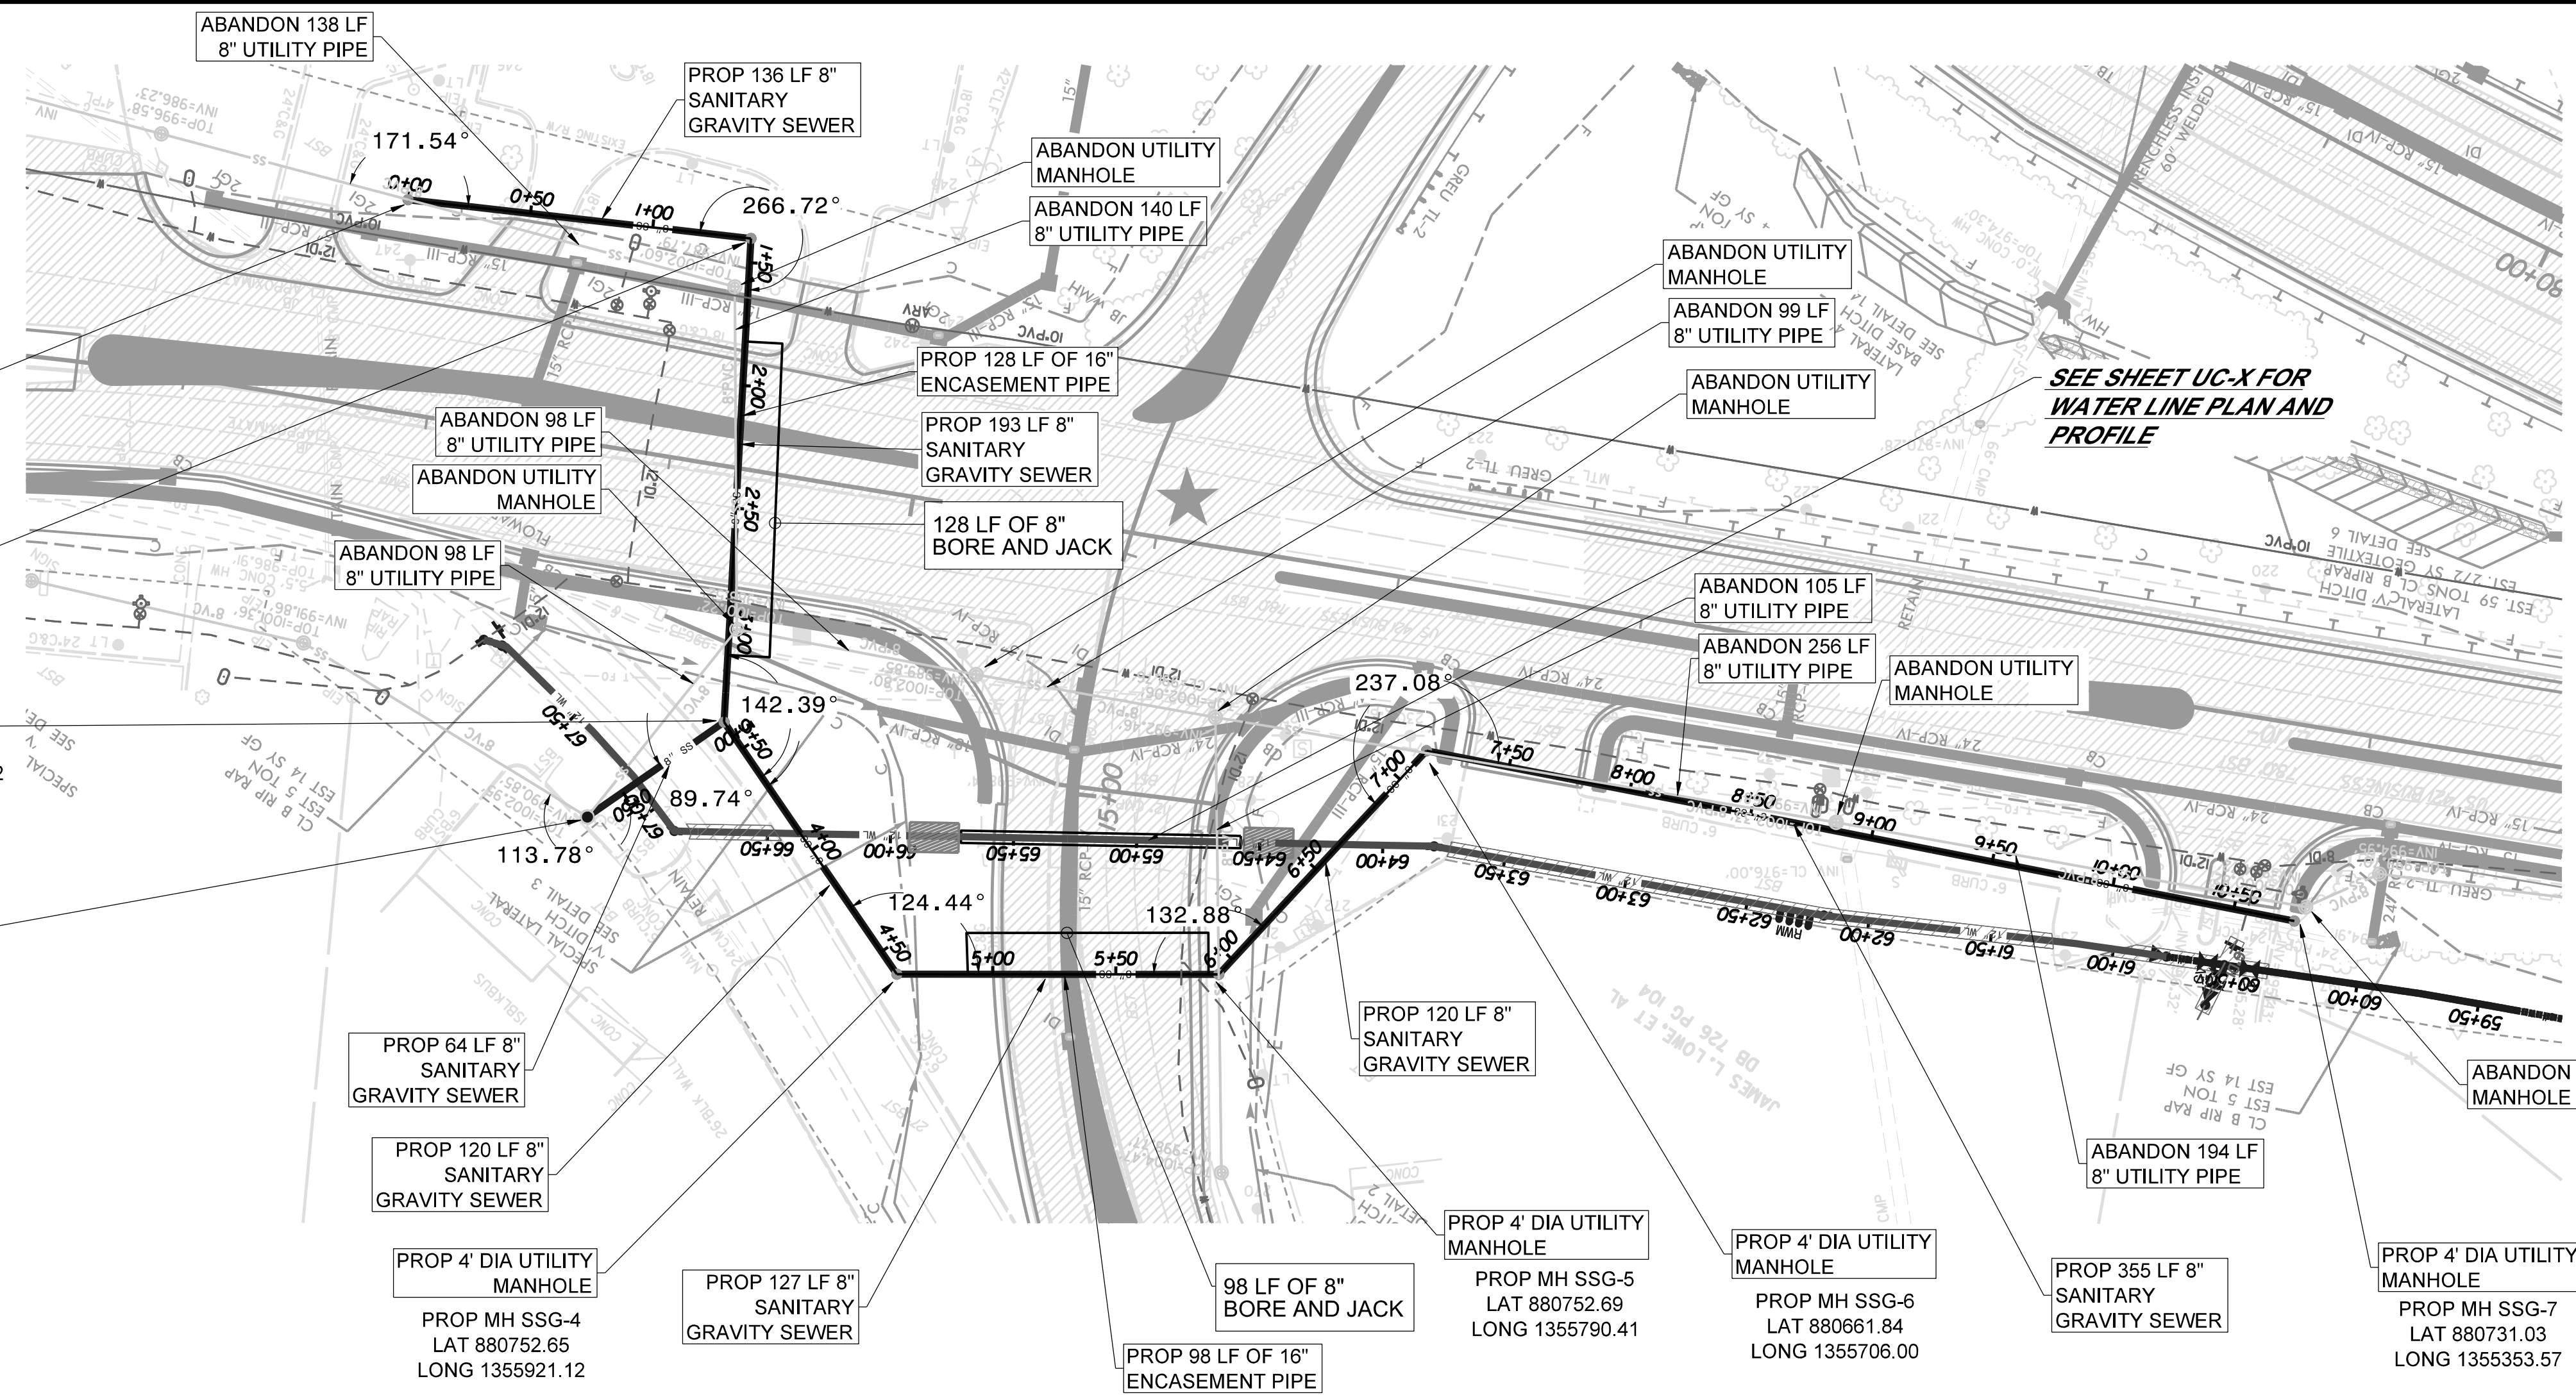

SEE SHEET UC-X FOR WATER LINE PLAN AND PROFILE

PROJECT REFERENCE NO.	SHEET NO.
U-5312	UC-16
DESIGNED BY: B. CLAWSON	
DRAWN BY: R. MOSS	
CHECKED BY: B. CLAWSON	
APPROVED BY:	
REVISER:	
MUNICIPAL ENGINEERING SERVICES COMPANY, PA.	
P.O. BOX 97 GARNER, NC 27529 19191772-5393	UTILITY CONSTRUCTION PLANS ONLY

