



5/14/22

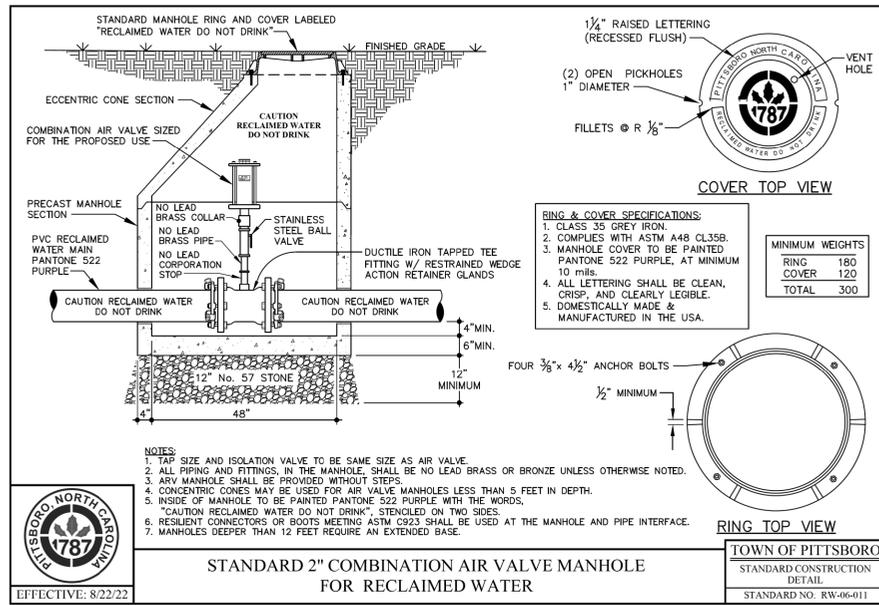

STANDARD 2" COMBINATION AIR VALVE MANHOLE FOR RECLAIMED WATER

TOWN OF PITTSBORO
STANDARD CONSTRUCTION
DETAIL
STANDARD NO. RW-06-011
EFFECTIVE: 8/22/22

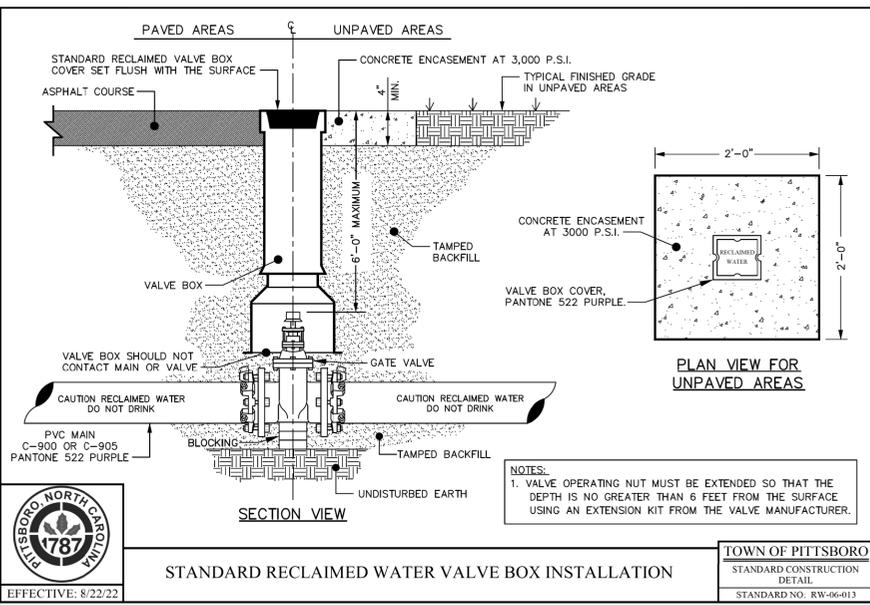


STANDARD RECLAIMED WATER VALVE BOX INSTALLATION

TOWN OF PITTSBORO
STANDARD CONSTRUCTION
DETAIL
STANDARD NO. RW-06-013
EFFECTIVE: 8/22/22

300 MORRIS STREET, SUITE 200
DURHAM, NC 27701


PROJECT REFERENCE NO.	SHEET NO.
R-5963D	UC-3C
DESIGNED BY: NLH	
DRAWN BY: JNB	
CHECKED BY: NDR	
APPROVED BY: NLH	
REVISED:	
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION	
UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151	
UTILITY CONSTRUCTION PLANS ONLY	

UTILITY CONSTRUCTION

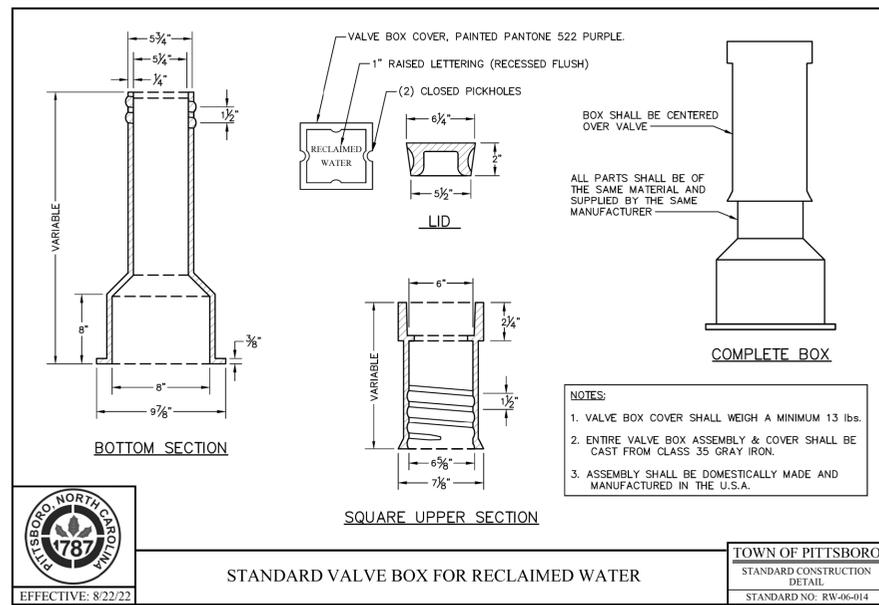


STANDARD VALVE BOX FOR RECLAIMED WATER

TOWN OF PITTSBORO
STANDARD CONSTRUCTION
DETAIL
STANDARD NO. RW-06-014
EFFECTIVE: 8/22/22

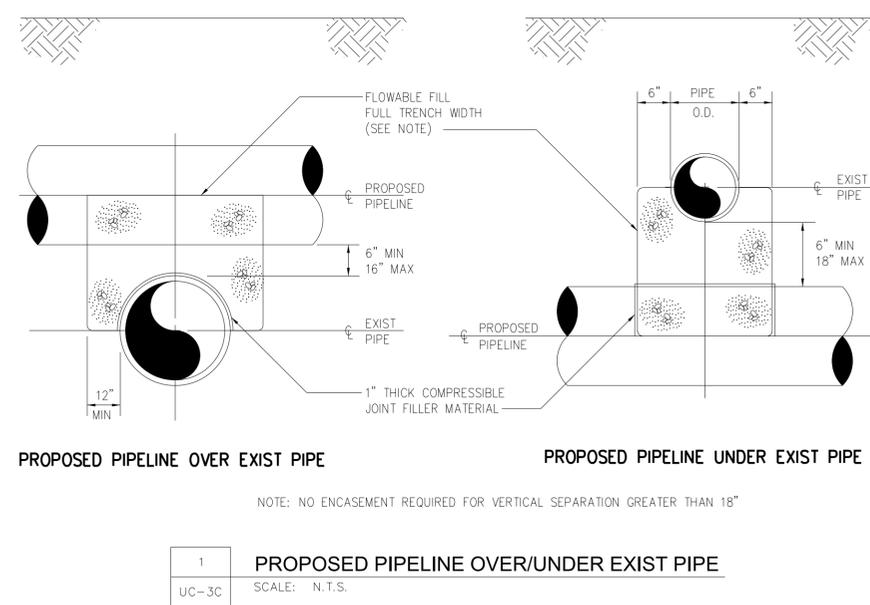


1
UC-3C

PROPOSED PIPELINE OVER/UNDER EXIST PIPE
SCALE: N.T.S.

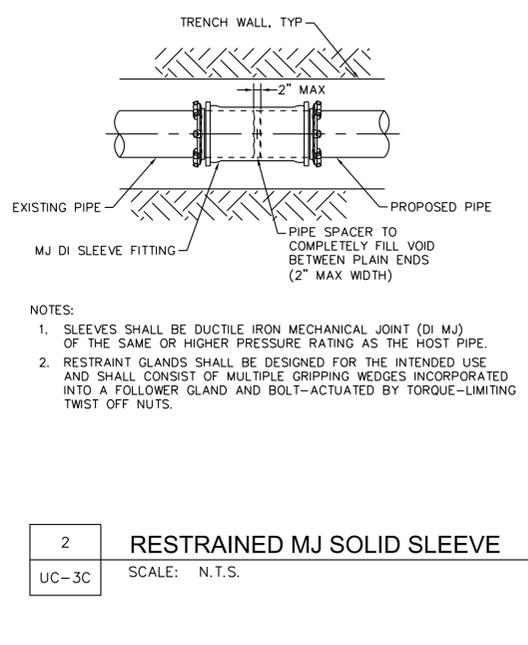


2
UC-3C

RESTRAINED MJ SOLID SLEEVE
SCALE: N.T.S.

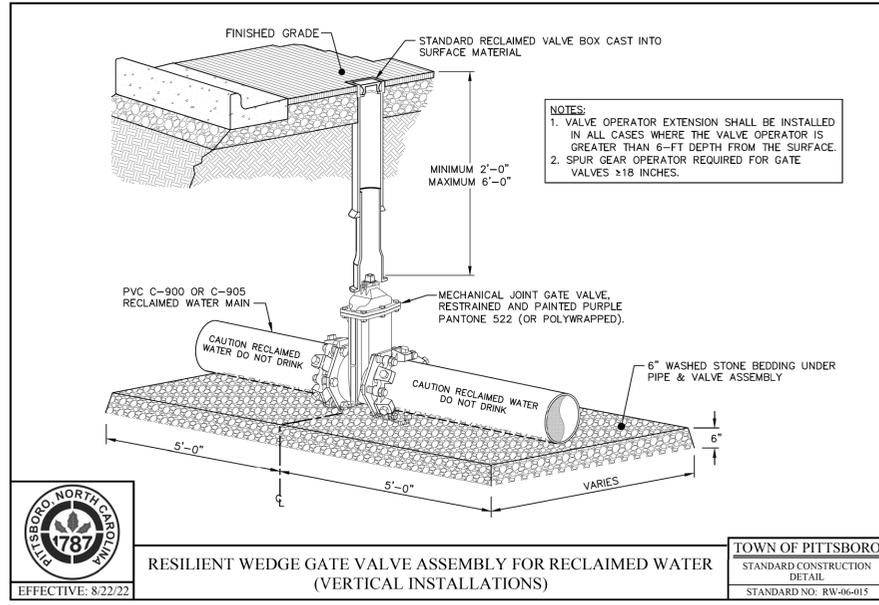

RESILIENT WEDGE GATE VALVE ASSEMBLY FOR RECLAIMED WATER (VERTICAL INSTALLATIONS)

TOWN OF PITTSBORO
STANDARD CONSTRUCTION
DETAIL
STANDARD NO. RW-06-015
EFFECTIVE: 8/22/22

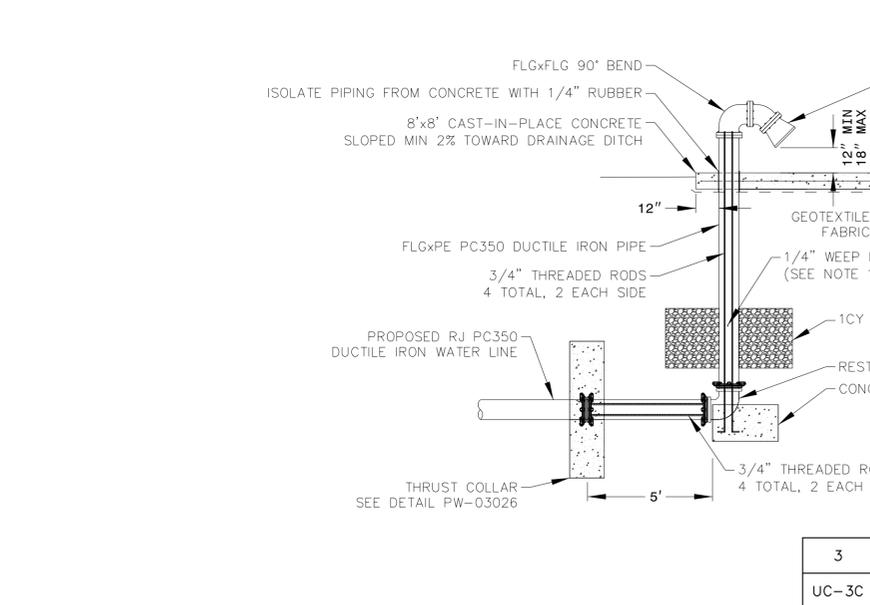

3
UC-3C

10" BLOW OFF
SCALE: N.T.S.

2/16/2024