DocuSign Envelope ID: 74F208B4-8AF7-43F7-89B2-1E8810A97908

5/14/99

NOTES:
1. PROVIDE MINIMUM 12" VERTICAL SEPARATION BETWEEN PROPOSED 4" PVC CASING AND PROPOSED WET UTILITY PIPE.

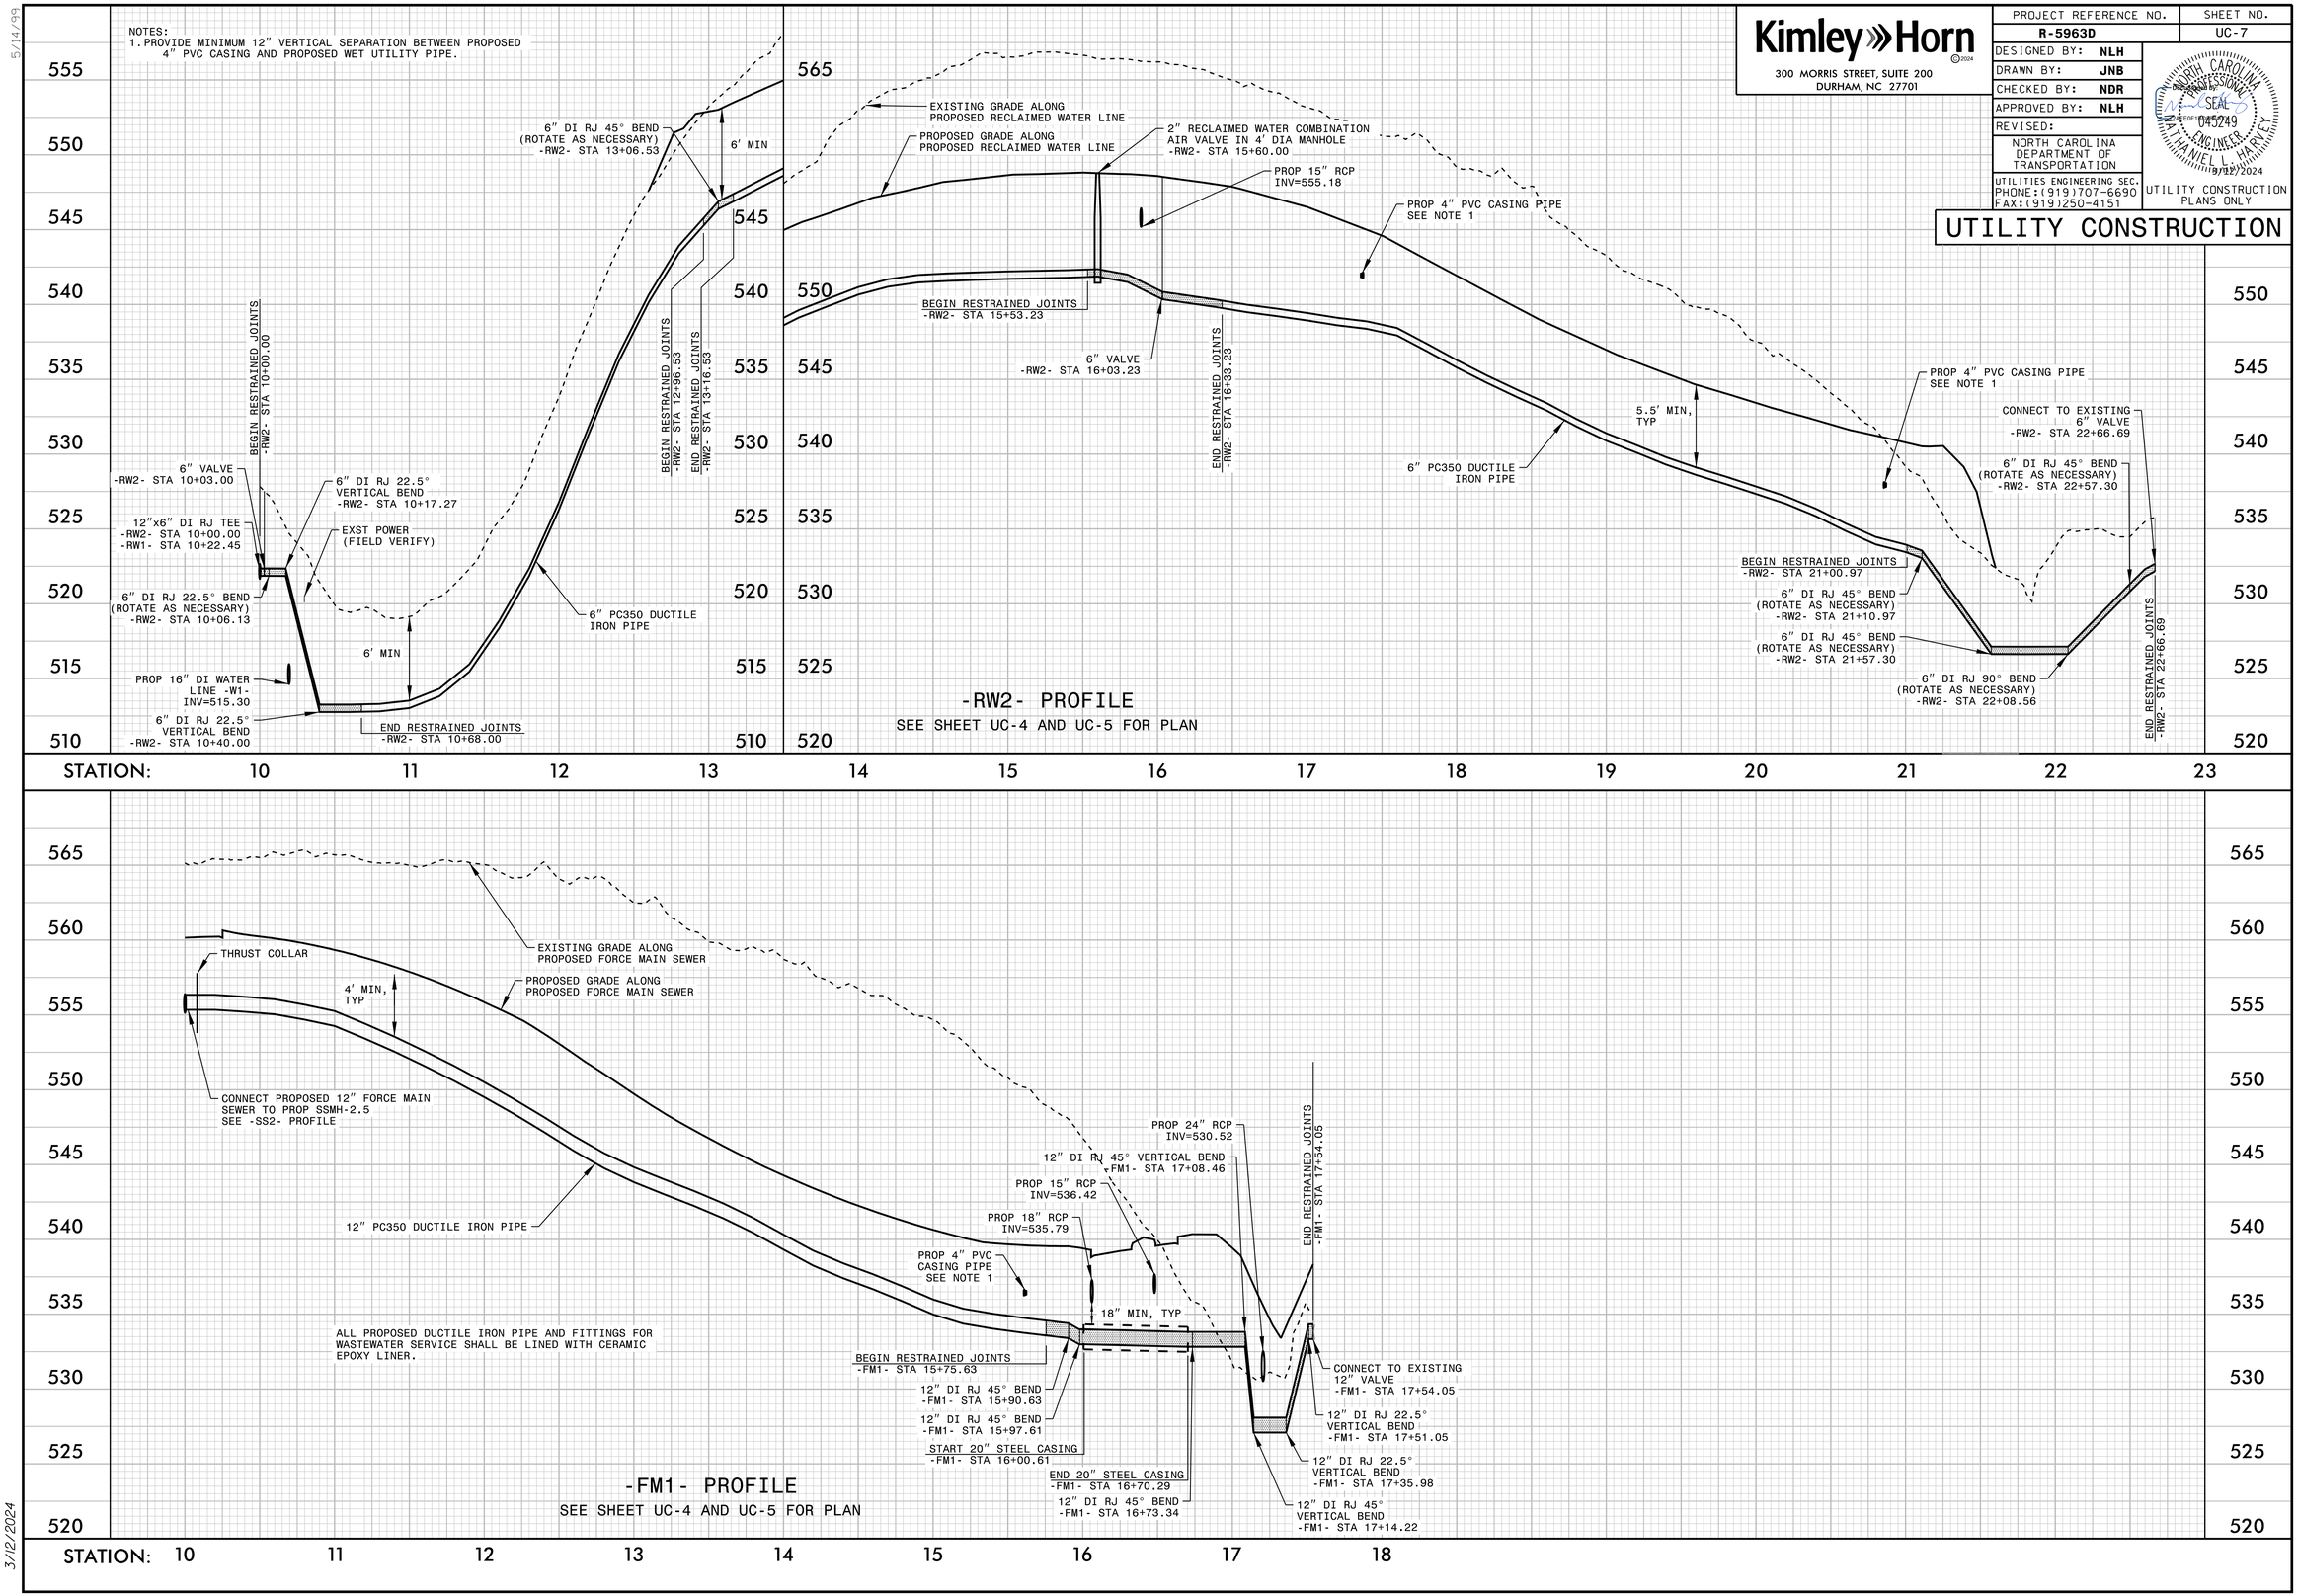

-RW2- PROFILE

SEE SHEET UC-4 AND UC-5 FOR PLAN

-FM1- PROFILE

SEE SHEET UC-4 AND UC-5 FOR PLAN

3/12/2024

Kimley»Horn ©2024
300 MORRIS STREET, SUITE 200
DURHAM, NC 27701

PROJECT REFERENCE NO.	SHEET NO.
R-5963D	UC-7

DESIGNED BY: NLH
DRAWN BY: JNB
CHECKED BY: NDR
APPROVED BY: NLH
REVISED:

NORTH CAROLINA DEPARTMENT OF TRANSPORTATION

UTILITIES ENGINEERING SEC.
PHONE:(919)707-6690
FAX:(919)250-4151

NORTH CAROLINA PROFESSIONAL SEAL 045249 ENGINEER NATHANIEL L. HARVEY
DocuSigned by: 3/12/2024

UTILITY CONSTRUCTION PLANS ONLY

UTILITY CONSTRUCTION