

**NOTES:**

MORTAR JOINTS 1/2" TO 1/4" THICK.

USE CLASS "B" CONCRETE THROUGHOUT.

USE TYPE "E", "F" AND "G" GRATES UNLESS OTHERWISE INDICATED.


USE BRICK OR CONCRETE BLOCK WHICH COMPLIES WITH THE REQUIREMENTS OF SECTION 840 OF THE STANDARD SPECIFICATIONS.

CHAMFER ALL EXPOSED CORNERS 1".

DRAWING NOT TO SCALE.

PROVIDE ALL CATCH BASINS OVER 3'-6" IN DEPTH WITH STEPS 12" ON CENTER. USE STEPS WHICH COMPLY WITH STD. DRAWING 840.66

Q:\AUG-2018 11:56  
 S:\Contracting\Cent595\Special Details\nbritt\english\hydro\840d06\_offset\_boxes.dgn  
 Kempf AT CSD-292596

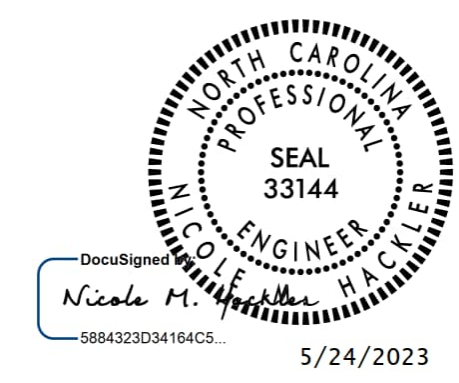

**DOCUMENT NOT CONSIDERED FINAL  
UNLESS ALL SIGNATURES COMPLETED**

**CONTRACT STANDARDS  
AND DEVELOPMENT UNIT**  
Office 919-707-6950 FAX 919-250-4119

**PROPOSED  
OFFSET CATCH BASIN**

ORIGINAL BY:	DATE:
MODIFIED BY: K. KEMPF	DATE: 11/13/15
CHECKED BY:	DATE:
FILE SPEC.: nbritt/english/840d06_offset_boxes.dgn	