



**PLAN**

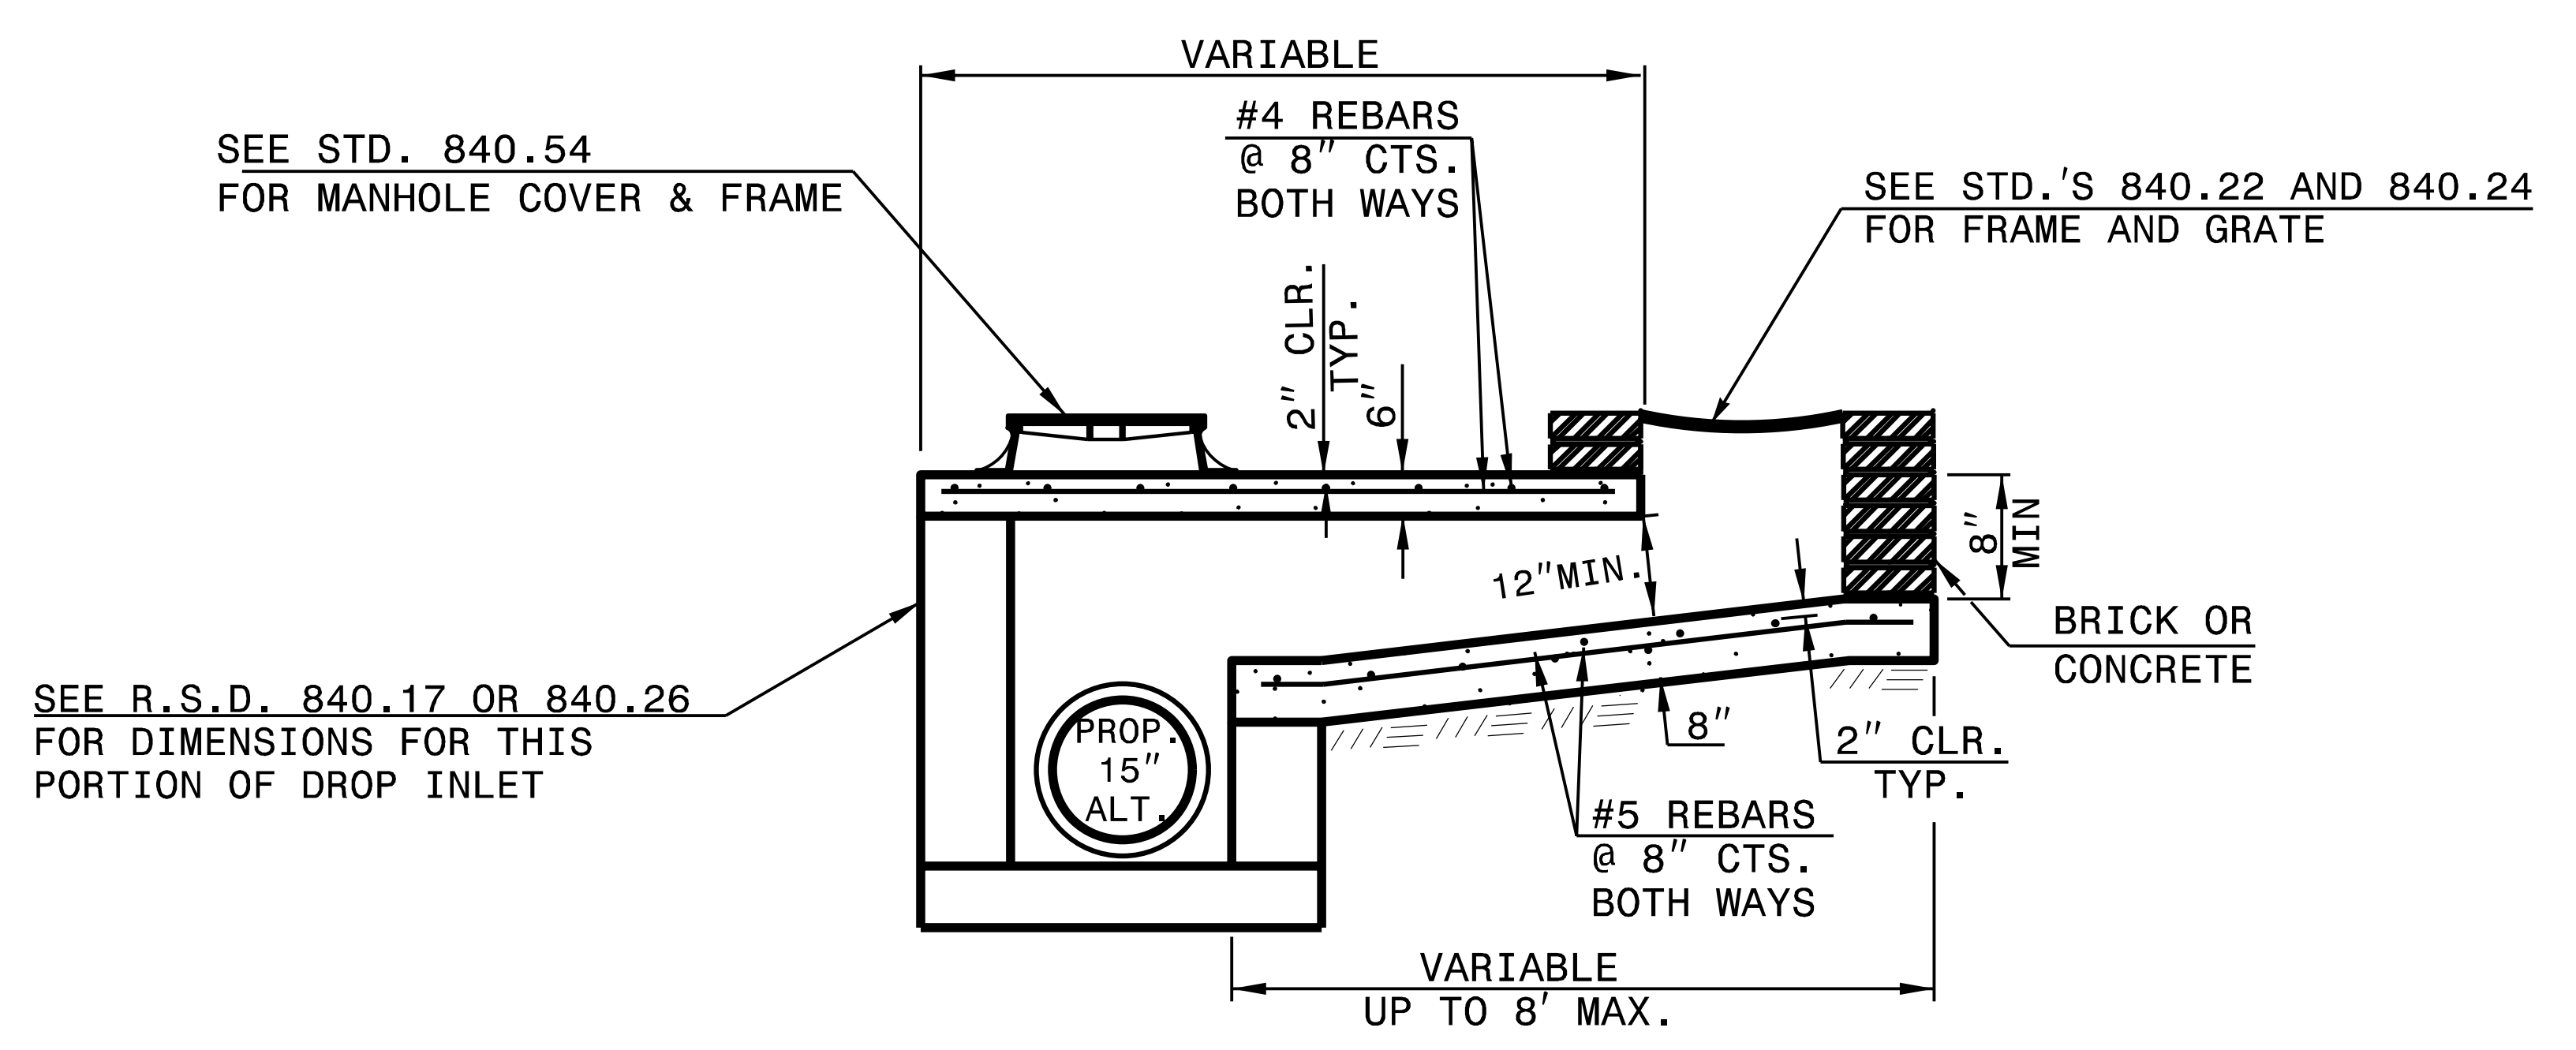

**SECTION X-X**

**NOTES:**  
 MORTAR JOINTS 1/2" TO 1/4" THICK.  
 USE CLASS "B" CONCRETE THROUGHOUT.  
 USE BRICK OR CONCRETE BLOCK WHICH COMPLIES WITH THE REQUIREMENTS OF SECTION 840 OF THE STANDARD SPECIFICATIONS.  
 CHAMFER ALL EXPOSED CORNERS 1".  
 DRAWING NOT TO SCALE.  
 PROVIDE ALL DROP INLET OVER 3'-6" IN DEPTH WITH STEPS 12" ON CENTER. USE STEPS WITH COMPLY WITH STD. DRAWING 840.66

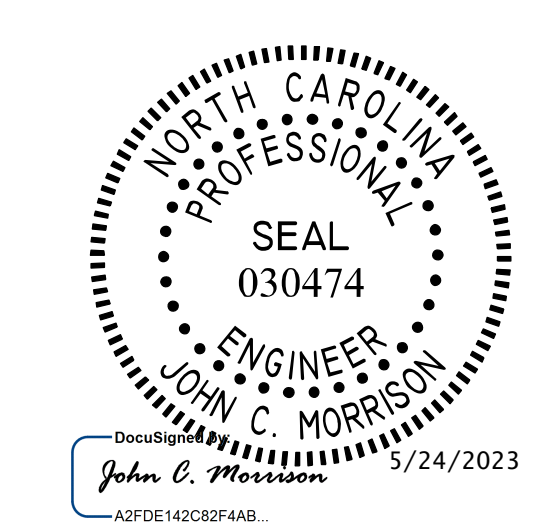

<b>CONTRACT STANDARDS AND DEVELOPMENT UNIT</b>	
Office 919-707-6950 FAX 919-250-4119	
<b>PROPOSED OFFSET DROP INLET</b>	
ORIGINAL BY: _____	DATE: _____
MODIFIED BY: <u>Karen Sloan</u>	DATE: <u>1/27/2023</u>
CHECKED BY: <u>Casey Morrison</u>	DATE: <u>1/27/2023</u>
FILE SPEC.: _____	

I:\30\2023\Nra\agcommet.com\1Fs\AMER\Rel\High-USRAL3\Legacy\Projects\60436195-B-4654\900\_Work\910\_CAD\70\_NCDOT\_TIP\Drainage\Special\_Details\100\_051\_B4654\_RDY\_FP\_PSH02D-2.dgn  
 Karen Sloan