

Prepared In the Office of:



AECOM TECHNICAL SERVICES OF NORTH CAROLINA, INC.  
5438 WADE PARK BLVD, SUITE 200, RALEIGH, NC 27607  
919-461-1100  
F - 0342

DOCUMENT NOT CONSIDERED FINAL  
UNLESS ALL SIGNATURES COMPLETED




PROJECT REFERENCE NO. B-4654 SHEET NO. UC-6

DESIGNED BY:	1/16/2024
DRAWN BY:	
CHECKED BY:	
APPROVED BY:	
REVISED:	
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION	
UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151	



D. Stephen Scruggs  
UTILITY CONSTRUCTION  
PLANS ONLY

# UTILITY CONSTRUCTION

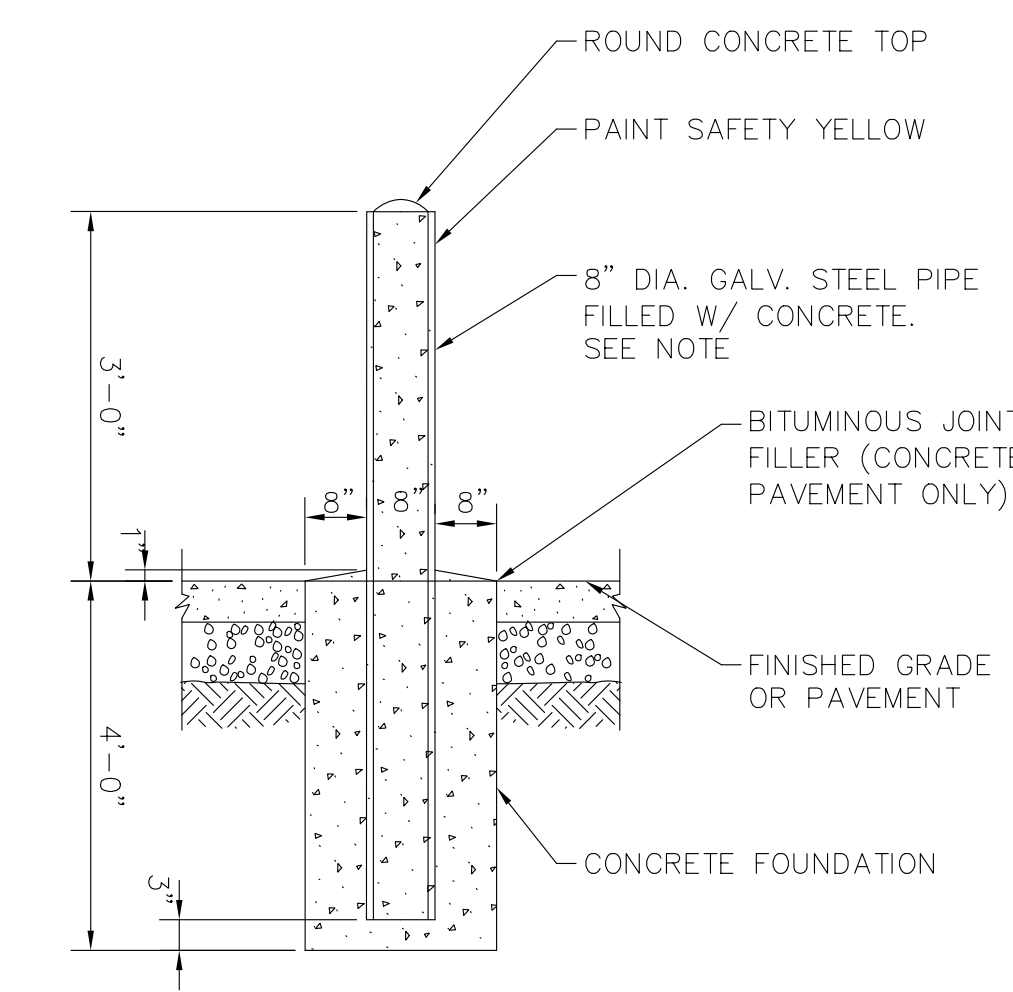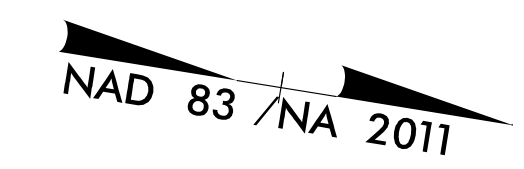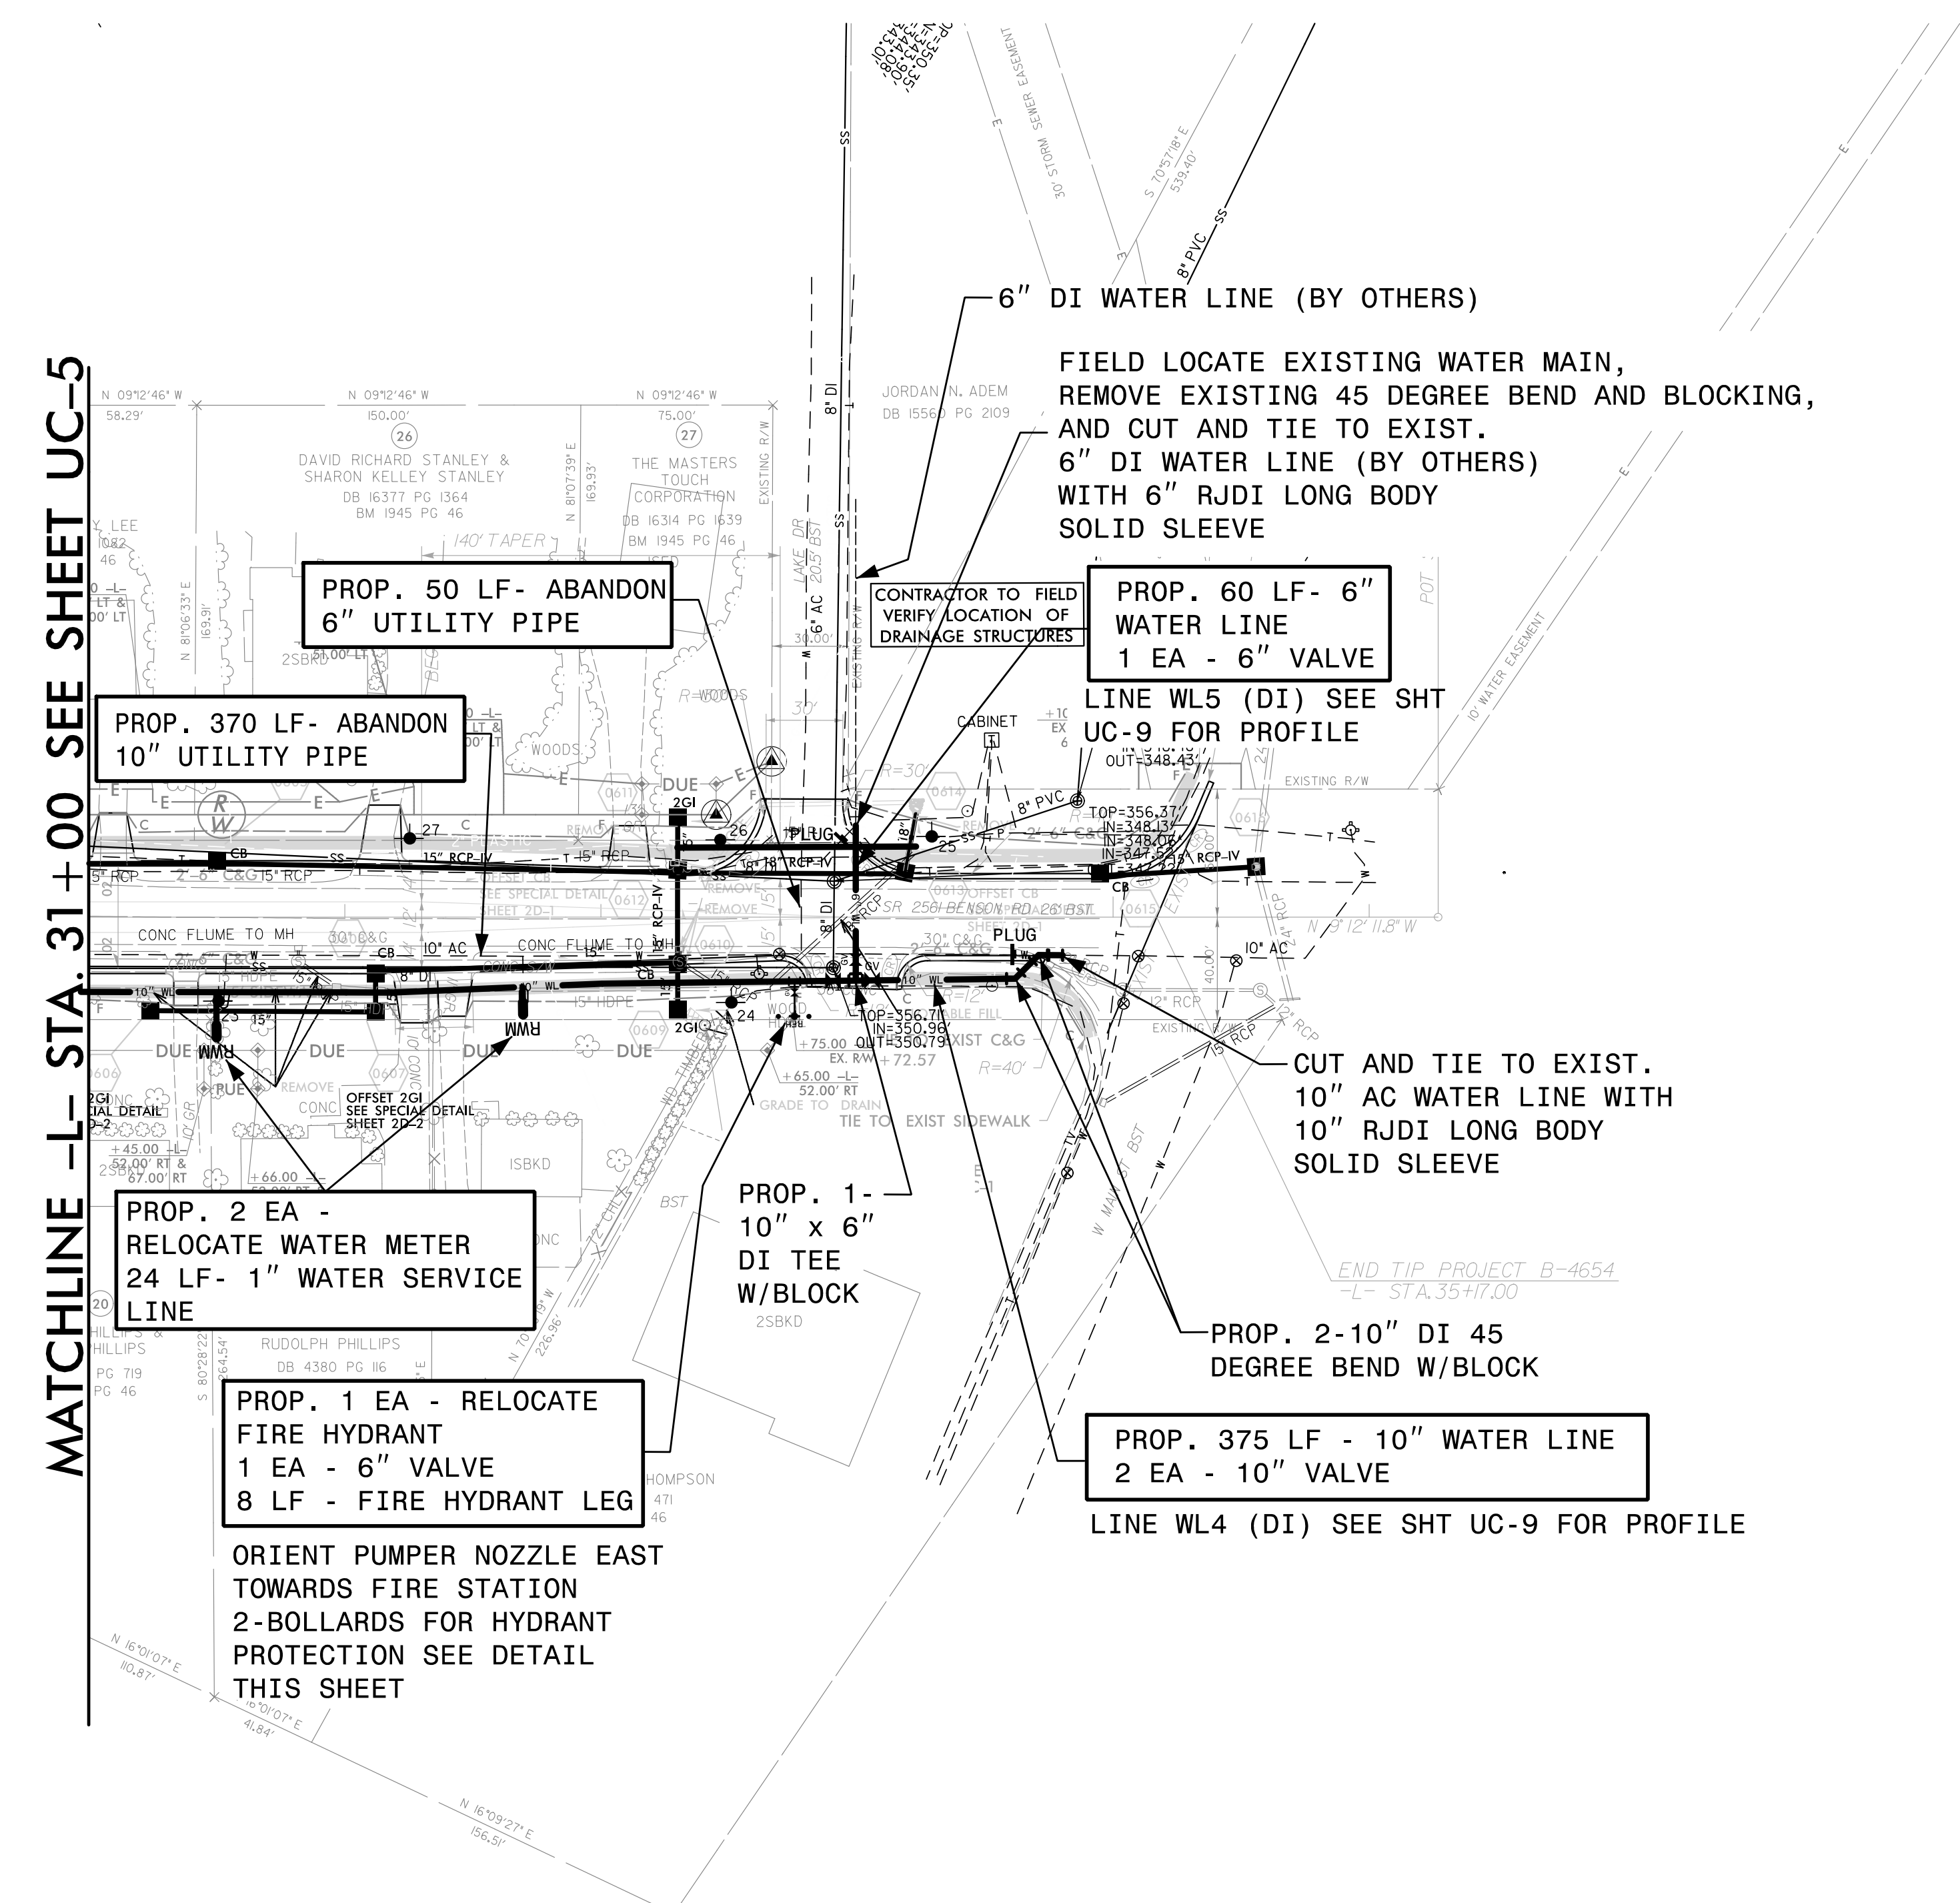

BOLLARD DETAIL

NOTE:  
STEEL PIPE SHALL BE GALVANIZED (2.0 OZ. ZINC/SQ. FT.) AND HAVE A MINIMUM THICKNESS OF 0.322 INCHES

THE ESTIMATED QUANTITY OF DUCTILE IRON WATER PIPE FITTINGS ON THIS PLAN SHEET IS 1080 LB. THE ACTUAL QUANTITY AND TYPE OF FITTINGS WILL VARY BASED ON FIELD CONDITIONS.

MATCHLINE -L- STA. 31+00 SEE SHEET UC-5