

REFERENCE: I-2513AA

PROJECT: 34165

**CONTENTS**

<u>SHEET NO.</u>	<u>DESCRIPTION</u>
1	TITLE SHEET
2	LEGENDS
3	SITE PLAN
4	PROFILE
5-7	BORE LOGS

**STATE OF NORTH CAROLINA**  
 DEPARTMENT OF TRANSPORTATION  
 DIVISION OF HIGHWAYS  
 GEOTECHNICAL ENGINEERING UNIT

**STRUCTURE**  
**SUBSURFACE INVESTIGATION**

COUNTY BUNCOMBE  
 PROJECT DESCRIPTION I-40 FROM EAST OF SR 1224  
(MONTE VISTA RD) TO PAVEMENT JOINT WEST  
OF SR 3412 (SAND HILL RD). INCLUDES INITIAL  
IMPROVEMENTS AT I-40EB TO I-26EB AT US 19/23  
(SMOKEY PARK HIGHWAY)  
 SITE DESCRIPTION RETAINING WALL NO. W601, FROM  
-Y5RPA- STATION 22+00.00, 25.50' LT TO -Y5RPA-  
STATION 26+60.00, 25.50' LT

STATE	STATE PROJECT REFERENCE NO.	SHEET NO.	TOTAL SHEETS
N.C.	I-2513AA	1	7

**CAUTION NOTICE**

THE SUBSURFACE INFORMATION AND THE SUBSURFACE INVESTIGATION ON WHICH IT IS BASED WERE MADE FOR THE PURPOSE OF STUDY, PLANNING AND DESIGN, AND NOT FOR CONSTRUCTION OR PAY PURPOSES. THE VARIOUS FIELD BORING LOGS, ROCK CORES AND SOIL TEST DATA AVAILABLE MAY BE REVIEWED OR INSPECTED IN RALEIGH BY CONTACTING THE N. C. DEPARTMENT OF TRANSPORTATION, GEOTECHNICAL ENGINEERING UNIT AT (919) 707-6850. THE SUBSURFACE PLANS AND REPORTS, FIELD BORING LOGS, ROCK CORES AND SOIL TEST DATA ARE NOT PART OF THE CONTRACT.

GENERAL SOIL AND ROCK STRATA DESCRIPTIONS AND INDICATED BOUNDARIES ARE BASED ON A GEOTECHNICAL INTERPRETATION OF ALL AVAILABLE SUBSURFACE DATA AND MAY NOT NECESSARILY REFLECT THE ACTUAL SUBSURFACE CONDITIONS BETWEEN BORINGS OR BETWEEN SAMPLED STRATA WITHIN THE BOREHOLE. THE LABORATORY SAMPLE DATA AND THE IN SITU (IN-PLACE) TEST DATA CAN BE RELIED ON ONLY TO THE DEGREE OF RELIABILITY INHERENT IN THE STANDARD TEST METHOD. THE OBSERVED WATER LEVELS OR SOIL MOISTURE CONDITIONS INDICATED IN THE SUBSURFACE INVESTIGATIONS ARE AS RECORDED AT THE TIME OF THE INVESTIGATION. THESE WATER LEVELS OR SOIL MOISTURE CONDITIONS MAY VARY CONSIDERABLY WITH TIME ACCORDING TO CLIMATIC CONDITIONS INCLUDING TEMPERATURES, PRECIPITATION AND WIND, AS WELL AS OTHER NON-CLIMATIC FACTORS.

THE BIDDER OR CONTRACTOR IS CAUTIONED THAT DETAILS SHOWN ON THE SUBSURFACE PLANS ARE PRELIMINARY ONLY AND IN MANY CASES THE FINAL DESIGN DETAILS ARE DIFFERENT. FOR BIDDING AND CONSTRUCTION PURPOSES, REFER TO THE CONSTRUCTION PLANS AND DOCUMENTS FOR FINAL DESIGN INFORMATION ON THIS PROJECT. THE DEPARTMENT DOES NOT WARRANT OR GUARANTEE THE SUFFICIENCY OR ACCURACY OF THE INVESTIGATION MADE, NOR THE INTERPRETATIONS MADE, OR OPINION OF THE DEPARTMENT AS TO THE TYPE OF MATERIALS AND CONDITIONS TO BE ENCOUNTERED. THE BIDDER OR CONTRACTOR IS CAUTIONED TO MAKE SUCH INDEPENDENT SUBSURFACE INVESTIGATIONS AS HE DEEMS NECESSARY TO SATISFY HIMSELF AS TO CONDITIONS TO BE ENCOUNTERED ON THE PROJECT. THE CONTRACTOR SHALL HAVE NO CLAIM FOR ADDITIONAL COMPENSATION OR FOR AN EXTENSION OF TIME FOR ANY REASON RESULTING FROM THE ACTUAL CONDITIONS ENCOUNTERED AT THE SITE DIFFERING FROM THOSE INDICATED IN THE SUBSURFACE INFORMATION.

- NOTES:
- THE INFORMATION CONTAINED HEREIN IS NOT IMPLIED OR GUARANTEED BY THE N. C. DEPARTMENT OF TRANSPORTATION AS ACCURATE NOR IS IT CONSIDERED PART OF THE PLANS, SPECIFICATIONS OR CONTRACT FOR THE PROJECT.
  - BY HAVING REQUESTED THIS INFORMATION, THE CONTRACTOR SPECIFICALLY WAIVES ANY CLAIMS FOR INCREASED COMPENSATION OR EXTENSION OF TIME BASED ON DIFFERENCES BETWEEN THE CONDITIONS INDICATED HEREIN AND THE ACTUAL CONDITIONS AT THE PROJECT SITE.

PERSONNEL

CG2

GOODNIGHT, D.J.

INVESTIGATED BY FALCON ENG.

DRAWN BY CROCKETT, S.C.

CHECKED BY HUNSBERGER, W.S.

SUBMITTED BY FALCON ENG.

DATE SEPTEMBER 2023



DocuSigned by:  
Stephen Crockett 9/8/2023  
 C5C85FED48E0435  
 SIGNATURE DATE

DOCUMENT NOT CONSIDERED FINAL  
 UNLESS ALL SIGNATURES COMPLETED


# NORTH CAROLINA DEPARTMENT OF TRANSPORTATION DIVISION OF HIGHWAYS GEOTECHNICAL ENGINEERING UNIT


## SUBSURFACE INVESTIGATION

### SOIL AND ROCK LEGEND, TERMS, SYMBOLS, AND ABBREVIATIONS


SOIL DESCRIPTION				GRADATION				ROCK DESCRIPTION				TERMS AND DEFINITIONS																																																																																																																						
SOIL IS CONSIDERED UNCONSOLIDATED, SEMI-CONSOLIDATED, OR WEATHERED EARTH MATERIALS THAT CAN BE PENETRATED WITH A CONTINUOUS FLIGHT POWER AUGER AND YIELD LESS THAN 100 BLOWS PER FOOT ACCORDING TO THE STANDARD PENETRATION TEST (AASHTO T 206, ASTM D1586). SOIL CLASSIFICATION IS BASED ON THE AASHTO SYSTEM. BASIC DESCRIPTIONS GENERALLY INCLUDE THE FOLLOWING: CONSISTENCY, COLOR, TEXTURE, MOISTURE, AASHTO CLASSIFICATION, AND OTHER PERTINENT FACTORS SUCH AS MINERALOGICAL COMPOSITION, ANGULARITY, STRUCTURE, PLASTICITY, ETC. FOR EXAMPLE, VERY STIFF, GRAY, SILTY CLAY, MOIST WITH INTERBEDDED FINE SAND LAYERS, HIGHLY PLASTIC, A-7-6				WELL GRADED - INDICATES A GOOD REPRESENTATION OF PARTICLE SIZES FROM FINE TO COARSE. UNIFORMLY GRADED - INDICATES THAT SOIL PARTICLES ARE ALL APPROXIMATELY THE SAME SIZE. GAP-GRADED - INDICATES A MIXTURE OF UNIFORM PARTICLE SIZES OF TWO OR MORE SIZES.				HARD ROCK IS NON-COASTAL PLAIN MATERIAL THAT WOULD YIELD SPT REFUSAL IF TESTED, AN INFERRED ROCK LINE INDICATES THE LEVEL AT WHICH NON-COASTAL PLAIN MATERIAL WOULD YIELD SPT REFUSAL. SPT REFUSAL IS PENETRATION BY A SPLIT SPOON SAMPLER EQUAL TO OR LESS THAN 0.1 FOOT PER 60 BLOWS IN NON-COASTAL PLAIN MATERIAL. THE TRANSITION BETWEEN SOIL AND ROCK IS OFTEN REPRESENTED BY A ZONE OF WEATHERED ROCK. ROCK MATERIALS ARE TYPICALLY DIVIDED AS FOLLOWS:				<b>ALLUVIUM (ALLUV.)</b> - SOILS THAT HAVE BEEN TRANSPORTED BY WATER. <b>AQUIFER</b> - A WATER BEARING FORMATION OR STRATA. <b>ARENACEOUS</b> - APPLIED TO ROCKS THAT HAVE BEEN DERIVED FROM SAND OR THAT CONTAIN SAND. <b>ARGILLACEOUS</b> - APPLIED TO ALL ROCKS OR SUBSTANCES COMPOSED OF CLAY MINERALS, OR HAVING A NOTABLE PROPORTION OF CLAY IN THEIR COMPOSITION, SUCH AS SHALE, SLATE, ETC. <b>ARTESIAN</b> - GROUND WATER THAT IS UNDER SUFFICIENT PRESSURE TO RISE ABOVE THE LEVEL AT WHICH IT IS ENCOUNTERED, BUT WHICH DOES NOT NECESSARILY RISE TO OR ABOVE THE GROUND SURFACE. <b>CALCAREOUS (CALC.)</b> - SOILS THAT CONTAIN APPRECIABLE AMOUNTS OF CALCIUM CARBONATE. <b>COLLUVIUM</b> - ROCK FRAGMENTS MIXED WITH SOIL DEPOSITED BY GRAVITY ON SLOPE OR AT BOTTOM OF SLOPE. <b>CORE RECOVERY (REC.)</b> - TOTAL LENGTH OF ALL MATERIAL RECOVERED IN THE CORE BARREL DIVIDED BY TOTAL LENGTH OF CORE RUN AND EXPRESSED AS A PERCENTAGE. <b>DIKE</b> - A TABULAR BODY OF IGNEOUS ROCK THAT CUTS ACROSS THE STRUCTURE OF ADJACENT ROCKS OR CUTS MASSIVE ROCK. <b>DIP</b> - THE ANGLE AT WHICH A STRATUM OR ANY PLANAR FEATURE IS INCLINED FROM THE HORIZONTAL. <b>DIP DIRECTION (DIP AZIMUTH)</b> - THE DIRECTION OR BEARING OF THE HORIZONTAL TRACE OF THE LINE OF DIP, MEASURED CLOCKWISE FROM NORTH. <b>FAULT</b> - A FRACTURE OR FRACTURE ZONE ALONG WHICH THERE HAS BEEN DISPLACEMENT OF THE SIDES RELATIVE TO ONE ANOTHER PARALLEL TO THE FRACTURE. <b>FISSILE</b> - A PROPERTY OF SPLITTING ALONG CLOSELY SPACED PARALLEL PLANES. <b>FLOAT</b> - ROCK FRAGMENTS ON SURFACE NEAR THEIR ORIGINAL POSITION AND DISLOGGED FROM PARENT MATERIAL. <b>FLOOD PLAIN (FP)</b> - LAND BORDERING A STREAM, BUILT OF SEDIMENTS DEPOSITED BY THE STREAM. <b>FORMATION (FM)</b> - A MAPPABLE GEOLOGIC UNIT THAT CAN BE RECOGNIZED AND TRACED IN THE FIELD. <b>JOINT</b> - FRACTURE IN ROCK ALONG WHICH NO APPRECIABLE MOVEMENT HAS OCCURRED. <b>LEDGE</b> - A SHELF-LIKE RIDGE OR PROJECTION OF ROCK WHOSE THICKNESS IS SMALL COMPARED TO ITS LATERAL EXTENT. <b>LENS</b> - A BODY OF SOIL OR ROCK THAT THINS OUT IN ONE OR MORE DIRECTIONS. <b>MOTTLED (MOT.)</b> - IRREGULARLY MARKED WITH SPOTS OF DIFFERENT COLORS. MOTTLING IN SOILS USUALLY INDICATES POOR AERATION AND LACK OF GOOD DRAINAGE. <b>PERCHED WATER</b> - WATER MAINTAINED ABOVE THE NORMAL GROUND WATER LEVEL BY THE PRESENCE OF AN INTERVENING IMPERVIOUS STRATUM. <b>RESIDUAL (RES.) SOIL</b> - SOIL FORMED IN PLACE BY THE WEATHERING OF ROCK. <b>ROCK QUALITY DESIGNATION (ROD)</b> - A MEASURE OF ROCK QUALITY DESCRIBED BY TOTAL LENGTH OF ROCK SEGMENTS EQUAL TO OR GREATER THAN 4 INCHES DIVIDED BY THE TOTAL LENGTH OF CORE RUN AND EXPRESSED AS A PERCENTAGE. <b>SAPROLITE (SAP.)</b> - RESIDUAL SOIL THAT RETAINS THE RELIC STRUCTURE OR FABRIC OF THE PARENT ROCK. <b>SILL</b> - AN INTRUSIVE BODY OF IGNEOUS ROCK OF APPROXIMATELY UNIFORM THICKNESS AND RELATIVELY THIN COMPARED WITH ITS LATERAL EXTENT, THAT HAS BEEN EMPLOYED PARALLEL TO THE BEDDING OR SCHISTOSITY OF THE INTRUDED ROCKS. <b>SLICKENSIDE</b> - POLISHED AND STRIATED SURFACE THAT RESULTS FROM FRICTION ALONG A FAULT OR SLIP PLANE. <b>STANDARD PENETRATION TEST (PENETRATION RESISTANCE) (SPT)</b> - NUMBER OF BLOWS (IN OR BPF) OF A 140 LB. HAMMER FALLING 30 INCHES REQUIRED TO PRODUCE A PENETRATION OF 1 FOOT INTO SOIL WITH A 2 INCH OUTSIDE DIAMETER SPLIT SPOON SAMPLER. SPT REFUSAL IS PENETRATION EQUAL TO OR LESS THAN 0.1 FOOT PER 60 BLOWS. <b>STRATA CORE RECOVERY (SREC.)</b> - TOTAL LENGTH OF STRATA MATERIAL RECOVERED DIVIDED BY TOTAL LENGTH OF STRATUM AND EXPRESSED AS A PERCENTAGE. <b>STRATA ROCK QUALITY DESIGNATION (SROD)</b> - A MEASURE OF ROCK QUALITY DESCRIBED BY TOTAL LENGTH OF ROCK SEGMENTS WITHIN A STRATUM EQUAL TO OR GREATER THAN 4 INCHES DIVIDED BY THE TOTAL LENGTH OF STRATA AND EXPRESSED AS A PERCENTAGE. <b>TOPSOIL (TS.)</b> - SURFACE SOILS USUALLY CONTAINING ORGANIC MATTER.																																																																																																																						
<b>SOIL LEGEND AND AASHTO CLASSIFICATION</b>				<b>ANGULARITY OF GRAINS</b>				<b>WEATHERED ROCK (WR)</b>				<b>NON-COASTAL PLAIN MATERIAL THAT WOULD YIELD SPT N VALUES &gt; 100 BLOWS PER FOOT IF TESTED.</b>																																																																																																																						
<table border="1" style="width: 100%; font-size: small;"> <thead> <tr> <th>GENERAL CLASS.</th> <th colspan="7">GRANULAR MATERIALS (&lt;= 35% PASSING #200)</th> <th colspan="4">SILT-CLAY MATERIALS (&gt; 35% PASSING #200)</th> <th colspan="3">ORGANIC MATERIALS</th> </tr> <tr> <th>GROUP CLASS.</th> <th>A-1</th> <th>A-3</th> <th colspan="2">A-2</th> <th>A-4</th> <th>A-5</th> <th>A-6</th> <th>A-7</th> <th>A-1, A-2</th> <th>A-3</th> <th>A-4, A-5</th> <th>A-6, A-7</th> <th></th> <th></th> <th></th> </tr> <tr> <th>SYMBOL</th> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </thead> </table>				GENERAL CLASS.	GRANULAR MATERIALS (<= 35% PASSING #200)							SILT-CLAY MATERIALS (> 35% PASSING #200)				ORGANIC MATERIALS			GROUP CLASS.	A-1	A-3	A-2		A-4	A-5	A-6	A-7	A-1, A-2	A-3	A-4, A-5	A-6, A-7				SYMBOL																<b>MINERALOGICAL COMPOSITION</b>				<b>CRYSTALLINE ROCK (CR)</b>				<b>FINE TO COARSE GRAIN IGNEOUS AND METAMORPHIC ROCK THAT WOULD YIELD SPT REFUSAL IF TESTED. ROCK TYPE INCLUDES GRANITE, GNEISS, GABBRO, SCHIST, ETC.</b>																																																																							
GENERAL CLASS.	GRANULAR MATERIALS (<= 35% PASSING #200)							SILT-CLAY MATERIALS (> 35% PASSING #200)				ORGANIC MATERIALS																																																																																																																						
GROUP CLASS.	A-1	A-3	A-2		A-4	A-5	A-6	A-7	A-1, A-2	A-3	A-4, A-5	A-6, A-7																																																																																																																						
SYMBOL																																																																																																																																		
<b>COMPRESSION</b>				<b>NON-CRYSTALLINE ROCK (NCR)</b>				<b>FINE TO COARSE GRAIN METAMORPHIC AND NON-COASTAL PLAIN SEDIMENTARY ROCK THAT WOULD YIELD SPT REFUSAL IF TESTED. ROCK TYPE INCLUDES PHYLLITE, SLATE, SANDSTONE, ETC.</b>				<b>COASTAL PLAIN SEDIMENTARY ROCK (CP)</b>				<b>COASTAL PLAIN SEDIMENTS CEMENTED INTO ROCK, BUT MAY NOT YIELD SPT REFUSAL. ROCK TYPE INCLUDES LIMESTONE, SANDSTONE, CEMENTED SHELL BEDS, ETC.</b>																																																																																																																		
<b>PERCENTAGE OF MATERIAL</b>				<b>GROUND WATER</b>				<b>WEATHERING</b>				<b>FRESH</b>				<b>ROCK FRESH, CRYSTALS BRIGHT, FEW JOINTS MAY SHOW SLIGHT STAINING. ROCK RINGS UNDER HAMMER IF CRYSTALLINE.</b>																																																																																																																		
<table border="1" style="width: 100%; font-size: x-small;"> <thead> <tr> <th></th> <th>GRANULAR SOILS</th> <th>SILT-CLAY SOILS</th> <th>OTHER MATERIAL</th> </tr> </thead> <tbody> <tr> <td>TRACE OF ORGANIC MATTER</td> <td>2 - 3%</td> <td>3 - 5%</td> <td>TRACE 1 - 10%</td> </tr> <tr> <td>LITTLE ORGANIC MATTER</td> <td>3 - 5%</td> <td>5 - 12%</td> <td>LITTLE 10 - 20%</td> </tr> <tr> <td>MODERATELY ORGANIC</td> <td>5 - 10%</td> <td>12 - 20%</td> <td>SOME 20 - 35%</td> </tr> <tr> <td>HIGHLY ORGANIC</td> <td>&gt; 10%</td> <td>&gt; 20%</td> <td>HIGHLY 35% AND ABOVE</td> </tr> </tbody> </table>					GRANULAR SOILS	SILT-CLAY SOILS	OTHER MATERIAL	TRACE OF ORGANIC MATTER	2 - 3%	3 - 5%	TRACE 1 - 10%	LITTLE ORGANIC MATTER	3 - 5%	5 - 12%	LITTLE 10 - 20%	MODERATELY ORGANIC	5 - 10%	12 - 20%	SOME 20 - 35%	HIGHLY ORGANIC	> 10%	> 20%	HIGHLY 35% AND ABOVE	<table border="1" style="width: 100%; font-size: x-small;"> <thead> <tr> <th>SYMBOL</th> <th>DESCRIPTION</th> </tr> </thead> <tbody> <tr> <td></td> <td>WATER LEVEL IN BORE HOLE IMMEDIATELY AFTER DRILLING</td> </tr> <tr> <td></td> <td>STATIC WATER LEVEL AFTER 24 HOURS</td> </tr> <tr> <td></td> <td>PERCHED WATER, SATURATED ZONE, OR WATER BEARING STRATA</td> </tr> <tr> <td></td> <td>SPRING OR SEEP</td> </tr> </tbody> </table>				SYMBOL	DESCRIPTION		WATER LEVEL IN BORE HOLE IMMEDIATELY AFTER DRILLING		STATIC WATER LEVEL AFTER 24 HOURS		PERCHED WATER, SATURATED ZONE, OR WATER BEARING STRATA		SPRING OR SEEP	<table border="1" style="width: 100%; font-size: x-small;"> <thead> <tr> <th>MODERATE (MOD.)</th> <th>MODERATELY SEVERE (MOD. SEV.)</th> <th>SEVERE (SEV.)</th> <th>VERY SEVERE (IV SEV.)</th> <th>COMPLETE</th> </tr> </thead> <tbody> <tr> <td>SIGNIFICANT PORTIONS OF ROCK SHOW DISCOLORATION AND WEATHERING EFFECTS. IN GRANITOID ROCKS, MOST FELDSPARS ARE DULL AND DISCOLORED, SOME SHOW CLAY. ROCK HAS DULL SOUND UNDER HAMMER BLOWS AND SHOWS SIGNIFICANT LOSS OF STRENGTH AS COMPARED WITH FRESH ROCK.</td> <td>ALL ROCK EXCEPT QUARTZ DISCOLORED OR STAINED. IN GRANITOID ROCKS, ALL FELDSPARS DULL AND DISCOLORED AND A MAJORITY SHOW KAOLINIZATION. ROCK SHOWS SEVERE LOSS OF STRENGTH AND CAN BE EXCAVATED WITH A GEOLOGIST'S PICK. ROCK GIVES "CLUNK" SOUND WHEN STRUCK. IF TESTED, WOULD YIELD SPT REFUSAL.</td> <td>ALL ROCK EXCEPT QUARTZ DISCOLORED OR STAINED. ROCK FABRIC CLEAR AND EVIDENT BUT REDUCED IN STRENGTH TO STRONG SOIL. IN GRANITOID ROCKS ALL FELDSPARS ARE KAOLINIZED TO SOME EXTENT. SOME FRAGMENTS OF STRONG ROCK USUALLY REMAIN. IF TESTED, WOULD YIELD SPT N VALUES &gt; 100 BPF.</td> <td>ALL ROCK EXCEPT QUARTZ DISCOLORED OR STAINED. ROCK FABRIC ELEMENTS ARE DISCERNIBLE BUT MASS IS EFFECTIVELY REDUCED TO SOIL STATUS, WITH ONLY FRAGMENTS OF STRONG ROCK REMAINING. SAPROLITE IS AN EXAMPLE OF ROCK WEATHERED TO A DEGREE THAT ONLY MINOR VESTIGES OF ORIGINAL ROCK FABRIC REMAIN. IF TESTED, WOULD YIELD SPT N VALUES &lt; 100 BPF.</td> <td>ROCK REDUCED TO SOIL. ROCK FABRIC NOT DISCERNIBLE, OR DISCERNIBLE ONLY IN SMALL AND SCATTERED CONCENTRATIONS. QUARTZ MAY BE PRESENT AS DIKES OR STRINGERS. SAPROLITE IS ALSO AN EXAMPLE.</td> </tr> </tbody> </table>				MODERATE (MOD.)	MODERATELY SEVERE (MOD. SEV.)	SEVERE (SEV.)	VERY SEVERE (IV SEV.)	COMPLETE	SIGNIFICANT PORTIONS OF ROCK SHOW DISCOLORATION AND WEATHERING EFFECTS. IN GRANITOID ROCKS, MOST FELDSPARS ARE DULL AND DISCOLORED, SOME SHOW CLAY. ROCK HAS DULL SOUND UNDER HAMMER BLOWS AND SHOWS SIGNIFICANT LOSS OF STRENGTH AS COMPARED WITH FRESH ROCK.	ALL ROCK EXCEPT QUARTZ DISCOLORED OR STAINED. IN GRANITOID ROCKS, ALL FELDSPARS DULL AND DISCOLORED AND A MAJORITY SHOW KAOLINIZATION. ROCK SHOWS SEVERE LOSS OF STRENGTH AND CAN BE EXCAVATED WITH A GEOLOGIST'S PICK. ROCK GIVES "CLUNK" SOUND WHEN STRUCK. IF TESTED, WOULD YIELD SPT REFUSAL.	ALL ROCK EXCEPT QUARTZ DISCOLORED OR STAINED. ROCK FABRIC CLEAR AND EVIDENT BUT REDUCED IN STRENGTH TO STRONG SOIL. IN GRANITOID ROCKS ALL FELDSPARS ARE KAOLINIZED TO SOME EXTENT. SOME FRAGMENTS OF STRONG ROCK USUALLY REMAIN. IF TESTED, WOULD YIELD SPT N VALUES > 100 BPF.	ALL ROCK EXCEPT QUARTZ DISCOLORED OR STAINED. ROCK FABRIC ELEMENTS ARE DISCERNIBLE BUT MASS IS EFFECTIVELY REDUCED TO SOIL STATUS, WITH ONLY FRAGMENTS OF STRONG ROCK REMAINING. SAPROLITE IS AN EXAMPLE OF ROCK WEATHERED TO A DEGREE THAT ONLY MINOR VESTIGES OF ORIGINAL ROCK FABRIC REMAIN. IF TESTED, WOULD YIELD SPT N VALUES < 100 BPF.	ROCK REDUCED TO SOIL. ROCK FABRIC NOT DISCERNIBLE, OR DISCERNIBLE ONLY IN SMALL AND SCATTERED CONCENTRATIONS. QUARTZ MAY BE PRESENT AS DIKES OR STRINGERS. SAPROLITE IS ALSO AN EXAMPLE.																																																																															
	GRANULAR SOILS	SILT-CLAY SOILS	OTHER MATERIAL																																																																																																																															
TRACE OF ORGANIC MATTER	2 - 3%	3 - 5%	TRACE 1 - 10%																																																																																																																															
LITTLE ORGANIC MATTER	3 - 5%	5 - 12%	LITTLE 10 - 20%																																																																																																																															
MODERATELY ORGANIC	5 - 10%	12 - 20%	SOME 20 - 35%																																																																																																																															
HIGHLY ORGANIC	> 10%	> 20%	HIGHLY 35% AND ABOVE																																																																																																																															
SYMBOL	DESCRIPTION																																																																																																																																	
	WATER LEVEL IN BORE HOLE IMMEDIATELY AFTER DRILLING																																																																																																																																	
	STATIC WATER LEVEL AFTER 24 HOURS																																																																																																																																	
	PERCHED WATER, SATURATED ZONE, OR WATER BEARING STRATA																																																																																																																																	
	SPRING OR SEEP																																																																																																																																	
MODERATE (MOD.)	MODERATELY SEVERE (MOD. SEV.)	SEVERE (SEV.)	VERY SEVERE (IV SEV.)	COMPLETE																																																																																																																														
SIGNIFICANT PORTIONS OF ROCK SHOW DISCOLORATION AND WEATHERING EFFECTS. IN GRANITOID ROCKS, MOST FELDSPARS ARE DULL AND DISCOLORED, SOME SHOW CLAY. ROCK HAS DULL SOUND UNDER HAMMER BLOWS AND SHOWS SIGNIFICANT LOSS OF STRENGTH AS COMPARED WITH FRESH ROCK.	ALL ROCK EXCEPT QUARTZ DISCOLORED OR STAINED. IN GRANITOID ROCKS, ALL FELDSPARS DULL AND DISCOLORED AND A MAJORITY SHOW KAOLINIZATION. ROCK SHOWS SEVERE LOSS OF STRENGTH AND CAN BE EXCAVATED WITH A GEOLOGIST'S PICK. ROCK GIVES "CLUNK" SOUND WHEN STRUCK. IF TESTED, WOULD YIELD SPT REFUSAL.	ALL ROCK EXCEPT QUARTZ DISCOLORED OR STAINED. ROCK FABRIC CLEAR AND EVIDENT BUT REDUCED IN STRENGTH TO STRONG SOIL. IN GRANITOID ROCKS ALL FELDSPARS ARE KAOLINIZED TO SOME EXTENT. SOME FRAGMENTS OF STRONG ROCK USUALLY REMAIN. IF TESTED, WOULD YIELD SPT N VALUES > 100 BPF.	ALL ROCK EXCEPT QUARTZ DISCOLORED OR STAINED. ROCK FABRIC ELEMENTS ARE DISCERNIBLE BUT MASS IS EFFECTIVELY REDUCED TO SOIL STATUS, WITH ONLY FRAGMENTS OF STRONG ROCK REMAINING. SAPROLITE IS AN EXAMPLE OF ROCK WEATHERED TO A DEGREE THAT ONLY MINOR VESTIGES OF ORIGINAL ROCK FABRIC REMAIN. IF TESTED, WOULD YIELD SPT N VALUES < 100 BPF.	ROCK REDUCED TO SOIL. ROCK FABRIC NOT DISCERNIBLE, OR DISCERNIBLE ONLY IN SMALL AND SCATTERED CONCENTRATIONS. QUARTZ MAY BE PRESENT AS DIKES OR STRINGERS. SAPROLITE IS ALSO AN EXAMPLE.																																																																																																																														
<b>CONSISTENCY OR DENSENESS</b>				<b>MISCELLANEOUS SYMBOLS</b>				<b>RECOMMENDATION SYMBOLS</b>				<b>ABBREVIATIONS</b>																																																																																																																						
<table border="1" style="width: 100%; font-size: x-small;"> <thead> <tr> <th>PRIMARY SOIL TYPE</th> <th>COMPACTNESS OR CONSISTENCY</th> <th>RANGE OF STANDARD PENETRATION RESISTANCE (N-VALUE)</th> <th>RANGE OF UNCONFINED COMPRESSIVE STRENGTH (TONS/FT<sup>2</sup>)</th> </tr> </thead> <tbody> <tr> <td>GENERALLY GRANULAR MATERIAL (NON-COHESIVE)</td> <td>VERY LOOSE LOOSE MEDIUM DENSE DENSE VERY DENSE</td> <td>&lt; 4 4 TO 10 10 TO 30 30 TO 50 &gt; 50</td> <td>N/A</td> </tr> <tr> <td>GENERALLY SILT-CLAY MATERIAL (COHESIVE)</td> <td>VERY SOFT SOFT MEDIUM STIFF STIFF VERY STIFF HARD</td> <td>&lt; 2 2 TO 4 4 TO 8 8 TO 15 15 TO 30 &gt; 30</td> <td>&lt; 0.25 0.25 TO 0.5 0.5 TO 1.0 1 TO 2 2 TO 4 &gt; 4</td> </tr> </tbody> </table>				PRIMARY SOIL TYPE	COMPACTNESS OR CONSISTENCY	RANGE OF STANDARD PENETRATION RESISTANCE (N-VALUE)	RANGE OF UNCONFINED COMPRESSIVE STRENGTH (TONS/FT <sup>2</sup> )	GENERALLY GRANULAR MATERIAL (NON-COHESIVE)	VERY LOOSE LOOSE MEDIUM DENSE DENSE VERY DENSE	< 4 4 TO 10 10 TO 30 30 TO 50 > 50	N/A	GENERALLY SILT-CLAY MATERIAL (COHESIVE)	VERY SOFT SOFT MEDIUM STIFF STIFF VERY STIFF HARD	< 2 2 TO 4 4 TO 8 8 TO 15 15 TO 30 > 30	< 0.25 0.25 TO 0.5 0.5 TO 1.0 1 TO 2 2 TO 4 > 4	<table border="1" style="width: 100%; font-size: x-small;"> <tbody> <tr> <td></td> <td>ROADWAY EMBANKMENT (RE) WITH SOIL DESCRIPTION</td> <td></td> <td>DIP &amp; DIP DIRECTION OF ROCK STRUCTURES</td> <td></td> <td>SLOPE INDICATOR INSTALLATION</td> </tr> <tr> <td></td> <td>SOIL SYMBOL</td> <td></td> <td>TEST BORING</td> <td></td> <td>CONE PENETROMETER TEST</td> </tr> <tr> <td></td> <td>ARTIFICIAL FILL (AF) OTHER THAN ROADWAY EMBANKMENT</td> <td></td> <td>AUGER BORING</td> <td></td> <td>SOUNDING ROD</td> </tr> <tr> <td></td> <td>INFERRED SOIL BOUNDARY</td> <td></td> <td>CORE BORING</td> <td></td> <td>TEST BORING WITH CORE</td> </tr> <tr> <td></td> <td>INFERRED ROCK LINE</td> <td></td> <td>MONITORING WELL</td> <td></td> <td>SPT N-VALUE</td> </tr> <tr> <td></td> <td>ALLUVIAL SOIL BOUNDARY</td> <td></td> <td>PIEZOMETER INSTALLATION</td> <td></td> <td></td> </tr> </tbody> </table>					ROADWAY EMBANKMENT (RE) WITH SOIL DESCRIPTION		DIP & DIP DIRECTION OF ROCK STRUCTURES		SLOPE INDICATOR INSTALLATION		SOIL SYMBOL		TEST BORING		CONE PENETROMETER TEST		ARTIFICIAL FILL (AF) OTHER THAN ROADWAY EMBANKMENT		AUGER BORING		SOUNDING ROD		INFERRED SOIL BOUNDARY		CORE BORING		TEST BORING WITH CORE		INFERRED ROCK LINE		MONITORING WELL		SPT N-VALUE		ALLUVIAL SOIL BOUNDARY		PIEZOMETER INSTALLATION			<table border="1" style="width: 100%; font-size: x-small;"> <tbody> <tr> <td></td> <td>UNDERCUT EXCAVATION</td> <td></td> <td>UNCLASSIFIED EXCAVATION - UNSUITABLE WASTE</td> <td></td> <td>UNCLASSIFIED EXCAVATION - ACCEPTABLE DEGRADABLE ROCK</td> </tr> <tr> <td></td> <td>SHALLOW UNDERCUT</td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>					UNDERCUT EXCAVATION		UNCLASSIFIED EXCAVATION - UNSUITABLE WASTE		UNCLASSIFIED EXCAVATION - ACCEPTABLE DEGRADABLE ROCK		SHALLOW UNDERCUT					<table border="1" style="width: 100%; font-size: x-small;"> <tbody> <tr> <td>AR - AUGER REFUSAL</td> <td>BT - BORING TERMINATED</td> <td>CL - CLAY</td> <td>CPT - CONE PENETRATION TEST</td> <td>CSE - COARSE</td> <td>DMT - DILATOMETER TEST</td> <td>DPT - DYNAMIC PENETRATION TEST</td> <td>e - VOID RATIO</td> <td>F - FINE</td> <td>FOSS. - FOSSILIFEROUS</td> <td>FRAC. - FRACTURED, FRACTURES</td> <td>FRAGS. - FRAGMENTS</td> <td>HI. - HIGHLY</td> <td>MED. - MEDIUM</td> <td>MICA. - MICACEOUS</td> <td>MOD. - MODERATELY</td> <td>NP - NON PLASTIC</td> <td>ORG. - ORGANIC</td> <td>PMT - PRESSUREMETER TEST</td> <td>SAP. - SAPROLITIC</td> <td>SD. - SAND, SANDY</td> <td>SL. - SILT, SILTY</td> <td>SLI. - SLIGHTLY</td> <td>TCR - TRICONE REFUSAL</td> <td>w - MOISTURE CONTENT</td> <td>V - VERY</td> <td>VST - VANE SHEAR TEST</td> <td>WEA. - WEATHERED</td> <td>Z - UNIT WEIGHT</td> <td>g - DRY UNIT WEIGHT</td> </tr> </tbody> </table>				AR - AUGER REFUSAL	BT - BORING TERMINATED	CL - CLAY	CPT - CONE PENETRATION TEST	CSE - COARSE	DMT - DILATOMETER TEST	DPT - DYNAMIC PENETRATION TEST	e - VOID RATIO	F - FINE	FOSS. - FOSSILIFEROUS	FRAC. - FRACTURED, FRACTURES	FRAGS. - FRAGMENTS	HI. - HIGHLY	MED. - MEDIUM	MICA. - MICACEOUS	MOD. - MODERATELY	NP - NON PLASTIC	ORG. - ORGANIC	PMT - PRESSUREMETER TEST	SAP. - SAPROLITIC	SD. - SAND, SANDY	SL. - SILT, SILTY	SLI. - SLIGHTLY	TCR - TRICONE REFUSAL	w - MOISTURE CONTENT	V - VERY	VST - VANE SHEAR TEST	WEA. - WEATHERED	Z - UNIT WEIGHT	g - DRY UNIT WEIGHT																									
PRIMARY SOIL TYPE	COMPACTNESS OR CONSISTENCY	RANGE OF STANDARD PENETRATION RESISTANCE (N-VALUE)	RANGE OF UNCONFINED COMPRESSIVE STRENGTH (TONS/FT <sup>2</sup> )																																																																																																																															
GENERALLY GRANULAR MATERIAL (NON-COHESIVE)	VERY LOOSE LOOSE MEDIUM DENSE DENSE VERY DENSE	< 4 4 TO 10 10 TO 30 30 TO 50 > 50	N/A																																																																																																																															
GENERALLY SILT-CLAY MATERIAL (COHESIVE)	VERY SOFT SOFT MEDIUM STIFF STIFF VERY STIFF HARD	< 2 2 TO 4 4 TO 8 8 TO 15 15 TO 30 > 30	< 0.25 0.25 TO 0.5 0.5 TO 1.0 1 TO 2 2 TO 4 > 4																																																																																																																															
	ROADWAY EMBANKMENT (RE) WITH SOIL DESCRIPTION		DIP & DIP DIRECTION OF ROCK STRUCTURES		SLOPE INDICATOR INSTALLATION																																																																																																																													
	SOIL SYMBOL		TEST BORING		CONE PENETROMETER TEST																																																																																																																													
	ARTIFICIAL FILL (AF) OTHER THAN ROADWAY EMBANKMENT		AUGER BORING		SOUNDING ROD																																																																																																																													
	INFERRED SOIL BOUNDARY		CORE BORING		TEST BORING WITH CORE																																																																																																																													
	INFERRED ROCK LINE		MONITORING WELL		SPT N-VALUE																																																																																																																													
	ALLUVIAL SOIL BOUNDARY		PIEZOMETER INSTALLATION																																																																																																																															
	UNDERCUT EXCAVATION		UNCLASSIFIED EXCAVATION - UNSUITABLE WASTE		UNCLASSIFIED EXCAVATION - ACCEPTABLE DEGRADABLE ROCK																																																																																																																													
	SHALLOW UNDERCUT																																																																																																																																	
AR - AUGER REFUSAL	BT - BORING TERMINATED	CL - CLAY	CPT - CONE PENETRATION TEST	CSE - COARSE	DMT - DILATOMETER TEST	DPT - DYNAMIC PENETRATION TEST	e - VOID RATIO	F - FINE	FOSS. - FOSSILIFEROUS	FRAC. - FRACTURED, FRACTURES	FRAGS. - FRAGMENTS	HI. - HIGHLY	MED. - MEDIUM	MICA. - MICACEOUS	MOD. - MODERATELY	NP - NON PLASTIC	ORG. - ORGANIC	PMT - PRESSUREMETER TEST	SAP. - SAPROLITIC	SD. - SAND, SANDY	SL. - SILT, SILTY	SLI. - SLIGHTLY	TCR - TRICONE REFUSAL	w - MOISTURE CONTENT	V - VERY	VST - VANE SHEAR TEST	WEA. - WEATHERED	Z - UNIT WEIGHT	g - DRY UNIT WEIGHT																																																																																																					
<b>TEXTURE OR GRAIN SIZE</b>				<b>SOIL MOISTURE - CORRELATION OF TERMS</b>				<b>FRACTURE SPACING</b>				<b>BEDDING</b>																																																																																																																						
<table border="1" style="width: 100%; font-size: x-small;"> <thead> <tr> <th>U.S. STD. SIEVE SIZE OPENING (MM)</th> <th>4</th> <th>10</th> <th>40</th> <th>60</th> <th>200</th> <th>270</th> </tr> </thead> <tbody> <tr> <td></td> <td>4.76</td> <td>2.00</td> <td>0.42</td> <td>0.25</td> <td>0.075</td> <td>0.053</td> </tr> </tbody> </table>				U.S. STD. SIEVE SIZE OPENING (MM)	4	10	40	60	200	270		4.76	2.00	0.42	0.25	0.075	0.053	<table border="1" style="width: 100%; font-size: x-small;"> <thead> <tr> <th>BOULDER (BLDR.)</th> <th>COBBLE (COB.)</th> <th>GRAVEL (GR.)</th> <th>COARSE SAND (CSE, SD.)</th> <th>FINE SAND (F SD.)</th> <th>SILT (SL.)</th> <th>CLAY (CL.)</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>				BOULDER (BLDR.)	COBBLE (COB.)	GRAVEL (GR.)	COARSE SAND (CSE, SD.)	FINE SAND (F SD.)	SILT (SL.)	CLAY (CL.)								<table border="1" style="width: 100%; font-size: x-small;"> <thead> <tr> <th>GRAIN SIZE</th> <th>MM</th> <th>305</th> <th>75</th> <th>2.0</th> <th>0.25</th> <th>0.05</th> <th>0.005</th> </tr> </thead> <tbody> <tr> <td></td> <td>IN.</td> <td>12</td> <td>3</td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>				GRAIN SIZE	MM	305	75	2.0	0.25	0.05	0.005		IN.	12	3					<table border="1" style="width: 100%; font-size: x-small;"> <thead> <tr> <th>SOIL MOISTURE SCALE (ATTERBERG LIMITS)</th> <th>FIELD MOISTURE DESCRIPTION</th> <th>GUIDE FOR FIELD MOISTURE DESCRIPTION</th> </tr> </thead> <tbody> <tr> <td>LL - LIQUID LIMIT</td> <td>- SATURATED - (SAT.)</td> <td>USUALLY LIQUID; VERY WET, USUALLY FROM BELOW THE GROUND WATER TABLE</td> </tr> <tr> <td>PL - PLASTIC LIMIT</td> <td>- WET - (W)</td> <td>SEMISOLID; REQUIRES DRYING TO ATTAIN OPTIMUM MOISTURE</td> </tr> <tr> <td>OM - OPTIMUM MOISTURE SHRINKAGE LIMIT</td> <td>- MOIST - (M)</td> <td>SOLID; AT OR NEAR OPTIMUM MOISTURE</td> </tr> <tr> <td>SL - SHRINKAGE LIMIT</td> <td>- DRY - (D)</td> <td>REQUIRES ADDITIONAL WATER TO ATTAIN OPTIMUM MOISTURE</td> </tr> </tbody> </table>				SOIL MOISTURE SCALE (ATTERBERG LIMITS)	FIELD MOISTURE DESCRIPTION	GUIDE FOR FIELD MOISTURE DESCRIPTION	LL - LIQUID LIMIT	- SATURATED - (SAT.)	USUALLY LIQUID; VERY WET, USUALLY FROM BELOW THE GROUND WATER TABLE	PL - PLASTIC LIMIT	- WET - (W)	SEMISOLID; REQUIRES DRYING TO ATTAIN OPTIMUM MOISTURE	OM - OPTIMUM MOISTURE SHRINKAGE LIMIT	- MOIST - (M)	SOLID; AT OR NEAR OPTIMUM MOISTURE	SL - SHRINKAGE LIMIT	- DRY - (D)	REQUIRES ADDITIONAL WATER TO ATTAIN OPTIMUM MOISTURE	<table border="1" style="width: 100%; font-size: x-small;"> <thead> <tr> <th>TERM</th> <th>SPACING</th> <th>TERM</th> <th>THICKNESS</th> </tr> </thead> <tbody> <tr> <td>VERY WIDE</td> <td>MORE THAN 10 FEET</td> <td>VERY THICKLY BEDDED</td> <td>4 FEET</td> </tr> <tr> <td>WIDE</td> <td>3 TO 10 FEET</td> <td>THICKLY BEDDED</td> <td>1.5 - 4 FEET</td> </tr> <tr> <td>MODERATELY CLOSE</td> <td>1 TO 3 FEET</td> <td>THINLY BEDDED</td> <td>0.16 - 1.5 FEET</td> </tr> <tr> <td>CLOSE</td> <td>0.16 TO 1 FOOT</td> <td>VERY THINLY BEDDED</td> <td>0.03 - 0.16 FEET</td> </tr> <tr> <td>VERY CLOSE</td> <td>LESS THAN 0.16 FEET</td> <td>THICKLY LAMINATED</td> <td>0.008 - 0.03 FEET</td> </tr> <tr> <td></td> <td></td> <td>THINLY LAMINATED</td> <td>&lt; 0.008 FEET</td> </tr> </tbody> </table>				TERM	SPACING	TERM	THICKNESS	VERY WIDE	MORE THAN 10 FEET	VERY THICKLY BEDDED	4 FEET	WIDE	3 TO 10 FEET	THICKLY BEDDED	1.5 - 4 FEET	MODERATELY CLOSE	1 TO 3 FEET	THINLY BEDDED	0.16 - 1.5 FEET	CLOSE	0.16 TO 1 FOOT	VERY THINLY BEDDED	0.03 - 0.16 FEET	VERY CLOSE	LESS THAN 0.16 FEET	THICKLY LAMINATED	0.008 - 0.03 FEET			THINLY LAMINATED	< 0.008 FEET																								
U.S. STD. SIEVE SIZE OPENING (MM)	4	10	40	60	200	270																																																																																																																												
	4.76	2.00	0.42	0.25	0.075	0.053																																																																																																																												
BOULDER (BLDR.)	COBBLE (COB.)	GRAVEL (GR.)	COARSE SAND (CSE, SD.)	FINE SAND (F SD.)	SILT (SL.)	CLAY (CL.)																																																																																																																												
GRAIN SIZE	MM	305	75	2.0	0.25	0.05	0.005																																																																																																																											
	IN.	12	3																																																																																																																															
SOIL MOISTURE SCALE (ATTERBERG LIMITS)	FIELD MOISTURE DESCRIPTION	GUIDE FOR FIELD MOISTURE DESCRIPTION																																																																																																																																
LL - LIQUID LIMIT	- SATURATED - (SAT.)	USUALLY LIQUID; VERY WET, USUALLY FROM BELOW THE GROUND WATER TABLE																																																																																																																																
PL - PLASTIC LIMIT	- WET - (W)	SEMISOLID; REQUIRES DRYING TO ATTAIN OPTIMUM MOISTURE																																																																																																																																
OM - OPTIMUM MOISTURE SHRINKAGE LIMIT	- MOIST - (M)	SOLID; AT OR NEAR OPTIMUM MOISTURE																																																																																																																																
SL - SHRINKAGE LIMIT	- DRY - (D)	REQUIRES ADDITIONAL WATER TO ATTAIN OPTIMUM MOISTURE																																																																																																																																
TERM	SPACING	TERM	THICKNESS																																																																																																																															
VERY WIDE	MORE THAN 10 FEET	VERY THICKLY BEDDED	4 FEET																																																																																																																															
WIDE	3 TO 10 FEET	THICKLY BEDDED	1.5 - 4 FEET																																																																																																																															
MODERATELY CLOSE	1 TO 3 FEET	THINLY BEDDED	0.16 - 1.5 FEET																																																																																																																															
CLOSE	0.16 TO 1 FOOT	VERY THINLY BEDDED	0.03 - 0.16 FEET																																																																																																																															
VERY CLOSE	LESS THAN 0.16 FEET	THICKLY LAMINATED	0.008 - 0.03 FEET																																																																																																																															
		THINLY LAMINATED	< 0.008 FEET																																																																																																																															
<b>PLASTICITY</b>				<b>EQUIPMENT USED ON SUBJECT PROJECT</b>				<b>INDURATION</b>				<b>NOTES:</b>																																																																																																																						
<table border="1" style="width: 100%; font-size: x-small;"> <thead> <tr> <th></th> <th>PLASTICITY INDEX (PI)</th> <th>DRY STRENGTH</th> </tr> </thead> <tbody> <tr> <td>NON PLASTIC</td> <td>0-5</td> <td>VERY LOW</td> </tr> <tr> <td>SLIGHTLY PLASTIC</td> <td>6-15</td> <td>SLIGHT</td> </tr> <tr> <td>MODERATELY PLASTIC</td> <td>16-25</td> <td>MEDIUM</td> </tr> <tr> <td>HIGHLY PLASTIC</td> <td>26 OR MORE</td> <td>HIGH</td> </tr> </tbody> </table>					PLASTICITY INDEX (PI)	DRY STRENGTH	NON PLASTIC	0-5	VERY LOW	SLIGHTLY PLASTIC	6-15	SLIGHT	MODERATELY PLASTIC	16-25	MEDIUM	HIGHLY PLASTIC	26 OR MORE	HIGH	<table border="1" style="width: 100%; font-size: x-small;"> <tbody> <tr> <td><input type="checkbox"/></td> <td>CME-45C</td> <td><input type="checkbox"/></td> <td>CLAY BITS</td> <td><input checked="" type="checkbox"/></td> <td>AUTOMATIC</td> <td><input type="checkbox"/></td> <td>MANUAL</td> </tr> <tr> <td><input type="checkbox"/></td> <td>CME-55</td> <td><input type="checkbox"/></td> <td>6" CONTINUOUS FLIGHT AUGER</td> <td><input type="checkbox"/></td> <td></td> <td><input type="checkbox"/></td> <td></td> </tr> <tr> <td><input checked="" type="checkbox"/></td> <td>CME-550X</td> <td><input checked="" type="checkbox"/></td> <td>8" HOLLOW AUGERS</td> <td><input type="checkbox"/></td> <td></td> <td><input type="checkbox"/></td> <td></td> </tr> <tr> <td><input type="checkbox"/></td> <td></td> <td><input type="checkbox"/></td> <td>HARD FACED FINGER BITS</td> <td><input type="checkbox"/></td> <td></td> <td><input type="checkbox"/></td> <td></td> </tr> <tr> <td><input type="checkbox"/></td> <td></td> <td><input type="checkbox"/></td> <td>TUNG-CARBIDE INSERTS</td> <td><input type="checkbox"/></td> <td></td> <td><input type="checkbox"/></td> <td></td> </tr> <tr> <td><input type="checkbox"/></td> <td></td> <td><input type="checkbox"/></td> <td>CASING w/ ADVANCER</td> <td><input type="checkbox"/></td> <td></td> <td><input type="checkbox"/></td> <td></td> </tr> <tr> <td><input type="checkbox"/></td> <td></td> <td><input type="checkbox"/></td> <td>TRICONE *STEEL TEETH</td> <td><input type="checkbox"/></td> <td></td> <td><input type="checkbox"/></td> <td></td> </tr> <tr> <td><input type="checkbox"/></td> <td></td> <td><input type="checkbox"/></td> <td>TRICONE *TUNG-CARB.</td> <td><input type="checkbox"/></td> <td></td> <td><input type="checkbox"/></td> <td></td> </tr> <tr> <td><input type="checkbox"/></td> <td></td> <td><input type="checkbox"/></td> <td>CORE BIT</td> <td><input type="checkbox"/></td> <td></td> <td><input type="checkbox"/></td> <td></td> </tr> <tr> <td><input type="checkbox"/></td> <td></td> <td><input type="checkbox"/></td> <td></td> <td><input type="checkbox"/></td> <td></td> <td><input type="checkbox"/></td> <td></td> </tr> <tr> <td><input type="checkbox"/></td> <td></td> <td><input type="checkbox"/></td> <td></td> <td><input type="checkbox"/></td> <td></td> <td><input type="checkbox"/></td> <td></td> </tr> </tbody> </table>				<input type="checkbox"/>	CME-45C	<input type="checkbox"/>	CLAY BITS	<input checked="" type="checkbox"/>	AUTOMATIC	<input type="checkbox"/>	MANUAL	<input type="checkbox"/>	CME-55	<input type="checkbox"/>	6" CONTINUOUS FLIGHT AUGER	<input type="checkbox"/>		<input type="checkbox"/>		<input checked="" type="checkbox"/>	CME-550X	<input checked="" type="checkbox"/>	8" HOLLOW AUGERS	<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>	HARD FACED FINGER BITS	<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>	TUNG-CARBIDE INSERTS	<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>	CASING w/ ADVANCER	<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>	TRICONE *STEEL TEETH	<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>	TRICONE *TUNG-CARB.	<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>	CORE BIT	<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>		<table border="1" style="width: 100%; font-size: x-small;"> <tbody> <tr> <td><input type="checkbox"/></td> <td>FRIABLE</td> <td>RUBBING WITH FINGER FREES NUMEROUS GRAINS; GENTLE BLOW BY HAMMER DISINTEGRATES SAMPLE.</td> </tr> <tr> <td><input type="checkbox"/></td> <td>MODERATELY INDURATED</td> <td>GRAINS CAN BE SEPARATED FROM SAMPLE WITH STEEL PROBE; BREAKS EASILY WHEN HIT WITH HAMMER.</td> </tr> <tr> <td><input type="checkbox"/></td> <td>INDURATED</td> <td>GRAINS ARE DIFFICULT TO SEPARATE WITH STEEL PROBE; DIFFICULT TO BREAK WITH HAMMER.</td> </tr> <tr> <td><input type="checkbox"/></td> <td>EXTREMELY INDURATED</td> <td>SHARP HAMMER BLOWS REQUIRED TO BREAK SAMPLE; SAMPLE BREAKS ACROSS GRAINS.</td> </tr> </tbody> </table>				<input type="checkbox"/>	FRIABLE	RUBBING WITH FINGER FREES NUMEROUS GRAINS; GENTLE BLOW BY HAMMER DISINTEGRATES SAMPLE.	<input type="checkbox"/>	MODERATELY INDURATED	GRAINS CAN BE SEPARATED FROM SAMPLE WITH STEEL PROBE; BREAKS EASILY WHEN HIT WITH HAMMER.	<input type="checkbox"/>	INDURATED	GRAINS ARE DIFFICULT TO SEPARATE WITH STEEL PROBE; DIFFICULT TO BREAK WITH HAMMER.	<input type="checkbox"/>	EXTREMELY INDURATED	SHARP HAMMER BLOWS REQUIRED TO BREAK SAMPLE; SAMPLE BREAKS ACROSS GRAINS.	BENCH MARK: ELEVATIONS TAKEN FROM I2513.is.tnl.tin DATE: 04/15/2022 ELEVATION: _____ FEET FIAD - FILLED IMMEDIATELY AFTER DRILLING			
	PLASTICITY INDEX (PI)	DRY STRENGTH																																																																																																																																
NON PLASTIC	0-5	VERY LOW																																																																																																																																
SLIGHTLY PLASTIC	6-15	SLIGHT																																																																																																																																
MODERATELY PLASTIC	16-25	MEDIUM																																																																																																																																
HIGHLY PLASTIC	26 OR MORE	HIGH																																																																																																																																
<input type="checkbox"/>	CME-45C	<input type="checkbox"/>	CLAY BITS	<input checked="" type="checkbox"/>	AUTOMATIC	<input type="checkbox"/>	MANUAL																																																																																																																											
<input type="checkbox"/>	CME-55	<input type="checkbox"/>	6" CONTINUOUS FLIGHT AUGER	<input type="checkbox"/>		<input type="checkbox"/>																																																																																																																												
<input checked="" type="checkbox"/>	CME-550X	<input checked="" type="checkbox"/>	8" HOLLOW AUGERS	<input type="checkbox"/>		<input type="checkbox"/>																																																																																																																												
<input type="checkbox"/>		<input type="checkbox"/>	HARD FACED FINGER BITS	<input type="checkbox"/>		<input type="checkbox"/>																																																																																																																												
<input type="checkbox"/>		<input type="checkbox"/>	TUNG-CARBIDE INSERTS	<input type="checkbox"/>		<input type="checkbox"/>																																																																																																																												
<input type="checkbox"/>		<input type="checkbox"/>	CASING w/ ADVANCER	<input type="checkbox"/>		<input type="checkbox"/>																																																																																																																												
<input type="checkbox"/>		<input type="checkbox"/>	TRICONE *STEEL TEETH	<input type="checkbox"/>		<input type="checkbox"/>																																																																																																																												
<input type="checkbox"/>		<input type="checkbox"/>	TRICONE *TUNG-CARB.	<input type="checkbox"/>		<input type="checkbox"/>																																																																																																																												
<input type="checkbox"/>		<input type="checkbox"/>	CORE BIT	<input type="checkbox"/>		<input type="checkbox"/>																																																																																																																												
<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>																																																																																																																												
<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>																																																																																																																												
<input type="checkbox"/>	FRIABLE	RUBBING WITH FINGER FREES NUMEROUS GRAINS; GENTLE BLOW BY HAMMER DISINTEGRATES SAMPLE.																																																																																																																																
<input type="checkbox"/>	MODERATELY INDURATED	GRAINS CAN BE SEPARATED FROM SAMPLE WITH STEEL PROBE; BREAKS EASILY WHEN HIT WITH HAMMER.																																																																																																																																
<input type="checkbox"/>	INDURATED	GRAINS ARE DIFFICULT TO SEPARATE WITH STEEL PROBE; DIFFICULT TO BREAK WITH HAMMER.																																																																																																																																
<input type="checkbox"/>	EXTREMELY INDURATED	SHARP HAMMER BLOWS REQUIRED TO BREAK SAMPLE; SAMPLE BREAKS ACROSS GRAINS.																																																																																																																																
<b>COLOR</b>				<b>INDURATION</b>				<b>INDURATION</b>				<b>INDURATION</b>																																																																																																																						
DESCRIPTIONS MAY INCLUDE COLOR OR COLOR COMBINATIONS (TAN, RED, YELLOW-BROWN, BLUE-BROWN). MODIFIERS SUCH AS LIGHT, DARK, STREAKED, ETC. ARE USED TO DESCRIBE APPEARANCE.				FOR SEDIMENTARY ROCKS, INDURATION IS THE HARDENING OF MATERIAL BY CEMENTING, HEAT, PRESSURE, ETC.				RUBBING WITH FINGER FREES NUMEROUS GRAINS; GENTLE BLOW BY HAMMER DISINTEGRATES SAMPLE.				GRAINS CAN BE SEPARATED FROM SAMPLE WITH STEEL PROBE; BREAKS EASILY WHEN HIT WITH HAMMER.																																																																																																																						

PROJECT REFERENCE NO.	SHEET NO.
I-2513AA	3
<b>SITE PLAN</b>	
0 50 100 FEET	

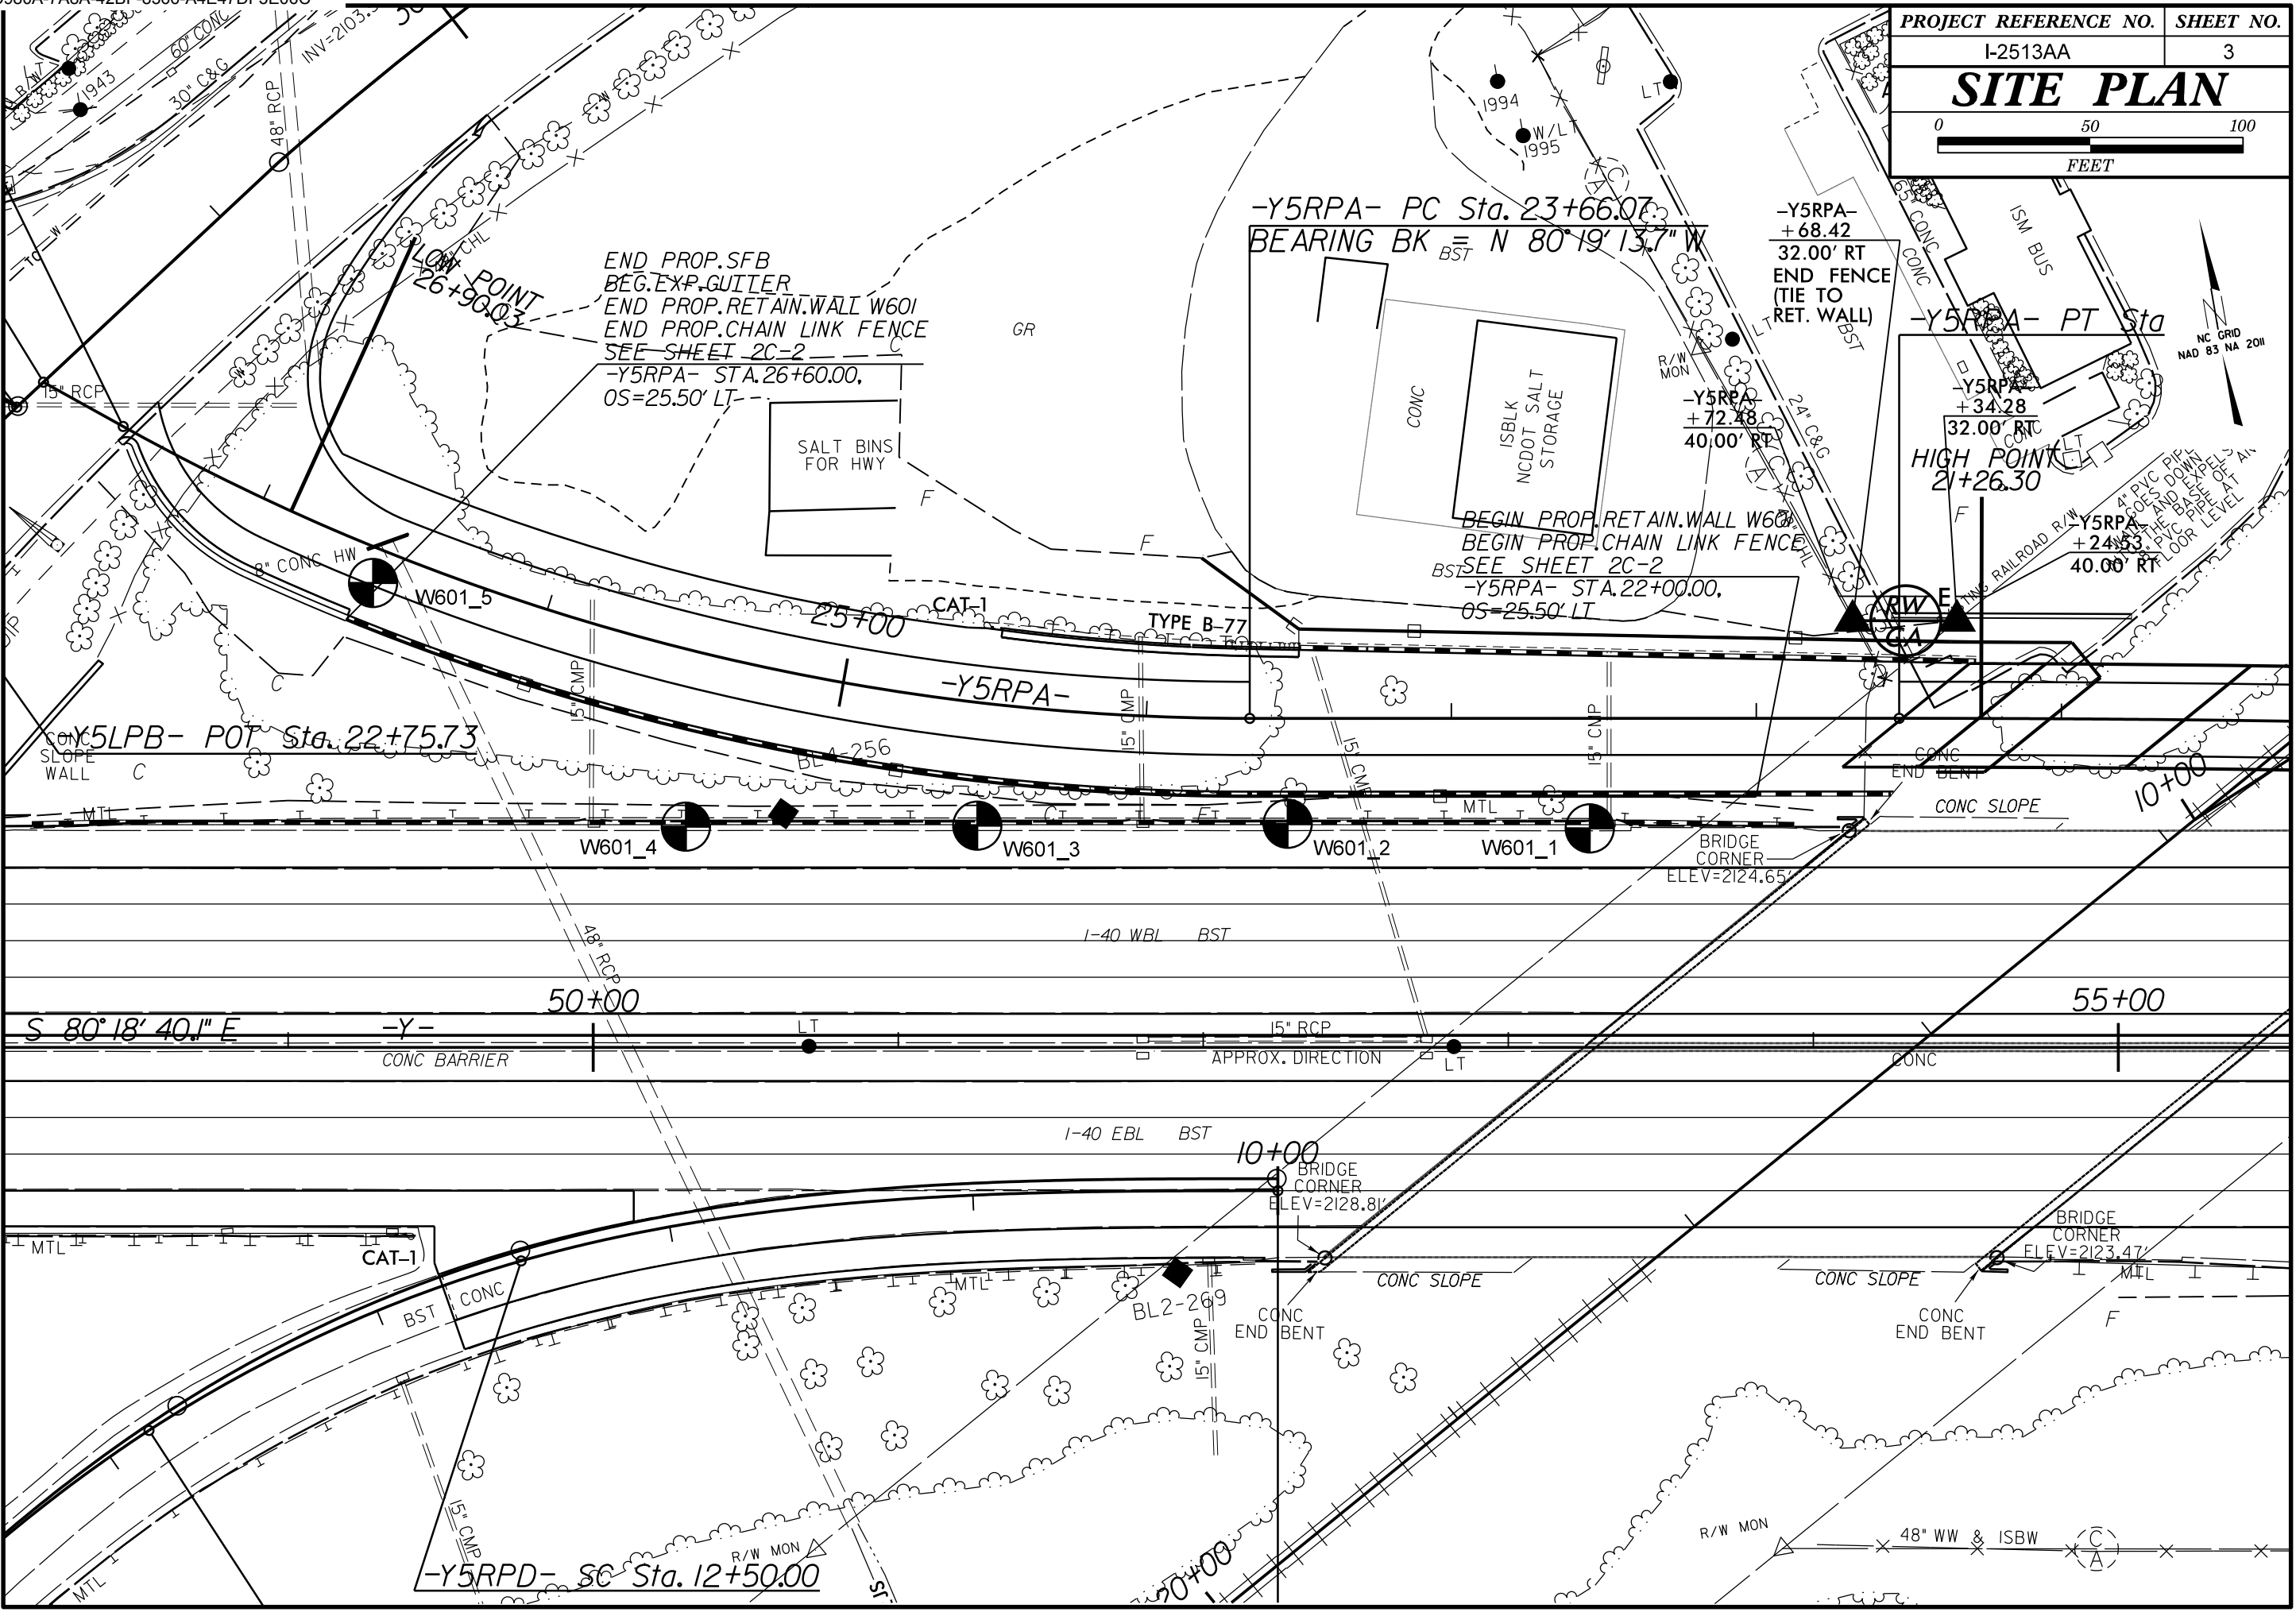

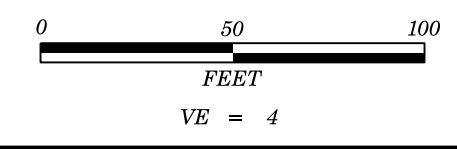

<b>PROJECT REFERENCE NO.</b>	<b>SHEET NO.</b>
I-2513AA	4
<b>RETAINING WALL NO. W601, FROM</b>	
<b>-YSRPA- STA. 22+00.00, 25.50' LT TO</b>	
<b>-YSRPA- STA. 26+60.00, 25.50' LT</b>	

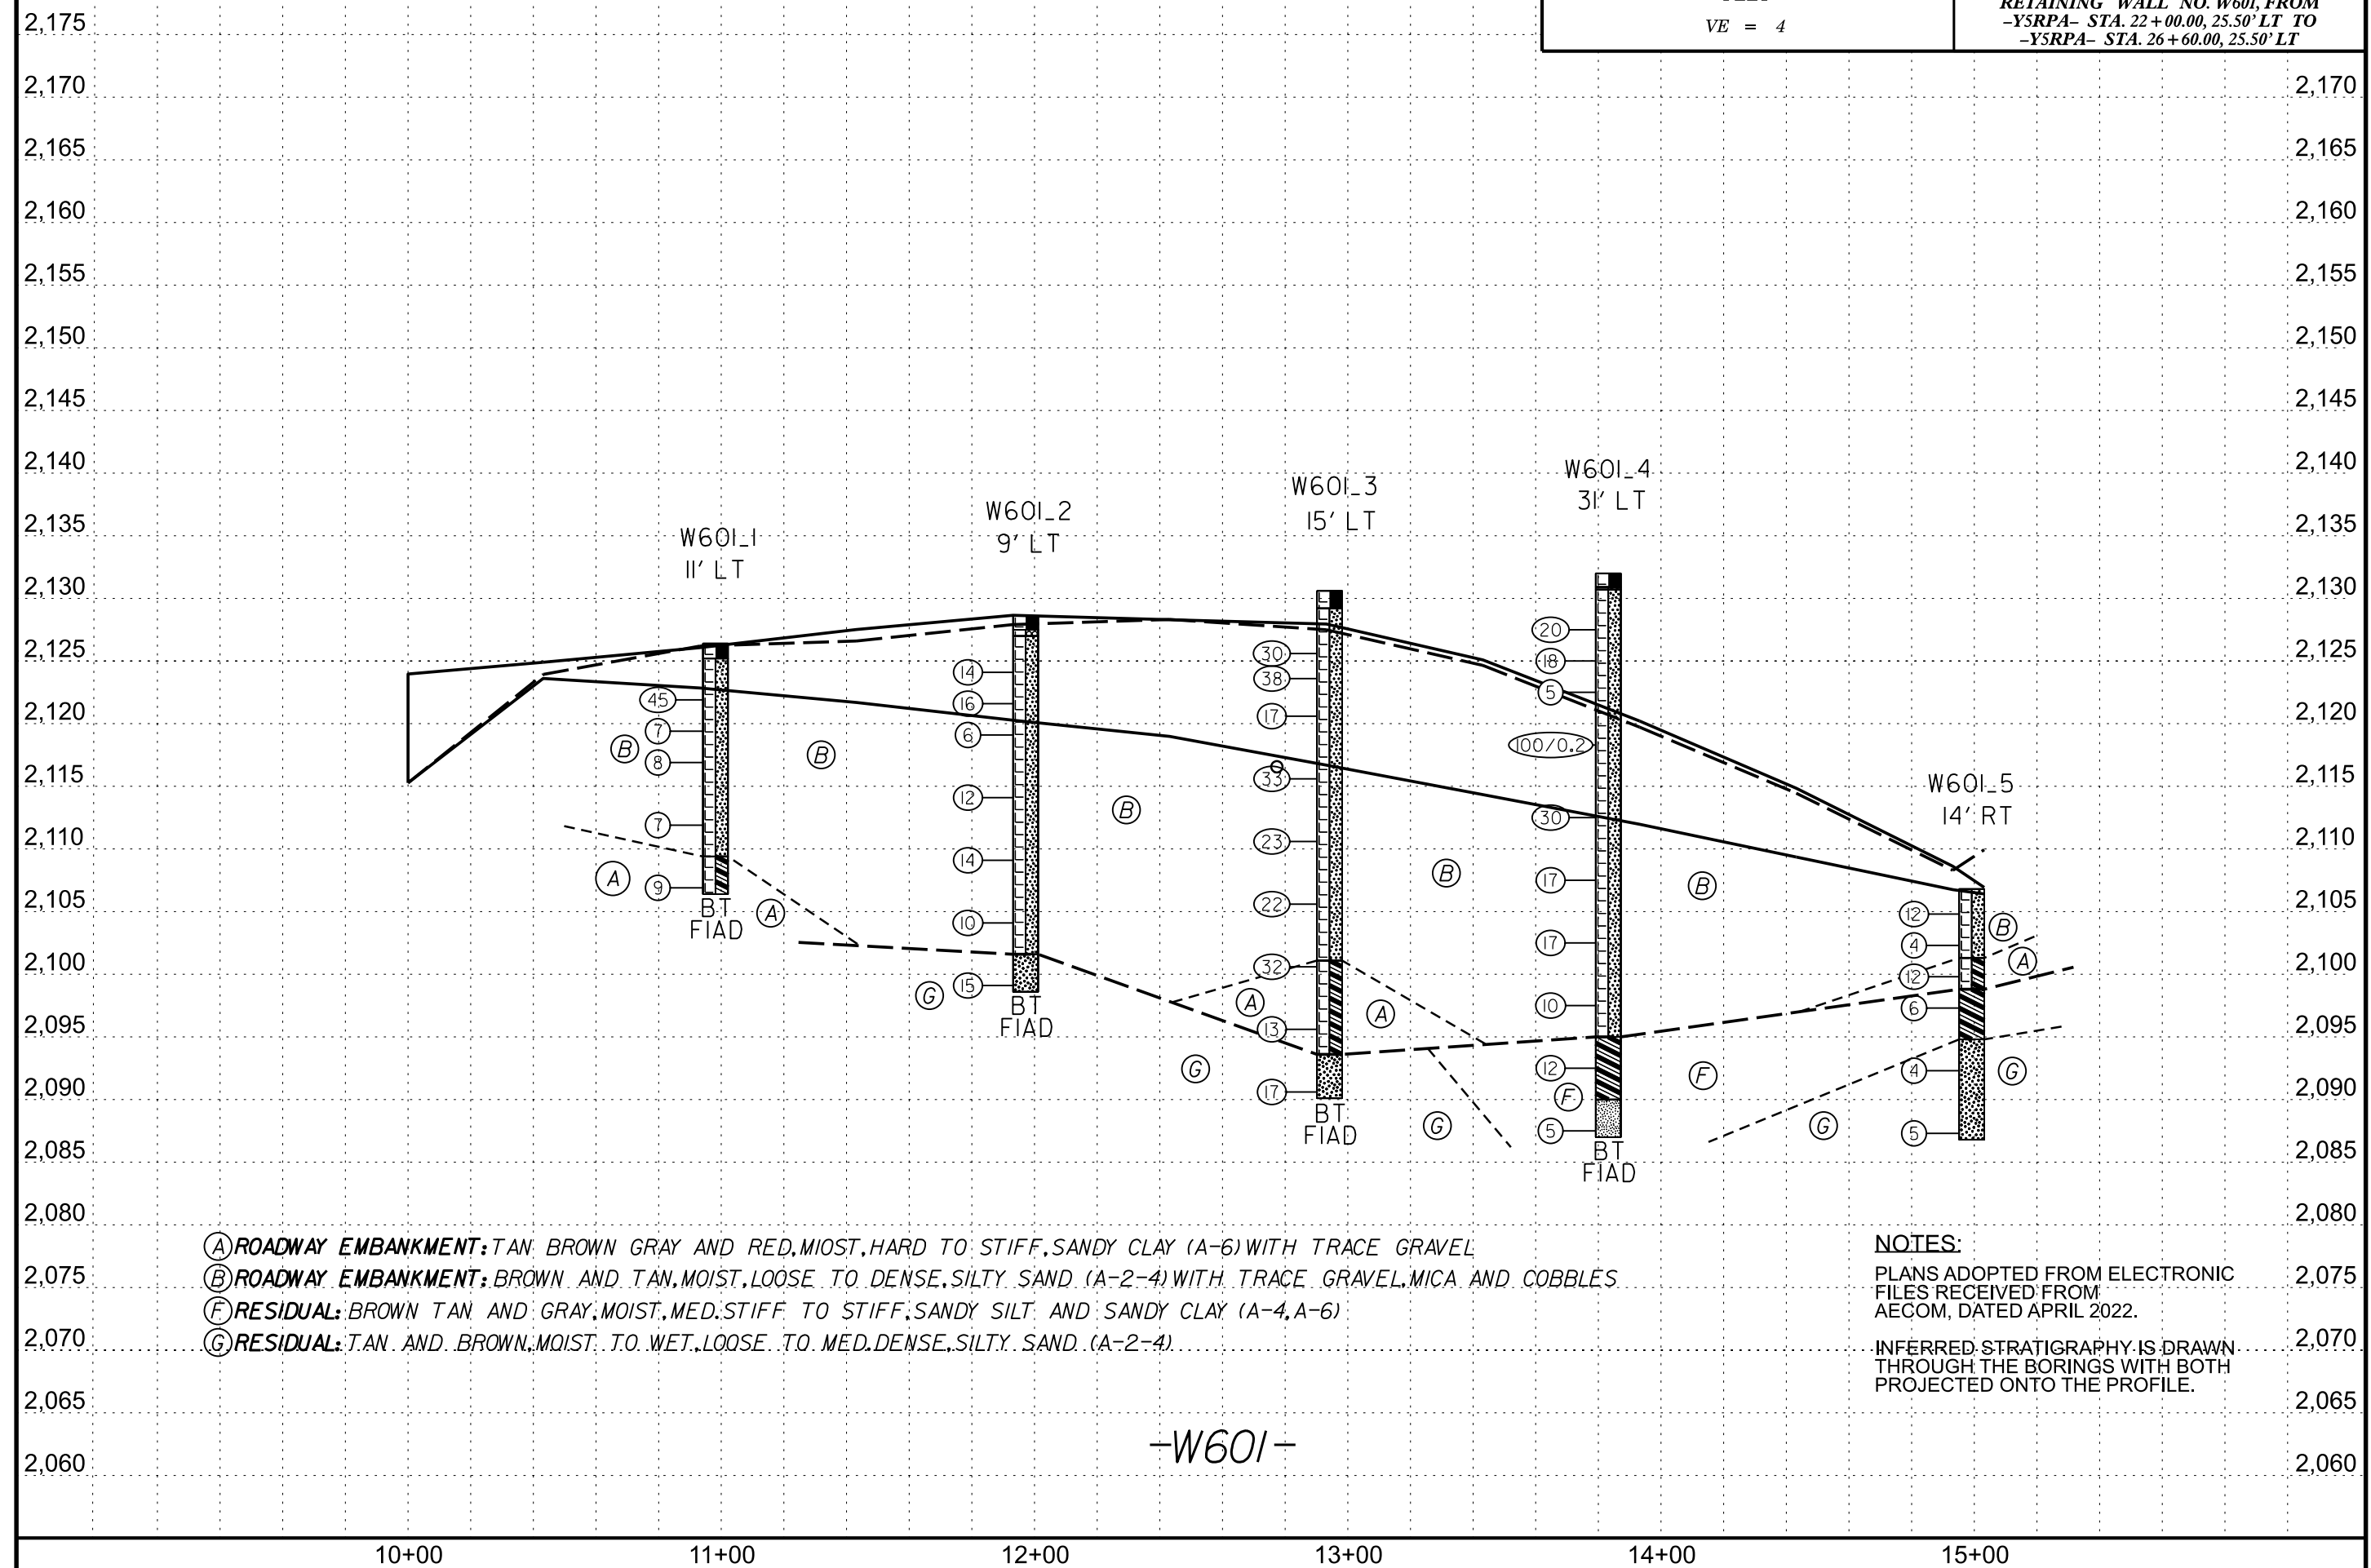

- (A) ROADWAY EMBANKMENT: TAN, BROWN GRAY AND RED, MOST, HARD TO STIFF, SANDY CLAY (A-6) WITH TRACE GRAVEL
- (B) ROADWAY EMBANKMENT: BROWN AND TAN, MOIST, LOOSE TO DENSE, SILTY SAND (A-2-4) WITH TRACE GRAVEL, MICA AND COBBLES
- (F) RESIDUAL: BROWN TAN AND GRAY, MOIST, MED: STIFF TO STIFF, SANDY SILT AND SANDY CLAY (A-4, A-6)
- (G) RESIDUAL: TAN AND BROWN, MOIST TO WET, LOOSE TO MED. DENSE, SILTY SAND (A-2-4)

**NOTES:**  
 PLANS ADOPTED FROM ELECTRONIC FILES RECEIVED FROM AECOM, DATED APRIL 2022.  
 INFERRED STRATIGRAPHY IS DRAWN THROUGH THE BORINGS WITH BOTH PROJECTED ONTO THE PROFILE.

-W601-

# GEOTECHNICAL BORING REPORT

## BORE LOG

WBS 34165.1.2		TIP 1-2513AA		COUNTY BUNCOMBE		GEOLOGIST Goodnight, D.J.									
SITE DESCRIPTION RETAINING WALL NO. W601, FROM -Y5RPA- STA. 22+00.00, 25.50' LT TO -Y5RPA- STA. 26+60.00, 25.50' LT							GROUND WTR (ft)								
BORING NO. W601_1		STATION 22+55		OFFSET 36 ft LT		ALIGNMENT -Y5RPA-									
COLLAR ELEV. 2,126.4 ft		TOTAL DEPTH 20.0 ft		NORTHING 678,257		EASTING 918,795									
DRILL RIG/HAMMER EFF./DATE CG20446 Diedrich D50 87% 05/10/2022			DRILL METHOD H.S. Augers		HAMMER TYPE Automatic										
DRILLER Odom, C.		START DATE 10/19/22		COMP. DATE 10/19/22		SURFACE WATER DEPTH N/A									
ELEV (ft)	DRIVE ELEV (ft)	DEPTH (ft)	BLOW COUNT			BLOWS PER FOOT					SAMP. NO.	LOG	SOIL AND ROCK DESCRIPTION	DEPTH (ft)	
			0.5ft	0.5ft	0.5ft	0	25	50	75	100					
2130															
2125	2,122.9	3.5	20	26	19								M	2,126.4 GROUND SURFACE 0.0 2,125.2 ASPHALT 1.2	
2120	2,120.4	6.0	5	3	4								M	ROADWAY EMBANKMENT BROWN, LOOSE TO DENSE, SILTY SAND (A-2-4) WITH LITTLE GRAVEL AND MICA	
2115	2,117.9	8.5	3	3	5								M		
2110	2,112.9	13.5	3	3	4								M		
	2,107.9	18.5	3	3	6								M	2,109.4 BROWN, STIFF, SANDY CLAY (A-6) WITH TRACE GRAVEL 17.0 2,106.4 Boring Terminated at Elevation 2,106.4 ft in RE: (A-6) 20.0	

WBS 34165.1.2		TIP 1-2513AA		COUNTY BUNCOMBE		GEOLOGIST Goodnight, D.J.									
SITE DESCRIPTION RETAINING WALL NO. W601, FROM -Y5RPA- STA. 22+00.00, 25.50' LT TO -Y5RPA- STA. 26+60.00, 25.50' LT							GROUND WTR (ft)								
BORING NO. W601_2		STATION 23+54		OFFSET 35 ft LT		ALIGNMENT -Y5RPA-									
COLLAR ELEV. 2,128.6 ft		TOTAL DEPTH 30.0 ft		NORTHING 678,275		EASTING 918,697									
DRILL RIG/HAMMER EFF./DATE CG20446 Diedrich D50 87% 05/10/2022			DRILL METHOD H.S. Augers		HAMMER TYPE Automatic										
DRILLER Odom, C.		START DATE 10/19/22		COMP. DATE 10/19/22		SURFACE WATER DEPTH N/A									
ELEV (ft)	DRIVE ELEV (ft)	DEPTH (ft)	BLOW COUNT			BLOWS PER FOOT					SAMP. NO.	LOG	SOIL AND ROCK DESCRIPTION	DEPTH (ft)	
			0.5ft	0.5ft	0.5ft	0	25	50	75	100					
2130															
2125	2,125.1	3.5	5	7	7								M	2,128.6 GROUND SURFACE 0.0 2,127.5 ASPHALT 1.1 2,127.0 AGGREGATE BASE COURSE 1.6	
2120	2,122.6	6.0	5	9	7								M	ROADWAY EMBANKMENT BROWN AND TAN, LOOSE TO MED. DENSE, SILTY SAND (A-2-4) WITH TRACE TO LITTLE MICA	
2115	2,120.1	8.5	2	2	4								M		
2110	2,115.1	13.5	4	5	7								M		
2105	2,110.1	18.5	3	6	8								M		
2100	2,105.1	23.5	5	5	5								M	2,101.6 RESIDUAL 27.0 2,098.6 TAN-BROWN, MED. DENSE, SILTY SAND (A-2-4) SAPROLITIC WITH LITTLE MICA 30.0 Boring Terminated at Elevation 2,098.6 ft in RESIDUAL: (A-2-4)	

# GEOTECHNICAL BORING REPORT BORE LOG

WBS 34165.1.2		TIP 1-2513AA		COUNTY BUNCOMBE		GEOLOGIST Goodnight, D.J.									
SITE DESCRIPTION RETAINING WALL NO. W601, FROM -Y5RPA- STA. 22+00.00, 25.50' LT TO -Y5RPA- STA. 26+60.00, 25.50' LT							GROUND WTR (ft)								
BORING NO. W601_3		STATION 24+51		OFFSET 40 ft LT		ALIGNMENT -Y5RPA-									
COLLAR ELEV. 2,130.6 ft		TOTAL DEPTH 40.5 ft		NORTHING 678,292		EASTING 918,597									
DRILL RIG/HAMMER EFF./DATE CG20446 Diedrich D50 87% 05/10/2022				DRILL METHOD H.S. Augers		HAMMER TYPE Automatic									
DRILLER Odom, C.		START DATE 10/21/22		COMP. DATE 10/21/22		SURFACE WATER DEPTH N/A									
ELEV (ft)	DRIVE ELEV (ft)	DEPTH (ft)	BLOW COUNT			BLOWS PER FOOT					SAMP. NO.	LOG MOI	SOIL AND ROCK DESCRIPTION	DEPTH (ft)	
			0.5ft	0.5ft	0.5ft	0	25	50	75	100					
2135															
2130															
2125	2,126.6	4.0	14	11	19										
	2,124.6	6.0	15	22	16										
2120	2,121.6	9.0	7	8	9										
	2,116.6	14.0	19	18	15										
2115	2,111.6	19.0	5	8	15										
2110	2,106.6	24.0	5	8	14										
2105	2,101.6	29.0	7	13	19										
2100	2,096.6	34.0	4	5	8										
2095	2,091.6	39.0	7	8	9										

WBS 34165.1.2		TIP 1-2513AA		COUNTY BUNCOMBE		GEOLOGIST Goodnight, D.J.									
SITE DESCRIPTION RETAINING WALL NO. W601, FROM -Y5RPA- STA. 22+00.00, 25.50' LT TO -Y5RPA- STA. 26+60.00, 25.50' LT							GROUND WTR (ft)								
BORING NO. W601_4		STATION 25+40		OFFSET 57 ft LT		ALIGNMENT -Y5RPA-									
COLLAR ELEV. 2,132.0 ft		TOTAL DEPTH 45.0 ft		NORTHING 678,308		EASTING 918,503									
DRILL RIG/HAMMER EFF./DATE CG20446 Diedrich D50 87% 05/10/2022				DRILL METHOD H.S. Augers		HAMMER TYPE Automatic									
DRILLER Odom, C.		START DATE 10/19/22		COMP. DATE 10/19/22		SURFACE WATER DEPTH N/A									
ELEV (ft)	DRIVE ELEV (ft)	DEPTH (ft)	BLOW COUNT			BLOWS PER FOOT					SAMP. NO.	LOG MOI	SOIL AND ROCK DESCRIPTION	DEPTH (ft)	
			0.5ft	0.5ft	0.5ft	0	25	50	75	100					
2135															
2130															
	2,132.0														0.0
	2,130.9														1.1
	2,130.7														1.3
2125	2,128.5	3.5	5	6	14										
	2,126.0	6.0	8	9	9										
2120	2,123.5	8.5	2	2	3										
	2,118.5	13.5													
2115	2,113.5	18.5	10	13	17										
2110	2,108.5	23.5	7	6	11										
2105	2,103.5	28.5	3	7	10										
2100	2,098.5	33.5	5	5	5										
2095	2,093.5	38.5	3	4	8										
2090	2,088.5	43.5	2	2	3										

NCDOT BORE DOUBLE I-1213AA\_GEO.GPJ NC\_DOT.GDT 9/8/23

# GEOTECHNICAL BORING REPORT

## BORE LOG

WBS 34165.1.2		TIP 1-2513AA		COUNTY BUNCOMBE		GEOLOGIST Goodnight, D.J.										
SITE DESCRIPTION RETAINING WALL NO. W601, FROM -Y5RPA- STA. 22+00.00, 25.50' LT TO -Y5RPA- STA. 26+60.00, 25.50' LT							GROUND WTR (ft)									
BORING NO. W601_5		STATION 26+56		OFFSET 11 ft LT		ALIGNMENT -Y5RPA-										
COLLAR ELEV. 2,106.8 ft		TOTAL DEPTH 20.0 ft		NORTHING 678,404		EASTING 918,415										
DRILL RIG/HAMMER EFF./DATE CG24113 CME-550X 74% 04/08/2022				DRILL METHOD H.S. Augers		HAMMER TYPE Automatic										
DRILLER Odom, C.		START DATE 10/06/22		COMP. DATE 10/06/22		SURFACE WATER DEPTH N/A										
ELEV (ft)	DRIVE ELEV (ft)	DEPTH (ft)	BLOW COUNT			BLOWS PER FOOT					SAMP. NO.	LOG	SOIL AND ROCK DESCRIPTION			
			0.5ft	0.5ft	0.5ft	0	25	50	75	100			ELEV. (ft)	DEPTH (ft)		
2110																
2105	2,105.8	1.0	3	4	8								M	2,106.8	0.0	GROUND SURFACE
	2,103.3	3.5	2	2	2								M			<b>ROADWAY EMBANKMENT</b> BROWN, LOOSE TO MED. DENSE, SILTY SAND (A-2-4) WITH TRACE GRAVEL
2100	2,100.8	6.0	4	4	8								M	2,101.3	5.5	BROWN AND GRAY, STIFF, SANDY CLAY (A-6) WITH TRACE GRAVEL
	2,098.3	8.5	3	3	3								M	2,098.8	8.0	<b>RESIDUAL</b> TAN, MED. STIFF, SANDY CLAY (A-6)
2095														2,094.8	12.0	TAN, LOOSE, SILTY SAND (A-2-4)
2090	2,093.3	13.5	2	2	2								W			
	2,088.3	18.5	2	2	3								W	2,086.8	20.0	Boring Terminated at Elevation 2,086.8 ft in RESIDUAL: (A-2-4)

NCDOT BORE DOUBLE I-1213AA\_GEO.GPJ NC\_DOT\_GDT\_9/8/23