

**HINDE ENGINEERING**  
 License No. C-2639  
 10815 Sikes Place, Suite 210 Charlotte, NC 28277


**DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED**

PROJECT REFERENCE NO.	SHEET NO.
U-5108	UC-10
DESIGNED BY: JKC	
DRAWN BY: JNA	
CHECKED BY: JKC	
APPROVED BY: CLS	
REVISED:	
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION UTILITIES ENGINEERING SECTION PHONE: (919) 707-6690 FAX: (919) 250-4151	
UTILITY CONSTRUCTION PLANS ONLY 3/6/2024	

**NOTE:**  
 THE ESTIMATED QUANTITY OF DUCTILE IRON WATER PIPE FITTINGS ON THIS PLAN SHEET IS 6,227 POUNDS. THE ACTUAL QUANTITY AND TYPE OF FITTINGS WILL VARY BASED ON FIELD CONDITIONS.



**UTILITY CONSTRUCTION**

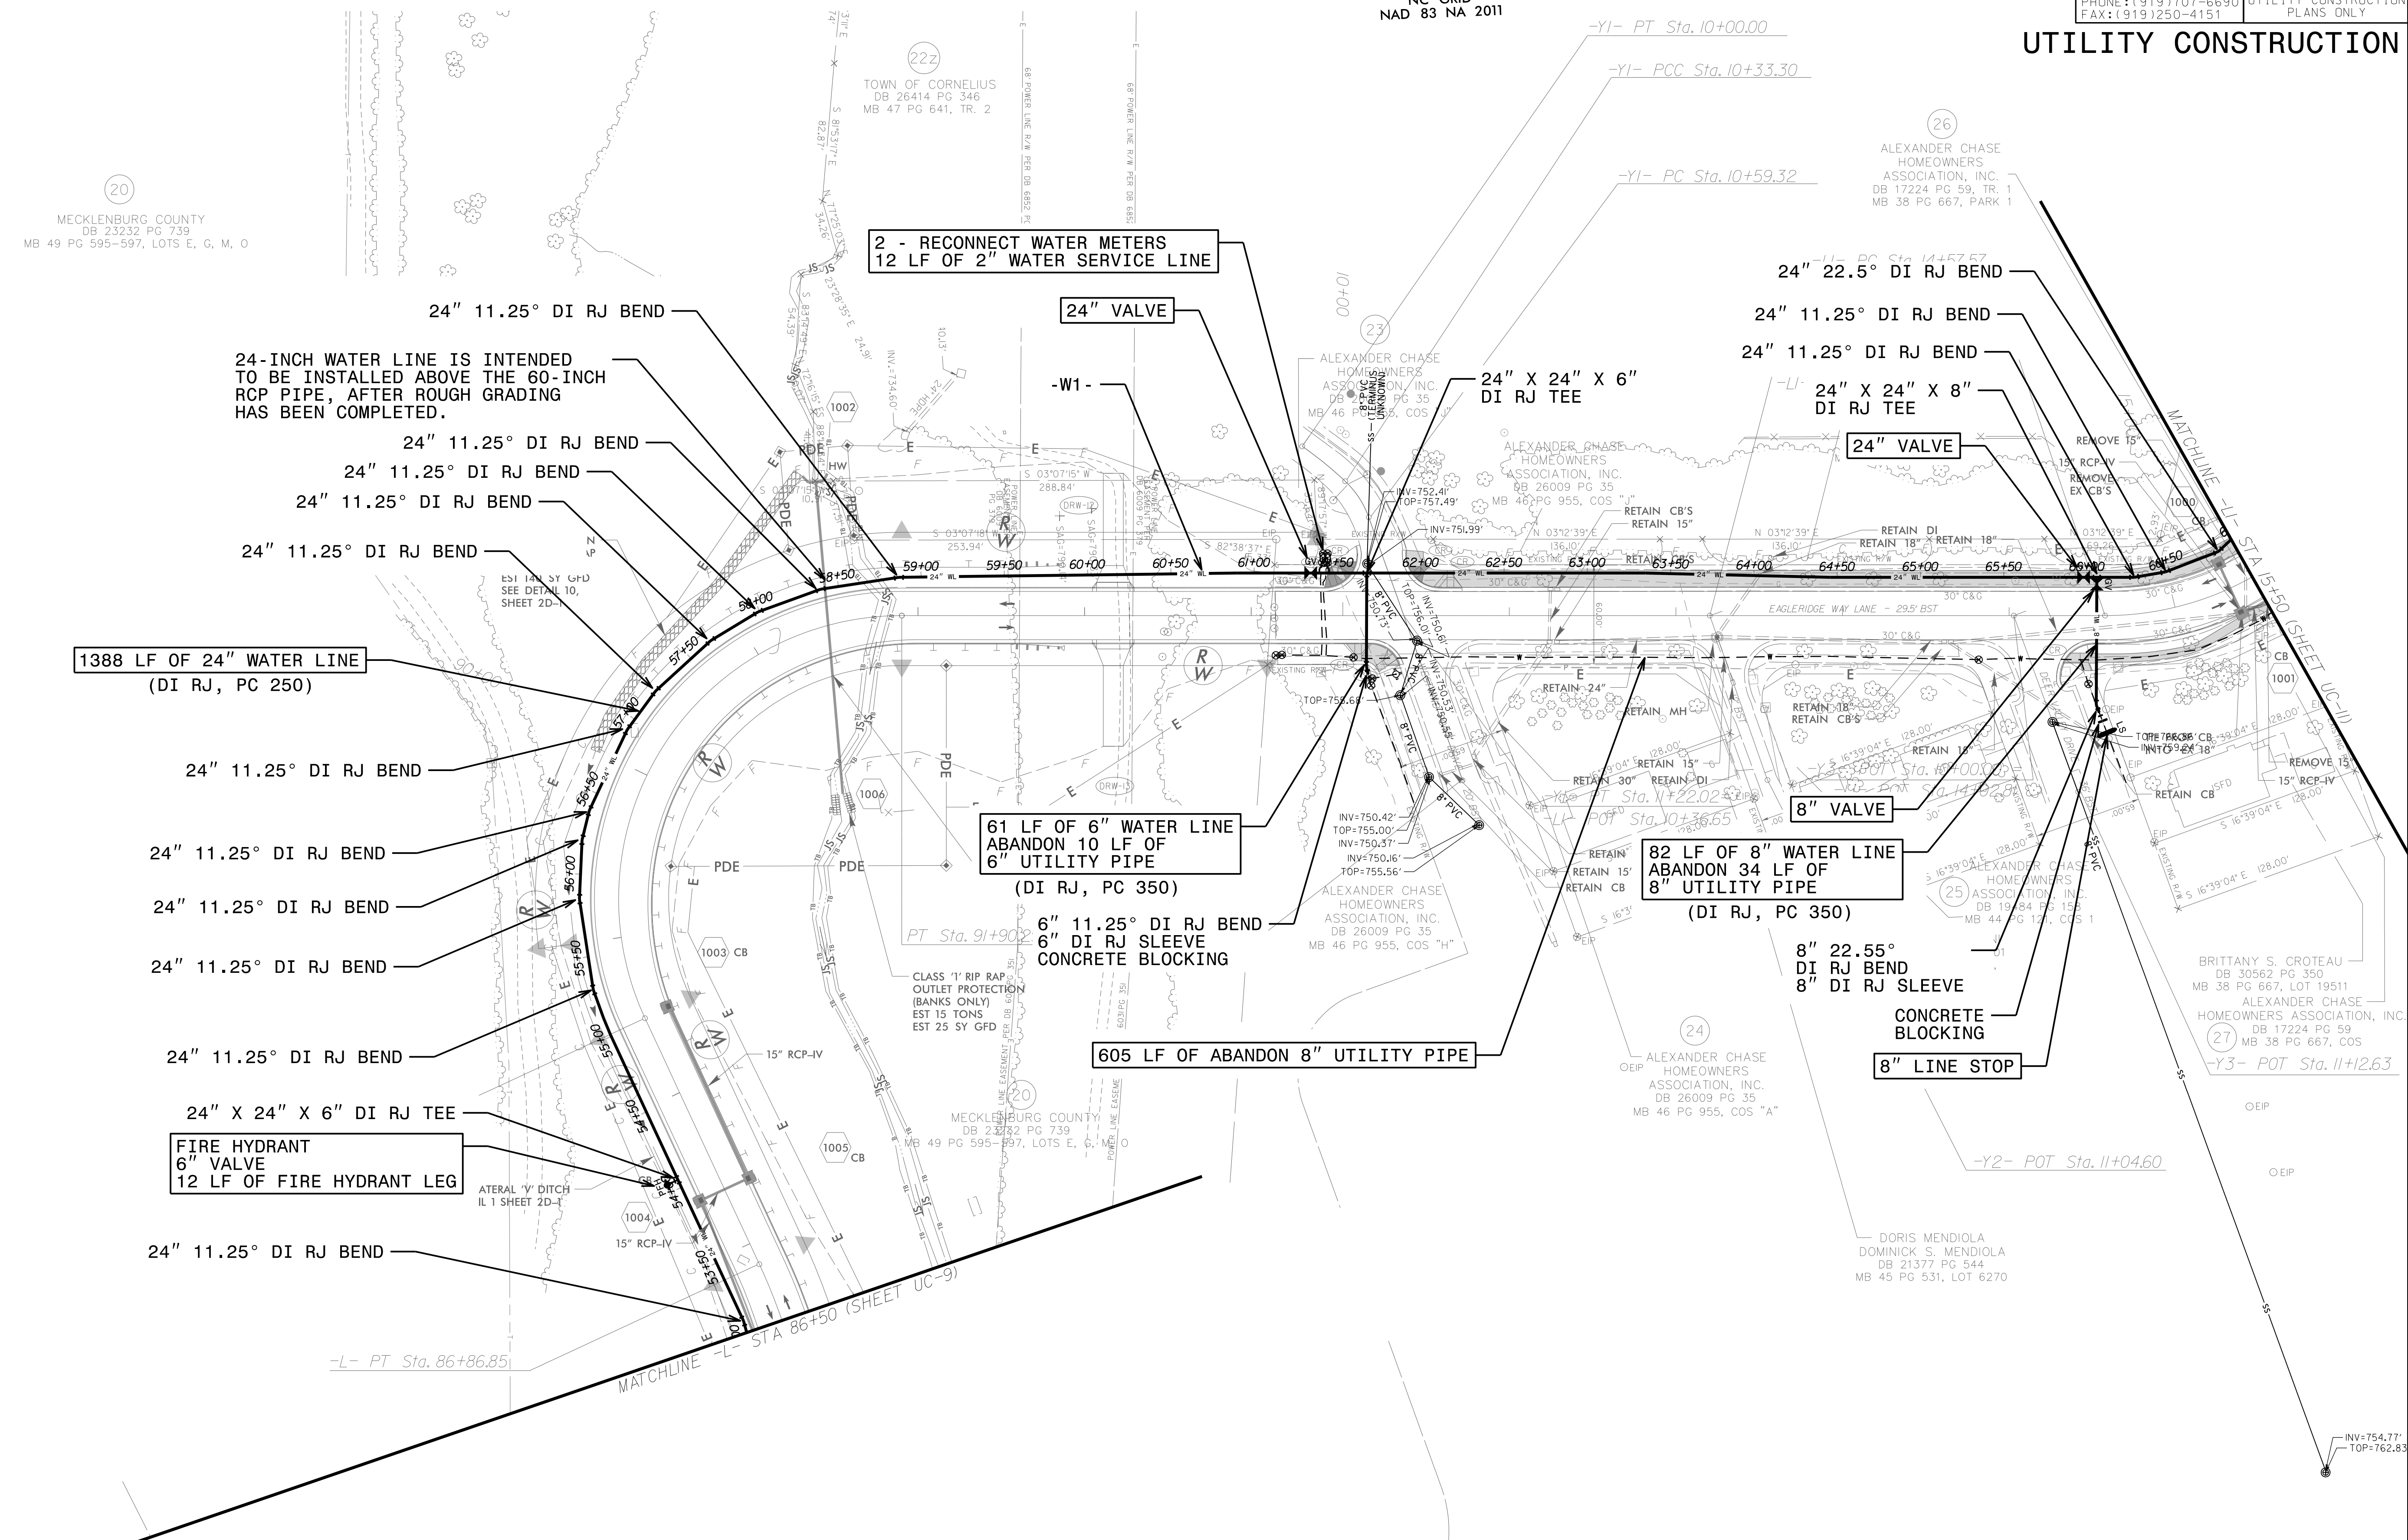

20  
 MECKLENBURG COUNTY  
 DB 23232 PG 739  
 MB 49 PG 595-597, LOTS E, G, M, O

22Z  
 TOWN OF CORNELIUS  
 DB 26414 PG 346  
 MB 47 PG 641, TR. 2

26  
 ALEXANDER CHASE HOMEOWNERS ASSOCIATION, INC.  
 DB 17224 PG 59, TR. 1  
 MB 38 PG 667, PARK 1

27  
 BRITTANY S. CROTEAU  
 DB 30562 PG 350  
 MB 38 PG 667, LOT 19511  
 ALEXANDER CHASE HOMEOWNERS ASSOCIATION, INC.  
 DB 17224 PG 59  
 MB 38 PG 667, COS

1388 LF OF 24" WATER LINE  
 (DI RJ, PC 250)

2 - RECONNECT WATER METERS  
 12 LF OF 2" WATER SERVICE LINE

61 LF OF 6" WATER LINE  
 ABANDON 10 LF OF 6" UTILITY PIPE  
 (DI RJ, PC 350)

82 LF OF 8" WATER LINE  
 ABANDON 34 LF OF 8" UTILITY PIPE  
 (DI RJ, PC 350)

605 LF OF ABANDON 8" UTILITY PIPE

FIRE HYDRANT  
 6" VALVE  
 12 LF OF FIRE HYDRANT LEG

26-MAR-2024 09:25:51  
 C:\Users\jstevens\OneDrive\Documents\Projects\2018\A2018401.001\NCDDT\_U-5108\Design\Utilities\Engineering\UC-Proj\_U-5108\_Ut\_redj10\_UC10\_psh.dgn