
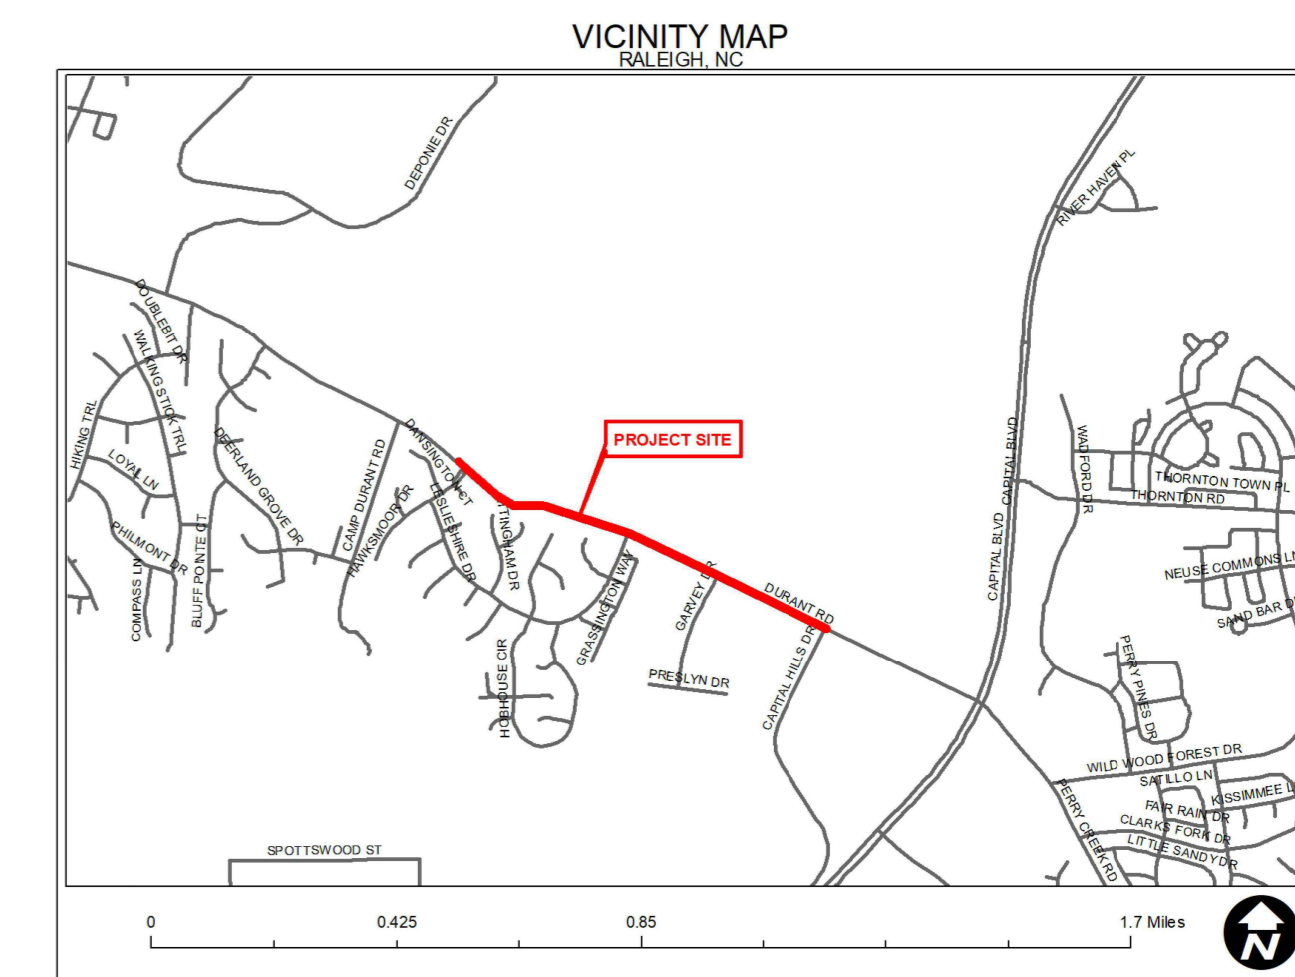


**NOTES**

1. INSTALL 2" PVC SCHEDULE 40 STICK CONDUIT PROVIDED BY DUKE ENERGY WHERE INDICATED ON DRAWING.
2. BURY CONDUIT AT LEAST 36" DEEP WITHIN THE RIGHT OF WAY.
3. INSTALL CONTINUOUS RUN OF CONDUIT AND MARK LIGHT AND PEDESTAL LOCATIONS WITH AN EXTRA PIECE OF VERTICAL CONDUIT.

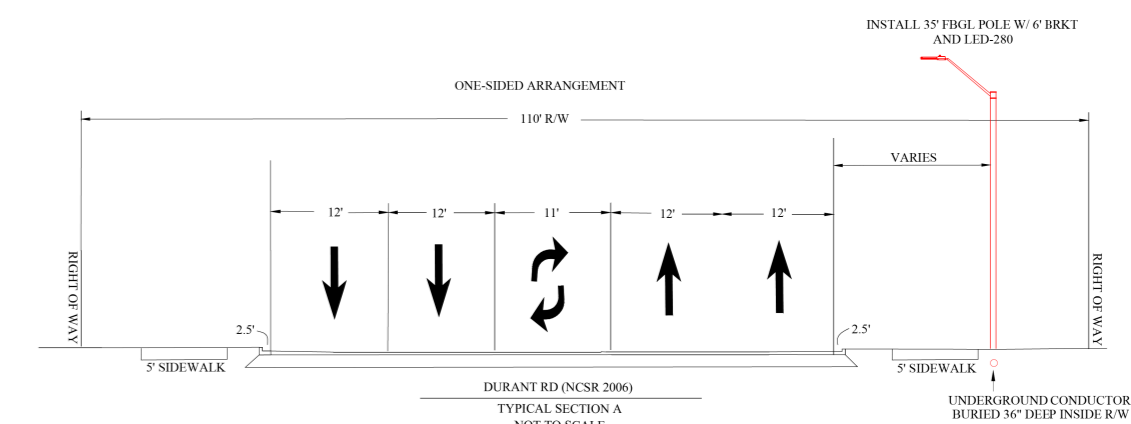

**Safety Reminders / Adverse Conditions**


**SAFETYFirst**  
 ? PERSONAL ACCOUNTABILITY  
 ? ACTIVE CAREER  
 ? HAZARD RECOGNITION

**WZS: REMEMBER "YOUR CIRCLE OF SAFETY"**  
**WZS: SET PROPER WORK ZONE NEEDED**  
**WZS: SET PROPER SIGNS, CONES, AND BARRICADES**  
**WZS: REMEMBER WALK AROUNDS AND PRETRIP**  
**WZS:**

**REMEMBER: Work zone area conditions may have changed for this job! Everyone is responsible for verifying the above safety information is correct prior to any work being performed each day.**

PROPOSED	EXISTING	REMOVE	INSTALL	LEGEND
				LED LUMINAIRE
				2" CONDUIT
				FIBERGLASS/STEEL LIGHTING POLE
				WOOD POLE
				FOREIGN POLE
				TRANSFORMER POLE MOUNTED
				STREET LIGHT CIRCUIT UNDERGROUND
				STREET LIGHT CIRCUIT OVERHEAD
				ON PRIMARY CIRCUIT
				R/W/PROPERTY LINES
				SECONDARY PEDESTAL
				TRANSFORMER PAD MOUNTED

**LIGHTING DESIGN TOLERANCE**  
 The calculated footcandle light levels in this lighting design are predicted values and are based on specific information that has been supplied to Duke Energy. Any inaccuracies in the supplied information, differences in luminaire installation, lighted area geometry including elevation differences, reflective properties of surrounding surfaces, obstructions (trees or otherwise) in the lighted area, or lighting from sources other than listed in this design may produce different results from the predicted values. Normal tolerances of voltage, lamp output, and ballast and luminaire manufacturers will also affect results.

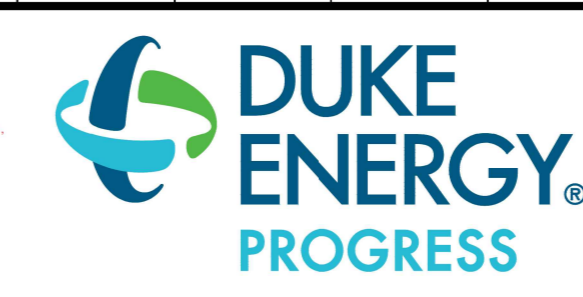

**PROPRIETARY & CONFIDENTIAL**  
 This document together with the concepts and designs presented herein, presented as an instrument of service, is the sole property of Duke Energy, and is intended only for the specific purpose and prospective client as stated in the title block of this drawing. Any use, copying, reproduction or disclosure of the drawing, design or any information contained herein by the prospective customer or other entities, including without limitation, architects, engineers, or equipment manufacturers is hereby expressly prohibited and shall not be permitted absent prior written consent from, and payment of compensation to Duke Energy. Duke Energy disclaims any liability or responsibility for any unauthorized use of or reliance on this document.

**CONDUIT ARRANGEMENT FOR**  
 (NCSR 2006) DURANT RD  
 RALEIGH, NC

Designed by DUKE ENERGY PROGRESS LIGHTING SOLUTIONS  
 Reviewed by JESSICA WESTERVELT Scale 1" = 50'  
 Date 08/03/2021 Size Drawing size "D"  
 Description WO # 31453962 (UG); WO # 28952152 (OH)  
 Drawing No. 53962 Sht. 1 OF 2

NO.	DATE	REVISION	BY

REVISIONS

5/14/99

9/13/2021