PROJECT REFERENCE NO. SHEET NO. U-3422A 2C-3


## NOTES:

CONSTRUCT STANDARD SIDEWALK 5' WIDE AND 4" THICK UNLESS OTHERWISE DENOTED ON PLANS.

PLACE A GROOVE JOINT 1" DEEP WITH 1/8" RADII IN THE CONCRETE SIDEWALK AT 5' INTERVALS.

ONE 1/2" EXPANSION JOINT WILL BE REQUIRED AT 50' INTERVALS. A 1/2" EXPANSION JOINT WILL BE REQUIRED WHERE THE SIDEWALK JOINS ANY RIGID STRUCTURE.

SEE STD. DWG. 848.06 FOR CURB RAMP LOCATION REQUIREMENTS AND CONSTRUCTION GUIDELINES.

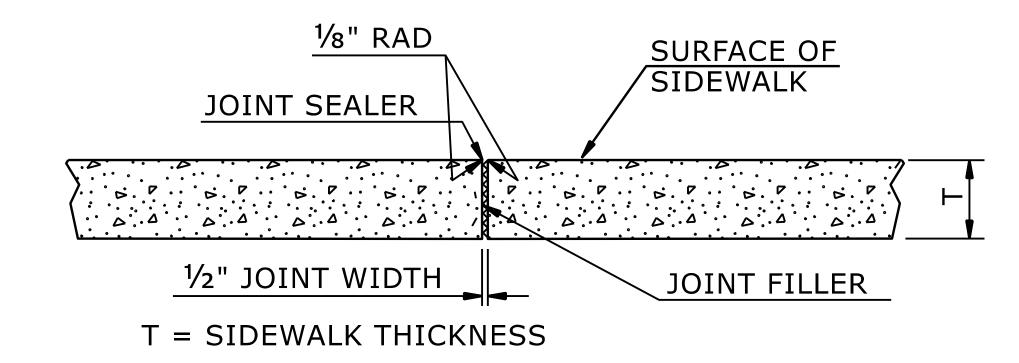

TRANSVERSE EXPANSION JOINT IN SIDEWALK

BUILDING, WALL, ETC.

PROPOSED
CONCRETE
SIDEWALK

PSAWN JOINT WITH JOINT
SEALING COMPOUND

1/8" RAD

PROPOSED
CONCRETE
SIDEWALK

PROPOSED
CONC. PAVEMENT

DETAILS SHOWING JOINTS IN CONCRETE SIDEWALK

ROADWAY DETAIL DRAWING FOR CONCRETE SIDEWALK

NA TATION WAYS



SHEET 1 OF 1 **848D01** 

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

CONTRACTS STANDARDS AND DEVELOPMENT UNIT Office 919-707-6950 FAX 919-250-4119

**SEE TITLE BLOCK** 

ORIGINAL BY: S.CALHOUN DATE: 7-25-2024

MODIFIED BY: DATE: DATE: FILE SPEC.: