

REFERENCE: R-5963A

PROJECT: 48599

CONTENTS

SHEET NO.	DESCRIPTION
1	TITLE SHEET
2	LEGEND (SOIL & ROCK)
3	SITE PLAN
4	PROFILE
5	SOIL TEST RESULTS

STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
DIVISION OF HIGHWAYS
GEOTECHNICAL ENGINEERING UNIT

STRUCTURE
SUBSURFACE INVESTIGATION

COUNTY CHATHAM
PROJECT DESCRIPTION CHATHAM PARK WAY FROM
US 15-501 TO US 64 BUSINESS

SITE DESCRIPTION RETAINING WALL NO. 5:
FROM -W5- STA. 174 + 00.00 TO -W5- STA. 176 + 98.00

STATE	STATE PROJECT REFERENCE NO.	SHEET NO.	TOTAL SHEETS
N.C.	R-5963A	1	

CAUTION NOTICE

THE SUBSURFACE INFORMATION AND THE SUBSURFACE INVESTIGATION ON WHICH IT IS BASED WERE MADE FOR THE PURPOSE OF STUDY, PLANNING AND DESIGN, AND NOT FOR CONSTRUCTION OR PAY PURPOSES. THE VARIOUS FIELD BORING LOGS, ROCK CORES AND SOIL TEST DATA AVAILABLE MAY BE REVIEWED OR INSPECTED IN RALEIGH BY CONTACTING THE N.C. DEPARTMENT OF TRANSPORTATION, GEOTECHNICAL ENGINEERING UNIT, AT (919) 707-6850. THE SUBSURFACE PLANS AND REPORTS, FIELD BORING LOGS, ROCK CORES AND SOIL TEST DATA ARE NOT PART OF THE CONTRACT.

GENERAL SOIL AND ROCK STRATA DESCRIPTIONS AND INDICATED BOUNDARIES ARE BASED ON A GEOTECHNICAL INTERPRETATION OF ALL AVAILABLE SUBSURFACE DATA AND MAY NOT NECESSARILY REFLECT THE ACTUAL SUBSURFACE CONDITIONS BETWEEN BORINGS OR BETWEEN SAMPLED STRATA WITHIN THE BOREHOLE. THE LABORATORY SAMPLE DATA AND THE IN SITU (IN-PLACE) TEST DATA CAN BE RELIED ON ONLY TO THE DEGREE OF RELIABILITY INHERENT IN THE STANDARD TEST METHOD. THE OBSERVED WATER LEVELS OR SOIL MOISTURE CONDITIONS INDICATED IN THE SUBSURFACE INVESTIGATIONS ARE AS RECORDED AT THE TIME OF THE INVESTIGATION. THESE WATER LEVELS OR SOIL MOISTURE CONDITIONS MAY VARY CONSIDERABLY WITH TIME ACCORDING TO CLIMATIC CONDITIONS INCLUDING TEMPERATURES, PRECIPITATION AND WIND, AS WELL AS OTHER NON-CLIMATIC FACTORS.

THE BIDDER OR CONTRACTOR IS CAUTIONED THAT DETAILS SHOWN ON THE SUBSURFACE PLANS ARE PRELIMINARY ONLY AND IN MANY CASES THE FINAL DESIGN DETAILS ARE DIFFERENT. FOR BIDDING AND CONSTRUCTION PURPOSES, REFER TO THE CONSTRUCTION PLANS AND DOCUMENTS FOR FINAL DESIGN INFORMATION ON THIS PROJECT. THE DEPARTMENT DOES NOT WARRANT OR GUARANTEE THE SUFFICIENCY OR ACCURACY OF THE INVESTIGATION MADE, NOR THE INTERPRETATIONS MADE, OR OPINION OF THE DEPARTMENT AS TO THE TYPE OF MATERIALS AND CONDITIONS TO BE ENCOUNTERED. THE BIDDER OR CONTRACTOR IS CAUTIONED TO PERFORM INDEPENDENT SUBSURFACE INVESTIGATIONS AND MAKE INTERPRETATIONS AS NECESSARY TO CONFIRM CONDITIONS ENCOUNTERED ON THE PROJECT. THE CONTRACTOR SHALL HAVE NO CLAIM FOR ADDITIONAL COMPENSATION OR FOR AN EXTENSION OF TIME FOR ANY REASON RESULTING FROM THE ACTUAL CONDITIONS ENCOUNTERED AT THE SITE DIFFERING FROM THOSE INDICATED IN THE SUBSURFACE INFORMATION.

- NOTES:
- THE INFORMATION CONTAINED HEREIN IS NOT IMPLIED OR GUARANTEED BY THE N.C. DEPARTMENT OF TRANSPORTATION AS ACCURATE NOR IS IT CONSIDERED PART OF THE PLANS, SPECIFICATIONS OR CONTRACT FOR THE PROJECT.
 - BY HAVING REQUESTED THIS INFORMATION, THE CONTRACTOR SPECIFICALLY WAIVES ANY CLAIMS FOR INCREASED COMPENSATION OR EXTENSION OF TIME BASED ON DIFFERENCES BETWEEN THE CONDITIONS INDICATED HEREIN AND THE ACTUAL CONDITIONS AT THE PROJECT SITE.

PERSONNEL

P. TOMASIC, P.G.

CG2 EXPLORATION

INVESTIGATED BY CG2, PLLC

DRAWN BY K. DE MONTBRUN, P.E.

CHECKED BY M. WALKO, P.E.

SUBMITTED BY CG2, PLLC


DATE NOVEMBER 2024

Prepared in the Office of:



CAROLINAS
GEOTECHNICAL
GROUP

2400 CROWNPOINT EXECUTIVE DRIVE
SUITE 800
CHARLOTTE, NC 28227
(980) 339-8684

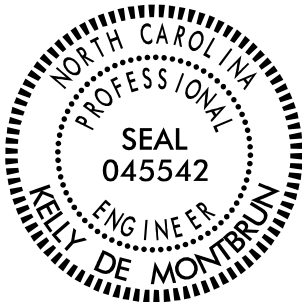

Signed by: Kelly De Montbrun 12/04/2024

Signature: _____ DATE: _____

DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED

NORTH CAROLINA DEPARTMENT OF TRANSPORTATION

DIVISION OF HIGHWAYS

GEOTECHNICAL ENGINEERING UNIT


SUBSURFACE INVESTIGATION

SOIL AND ROCK LEGEND, TERMS, SYMBOLS, AND ABBREVIATIONS

SOIL DESCRIPTION										GRADATION										ROCK DESCRIPTION										TERMS AND DEFINITIONS									
SOIL IS CONSIDERED UNCONSOLIDATED, SEMI-CONSOLIDATED, OR WEATHERED EARTH MATERIALS THAT CAN BE PENETRATED WITH A CONTINUOUS FLIGHT POWER AUGER AND YIELD LESS THAN 100 BLOWS PER FOOT ACCORDING TO THE STANDARD PENETRATION TEST (AASHTO T 206, ASTM D1586). SOIL CLASSIFICATION IS BASED ON THE AASHTO SYSTEM. BASIC DESCRIPTIONS GENERALLY INCLUDE THE FOLLOWING: CONSISTENCY, COLOR, TEXTURE, MOISTURE, AASHTO CLASSIFICATION, AND OTHER PERTINENT FACTORS SUCH AS MINERALOGICAL COMPOSITION, ANGULARITY, STRUCTURE, PLASTICITY, ETC. FOR EXAMPLE, <i>VERY STIFF, GRAY, SILTY CLAY, MOIST WITH INTERBEDDED FINE SAND LAYERS, HIGHLY PLASTIC, A-7-6</i>										WELL GRADED - INDICATES A GOOD REPRESENTATION OF PARTICLE SIZES FROM FINE TO COARSE. UNIFORMLY GRADED - INDICATES THAT SOIL PARTICLES ARE ALL APPROXIMATELY THE SAME SIZE. GAP-GRADED - INDICATES A MIXTURE OF UNIFORM PARTICLE SIZES OF TWO OR MORE SIZES.										HARD ROCK IS NON-COASTAL PLAIN MATERIAL THAT WOULD YIELD SPT REFUSAL IF TESTED. AN INFERRED ROCK LINE INDICATES THE LEVEL AT WHICH NON-COASTAL PLAIN MATERIAL WOULD YIELD SPT REFUSAL. SPT REFUSAL IS PENETRATION BY A SPLIT SPOON SAMPLER EQUAL TO OR LESS THAN 0.1 FOOT PER 60 BLOWS IN NON-COASTAL PLAIN MATERIAL. THE TRANSITION BETWEEN SOIL AND ROCK IS OFTEN REPRESENTED BY A ZONE OF WEATHERED ROCK. ROCK MATERIALS ARE TYPICALLY DIVIDED AS FOLLOWS:										ALLUVIUM (ALLUV.) - SOILS THAT HAVE BEEN TRANSPORTED BY WATER. AQUIFER - A WATER BEARING FORMATION OR STRATA. ARENACEOUS - APPLIED TO ROCKS THAT HAVE BEEN DERIVED FROM SAND OR THAT CONTAIN SAND. ARGILLACEOUS - APPLIED TO ALL ROCKS OR SUBSTANCES COMPOSED OF CLAY MINERALS, OR HAVING A NOTABLE PROPORTION OF CLAY IN THEIR COMPOSITION, SUCH AS SHALE, SLATE, ETC. ARTESIAN - GROUND WATER THAT IS UNDER SUFFICIENT PRESSURE TO RISE ABOVE THE LEVEL AT WHICH IT IS ENCOUNTERED, BUT WHICH DOES NOT NECESSARILY RISE TO OR ABOVE THE GROUND SURFACE. CALCAREOUS (CALC.) - SOILS THAT CONTAIN APPRECIABLE AMOUNTS OF CALCIUM CARBONATE. COLLUVIUM - ROCK FRAGMENTS MIXED WITH SOIL DEPOSITED BY GRAVITY ON SLOPE OR AT BOTTOM OF SLOPE. CORE RECOVERY (REC.) - TOTAL LENGTH OF ALL MATERIAL RECOVERED IN THE CORE BARREL DIVIDED BY TOTAL LENGTH OF CORE RUN AND EXPRESSED AS A PERCENTAGE. DIKE - A TABULAR BODY OF IGNEOUS ROCK THAT CUTS ACROSS THE STRUCTURE OF ADJACENT ROCKS OR CUTS MASSIVE ROCK. DIP - THE ANGLE AT WHICH A STRATUM OR ANY PLANAR FEATURE IS INCLINED FROM THE HORIZONTAL. DIP DIRECTION (DIP AZIMUTH) - THE DIRECTION OR BEARING OF THE HORIZONTAL TRACE OF THE LINE OF DIP, MEASURED CLOCKWISE FROM NORTH. FAULT - A FRACTURE OR FRACTURE ZONE ALONG WHICH THERE HAS BEEN DISPLACEMENT OF THE SIDES RELATIVE TO ONE ANOTHER PARALLEL TO THE FRACTURE. FISSILE - A PROPERTY OF SPLITTING ALONG CLOSELY SPACED PARALLEL PLANES. FLOAT - ROCK FRAGMENTS ON SURFACE NEAR THEIR ORIGINAL POSITION AND DISLOGGED FROM PARENT MATERIAL. FLOOD PLAIN (FP) - LAND BORDERING A STREAM, BUILT OF SEDIMENTS DEPOSITED BY THE STREAM. FORMATION (FM.) - A MAPPABLE GEOLOGIC UNIT THAT CAN BE RECOGNIZED AND TRACED IN THE FIELD. JOINT - FRACTURE IN ROCK ALONG WHICH NO APPRECIABLE MOVEMENT HAS OCCURRED. LEDGE - A SHELF-LIKE RIDGE OR PROJECTION OF ROCK WHOSE THICKNESS IS SMALL COMPARED TO ITS LATERAL EXTENT. LENS - A BODY OF SOIL OR ROCK THAT THINS OUT IN ONE OR MORE DIRECTIONS. MOTTLED (MOT.) - IRREGULARLY MARKED WITH SPOTS OF DIFFERENT COLORS. MOTTLING IN SOILS USUALLY INDICATES POOR AERATION AND LACK OF GOOD DRAINAGE. PERCHED WATER - WATER MAINTAINED ABOVE THE NORMAL GROUND WATER LEVEL BY THE PRESENCE OF AN INTERVENING IMPERVIOUS STRATUM. RESIDUAL (RES.) SOIL - SOIL FORMED IN PLACE BY THE WEATHERING OF ROCK. ROCK QUALITY DESIGNATION (RQD) - A MEASURE OF ROCK QUALITY DESCRIBED BY TOTAL LENGTH OF ROCK SEGMENTS EQUAL TO OR GREATER THAN 4 INCHES DIVIDED BY THE TOTAL LENGTH OF CORE RUN AND EXPRESSED AS A PERCENTAGE. SAPROLITE (SAP.) - RESIDUAL SOIL THAT RETAINS THE RELIC STRUCTURE OR FABRIC OF THE PARENT ROCK. SILL - AN INTRUSIVE BODY OF IGNEOUS ROCK OF APPROXIMATELY UNIFORM THICKNESS AND RELATIVELY THIN COMPARED WITH ITS LATERAL EXTENT, THAT HAS BEEN EMPLACED PARALLEL TO THE BEDDING OR SCHISTOSITY OF THE INTRUDED ROCKS. SLICKENSIDE - POLISHED AND STRIATED SURFACE THAT RESULTS FROM FRICTION ALONG A FAULT OR SLIP PLANE. STANDARD PENETRATION TEST (PENETRATION RESISTANCE) (SPT) - NUMBER OF BLOWS (N OR BPF) OF A 140 LB. HAMMER FALLING 30 INCHES REQUIRED TO PRODUCE A PENETRATION OF 1 FOOT INTO SOIL WITH A 2 INCH OUTSIDE DIAMETER SPLIT SPOON SAMPLER. SPT REFUSAL IS PENETRATION EQUAL TO OR LESS THAN 0.1 FOOT PER 60 BLOWS. STRATA CORE RECOVERY (SREC.) - TOTAL LENGTH OF STRATA MATERIAL RECOVERED DIVIDED BY TOTAL LENGTH OF STRATUM AND EXPRESSED AS A PERCENTAGE. STRATA ROCK QUALITY DESIGNATION (SROD) - A MEASURE OF ROCK QUALITY DESCRIBED BY TOTAL LENGTH OF ROCK SEGMENTS WITHIN A STRATUM EQUAL TO OR GREATER THAN 4 INCHES DIVIDED BY THE TOTAL LENGTH OF STRATA AND EXPRESSED AS A PERCENTAGE. TOPSOIL (TS.) - SURFACE SOILS USUALLY CONTAINING ORGANIC MATTER.									
SOIL LEGEND AND AASHTO CLASSIFICATION										ANGULARITY OF GRAINS										WEATHERED ROCK (WR)										CRISTALLINE ROCK (CR)									
GENERAL CLASS.		GRANULAR MATERIALS (≤ 35% PASSING #200)					SILT-CLAY MATERIALS (> 35% PASSING #200)					ORGANIC MATERIALS					CRYSTALLINE ROCK (CR)		NON-COASTAL PLAIN MATERIAL THAT WOULD YIELD SPT N VALUES > 100 BLOWS PER FOOT IF TESTED.																				
GROUP CLASS.	A-1-a	A-1-b	A-3	A-2-4	A-2	A-2-6	A-2-7	A-4	A-5	A-6	A-7	A-1, A-2	A-3	A-4, A-5	A-6, A-7	FINE TO COARSE GRAIN IGNEOUS AND METAMORPHIC ROCK THAT WOULD YIELD SPT REFUSAL IF TESTED. ROCK TYPE INCLUDES GRANITE, GNEISS, GABBRO, SCHIST, ETC.																							
SYMBOL																																							
% PASSING #10 #40 #200	50 MX 30 MX 50 MX 51 MN 10 MX 35 MX 35 MX 35 MX 35 MX 36 MN 36 MN 36 MN 36 MN															GRANULAR SOILS					SILT-CLAY SOILS					MUCK, PEAT													
MATERIAL PASSING #40 LL PI	- 6 MX					- NP					40 MX 41 MN 40 MX 41 MN 40 MX 41 MN 40 MX 41 MN 40 MX 41 MN 40 MX 41 MN					SOILS WITH LITTLE OR MODERATE AMOUNTS OF ORGANIC MATTER					HIGHLY ORGANIC SOILS																		
GROUP INDEX	0					0					4 MX					8 MX 12 MX 16 MX NO MX																							
USUAL TYPES OF MAJOR MATERIALS	STONE FRAGS, GRAVEL, AND SAND					FINE SAND					SILTY OR CLAYEY GRAVEL AND SAND					SILTY SOILS					CLAYEY SOILS																		
GEN. RATING AS SUBGRADE	EXCELLENT TO GOOD										FAIR TO POOR					FAIR TO POOR					POOR					UNSATURABLE													
PI OF A-7-5 SUBGROUP IS ≤ LL - 30; PI OF A-7-6 SUBGROUP IS > LL - 30																																							
CONSISTENCY OR DENSENESS										MISCELLANEOUS SYMBOLS										ROCK HARDNESS										BEDDING									
PRIMARY SOIL TYPE		COMPACTNESS OR CONSISTENCY		RANGE OF STANDARD PENETRATION RESISTANCE (N-VALUE)				RANGE OF UNCONFINED COMPRESSIVE STRENGTH (TONS/FT ²)				ROADWAY EMBANKMENT (RE) WITH SOIL DESCRIPTION		25/025 DIP & DIP DIRECTION OF ROCK STRUCTURES		SLOPE INDICATOR INSTALLATION		SEVERE (SEV.)		ALL ROCK EXCEPT QUARTZ DISCOLORED OR STAINED. ROCK FABRIC CLEAR AND EVIDENT BUT REDUCED IN STRENGTH TO STRONG SOIL. IN GRANITOID ROCKS ALL FELDSPARS ARE KAOLINIZED TO SOME EXTENT. SOME FRAGMENTS OF STRONG ROCK USUALLY REMAIN. IF TESTED, WOULD YIELD SPT REFUSAL		VERY SEVERE (V SEV.)		ALL ROCK EXCEPT QUARTZ DISCOLORED OR STAINED. ROCK FABRIC ELEMENTS ARE DISCERNIBLE BUT MASS IS EFFECTIVELY REDUCED TO SOIL STATUS, WITH ONLY FRAGMENTS OF STRONG ROCK REMAINING. SAPROLITE IS AN EXAMPLE OF ROCK WEATHERED TO A DEGREE THAT ONLY MINOR VESTIGES OF ORIGINAL ROCK FABRIC REMAIN. IF TESTED, WOULD YIELD SPT N VALUES < 100 BPF		COMPLETE		ROCK REDUCED TO SOIL. ROCK FABRIC NOT DISCERNIBLE, OR DISCERNIBLE ONLY IN SMALL AND SCATTERED CONCENTRATIONS. QUARTZ MAY BE PRESENT AS DIKES OR STRINGERS. SAPROLITE IS ALSO AN EXAMPLE.											
GENERALLY GRANULAR MATERIAL (NON-COHESIVE)		VERY LOOSE LOOSE MEDIUM DENSE DENSE VERY DENSE		< 4 4 TO 10 10 TO 30 30 TO 50				N/A				SOIL SYMBOL		TEST BORING		CONE PENETROMETER TEST																							
GENERALLY SILT-CLAY MATERIAL (COHESIVE)		VERY SOFT SOFT MEDIUM STIFF STIFF VERY STIFF HARD		< 2 2 TO 4 4 TO 8 8 TO 15 15 TO 30 > 30				< 0.25 0.25 TO 0.5 0.5 TO 1.0 1 TO 2 2 TO 4 > 4				ARTIFICIAL FILL (AF) OTHER THAN ROADWAY EMBANKMENT		AUGER BORING		TEST BORING WITH CORE		SOUNDING ROD																					
												INFERRED SOIL BOUNDARY		CORE BORING																									
												INFERRED ROCK LINE		MONITORING WELL																									
												ALLUVIAL SOIL BOUNDARY		PIEZOMETER INSTALLATION		SPT N-VALUE																							
TEXTURE OR GRAIN SIZE										RECOMMENDATION SYMBOLS										ROCK HARDNESS										BEDDING									
U.S. STD. SIEVE SIZE OPENING (MM)		4 10 40 60 200 270		4.76 2.00 0.42 0.25 0.075 0.053																																			
BOULDER (BLDR.)		COBBLE (COB.)		GRAVEL (GR.)		COARSE SAND (CSE. SD.)		FINE SAND (F SD.)		SILT (SL.)		CLAY (CL.)																											
GRAIN SIZE		305 75 2.0 0.25 0.05 0.005																																					
SOIL MOISTURE - CORRELATION OF TERMS										ABBREVIATIONS										ROCK HARDNESS										BEDDING									
SOIL MOISTURE SCALE (ATTERBERG LIMITS)		FIELD MOISTURE DESCRIPTION		GUIDE FOR FIELD MOISTURE DESCRIPTION				AR - AUGER REFUSAL		MED. - MEDIUM MICA. - MICACEOUS MOD. - MODERATELY NP - NON PLASTIC ORG. - ORGANIC PMT - PRESSUREMETER TEST		VST - VANE SHEAR TEST		WEA. - WEATHERED		UNIT WEIGHT		DRY UNIT WEIGHT		SAMPLE ABBREVIATIONS		SOFT		CAN BE GROUDED OR GOUGED READILY BY KNIFE OR PICK. CAN BE EXCAVATED IN FRAGMENTS FROM CHIPS TO SEVERAL INCHES IN SIZE BY MODERATE BLOWS OF A PICK POINT. SMALL, THIN PIECES CAN BE BROKEN BY FINGER PRESSURE.		VERY SOFT		CAN BE CARVED WITH KNIFE. CAN BE EXCAVATED READILY WITH POINT OF PICK. PIECES 1 INCH OR MORE IN THICKNESS CAN BE BROKEN BY FINGER PRESSURE. CAN BE SCRATCHED READILY BY FINGERNAIL.											
LL - LIQUID LIMIT		- SATURATED - (SAT.)		USUALLY LIQUID; VERY WET, USUALLY FROM BELOW THE GROUND WATER TABLE				CL. - CLAY		CPT - CONE PENETRATION TEST		CSE. - COARSE DMT - DILATOMETER TEST		DPT - DYNAMIC PENETRATION TEST		e - VOID RATIO		F - FINE		FOSS. - FOSSILIFEROUS		FRAC. - FRACTURED, FRACTURES		FRAGS. - FRAGMENTS		HL. - HIGHLY		SIL. - SILTY		SL. - SLIGHTLY		TRI. - TRICONE REFUSAL		w - MOISTURE CONTENT		V - VERY			
PL - PLASTIC LIMIT		- WET - (W)		SEMISOLID; REQUIRES DRYING TO ATTAIN OPTIMUM MOISTURE				F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE					
OM - OPTIMUM MOISTURE		- MOIST - (M)		SOLID; AT OR NEAR OPTIMUM MOISTURE				F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE					
SL - SHRINKAGE LIMIT		- DRY - (D)		REQUIRES ADDITIONAL WATER TO ATTAIN OPTIMUM MOISTURE				F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE		F - FINE					
PLASTICITY										EQUIPMENT USED ON SUBJECT PROJECT										ROCK HARDNESS										BEDDING									
NON PLASTIC		SLIGHTLY PLASTIC		MODERATELY PLASTIC		HIGHLY PLASTIC		PLASTICITY INDEX (PI)		DRY STRENGTH		DRILL UNITS:		ADVANCING TOOLS:		HAMMER TYPE:		CORE SIZE:		HAND TOOLS:		FOR SEDIMENTARY ROCKS, INDURATION IS THE HARDENING OF MATERIAL BY CEMENTING, HEAT, PRESSURE, ETC.		FRIABLE		MODERATELY INDURATED		INDURATED		EXTREMELY INDURATED									
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT		MEDIUM		HIGH		CME-45C		CME-55		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X		CME-550X							
0-5		6-15		16-25		26 OR MORE		VERY LOW		SLIGHT																													

PROJECT REFERENCE NO.	SHEET NO.
R-5963A	3
SITE PLAN	
0 50 100 FEET	

RETAINING WALL NO. 5:
FROM -W5- STA. 174+00.00
TO -W5- STA. 176+98.00

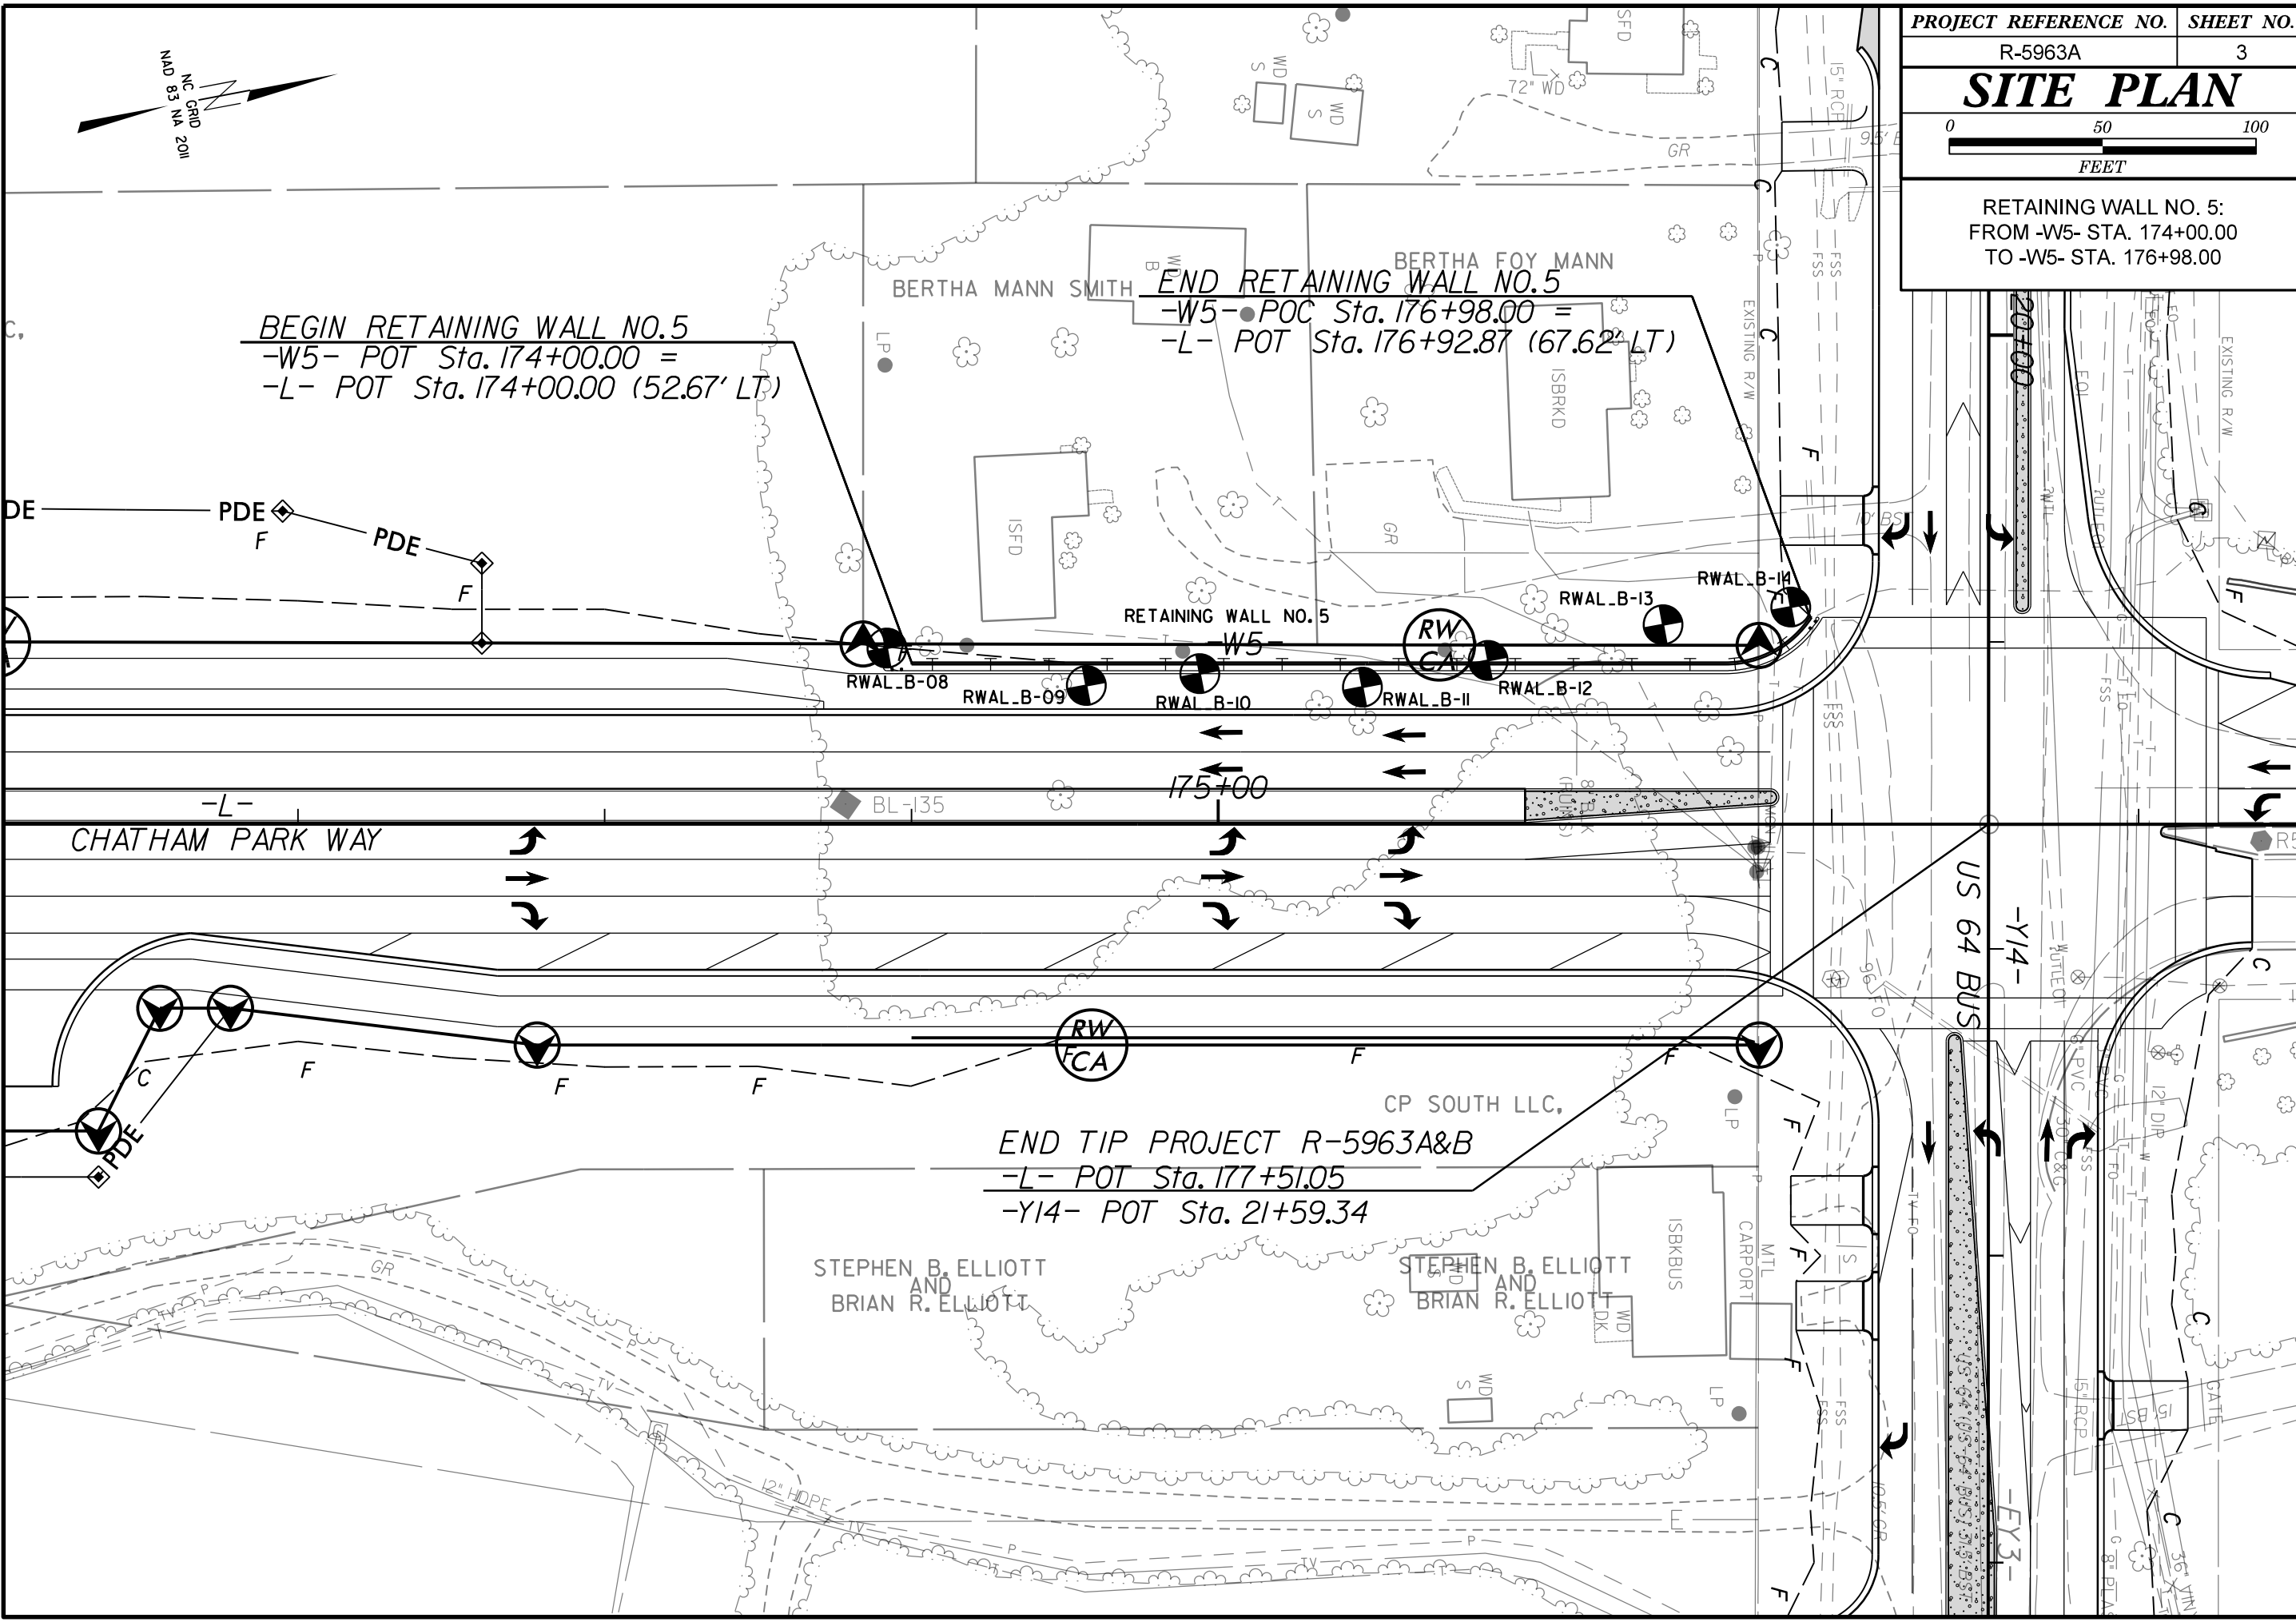

BEGIN RETAINING WALL NO.5
-W5- POT Sta. 174+00.00 =
-L- POT Sta. 174+00.00 (52.67' LT)


END RETAINING WALL NO.5
-W5- POT Sta. 176+98.00 =
-L- POT Sta. 176+92.87 (67.62' LT)

END TIP PROJECT R-5963A&B
-L- POT Sta. 177+51.05
-Y14- POT Sta. 21+59.34


5/14/99

-W5-

EXISTING GROUND LINE AND RETAINING WALL ENVELOPE ALONG
-W5- TAKEN FROM ROADWAY DESIGN PLANS PROVIDED
BY NCDOT. INFERRED STRATIGRAPHY IS DRAWN THROUGH THE BORING
WITH BOTH PROJECTED ONTO THE WALL ENVELOPE.



PROJECT REFERENCE NO.	SHEET NO.
R-5963A	4
RETAINING WALL NO. 5 PROFILE: BORINGS PROJECTED ALONG WALL ENVELOPE	

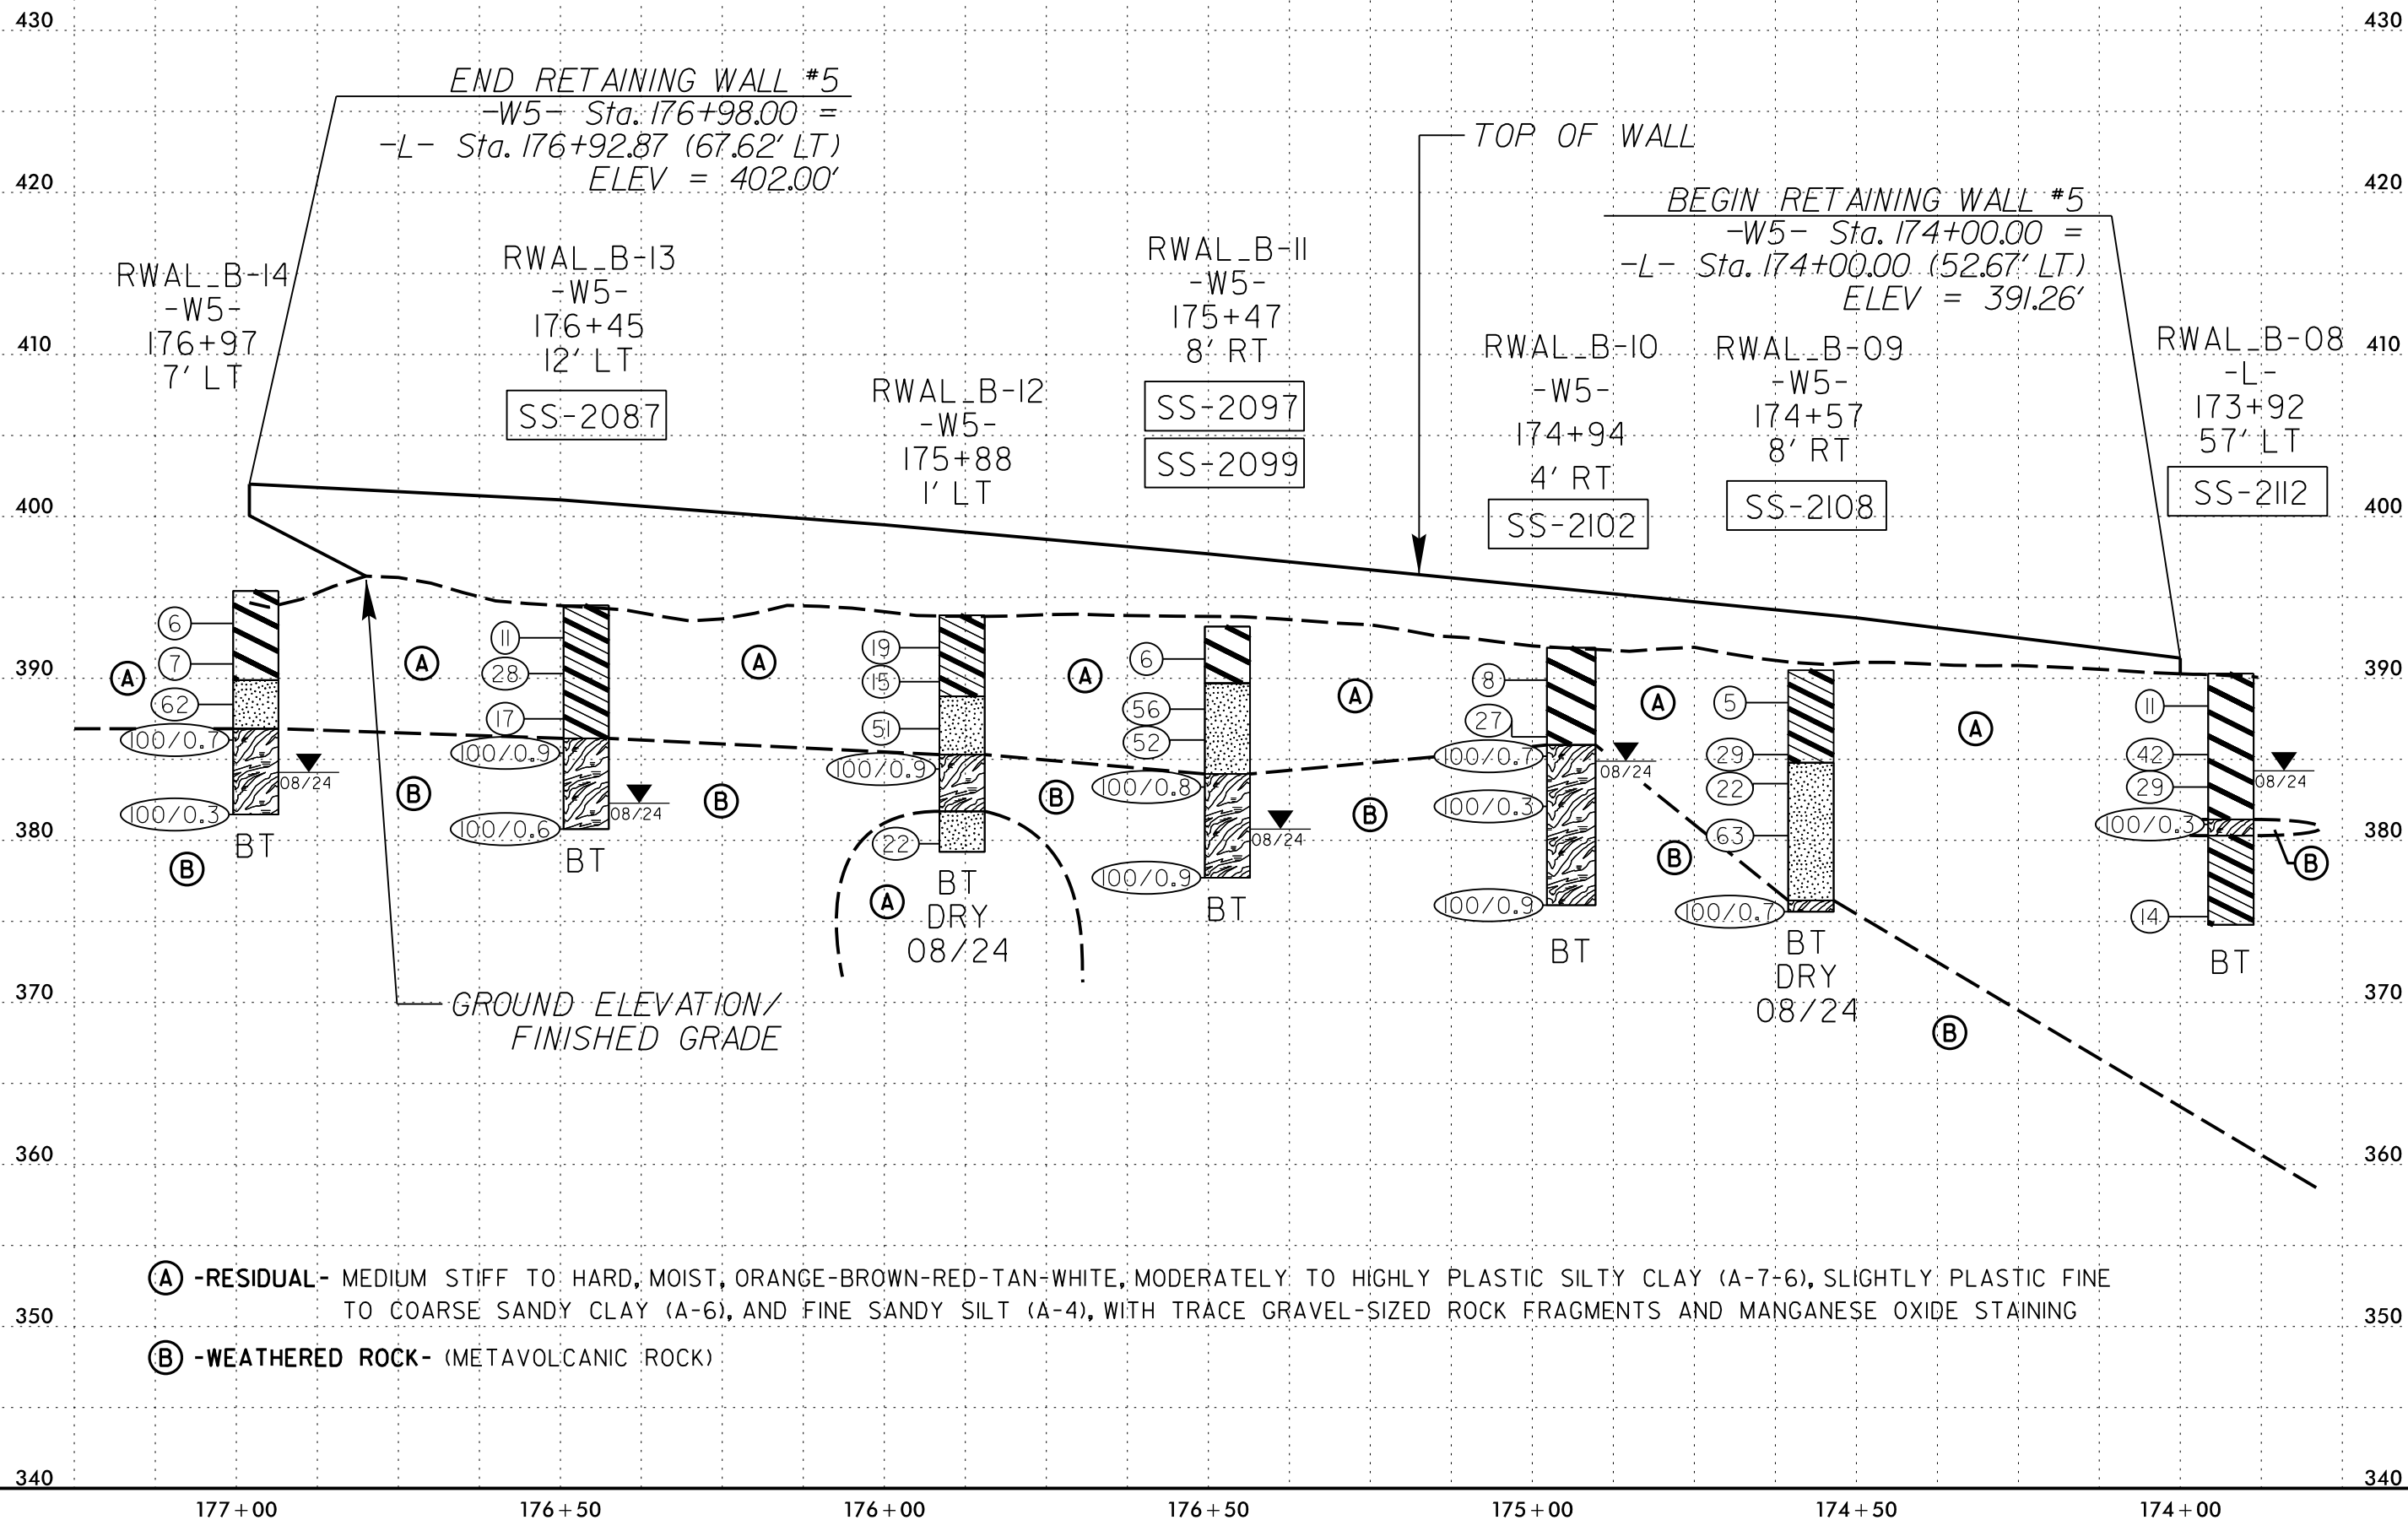

SOIL TEST RESULTS																		
BORING ID	SAMPLE NO.	OFFSET	STATION	NORTHING	EASTING	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.I.	% BY WEIGHT				% PASSING (SIEVES)			%	%
										C. SAND	F. SAND	SILT	CLAY	10	40	200	MOISTURE	ORGANIC
RWAL B-08	SS-2112	57' LT	173+92 -L-	716139	1955579	1.0 - 2.5'	A-7-6(29)	56	28	5.0	3.6	34.1	57.3	96.9	92.8	89.6	24.0	ND
RWAL B-09	SS-2108	8' RT	174+57 -W5-	716201	1955603	4.2 - 5.7'	A-6(12)	37	14	3.4	2.9	62.8	30.9	88.6	86.4	83.9	12.4	ND
RWAL B-10	SS-2102	4' RT	174+94 -W5-	716238	1955606	1.0 - 2.5'	A-7-6(17)	46	19	9.0	4.4	47.8	38.8	93.7	86.8	82.0	28.8	ND
RWAL B-11	SS-2097	8' RT	175+47 -W5-	716289	1955620	1.0 - 2.5'	A-7-6(22)	49	27	5.5	5.5	43.8	45.2	89.3	85.3	81.2	30.8	ND
RWAL B-11	SS-2099	8' RT	175+47 -W5-	716289	1955620	6.0 - 7.5'	A-4(9)	36	10	7.5	7.6	68.3	16.6	98.5	93.4	85.5	28.5	ND
RWAL B-13	SS-2087	12' LT	176+45 -W5-	716389	1955618	1.0 - 2.5'	A-6(7)	35	13	7.1	4.6	47.5	40.8	73.5	69.5	65.6	24.9	ND

Alex M. Armulky

AUTHORIZED SIGNATURE
NCDOT CERT NO. 130-04-0212

Prepared in the Office of:
F&ME CONSULTANTS, INC.
COLUMBIA, SOUTH CAROLINA
NCDOT LAB CERT. NO. 130-0212