


* INDICATES EPOXY COATED REINFORCING STEEL



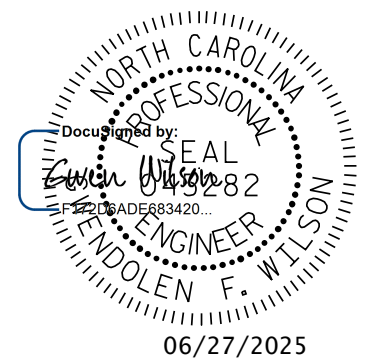


NOTES

FOR SECTION A-A AND B-B, SEE "JOINT DETAILS" SHEET.

GROOVED CONTRACTION JOINTS, 1/2" IN DEPTH, SHALL BE TOOLED IN ALL EXPOSED FACES OF THE CONCRETE MEDIAN STRIP IN ACCORDANCE WITH ARTICLE 825-10(B) OF THE STANDARD SPECIFICATIONS. THE CONTRACTION JOINTS SHALL BE LOCATED AT A SPACING OF 8 FEET TO 10 FEET BETWEEN EXPANSION JOINTS. NO CONTRACTION JOINTS WILL BE REQUIRED FOR SEGMENTS LESS THAN 10 FEET IN LENGTH.

THE CONCRETE MEDIAN IS TO BE REMOVED PRIOR TO PLACEMENT OF PC OVERLAY
AND REBUILT ONCE THE PC OVERLAY HAS BEEN COMPLETED AND FULLY CURED.

	SHOTCRETE REPAIRS
	CLASS II SURFACE PREPARATION
	SCARIFYING, SHOTBLASTING, AND POLYMER CONCRETE OVERLAY

**DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED**



Johnson, Mirmiran, & Thompson Inc.
4700 Falls of Neuse Rd, Suite 100,
Raleigh, NC, 27609
License No: C-3097

SHEET 3 OF 4

STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH

PLAN OF SPAN
SPAN C

		REVISIONS						SHEET NO. S1-6	
INC.	NO.	BY:	DATE:	NO.	BY:	DATE:			
	1			3					
	2			4					
							TOTAL SHEETS 21		

DWN. BY: BC	DATE: 10/2024
CHKD. BY: GFW	DATE: 11/2024