
PROJECT REFERENCE NO R-5600 2C-10

## NOTES:

CONSTRUCT STANDARD SIDEWALK 5' WIDE AND 4" THICK UNLESS OTHERWISE DENOTED ON PLANS.

PLACE A GROOVE JOINT 1" DEEP WITH 1/8" RADII IN THE CONCRETE SIDEWALK AT 5' INTERVALS. ONE ½" EXPANSION JOINT WILL BE REQUIRED AT 50' INTERVALS. A 1/2" EXPANSION JOINT WILL BE REQUIRED WHERE THE SIDEWALK JOINS ANY RIGID STRUCTURE.

SEE STD. DWG. 848.06 FOR CURB RAMP LOCATION REQUIREMENTS AND CONSTRUCTION GUIDELINES.

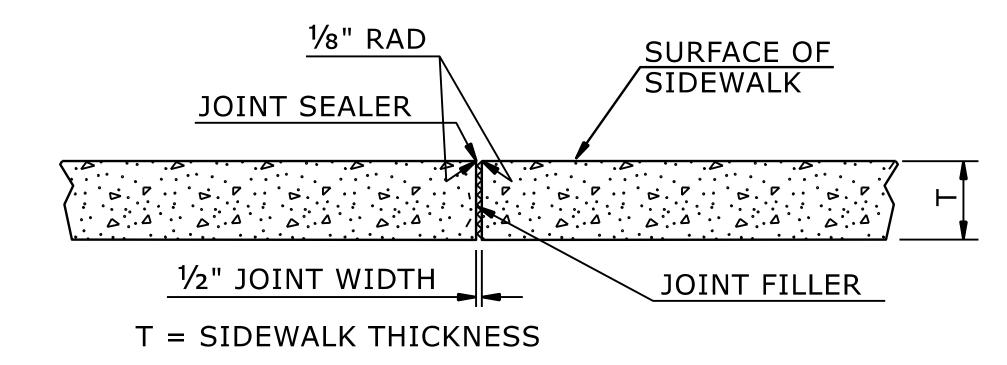

TRANSVERSE EXPANSION JOINT IN SIDEWALK

1/2" EXPANSION JOINT FILL 3/8" WIDE x 1" DEEP GROOVED OR SAWN JOINT WITH JOINT SEALING COMPOUND BUILDING, 1/8" RAD WALL, ETC. 1/8" RAD PROPOSED CONCRETE PROP. C&G CONC. PAVEMENT SIDEWALK

DETAILS SHOWING JOINTS IN CONCRETE SIDEWALK

ROADWAY CONCR

VA TATION WAYS



SHEET 1 OF 1 848D01

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

CONTRACTS STANDARDS AND DEVELOPMENT UNIT 919-707-6950 FAX 919-250-4119

SEE TITLE BLOCK

ORIGINAL BY: S.CALHOUN MODIFIED BY: CHECKED BY: FILE SPEC.: