


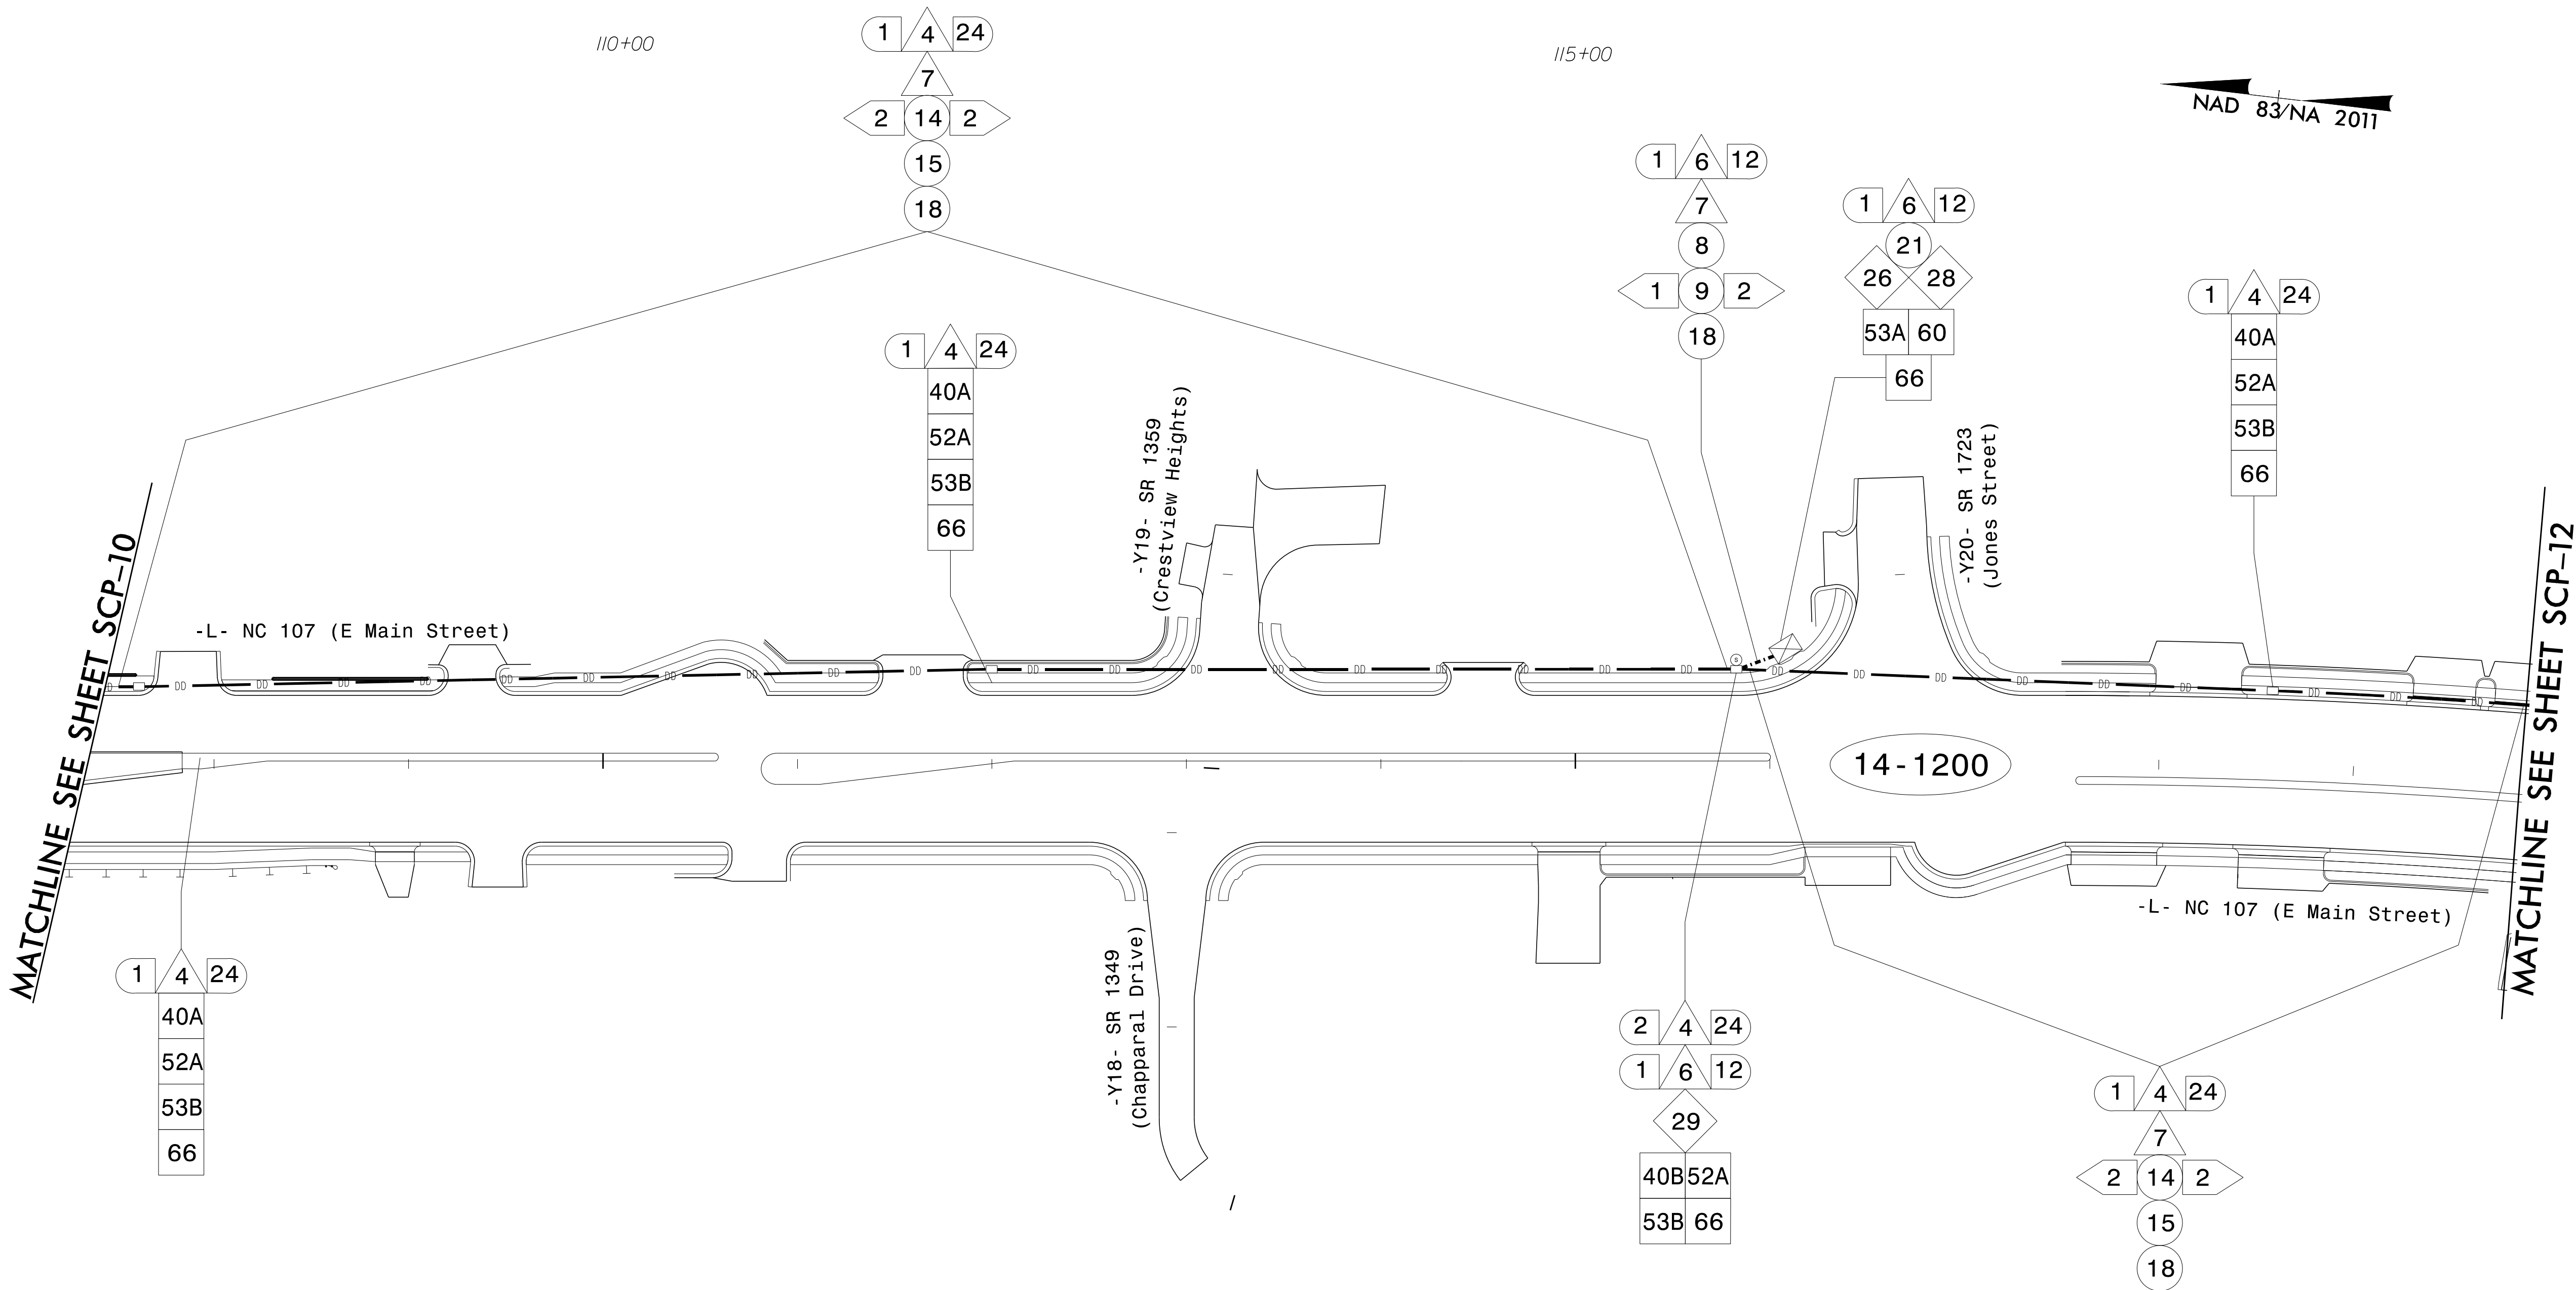

- NOTES:
1. UNLESS OTHERWISE NOTED:
 - OVERLASH NEW FIBER OPTIC CABLE TO EXISTING MESSENGER CABLE.
 2. SEAL ALL CONDUIT ENDS WITH DUCT AND CONDUIT SEALER, AT ALL JUNCTION BOX/CABINET ENTRANCES.
 3. ALTERNATE CONSTRUCTION METHODS MAY BE USED FOR INSTALLING CONDUIT WITH ENGINEER'S APPROVAL. CONDUIT WILL BE PAID FOR UNDER INSTALLATION METHODS SHOWN ON THESE PLANS.

I:\11-2025-17-28
D:\11-2025-17-28
Fernando.Vazquez AT CHA-FVAZQUEZ

Plans Prepared By:

DRMP

DRMP, INC.
8210 UNIVERSITY EXECUTIVE PARK DR.
SUITE 200
CHARLOTTE, NC 28262
NC LICENSE NO. F-1524 (704) 549-4260

Prepared for the Offices of: 750 N. Greenfield Pkwy, Garner, NC 27529		D14-14 NC 107 Cable Routing Plans Division 14 Jackson County Sylva PLAN DATE: June 2025 REVIEWED BY: BN Groome PREPARED BY: DJ White REVIEWED BY: LM Moon		DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED	
REVISIONS		INIT.	DATE	SEAL Signed by: <i>Brittany Groome</i> 8/26/2025 DATE	