


UTILITY CONSTRUCTION

SANITARY SEWER FORCEMAIN PRE-TESTING DETAILS


NOTE: ALL FITTINGS SHALL BE DUCTILE IRON MECHANICAL RESTRAINED JOINT USING GRIP RINGS. NO GLUED OR PUSH-ON FITTINGS ARE ALLOWED.

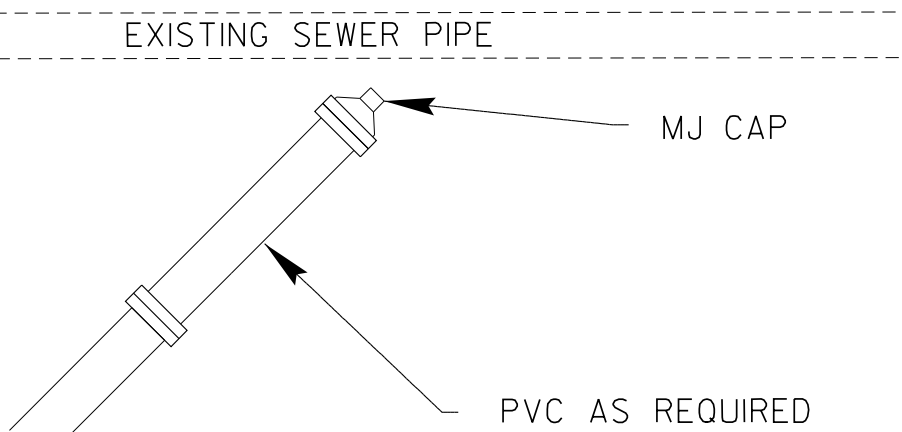

INSET 'D
NTS

SANITARY SEWER FORCEMAIN POST-TESTING DETAILS

NOTE: ALL FITTINGS SHALL BE DUCTILE IRON MECHANICAL RESTRAINED JOINT USING GRIP RINGS. NO GLUED OR PUSH-ON FITTINGS ARE ALLOWED.

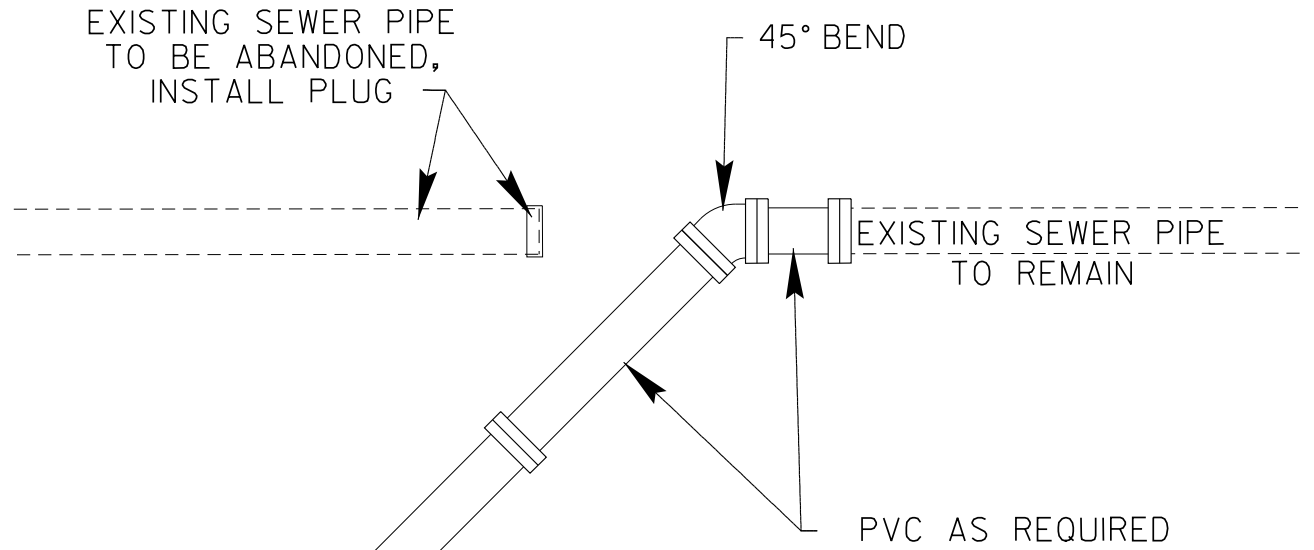

INSET 'D
NTS

