


5/14/99

7/2/2025 12:14:07 PM
\\Fs600\11100-7\PlanProfile.dgn
User: M... 152

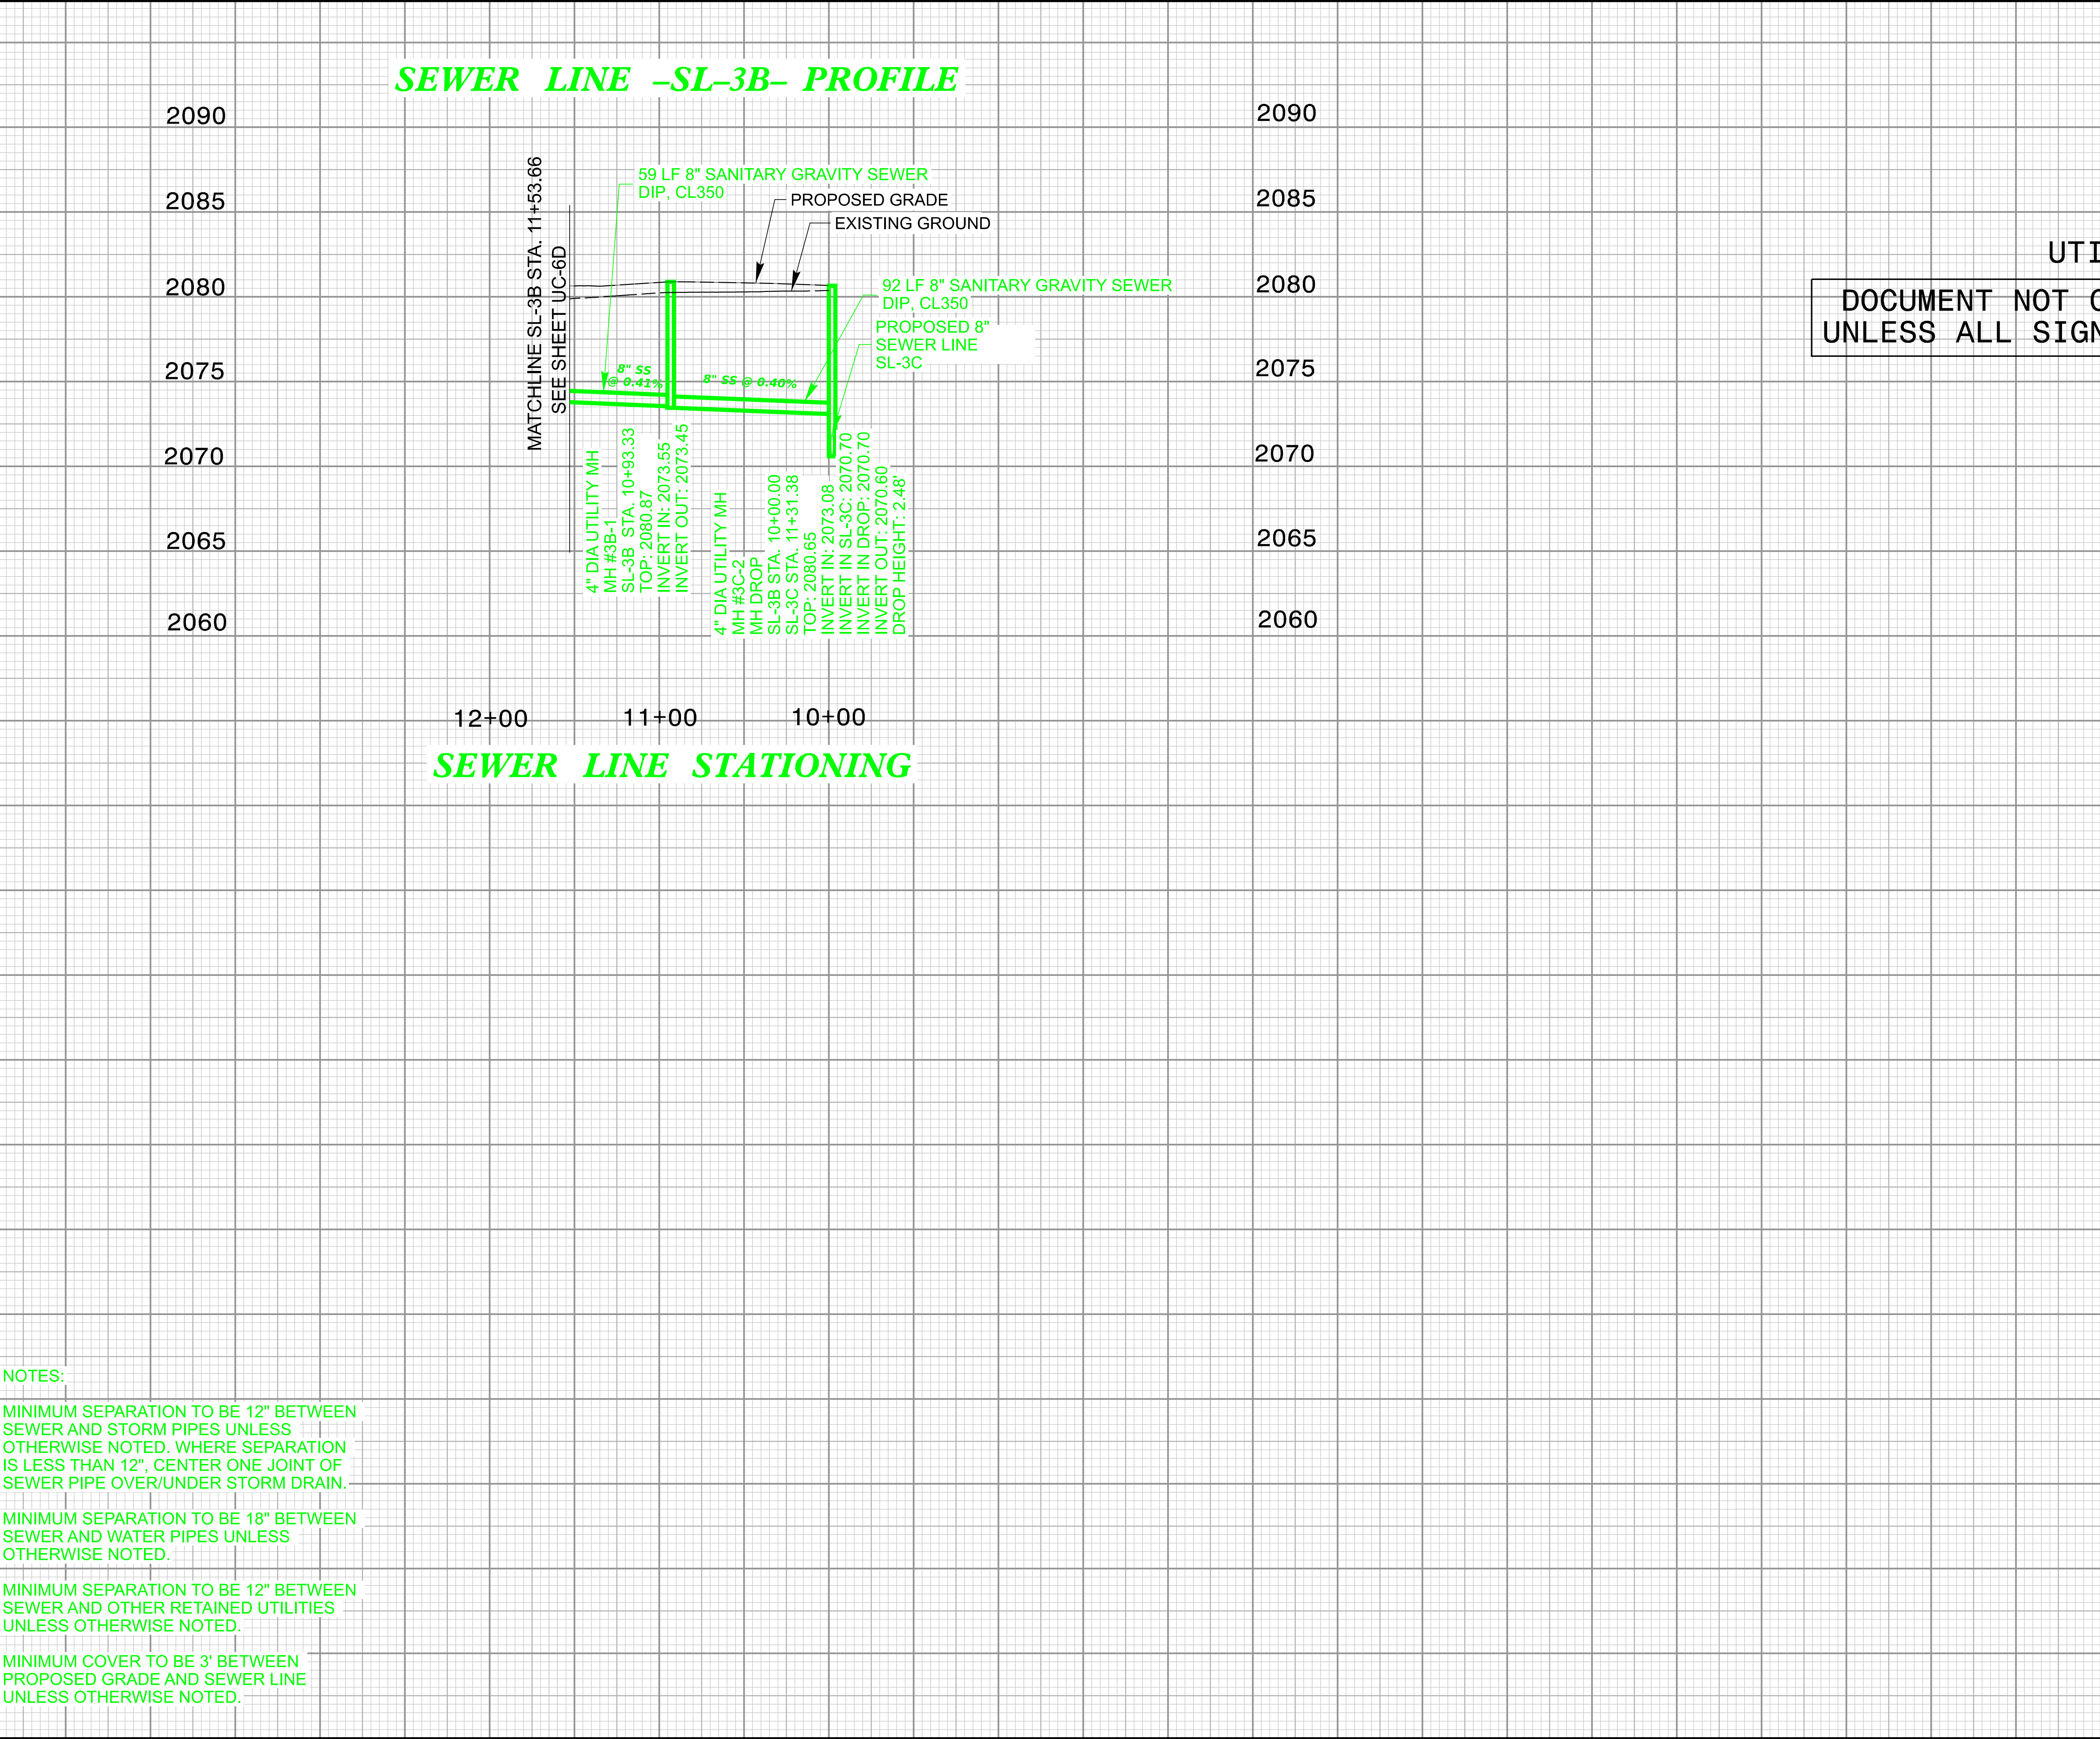

- NOTES:
- MINIMUM SEPARATION TO BE 12" BETWEEN SEWER AND STORM PIPES UNLESS OTHERWISE NOTED. WHERE SEPARATION IS LESS THAN 12", CENTER ONE JOINT OF SEWER PIPE OVER/UNDER STORM DRAIN.
 - MINIMUM SEPARATION TO BE 18" BETWEEN SEWER AND WATER PIPES UNLESS OTHERWISE NOTED.
 - MINIMUM SEPARATION TO BE 12" BETWEEN SEWER AND OTHER RETAINED UTILITIES UNLESS OTHERWISE NOTED.
 - MINIMUM COVER TO BE 3' BETWEEN PROPOSED GRADE AND SEWER LINE UNLESS OTHERWISE NOTED.

PROJECT REFERENCE NO.		SHEET NO.
R-5600		UC-7C
DESIGNED BY:	ELM	Professional Seal North Carolina Professional Engineer Signature: [Signature] Date: 12/20/21 Seal No: 8126 Exp. Date: 12/20/25
DRAWN BY:	HSN	
CHECKED BY:	MUP	
APPROVED BY:	MUP	
REVISED:		
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION		
UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151		UTILITY CONSTRUCTION PLANS ONLY

DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED

UTILITY CONSTRUCTION