


5/28/99

7/3/2025 9:02:22 AM
\\R5600\Utility\UC-B\PlanProfile.dgn
User: Mounis2

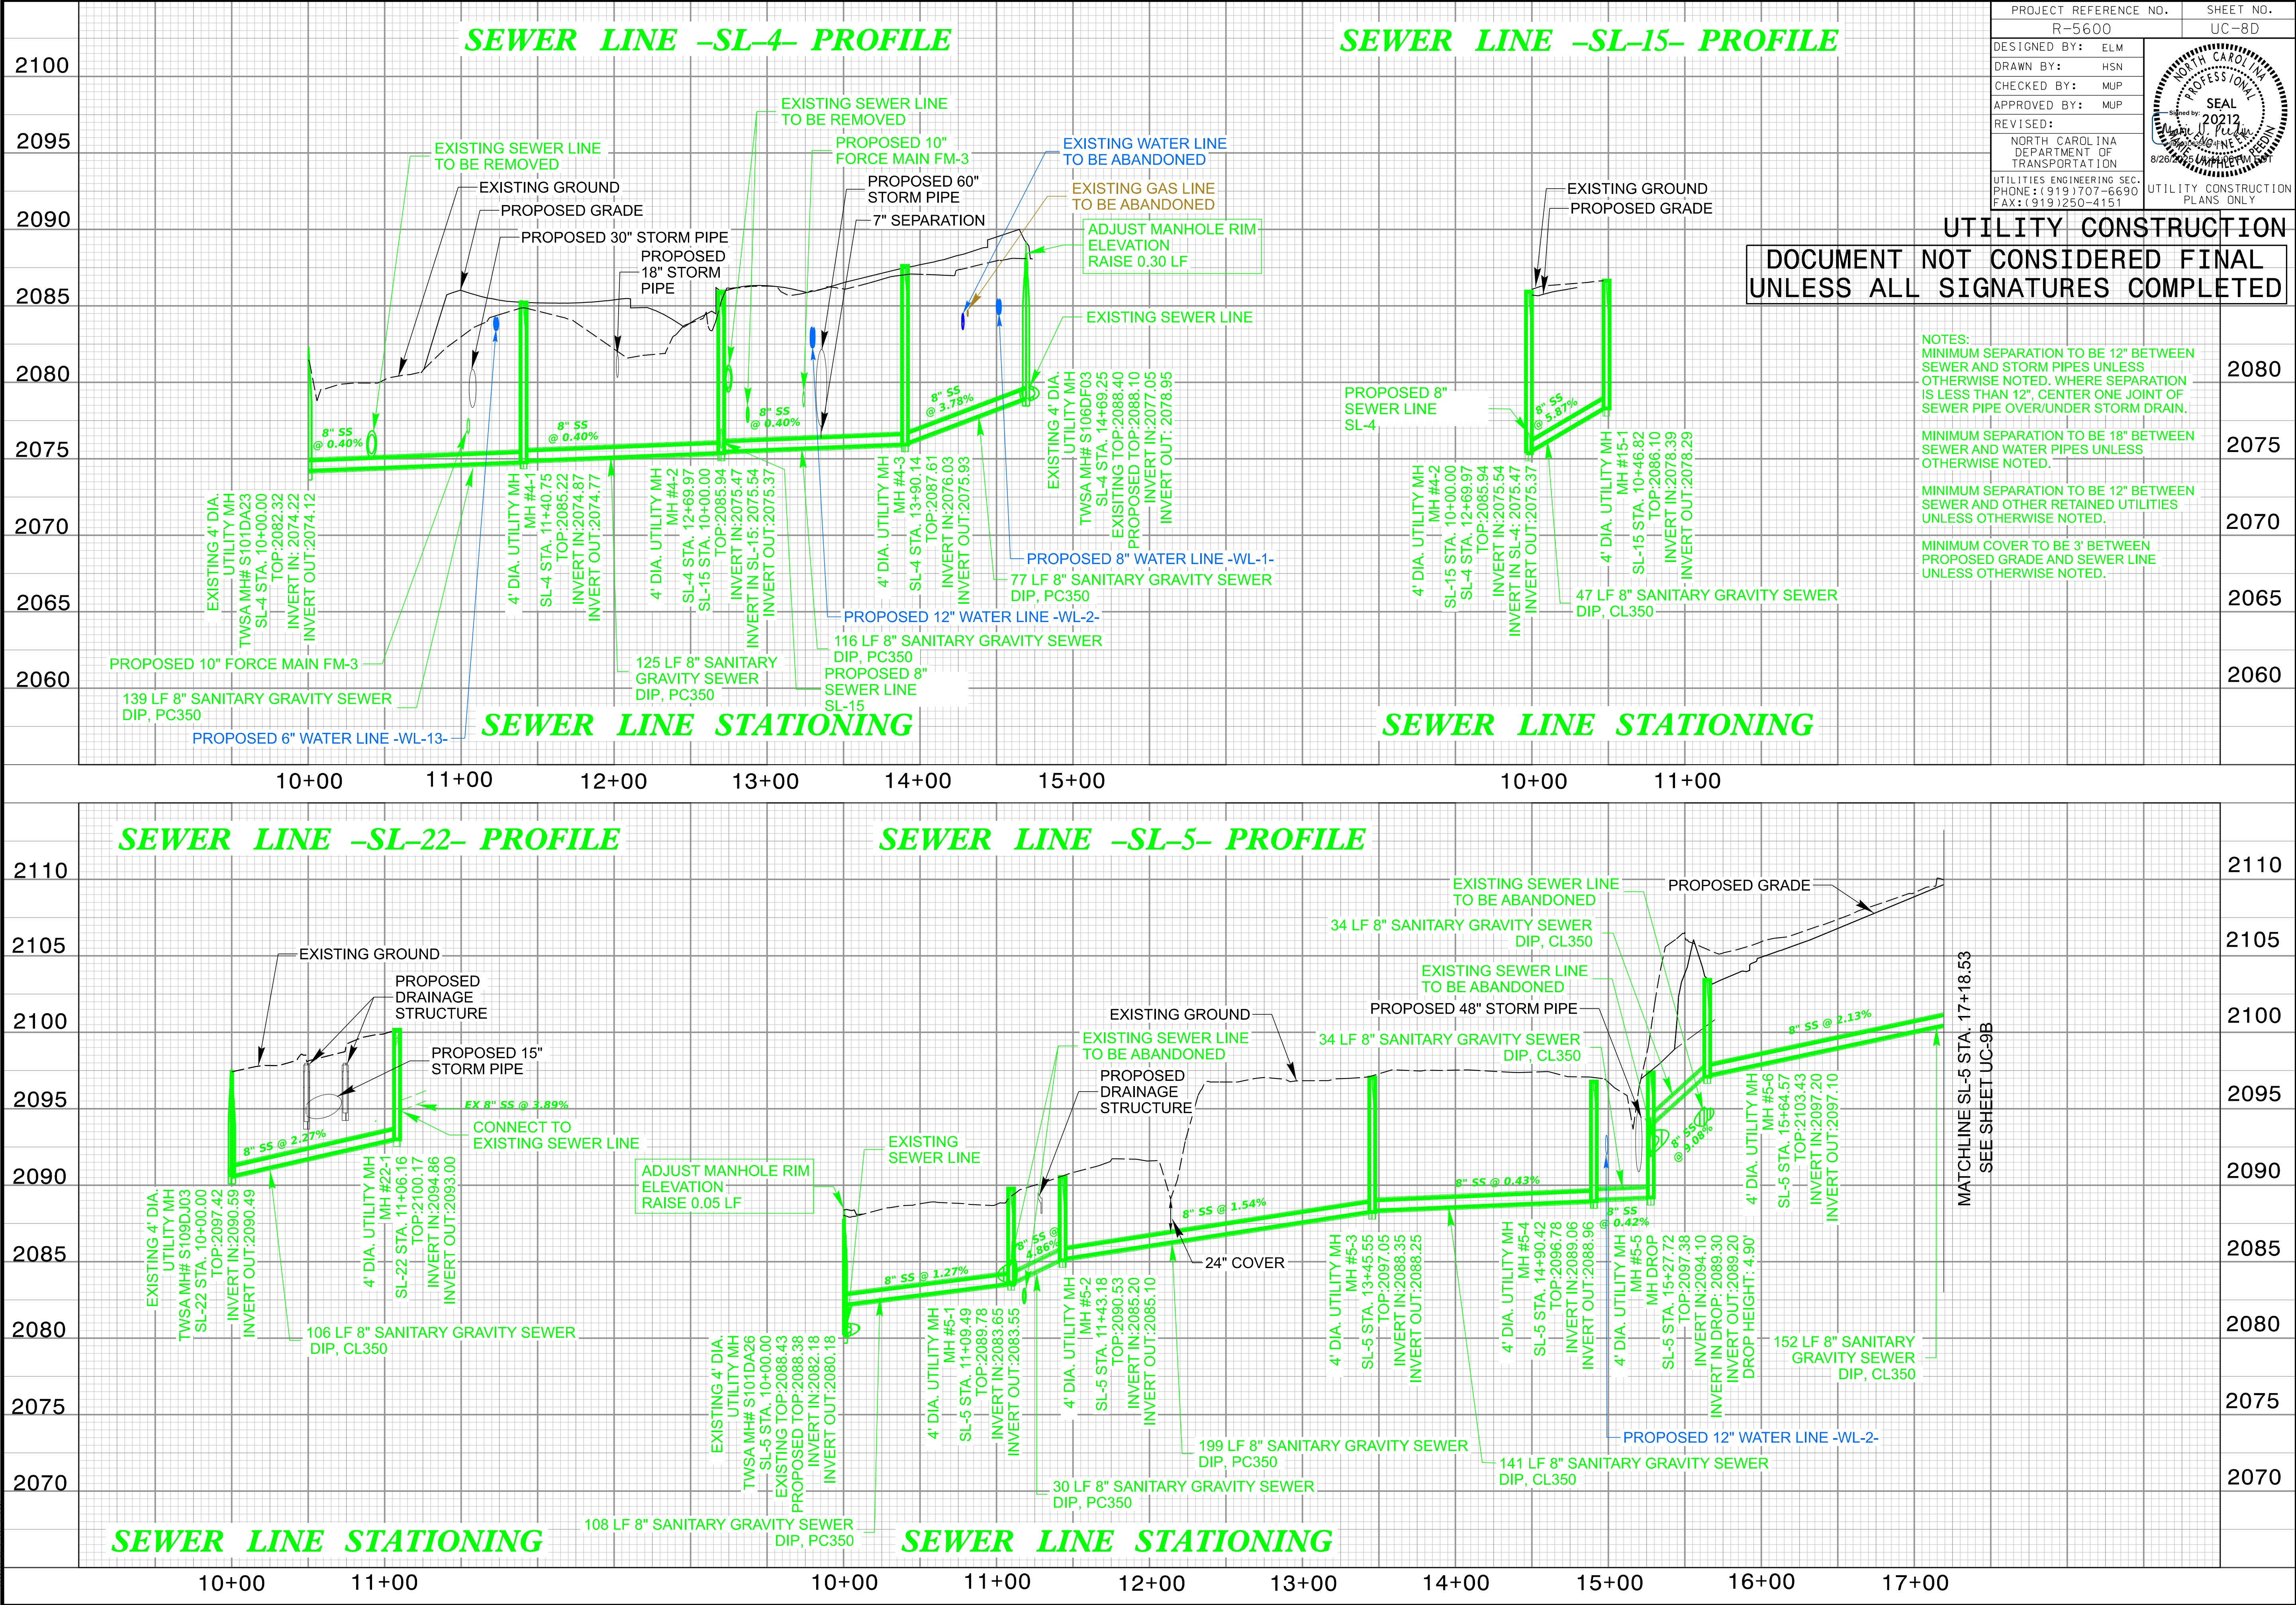

UTILITY CONSTRUCTION
DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED

NOTES:
MINIMUM SEPARATION TO BE 12" BETWEEN
SEWER AND STORM PIPES UNLESS
OTHERWISE NOTED. WHERE SEPARATION
IS LESS THAN 12", CENTER ONE JOINT OF
SEWER PIPE OVER/UNDER STORM DRAIN.

MINIMUM SEPARATION TO BE 18" BETWEEN
SEWER AND WATER PIPES UNLESS
OTHERWISE NOTED.

MINIMUM SEPARATION TO BE 12" BETWEEN
SEWER AND OTHER RETAINED UTILITIES
UNLESS OTHERWISE NOTED.

MINIMUM COVER TO BE 3' BETWEEN
PROPOSED GRADE AND SEWER LINE
UNLESS OTHERWISE NOTED.

MATCHLINE SL-5 STA. 17+18.53
SEE SHEET UC-9B