


5/14/99

7/2/2025 4:09:40 PM
R-5600 UC-8 Plan Profile.dgn
User: MORTIS2

SEWER LINE -SL-3C- PROFILE

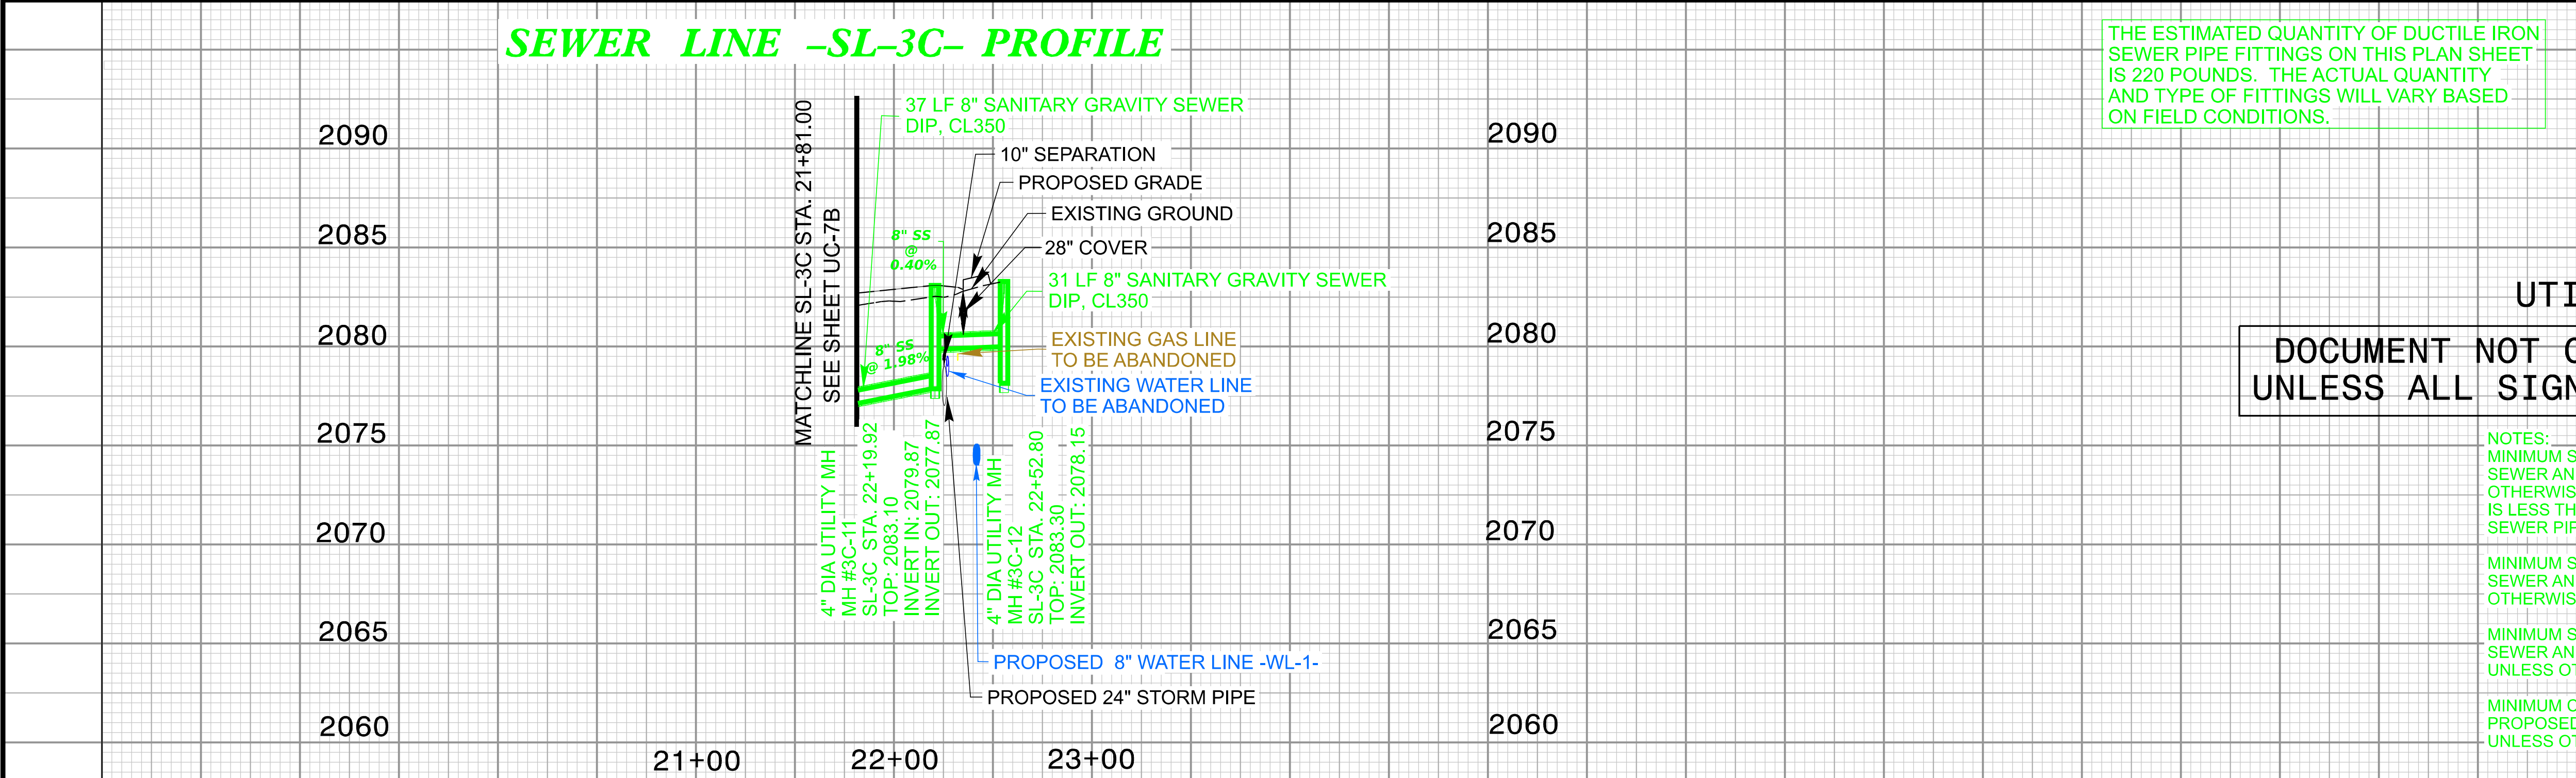

THE ESTIMATED QUANTITY OF DUCTILE IRON SEWER PIPE FITTINGS ON THIS PLAN SHEET IS 220 POUNDS. THE ACTUAL QUANTITY AND TYPE OF FITTINGS WILL VARY BASED ON FIELD CONDITIONS.

PROJECT REFERENCE NO.		SHEET NO.	
R-5600		UC-8E	
DESIGNED BY:	ELM		UTILITY CONSTRUCTION PLANS ONLY
DRAWN BY:	HSN		
CHECKED BY:	MUP		
APPROVED BY:	MUP		
REVISED:			
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION			
UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151			


UTILITY CONSTRUCTION

DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED

- NOTES:
- MINIMUM SEPARATION TO BE 12" BETWEEN SEWER AND STORM PIPES UNLESS OTHERWISE NOTED. WHERE SEPARATION IS LESS THAN 12", CENTER ONE JOINT OF SEWER PIPE OVER/UNDER STORM DRAIN.
 - MINIMUM SEPARATION TO BE 18" BETWEEN SEWER AND WATER PIPES UNLESS OTHERWISE NOTED.
 - MINIMUM SEPARATION TO BE 12" BETWEEN SEWER AND OTHER RETAINED UTILITIES UNLESS OTHERWISE NOTED.
 - MINIMUM COVER TO BE 3' BETWEEN PROPOSED GRADE AND SEWER LINE UNLESS OTHERWISE NOTED.

SEWER LINE STATIONING

SEWER LINE -FM-3- PROFILE

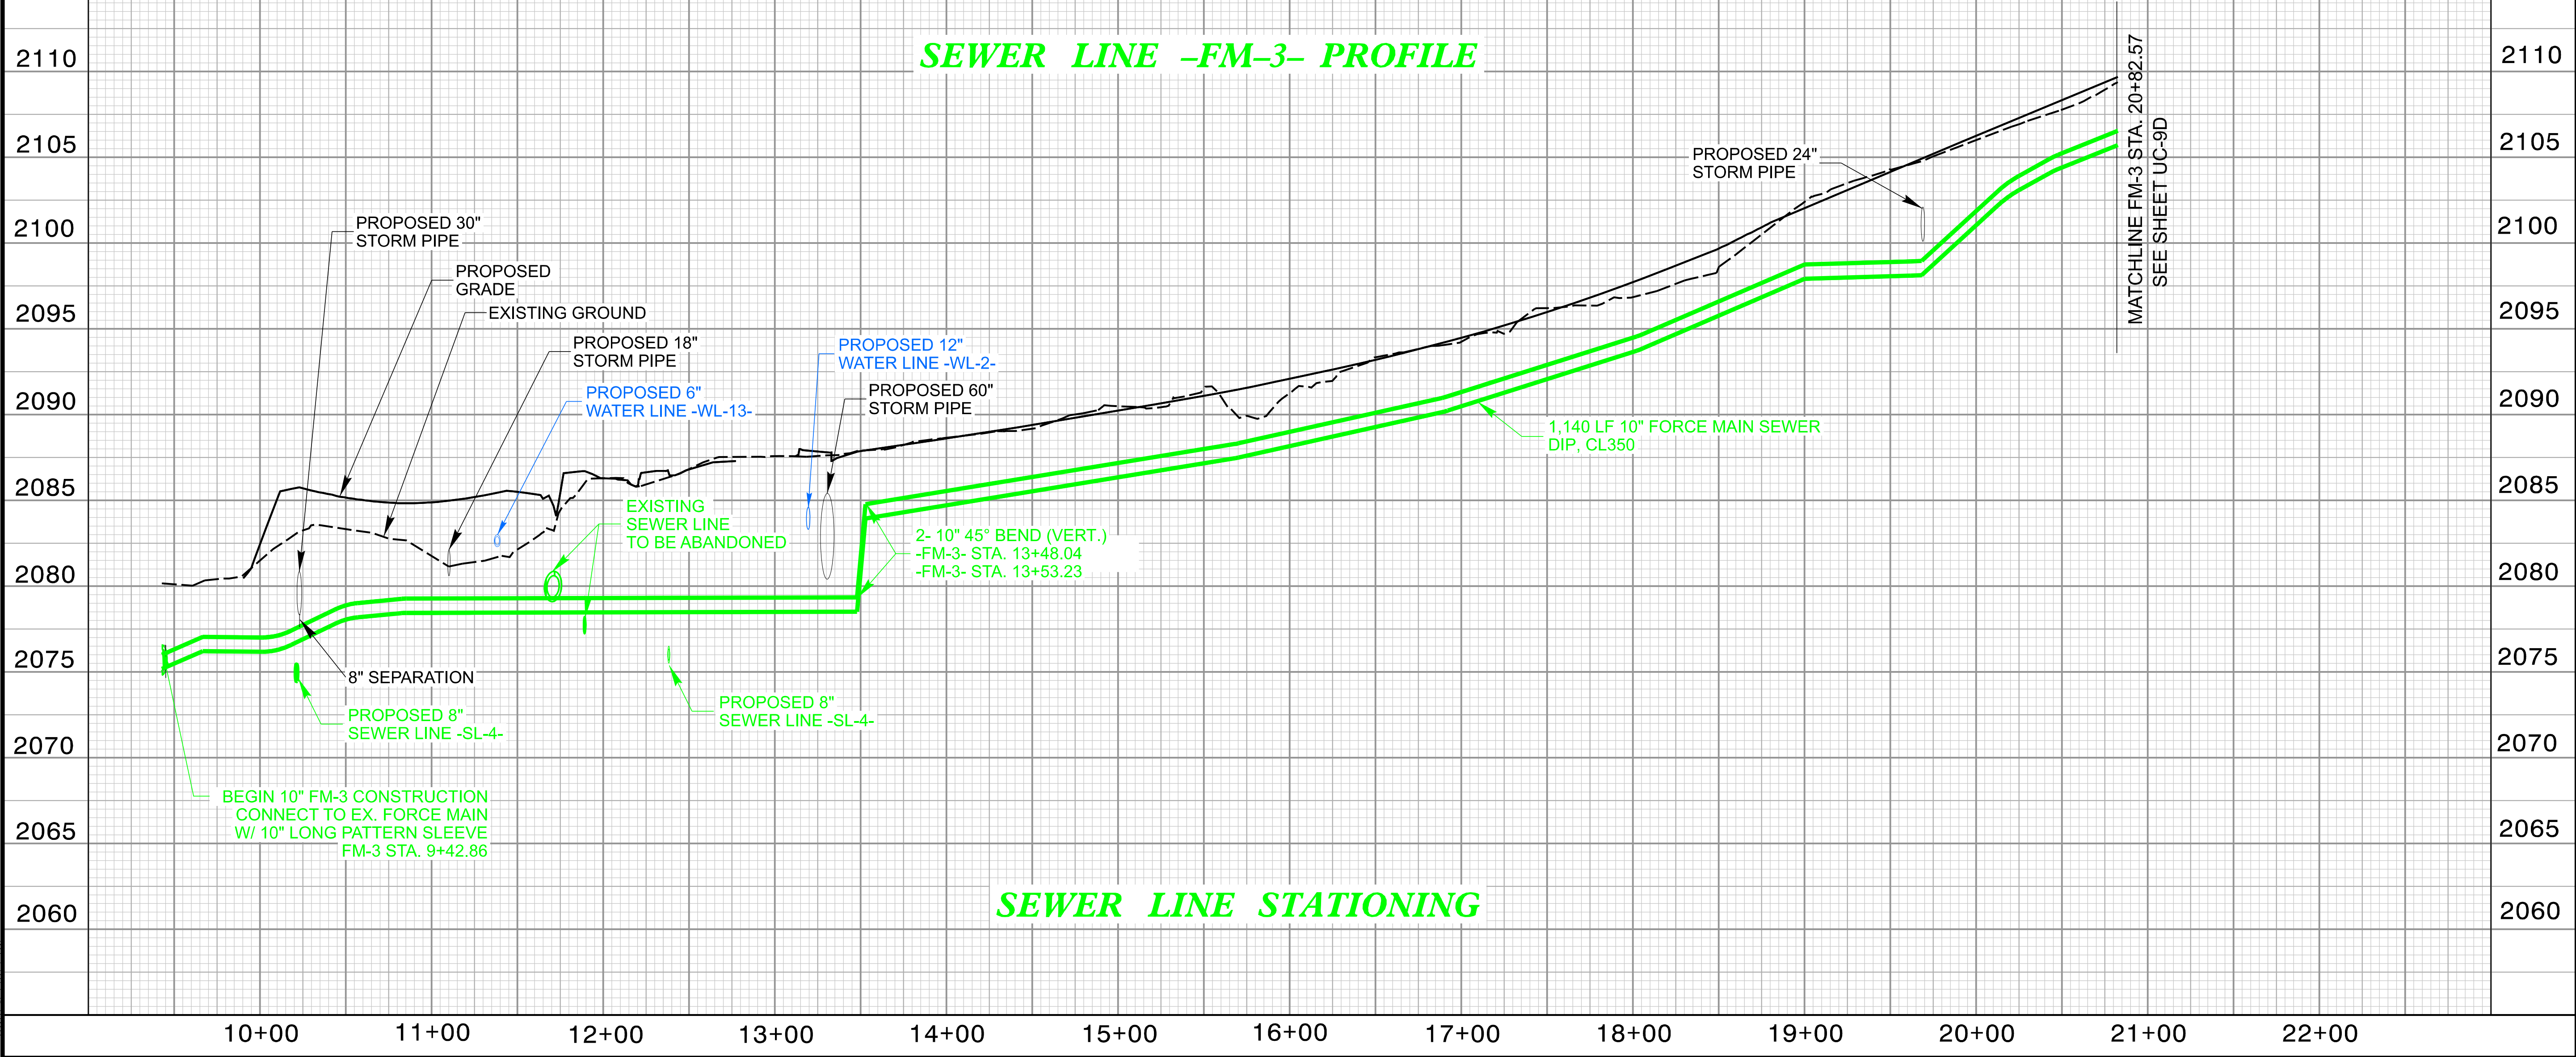

SEWER LINE STATIONING