

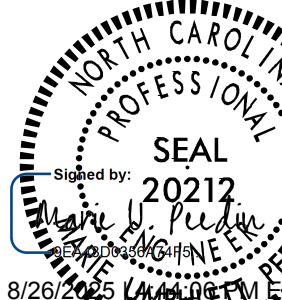
5/14/99

6/30/2025 2:26:47 PM
\\nas001\projects\911\planProfile.dgn
User: MORTIS

THE ESTIMATED QUANTITY OF DUCTILE IRON WATER PIPE FITTINGS ON THIS PLAN SHEET IS 430 POUNDS. THE ACTUAL QUANTITY AND TYPE OF FITTINGS WILL VARY BASED ON FIELD CONDITIONS.

- NOTES:
- MINIMUM SEPARATION TO BE 12" BETWEEN WATER AND STORM PIPES UNLESS OTHERWISE NOTED. WHERE SEPARATION IS LESS THAN 12", CENTER ONE JOINT OF WATER PIPE OVER/UNDER STORM DRAIN.
 - MINIMUM SEPARATION TO BE 18" BETWEEN WATER AND SEWER PIPES UNLESS OTHERWISE NOTED.
 - MINIMUM SEPARATION TO BE 12" BETWEEN WATER AND OTHER RETAINED UTILITIES UNLESS OTHERWISE NOTED.
 - MINIMUM COVER TO BE 3' BETWEEN PROPOSED GRADE AND WATER LINE UNLESS OTHERWISE NOTED.

WATER LINE -WL-2- PROFILE

PROJECT REFERENCE NO.		SHEET NO.
R-5600		UC-9A
DESIGNED BY:	ELM	
DRAWN BY:	HSN	
CHECKED BY:	MUP	
APPROVED BY:	MUP	
REVISED:		
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION		UTILITY CONSTRUCTION PLANS ONLY
UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151		

DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED

