


5/28/99

7/2/2025 12:44:08 PM
R5600_UFL UC-10-PlanProf.dgn
User: MURPHY

THE ESTIMATED QUANTITY OF DUCTILE IRON WATER PIPE FITTINGS ON THIS PLAN SHEET IS 1700 POUNDS. THE ACTUAL QUANTITY AND TYPE OF FITTINGS WILL VARY BASED ON FIELD CONDITIONS.

WATER LINE -WL-14- PROFILE

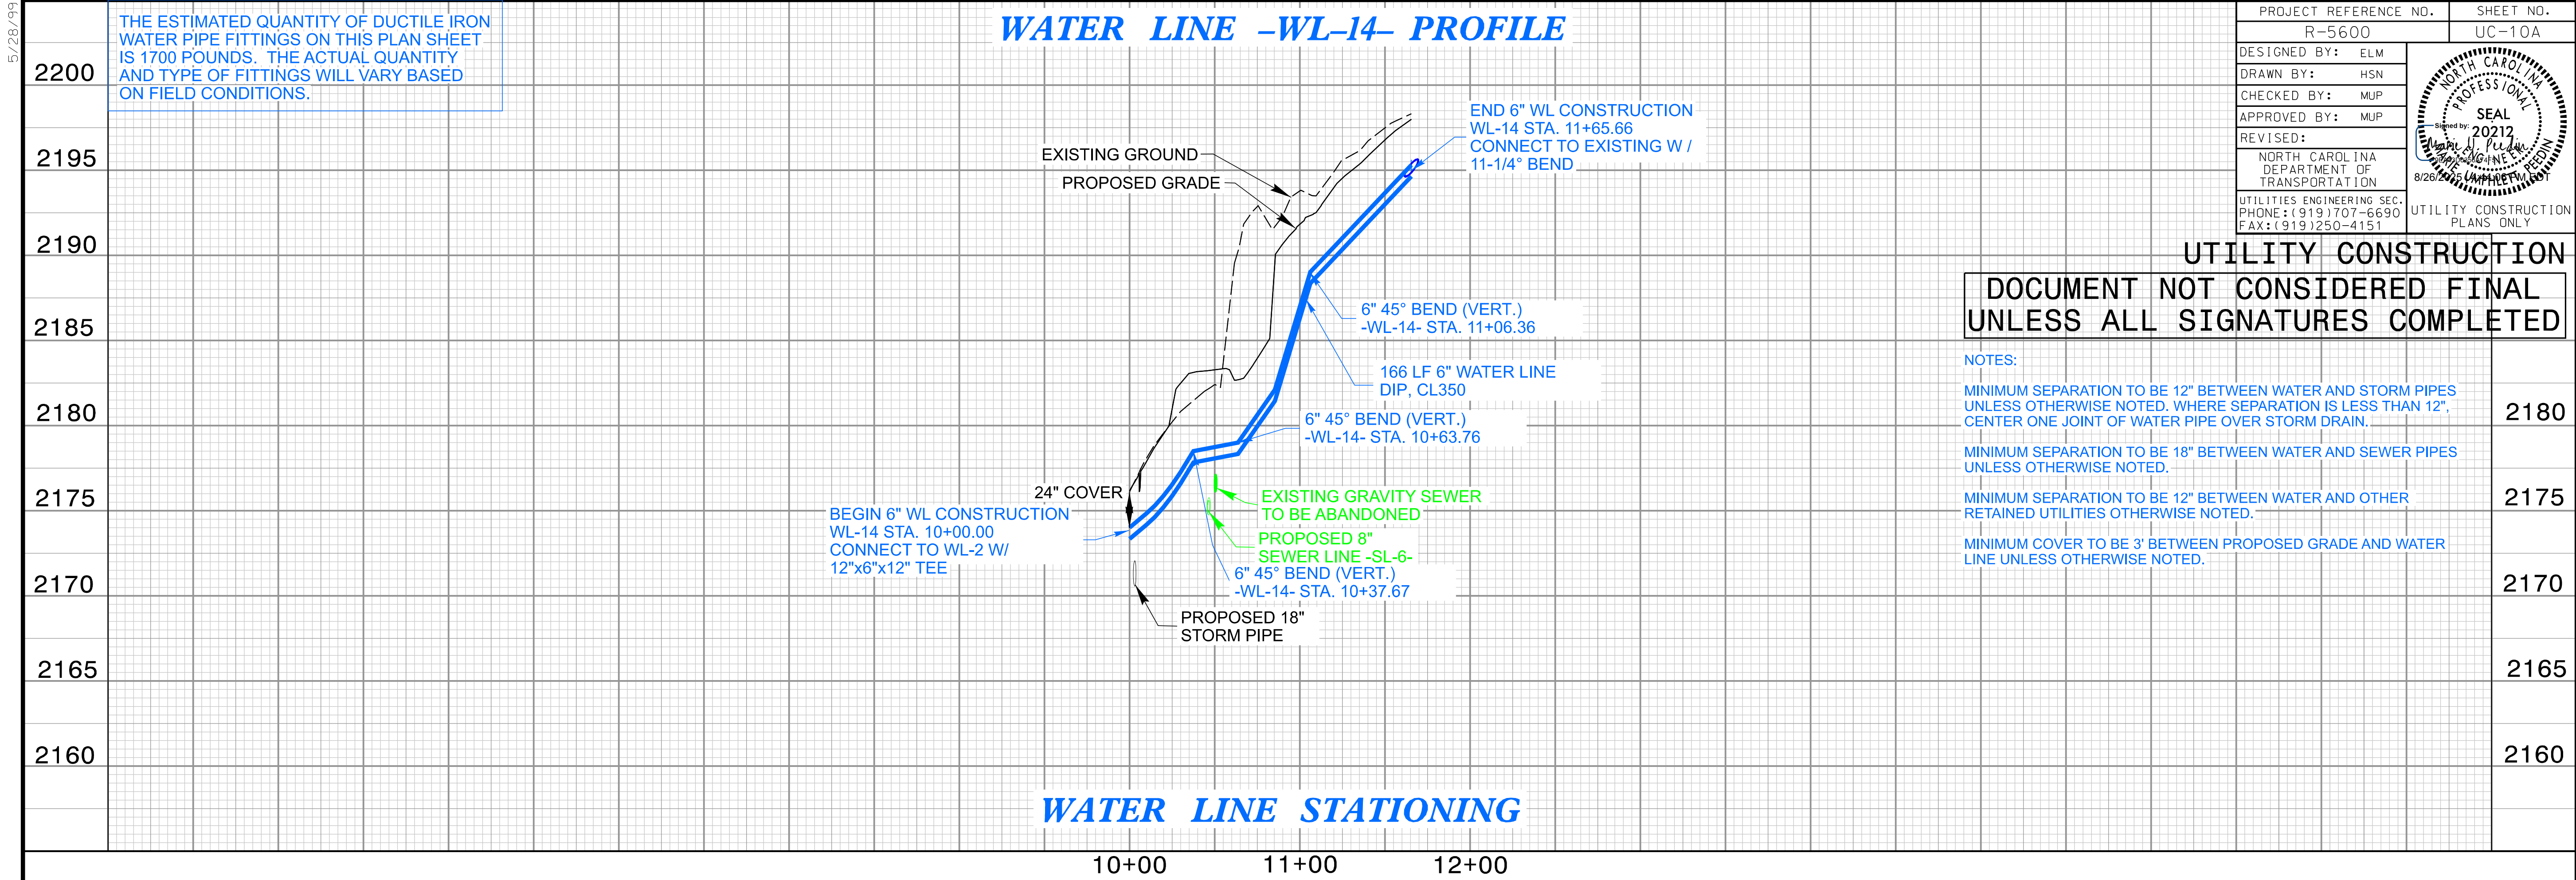

PROJECT REFERENCE NO. R-5600		SHEET NO. UC-10A	
DESIGNED BY:	ELM		
DRAWN BY:	HSN		
CHECKED BY:	MUP		
APPROVED BY:	MUP		
REVISED:		NORTH CAROLINA DEPARTMENT OF TRANSPORTATION	
UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151		UTILITY CONSTRUCTION PLANS ONLY	

UTILITY CONSTRUCTION
DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED

NOTES:
MINIMUM SEPARATION TO BE 12" BETWEEN WATER AND STORM PIPES UNLESS OTHERWISE NOTED. WHERE SEPARATION IS LESS THAN 12", CENTER ONE JOINT OF WATER PIPE OVER STORM DRAIN.
MINIMUM SEPARATION TO BE 18" BETWEEN WATER AND SEWER PIPES UNLESS OTHERWISE NOTED.
MINIMUM SEPARATION TO BE 12" BETWEEN WATER AND OTHER RETAINED UTILITIES OTHERWISE NOTED.
MINIMUM COVER TO BE 3' BETWEEN PROPOSED GRADE AND WATER LINE UNLESS OTHERWISE NOTED.

WATER LINE STATIONING

WATER LINE -WL-2- PROFILE

