

5/14/2025

PROJECT NOTES:
THRUST COLLAR TO BE CURED BEFORE INSTALLATION OF INSTERTION VALVE OR LINE STOP.
THRUST COLLAR TO BE ON SAME STRING OF PIPE AS LONG BODY SLEEVE.

Kimley»Horn

200 S TYRON STREET, SUITE 200
CHARLOTTE, NC 28202

RIGHT-OF-WAY REV.
CONST. REV.


PROJECT REFERENCE NO.
U-5956

SHEET NO.
UC-04A


UTILITY DESIGN ENGINEER

Seal
Matthew S. Smith
Professional Engineer
No. 027670
Exp. 12/31/2025

DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED

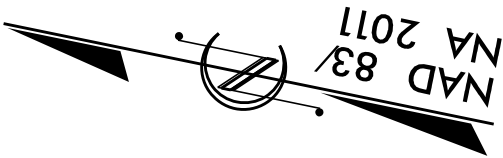

REVISIONS

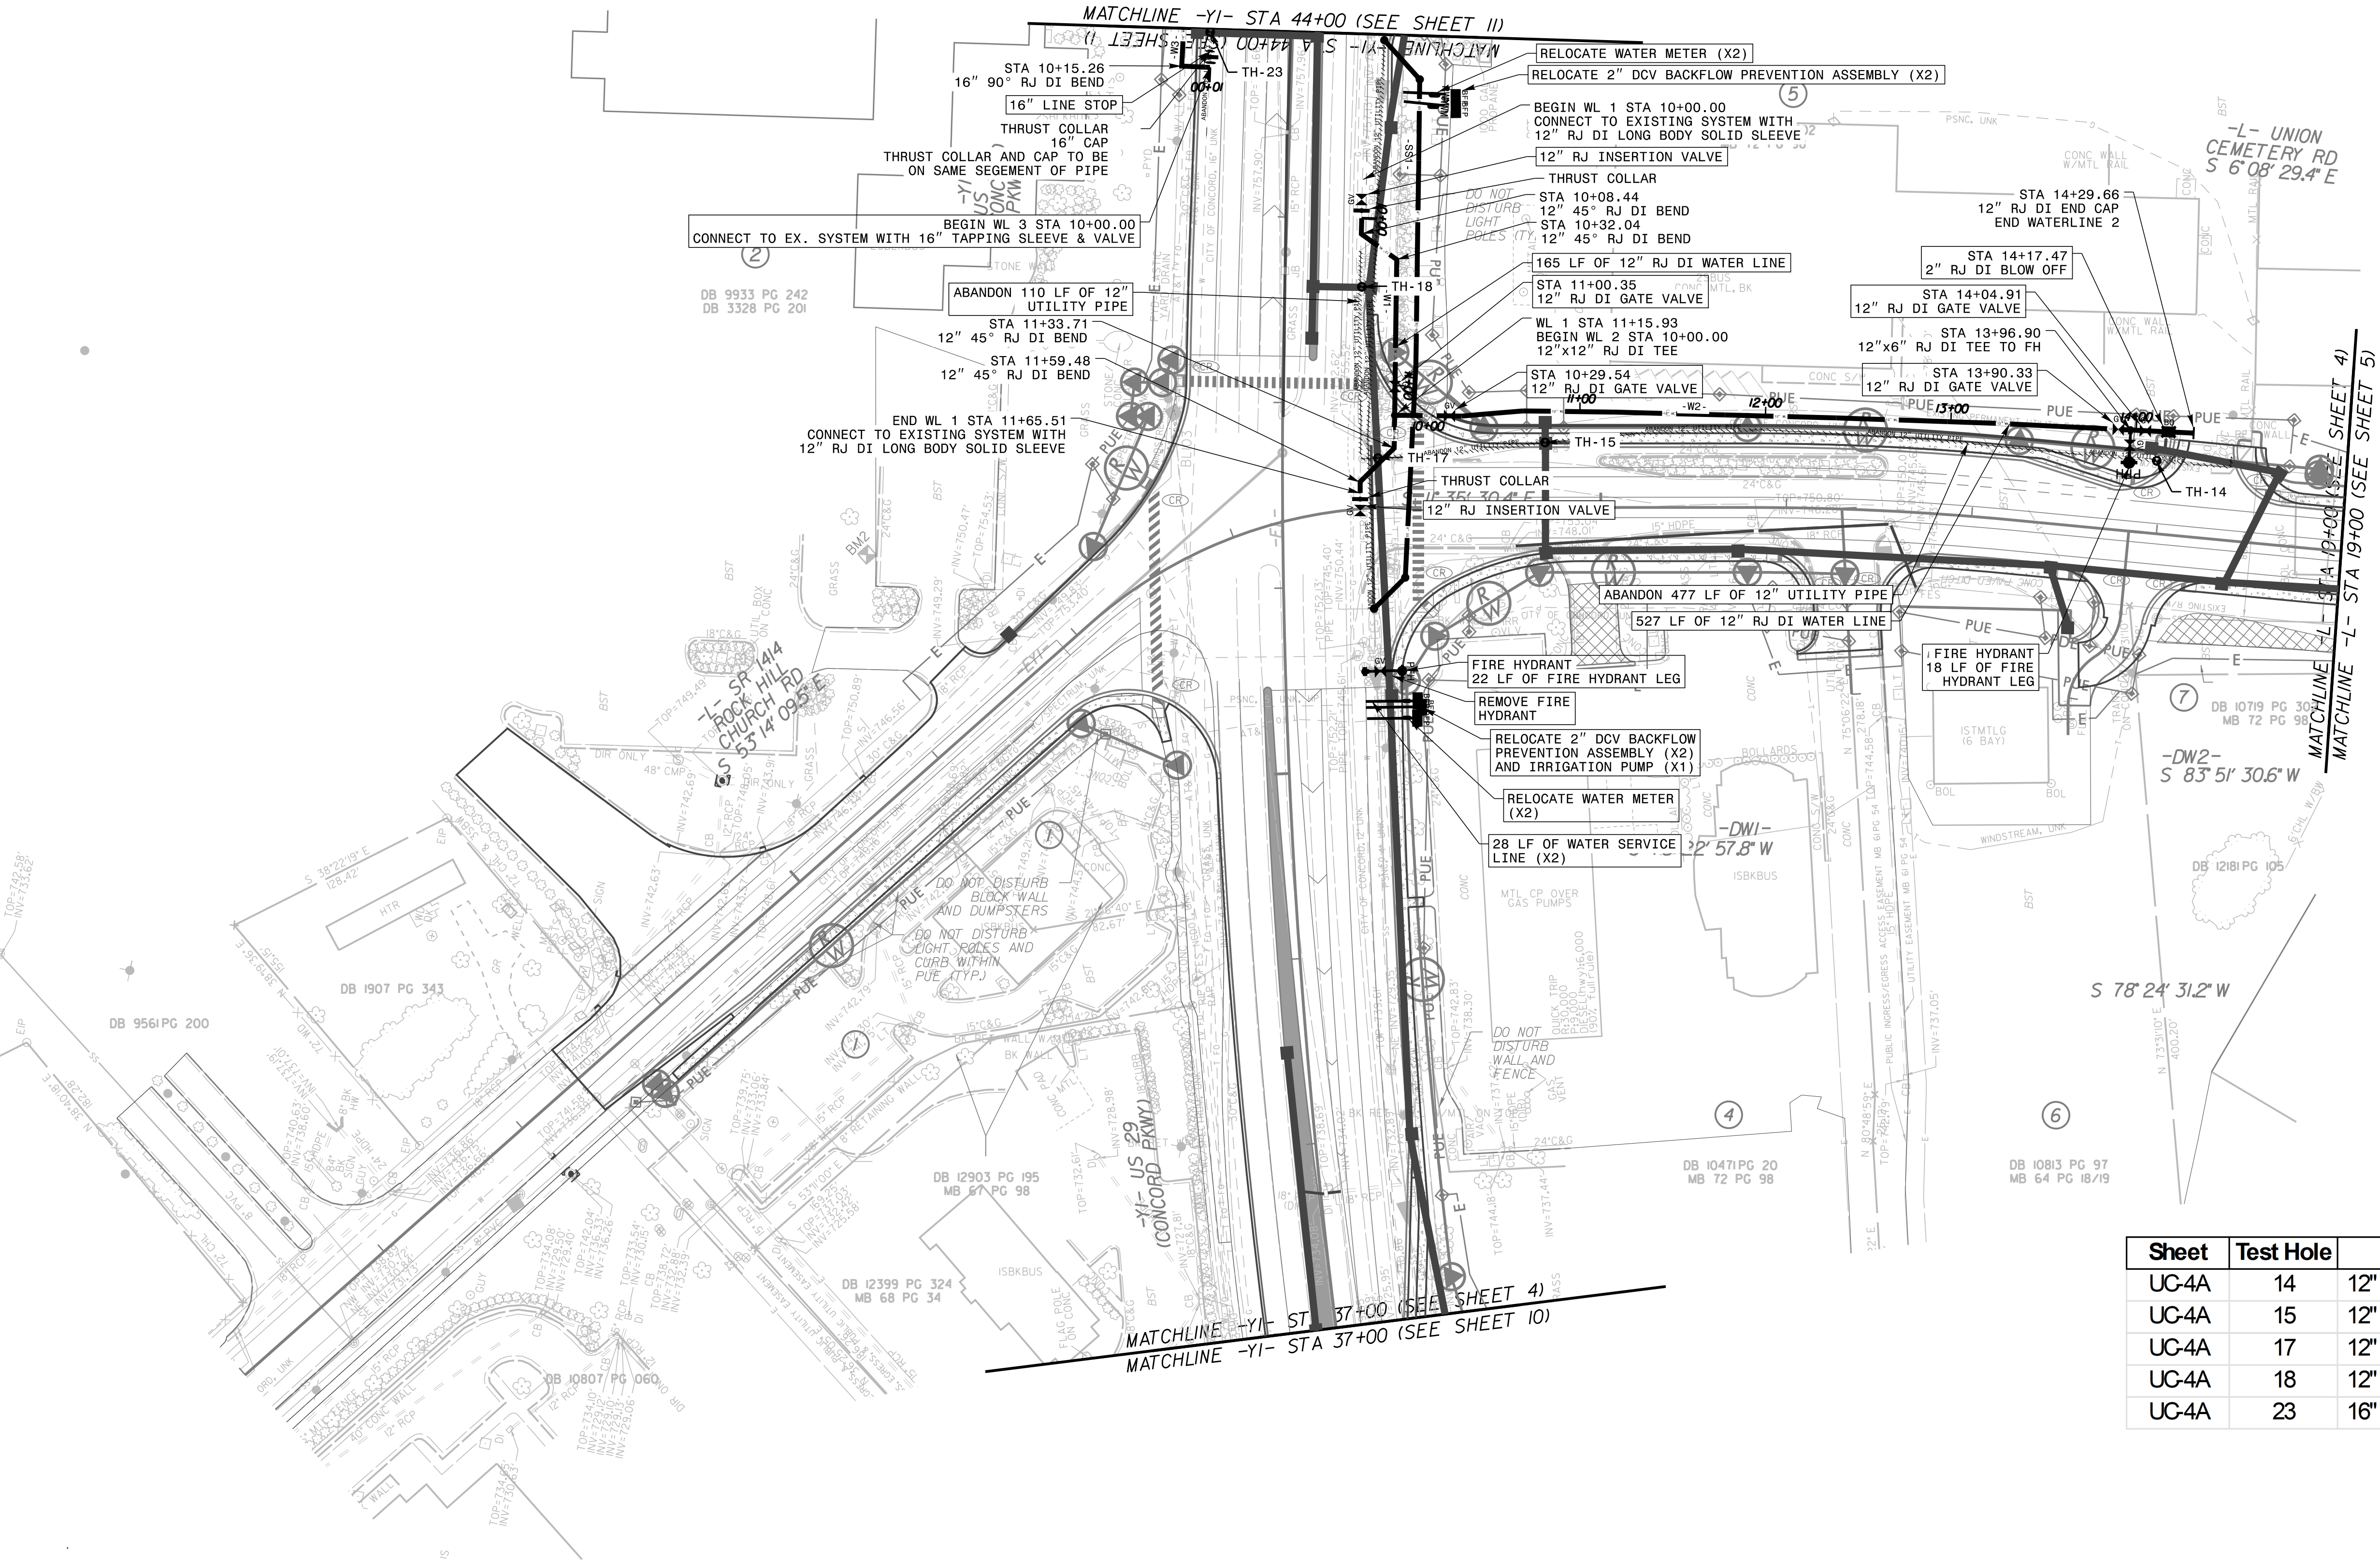

Sheet	Test Hole	Type	Cover	Top Elev
UC-4A	14	12" METAL WATERMAIN	3.1	747.16
UC-4A	15	12" METAL WATERMAIN	2.78	751.59
UC-4A	17	12" METAL WATERMAIN	3.02	752.25
UC-4A	18	12" METAL WATERMAIN	3.6	754.52
UC-4A	23	16" METAL WATERMAIN	5.09	756.8



12/17/2025