



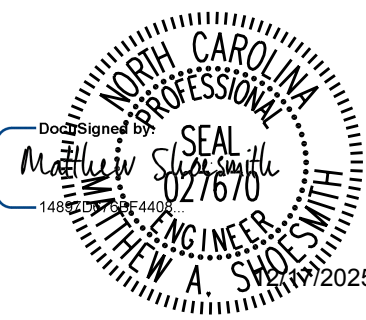


DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED

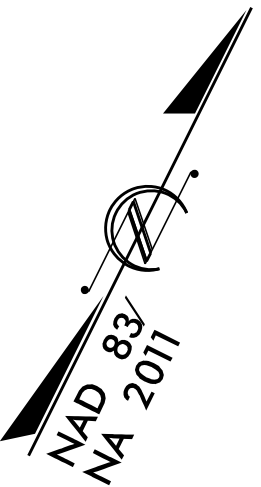

PROJECT NOTES:
THRUST COLLAR TO BE CURED BEFORE INSTALLATION OF INSERTION VALVE OR LINE STOP.
THRUST COLLAR TO BE ON SAME STRING OF PIPE AS LONG BODY SLEEVE.

REVISIONS

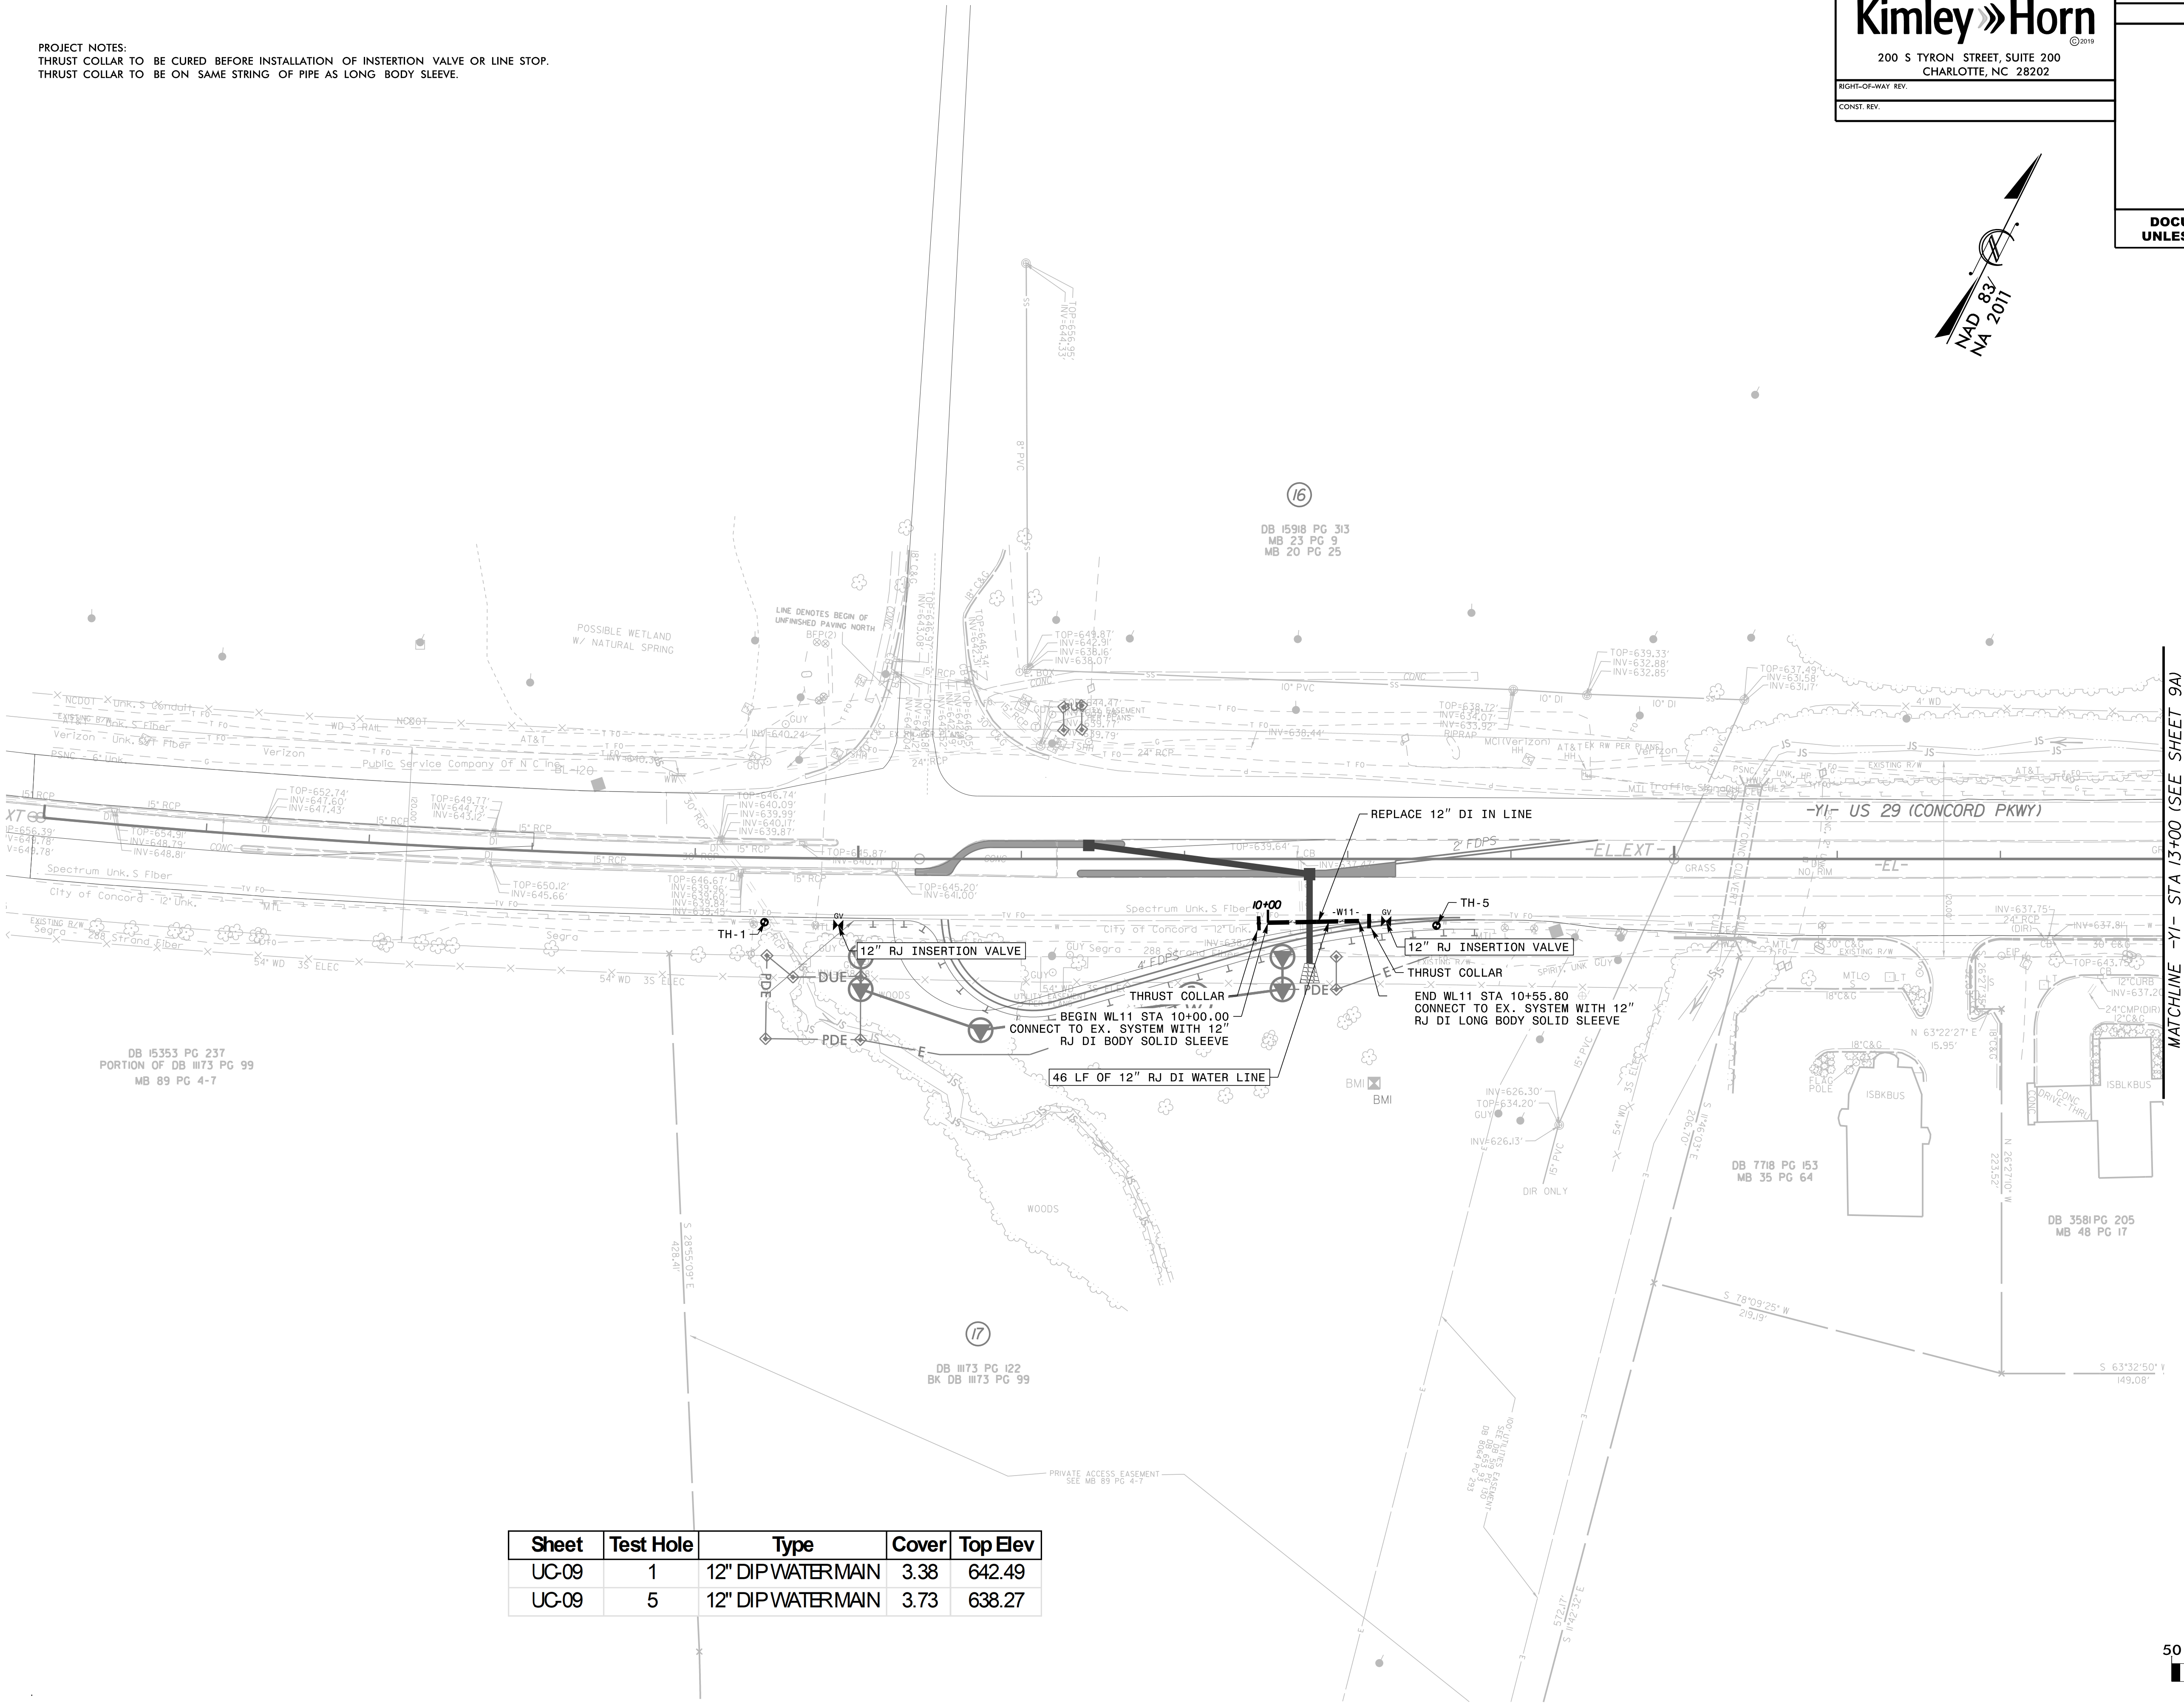

Sheet	Test Hole	Type	Cover	Top Elev
UC-09	1	12" DIP WATERMAIN	3.38	642.49
UC-09	5	12" DIP WATERMAIN	3.73	638.27

