
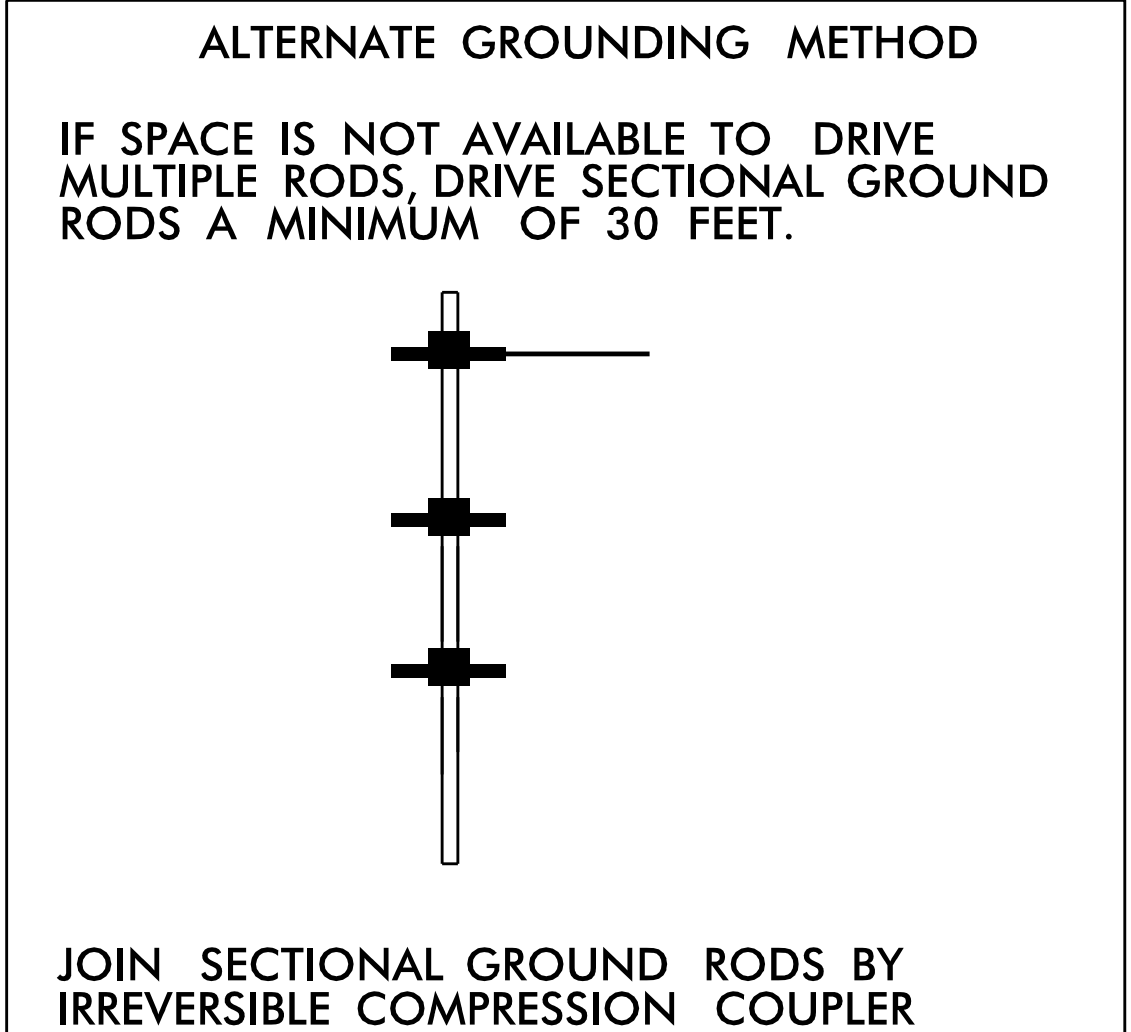
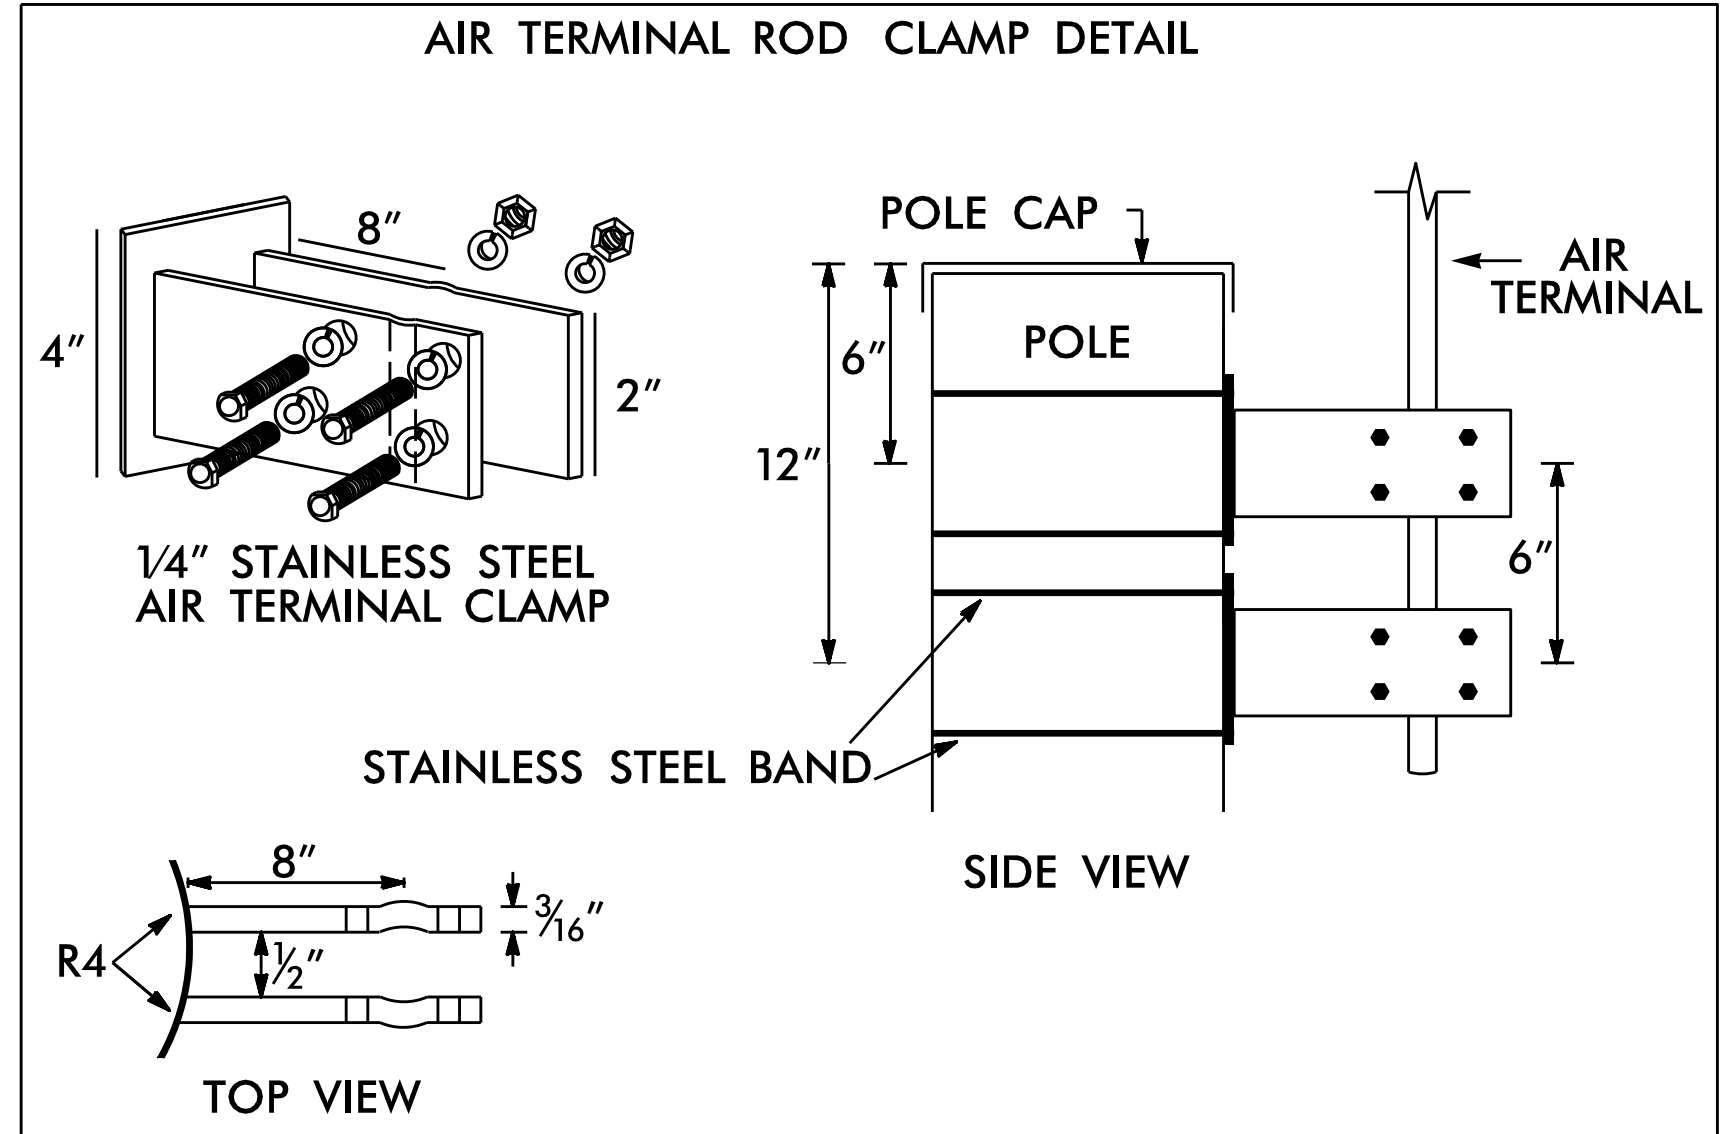
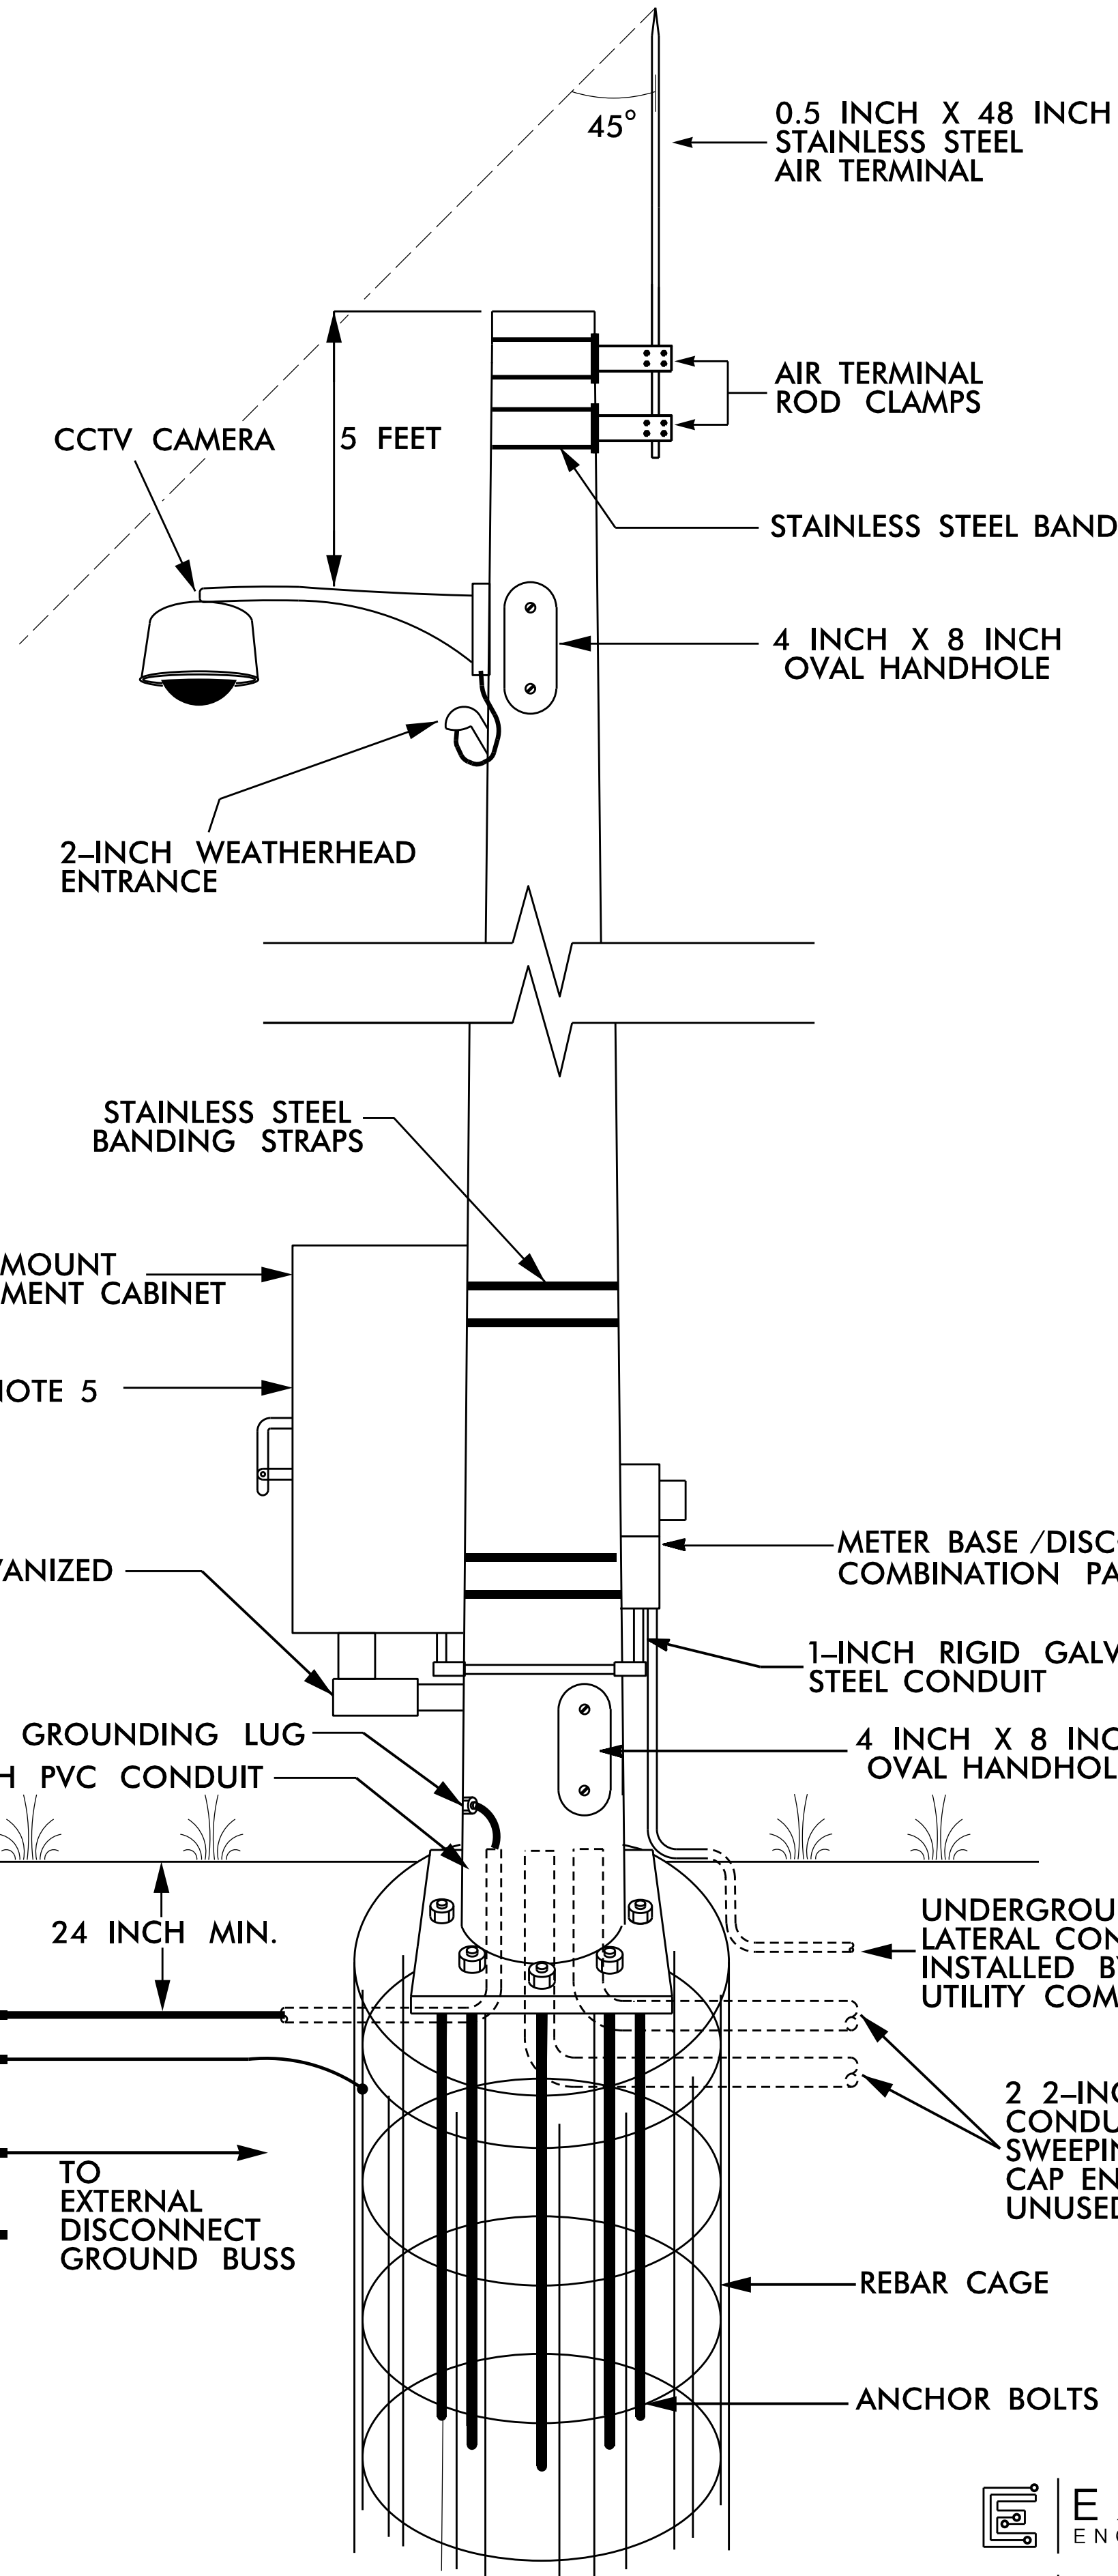
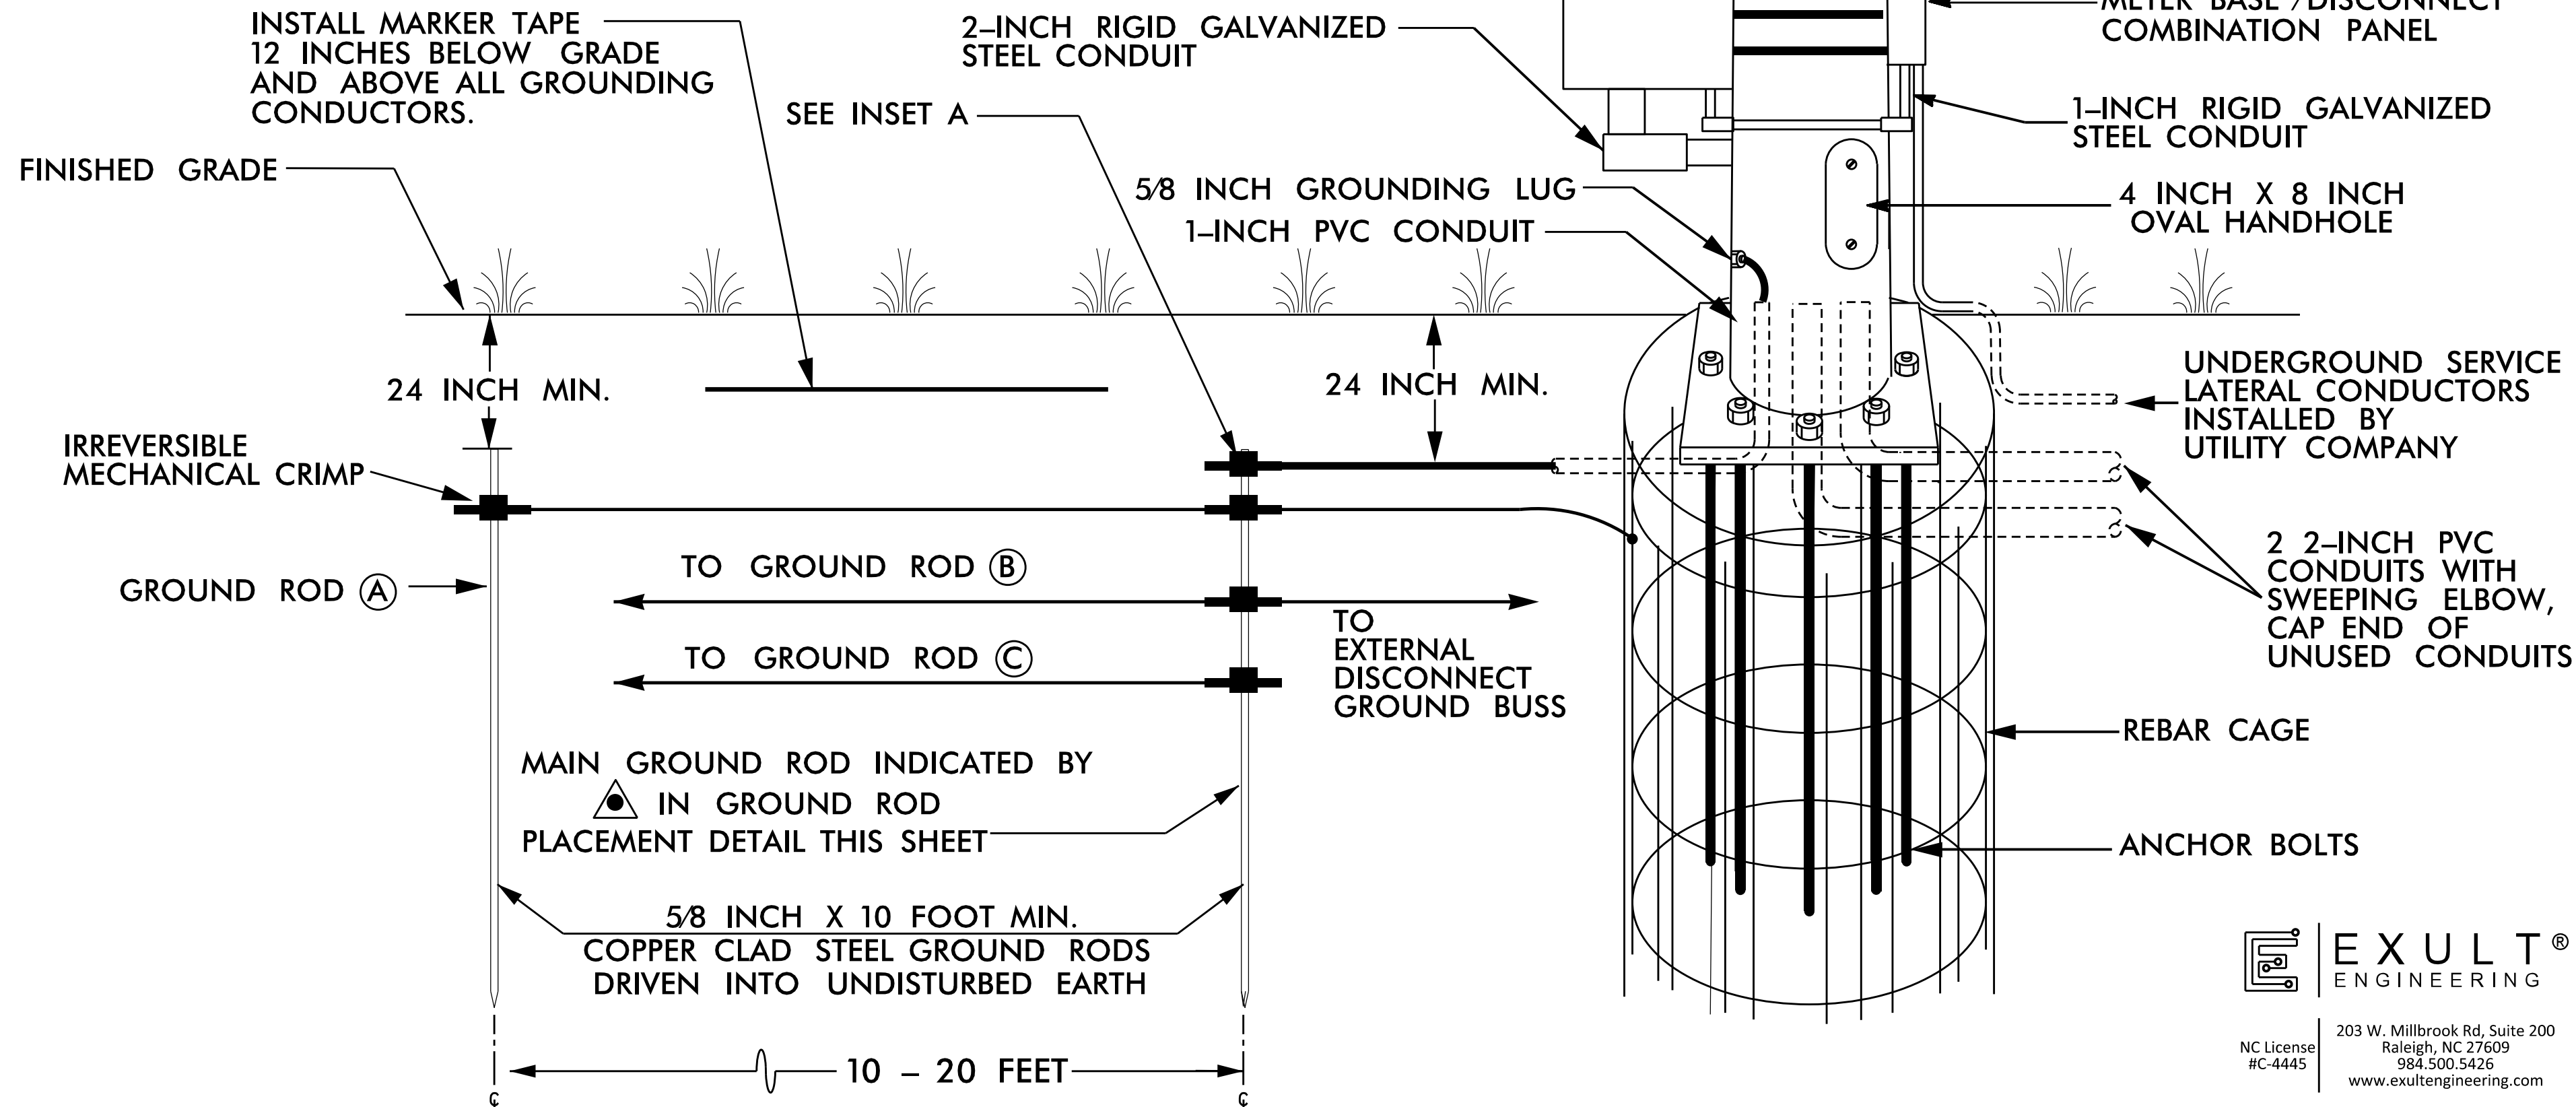
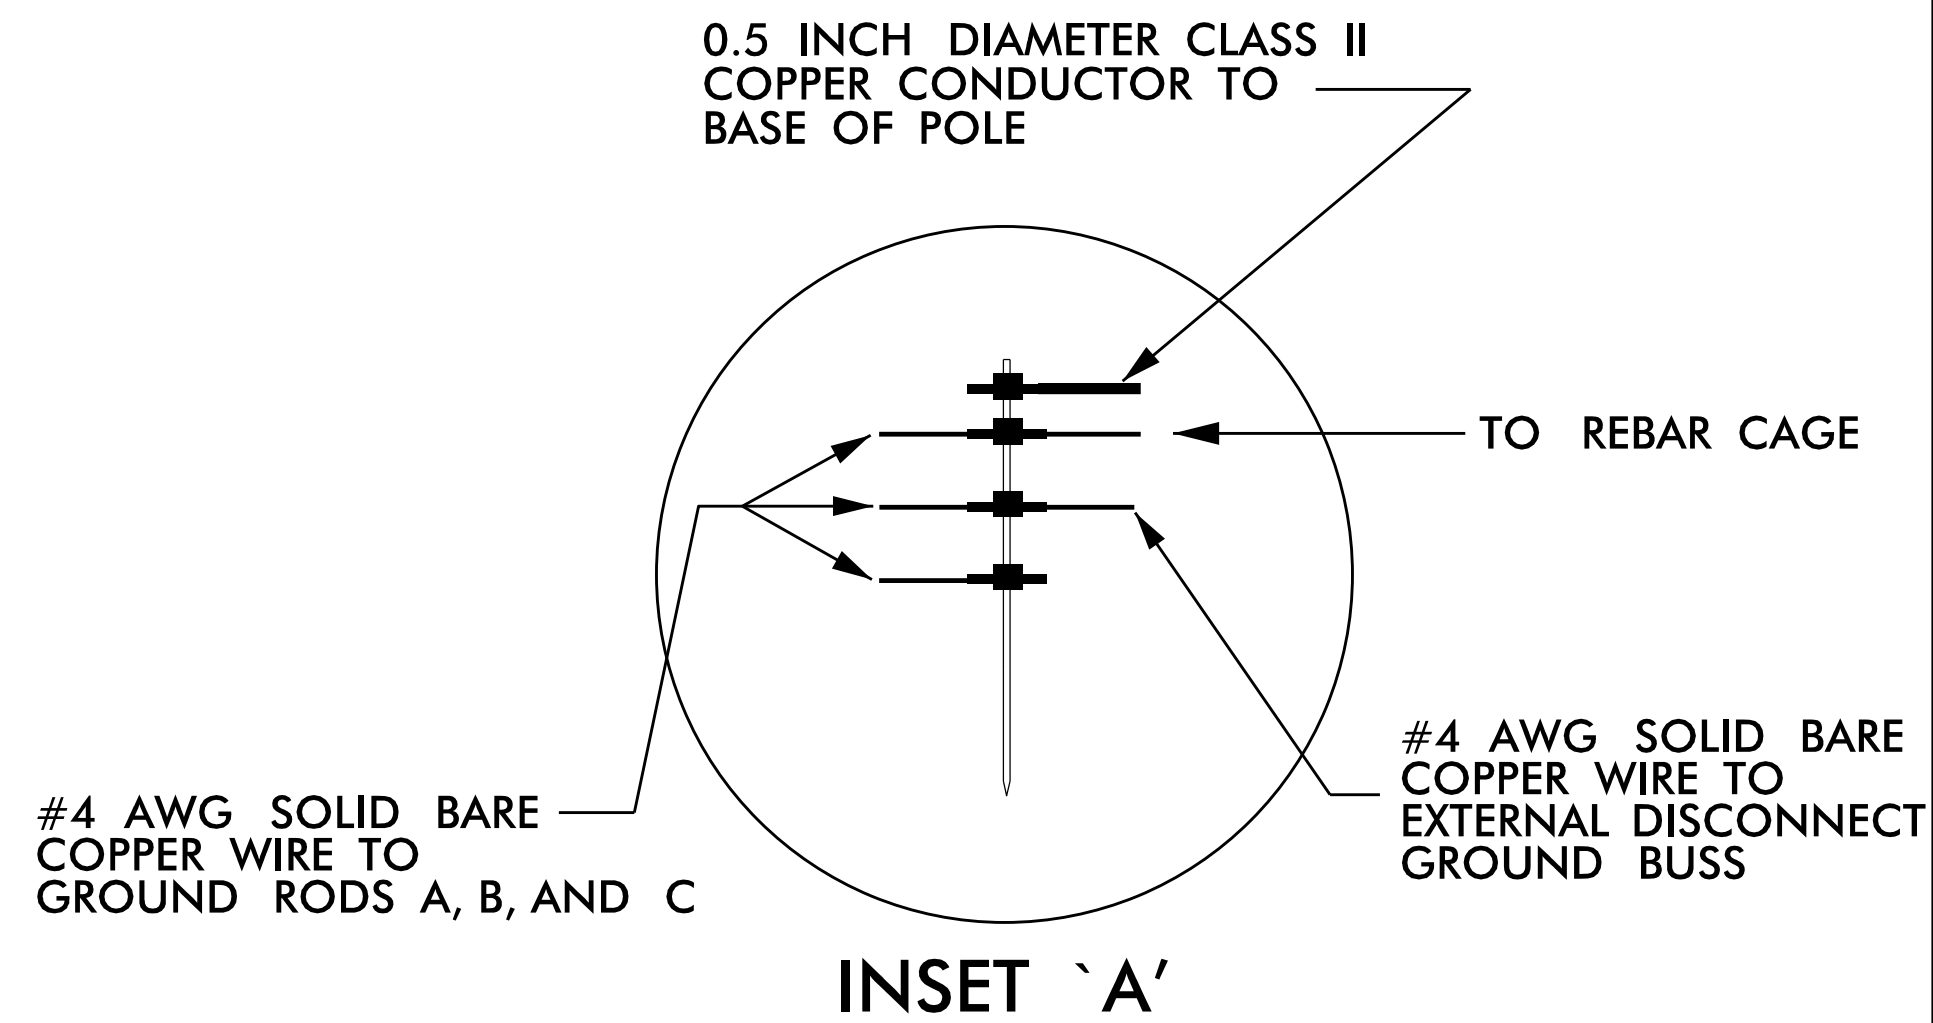
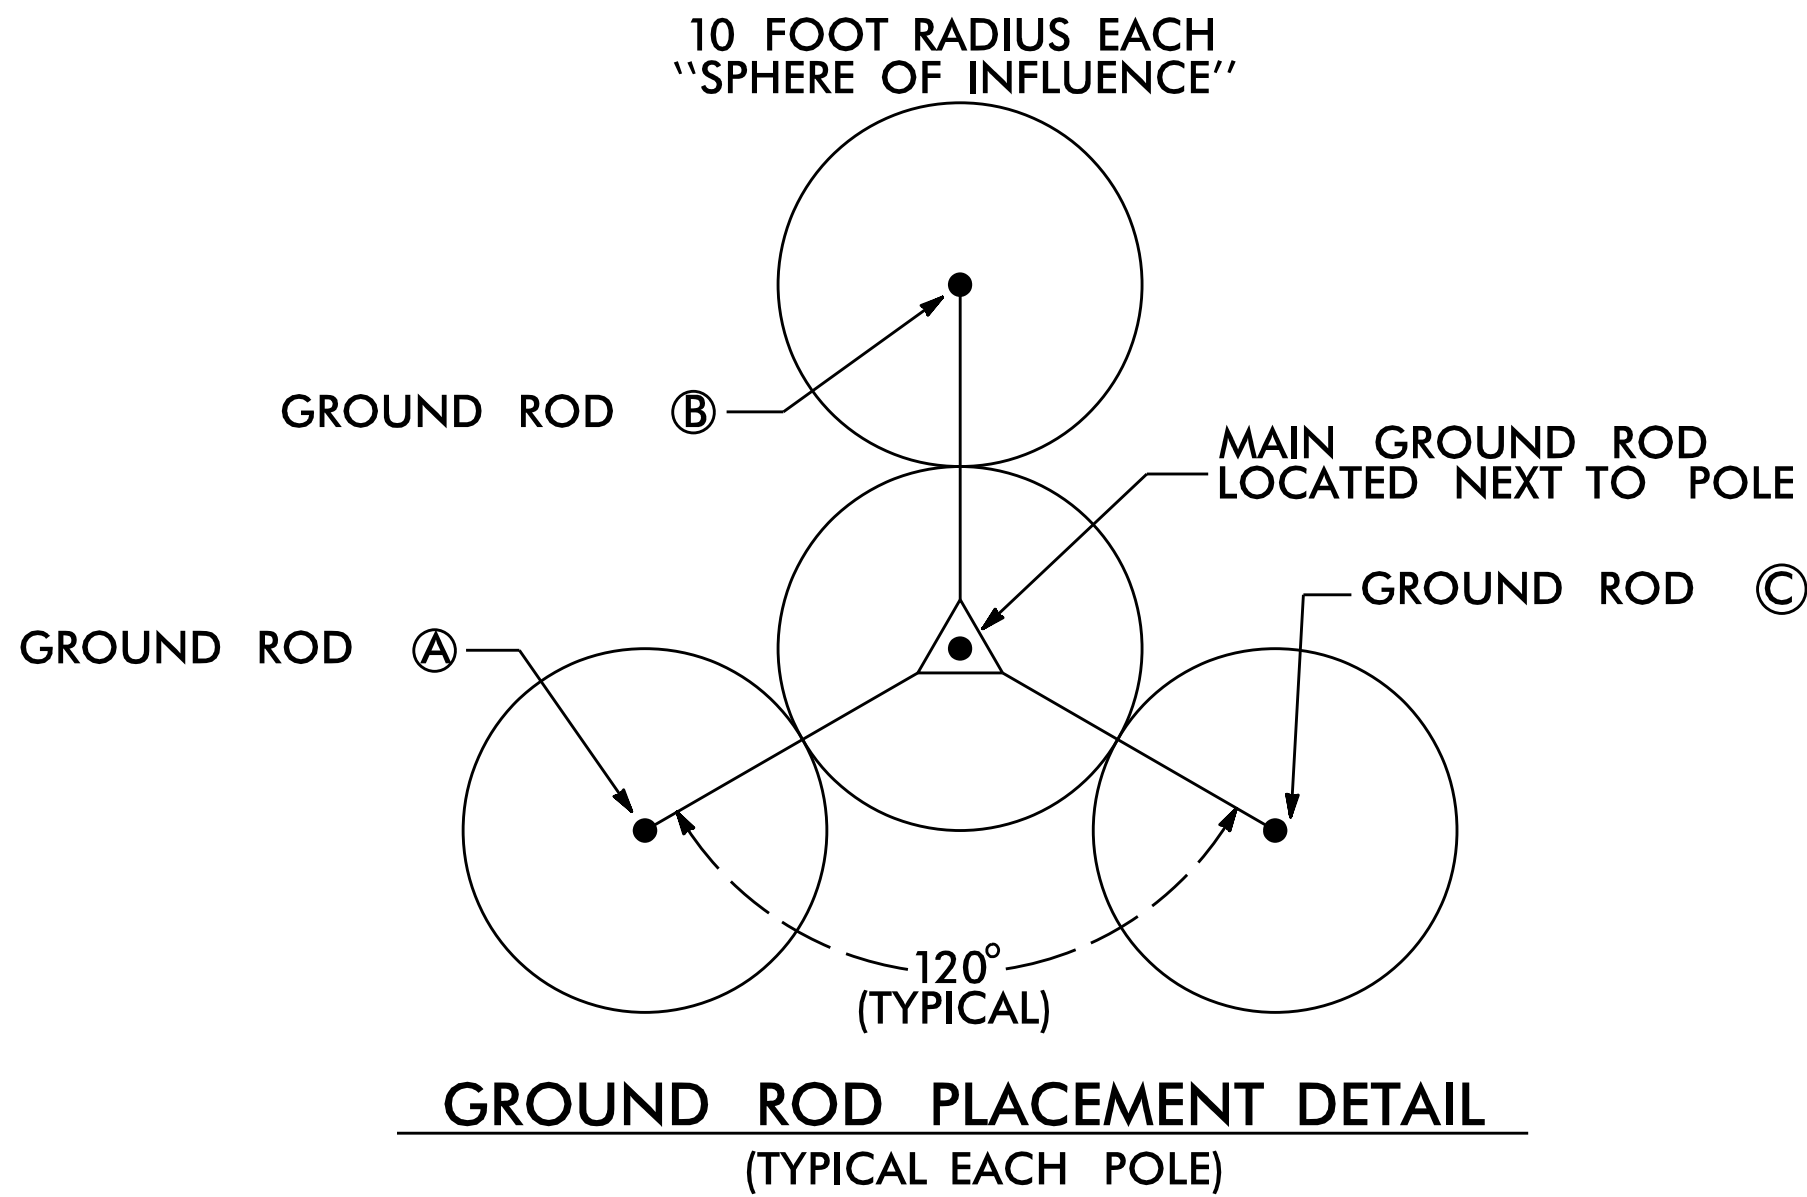


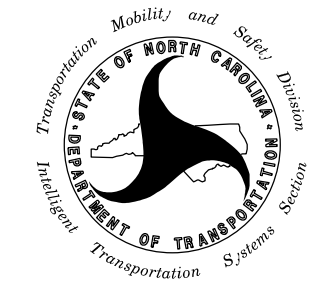

NOTES

1. BOND 0.5 INCH DIAMETER, 28 STRAND (MINIMUM) CLASS II COPPER CONDUCTOR TO THE MAIN GROUND ROD BY AN IRREVERSIBLE MECHANICAL CRIMP METHOD.
2. ALL CONNECTIONS TO GROUND RODS SHOULD BE MADE WITH AN IRREVERSIBLE MECHANICAL CRIMP METHOD.
3. BOND #4 AWG SOLID BARE COPPER WIRE TO REBAR CAGE AND THE MAIN GROUND ROD BY AN IRREVERSIBLE MECHANICAL CRIMP.
4. ENSURE CAMERA HOUSING, CAMERA, AND PAN -TILT UNIT ARE BONDED TO POLE.
5. REMOVE BONDING JUMPER BETWEEN EQUIPMENT CABINET GROUND BUSS AND NEUTRAL BUSS.
6. REFER TO STANDARD DRAWING 1700-2 FOR ALTERNATE GROUND ROD INSTALLATION METHOD AS APPROVED BY THE ENGINEER.
7. INSTALL MARKER TAPE DIRECTLY ABOVE ALL GROUNDING ELECTRODES AND CONDUCTORS AT A DEPTH OF 12 INCHES.

Plans Prepared For:  750 N. Greenfield Place, Garner, NC 27529	CCTV CAMERA INSTALLATION FOR METAL POLE WITH UNDERGROUND ELECTRICAL SERVICE		SEAL  08/11/2026										
	Division 13 Buncombe County Asheville PLAN DATE: August 2026 REVIEWED BY: TA Honeycutt PREPARED BY: MR Stanley REVIEWED BY: CJ Dagerhardt	<table><tr><th>REVISIONS</th><th>INIT.</th><th>DATE</th></tr><tr><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td></tr></table>		REVISIONS	INIT.	DATE							
REVISIONS	INIT.	DATE											

SCALE

0

NTS

EXULT[®]
ENGINEERING

203 W. Millbrook Rd, Suite 200
Raleigh, NC 27609
984.500.5425
www.exultengineering.com

NC License
#C-4445